Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: METALUX

Report Number: P1590950

Luminaire Tested: 24CGTX-40-L93050-W2A-5000K

Issue Date: 9/7/2026

Report Generated By 670265710 / DESKTOP-98SHLC4

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1590950
	TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G3-2512-631-17)
Test Lab:	COOPER LIGHTING SOLUTIONS
Issue Date:	9/7/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	METALUX
Catalog Number:	24CGTX-40-L93050-W2A-5000K
Description:	2X4 4000 LUMEN CGTX TROFFER WITH VividTune LEDS AT 5000K CCT
Light Source:	5000K CCT, 90 CRI LEDS
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	4778.1 lumens
Efficiency:	N/A
Efficacy:	122.2 lumens/watt
Spacing Criteria (0/90/45):	1.27 / 1.27 / 1.39
Luminous Opening:	Rectangular (W 2' x L: 4' x H: 0')
CIE Type:	Direct
Input Watts (W):	39.1
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT

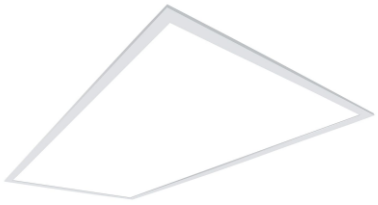


Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590950
CATALOG NUMBER: 24CGTX-40-L93050-W2A-5000K

Luminous Intensity Polar Plot

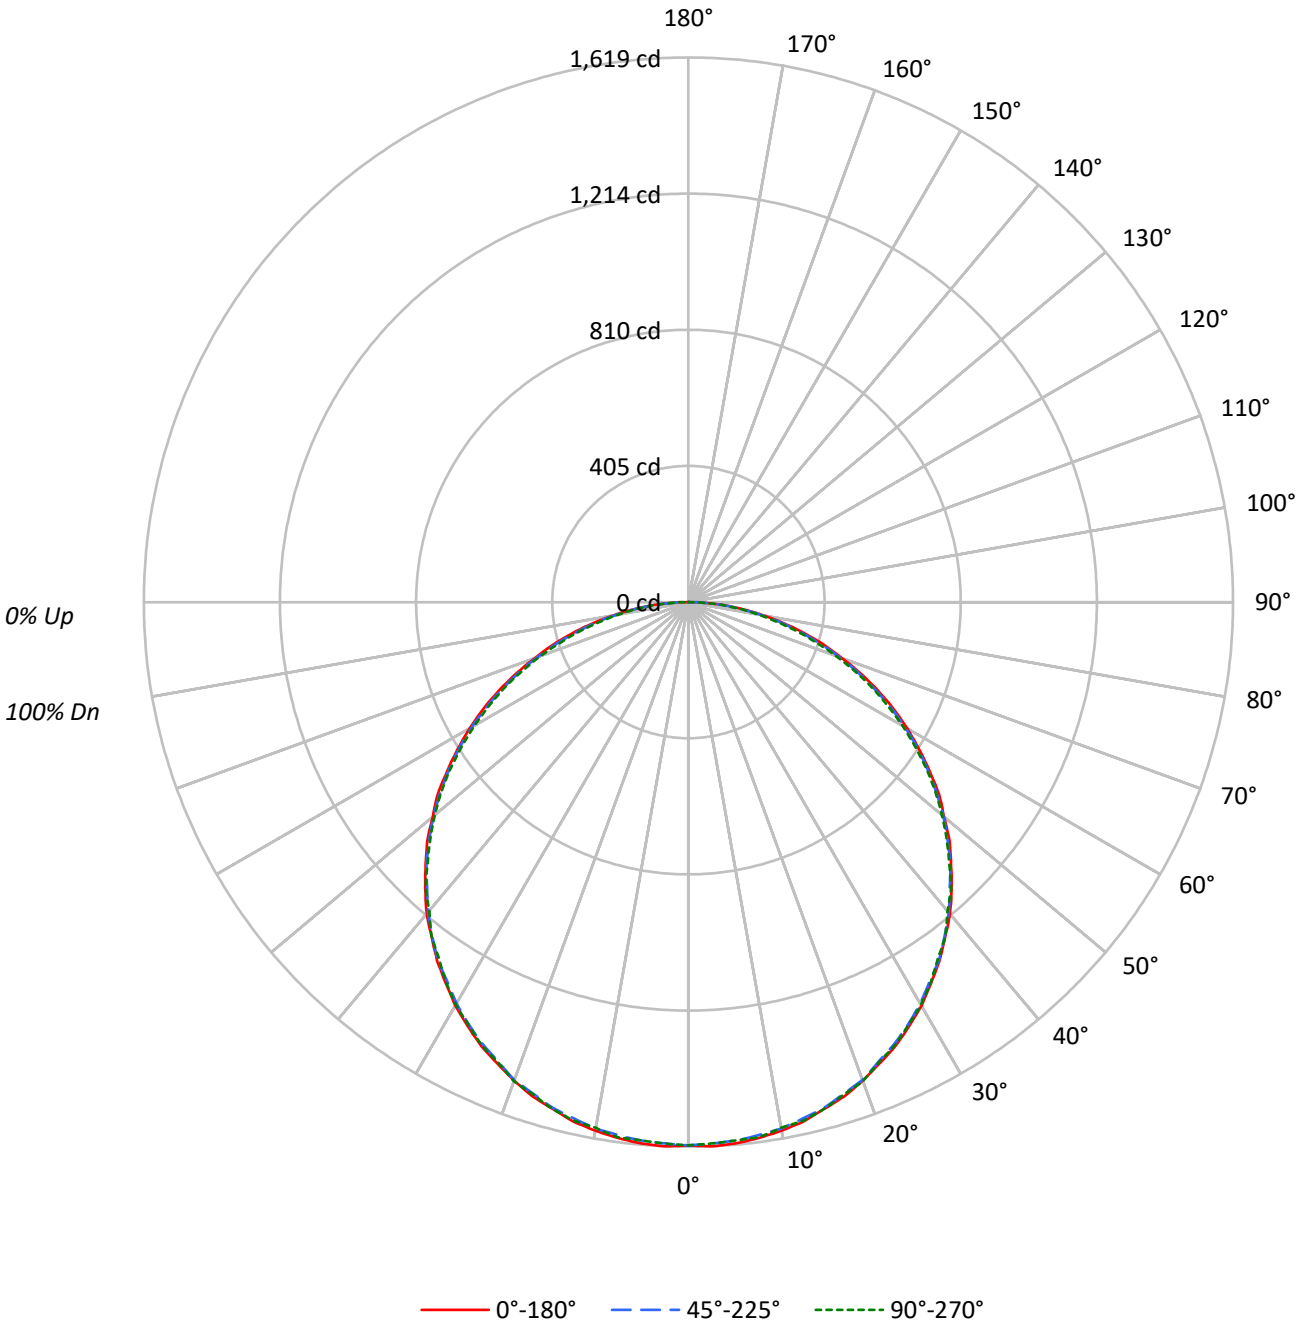

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590950
CATALOG NUMBER: 24CGTX-40-L93050-W2A-5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	106	101	97	93	97	93	90	93	90	88	89	87	85	83
2	98	90	83	77	96	88	81	76	84	79	74	81	76	72	78	74	71	69
3	89	79	70	64	87	77	69	63	74	67	62	71	66	61	69	64	60	57
4	82	70	61	54	79	68	60	53	66	58	53	63	57	52	61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	50	44	39	37
7	64	51	42	35	62	50	41	35	48	41	35	47	40	35	45	39	34	32
8	60	46	37	31	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	36	30	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2173	2173	2173
5°	2181	2170	2170
10°	2180	2171	2168
15°	2173	2168	2173
20°	2168	2165	2171
25°	2162	2151	2158
30°	2153	2141	2148
35°	2138	2133	2123
40°	2125	2114	2105
45°	2102	2096	2086
50°	2076	2072	2059
55°	2052	2038	2025
60°	2020	2000	1975
65°	1978	1941	1921
70°	1906	1873	1832
75°	1856	1786	1732
80°	1740	1683	1618
85°	1627	1579	1499

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2102 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590950
CATALOG NUMBER: 24CGTX-40-L93050-W2A-5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	152.9	3.2
10°-20°	439.5	9.2
20°-30°	668.7	14.0
30°-40°	811.3	17.0
40°-50°	848.6	17.8
50°-60°	776.4	16.2
60°-70°	603.8	12.6
70°-80°	364.1	7.6
80°-90°	112.9	2.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1261.1	26.4
0°-40°	2072.4	43.4
0°-60°	3697.4	77.4
0°-90°	4778.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4778.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1615	1615	1615	1615	1615	
5°	1615	1607	1607	1603	1607	154
15°	1560	1556	1557	1557	1560	441
25°	1456	1450	1449	1448	1453	671
35°	1302	1297	1299	1296	1292	814
45°	1105	1102	1102	1097	1096	853
55°	875	873	869	864	863	783
65°	621	617	610	604	604	614
75°	357	352	344	335	333	376
85°	105	104	102	96	97	117
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590950
CATALOG NUMBER: 24CGTX-40-L93050-W2A-5000K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	*1615.1*	1615.1	1615.1	1615.1	1615.1
2.5°	*1619.3*	*1611.0*	*1611.0*	*1606.8*	*1611.0*
5°	*1615.1*	1606.8	1606.8	1602.6	1606.8
7.5°	*1606.8*	1600.5	1598.4	1598.4	1604.7
10°	*1595.3*	1590.1	1589.0	1585.9	1587.0
12.5°	*1581.7*	1573.4	1572.3	1571.3	1578.6
15°	*1559.8*	1555.6	1556.7	1556.7	1559.8
17.5°	*1541.0*	1537.9	1532.7	1534.8	1534.8
20°	*1513.9*	1510.7	1511.8	1506.6	1516.0
22.5°	*1484.6*	1484.6	1478.4	1480.5	1480.5
25°	*1456.4*	1450.2	1449.1	1448.1	1453.3
27.5°	*1421.0*	1417.8	1414.7	1415.7	1416.8
30°	*1385.5*	1378.1	1378.1	1380.2	1382.3
32.5°	*1342.6*	1343.7	1335.3	1335.3	1340.6
35°	*1301.9*	1296.7	1298.8	1295.7	1292.5
37.5°	*1253.9*	1253.9	1250.8	1249.7	1253.9
40°	*1210.1*	1202.7	1203.8	1199.6	1198.6
42.5°	*1157.9*	1155.8	1149.5	1149.5	1155.8
45°	*1104.6*	1101.5	1101.5	1097.3	1096.3
47.5°	*1053.4*	1050.3	1044.0	1042.0	1040.9
50°	*991.8*	991.8	989.8	984.5	983.5
52.5°	*939.6*	935.5	928.2	927.1	925.0
55°	*874.9*	872.8	868.6	864.5	863.4
57.5°	*813.3*	811.2	807.0	801.8	798.7
60°	*750.7*	745.5	743.4	736.1	734.0
62.5°	*687.0*	681.8	676.5	669.2	668.2
65°	*621.2*	617.0	609.7	604.5	603.5
67.5°	*553.3*	550.2	545.0	535.6	534.6
70°	*484.4*	486.5	476.1	466.7	465.6
72.5°	*422.8*	417.6	410.3	402.0	396.7
75°	*357.1*	351.8	343.5	335.1	333.1
77.5°	*291.3*	287.1	281.9	271.5	268.3
80°	*224.5*	223.4	217.2	211.9	208.8
82.5°	*163.9*	163.9	159.7	151.4	152.4
85°	*105.4*	104.4	102.3	96.1	97.1
87.5°	*49.1*	47.0	45.9	47.0	45.9
90°	*0.0*	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

TEST NUMBER: P1590950
CATALOG NUMBER: 24CGTX-40-L93050-W2A-5000K

CIE UGR TABLE:

Reflectances:											
	Ceiling	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
	Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
	Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.70	16.36	15.07	16.68	16.99	14.61	16.27	14.98	16.59	16.90
	3H	16.63	18.14	17.01	18.46	18.82	16.48	17.98	16.85	18.31	18.67
	4H	17.40	18.82	17.80	19.17	19.54	17.19	18.61	17.59	18.96	19.33
	6H	18.00	19.32	18.41	19.68	20.07	17.74	19.06	18.15	19.42	19.82
	8H	18.21	19.47	18.64	19.86	20.26	17.94	19.20	18.36	19.59	19.98
	12H	18.37	19.58	18.80	19.96	20.39	18.08	19.29	18.51	19.67	20.10
4H	2H	15.35	16.77	15.75	17.12	17.50	15.28	16.70	15.68	17.05	17.43
	3H	17.51	18.71	17.92	19.11	19.51	17.37	18.57	17.78	18.97	19.36
	4H	18.42	19.50	18.85	19.92	20.35	18.22	19.30	18.65	19.72	20.15
	6H	19.16	20.11	19.61	20.55	21.00	18.91	19.86	19.36	20.30	20.75
	8H	19.43	20.32	19.89	20.76	21.23	19.16	20.05	19.62	20.49	20.95
	12H	19.64	20.44	20.12	20.92	21.38	19.35	20.15	19.83	20.63	21.10
8H	4H	18.76	19.65	19.22	20.09	20.55	18.59	19.48	19.04	19.92	20.38
	6H	19.64	20.38	20.13	20.87	21.34	19.41	20.15	19.90	20.64	21.12
	8H	20.00	20.67	20.51	21.17	21.65	19.74	20.41	20.25	20.91	21.40
	12H	20.30	20.89	20.81	21.38	21.94	20.02	20.61	20.52	21.10	21.66
12H	4H	18.80	19.60	19.28	20.08	20.55	18.64	19.44	19.11	19.91	20.38
	6H	19.71	20.38	20.22	20.88	21.37	19.49	20.16	20.00	20.67	21.15
	8H	20.14	20.73	20.64	21.22	21.77	19.89	20.48	20.39	20.97	21.53

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2512-631-24-R2

Test Date: 02/04/2026

Luminaire Tested: 22CGTX-50-L93050-W2A-5000K

Data in this report applies to families of products including 22CGTX

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.05


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2512-631-24-R2
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	07/28/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Metalux
Catalog Number:	**22CGTX-50-L93050-W2A-5000K**
Description:	*THIS IS A REVISION OF REPORT SP1-2512-631-24-R2 TO UPDATE THE CATALOG INFORMATION* 2X2 5000 LUMEN HE CGTX TUNABLE WHITE FROM 3000K TO 5000K - 1 Volt

Spectral Parameters

CCT (K):	5183
CIE u':	0.2084
CIE v':	0.4838
Duv:	0.0018
CIE x:	0.3404
CIE y:	0.3513
CIE z:	0.3084
Peak Wavelength (nm):	630
Dominant Wavelength (nm):	567
Purity:	7.523728
Rf:	89.8
Rg:	98.4

CRI (Ra):	93.0
R1:	94.0
R2:	95.9
R3:	95.1
R4:	93.5
R5:	92.7
R6:	92.2
R7:	94.0
R8:	86.9
R9:	64.0
R10:	88.2
R11:	93.7
R12:	69.8
R13:	94.9
R14:	97.0
R15:	92.0

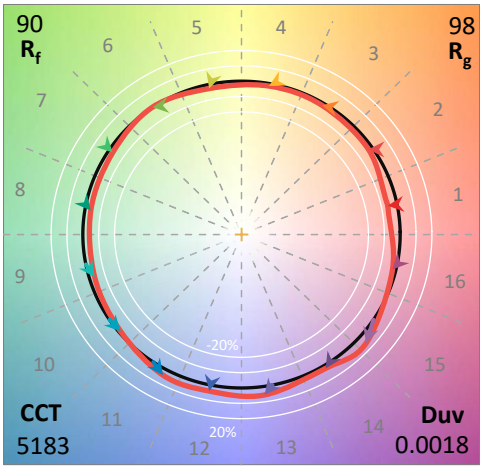


Test Conditions

Stabilization Time:	20M
Operation Time:	1H 20M
Sphere Temperature (°C):	25.1


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	12/16/2025	6/16/2026
Power Meter	XITRON INXT2011004	10/21/2025	10/21/2026
AC Power Source	CHROMA 61603 IN0063	10/21/2025	10/21/2026
DC Power Source	AGILENT E3634A IN0208	10/21/2025	10/21/2026
Sphere Thermometer	ONSET IN0085	10/21/2025	10/21/2026
Room Thermometer	ONSET IN0046	10/21/2025	10/21/2026

REPORT NUMBER: SP1-2512-631-24-R2

CIE 1931 Chromaticity Diagram

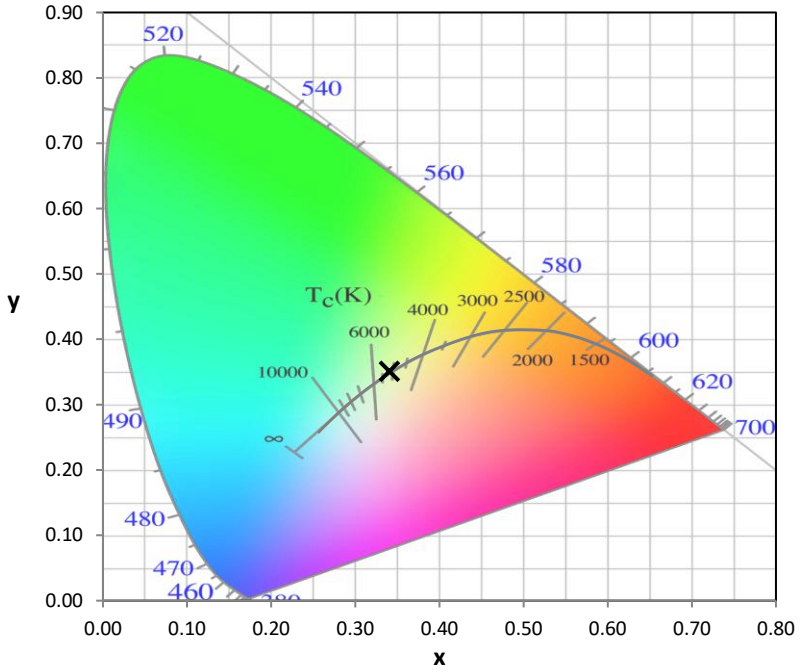

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

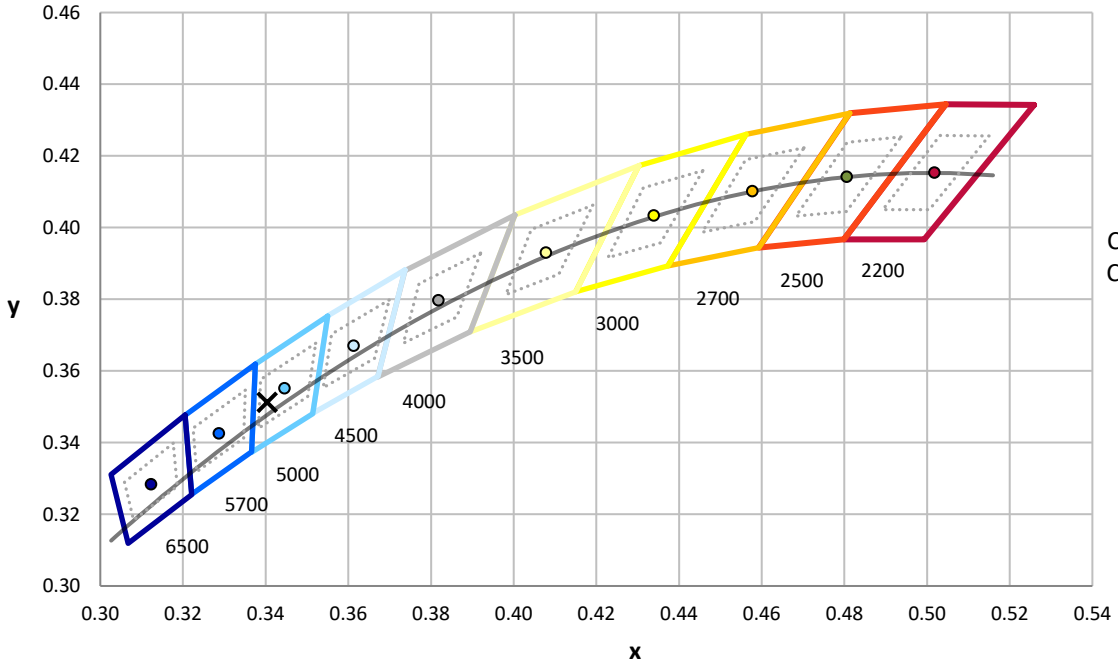


CCT = 5183K
CIE x = 0.3404
CIE y = 0.3513
Duv = 0.0018

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2512-631-24-R2

Photopic Flux vs. Wavelength

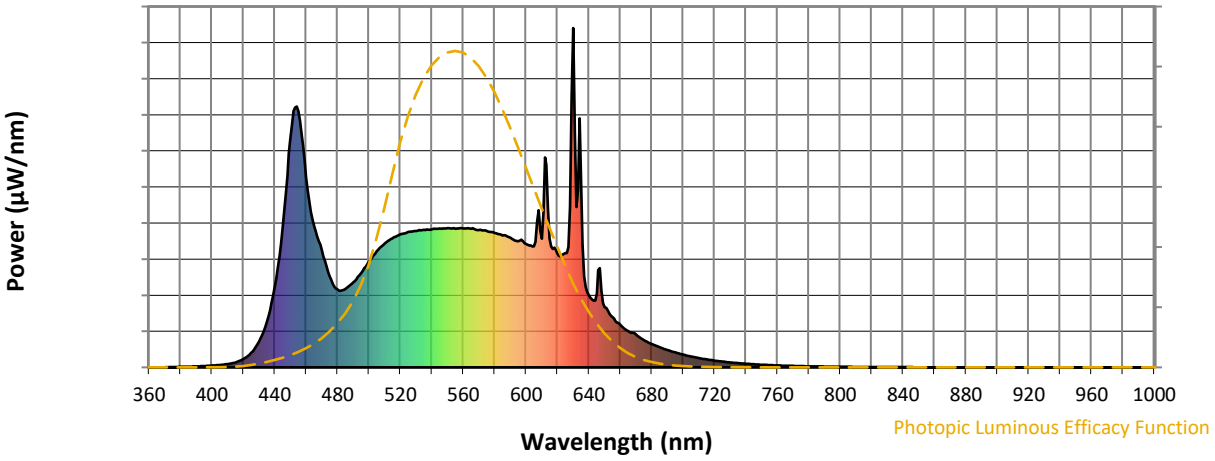


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	251	NR	620	335	NR	750	8	NR	880	0	NR
365	0	NR	495	277	NR	625	337	NR	755	7	NR	885	0	NR
370	0	NR	500	312	NR	630	1000	NR	760	6	NR	890	0	NR
375	1	NR	505	342	NR	635	569	NR	765	5	NR	895	0	NR
380	2	NR	510	365	NR	640	212	NR	770	4	NR	900	0	NR
385	2	NR	515	380	NR	645	218	NR	775	4	NR	905	0	NR
390	3	NR	520	392	NR	650	177	NR	780	3	NR	910	0	NR
395	4	NR	525	399	NR	655	148	NR	785	3	NR	915	0	NR
400	5	NR	530	402	NR	660	126	NR	790	2	NR	920	0	NR
405	7	NR	535	406	NR	665	106	NR	795	2	NR	925	0	NR
410	10	NR	540	407	NR	670	97	NR	800	2	NR	930	0	NR
415	15	NR	545	409	NR	675	80	NR	805	2	NR	935	0	NR
420	25	NR	550	410	NR	680	69	NR	810	1	NR	940	0	NR
425	43	NR	555	409	NR	685	59	NR	815	1	NR	945	0	NR
430	76	NR	560	409	NR	690	51	NR	820	1	NR	950	0	NR
435	135	NR	565	409	NR	695	44	NR	825	1	NR	955	0	NR
440	235	NR	570	405	NR	700	38	NR	830	1	NR	960	0	NR
445	412	NR	575	402	NR	705	32	NR	835	1	NR	965	0	NR
450	675	NR	580	396	NR	710	27	NR	840	1	NR	970	0	NR
455	756	NR	585	389	NR	715	23	NR	845	1	NR	975	0	NR
460	560	NR	590	382	NR	720	20	NR	850	0	NR	980	0	NR
465	418	NR	595	371	NR	725	17	NR	855	0	NR	985	0	NR
470	344	NR	600	363	NR	730	15	NR	860	0	NR	990	0	NR
475	268	NR	605	356	NR	735	13	NR	865	0	NR	995	0	NR
480	229	NR	610	379	NR	740	11	NR	870	0	NR	1000	0	NR
485	231	NR	615	379	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2512-631-24-R2

Scotopic Flux vs. Wavelength

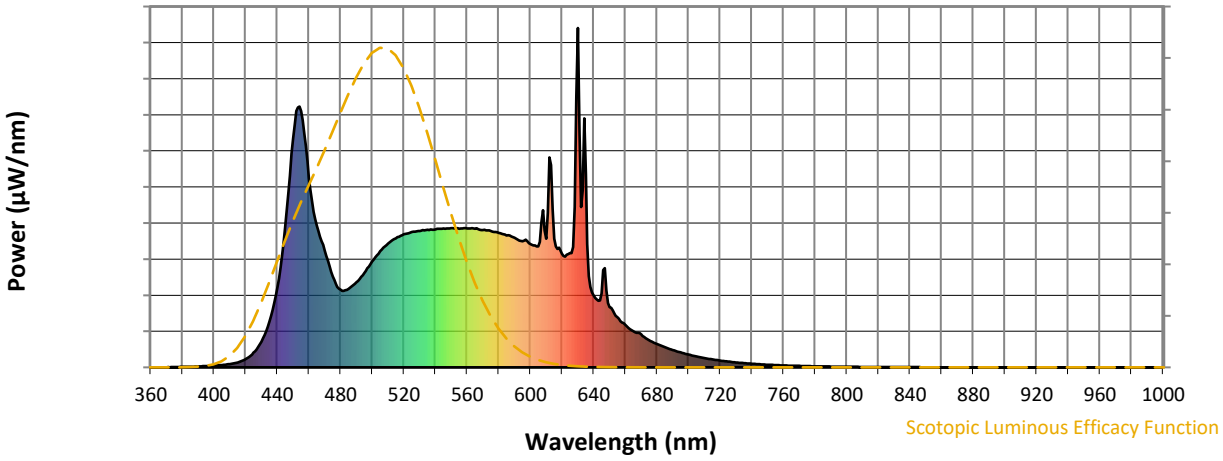


Scotopic Lumens: NR **S/P: 2.11**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	251	NR	620	335	NR	750	8	NR	880	0	NR
365	0	NR	495	277	NR	625	337	NR	755	7	NR	885	0	NR
370	0	NR	500	312	NR	630	1000	NR	760	6	NR	890	0	NR
375	1	NR	505	342	NR	635	569	NR	765	5	NR	895	0	NR
380	2	NR	510	365	NR	640	212	NR	770	4	NR	900	0	NR
385	2	NR	515	380	NR	645	218	NR	775	4	NR	905	0	NR
390	3	NR	520	392	NR	650	177	NR	780	3	NR	910	0	NR
395	4	NR	525	399	NR	655	148	NR	785	3	NR	915	0	NR
400	5	NR	530	402	NR	660	126	NR	790	2	NR	920	0	NR
405	7	NR	535	406	NR	665	106	NR	795	2	NR	925	0	NR
410	10	NR	540	407	NR	670	97	NR	800	2	NR	930	0	NR
415	15	NR	545	409	NR	675	80	NR	805	2	NR	935	0	NR
420	25	NR	550	410	NR	680	69	NR	810	1	NR	940	0	NR
425	43	NR	555	409	NR	685	59	NR	815	1	NR	945	0	NR
430	76	NR	560	409	NR	690	51	NR	820	1	NR	950	0	NR
435	135	NR	565	409	NR	695	44	NR	825	1	NR	955	0	NR
440	235	NR	570	405	NR	700	38	NR	830	1	NR	960	0	NR
445	412	NR	575	402	NR	705	32	NR	835	1	NR	965	0	NR
450	675	NR	580	396	NR	710	27	NR	840	1	NR	970	0	NR
455	756	NR	585	389	NR	715	23	NR	845	1	NR	975	0	NR
460	560	NR	590	382	NR	720	20	NR	850	0	NR	980	0	NR
465	418	NR	595	371	NR	725	17	NR	855	0	NR	985	0	NR
470	344	NR	600	363	NR	730	15	NR	860	0	NR	990	0	NR
475	268	NR	605	356	NR	735	13	NR	865	0	NR	995	0	NR
480	229	NR	610	379	NR	740	11	NR	870	0	NR	1000	0	NR
485	231	NR	615	379	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2512-631-24-R2

Melanopic Flux vs. Wavelength

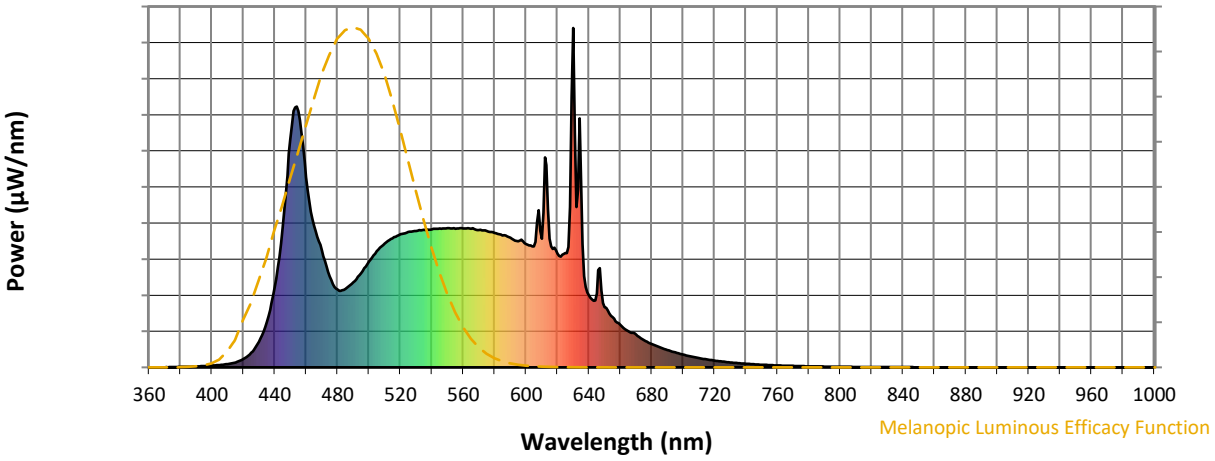

Melanopic Lumens: NR **M/P: 4.6**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	251	NR	620	335	NR	750	8	NR	880	0	NR
365	0	NR	495	277	NR	625	337	NR	755	7	NR	885	0	NR
370	0	NR	500	312	NR	630	1000	NR	760	6	NR	890	0	NR
375	1	NR	505	342	NR	635	569	NR	765	5	NR	895	0	NR
380	2	NR	510	365	NR	640	212	NR	770	4	NR	900	0	NR
385	2	NR	515	380	NR	645	218	NR	775	4	NR	905	0	NR
390	3	NR	520	392	NR	650	177	NR	780	3	NR	910	0	NR
395	4	NR	525	399	NR	655	148	NR	785	3	NR	915	0	NR
400	5	NR	530	402	NR	660	126	NR	790	2	NR	920	0	NR
405	7	NR	535	406	NR	665	106	NR	795	2	NR	925	0	NR
410	10	NR	540	407	NR	670	97	NR	800	2	NR	930	0	NR
415	15	NR	545	409	NR	675	80	NR	805	2	NR	935	0	NR
420	25	NR	550	410	NR	680	69	NR	810	1	NR	940	0	NR
425	43	NR	555	409	NR	685	59	NR	815	1	NR	945	0	NR
430	76	NR	560	409	NR	690	51	NR	820	1	NR	950	0	NR
435	135	NR	565	409	NR	695	44	NR	825	1	NR	955	0	NR
440	235	NR	570	405	NR	700	38	NR	830	1	NR	960	0	NR
445	412	NR	575	402	NR	705	32	NR	835	1	NR	965	0	NR
450	675	NR	580	396	NR	710	27	NR	840	1	NR	970	0	NR
455	756	NR	585	389	NR	715	23	NR	845	1	NR	975	0	NR
460	560	NR	590	382	NR	720	20	NR	850	0	NR	980	0	NR
465	418	NR	595	371	NR	725	17	NR	855	0	NR	985	0	NR
470	344	NR	600	363	NR	730	15	NR	860	0	NR	990	0	NR
475	268	NR	605	356	NR	735	13	NR	865	0	NR	995	0	NR
480	229	NR	610	379	NR	740	11	NR	870	0	NR	1000	0	NR
485	231	NR	615	379	NR	745	9	NR	875	0	NR			


REPORT NUMBER: SP1-2512-631-24-R2

TM-30-18


Summary


R_f = 89.8
R_g = 98.4
CIE R_a = 93.0
R_9 = 64.0


Spectral Power Distribution Comparison

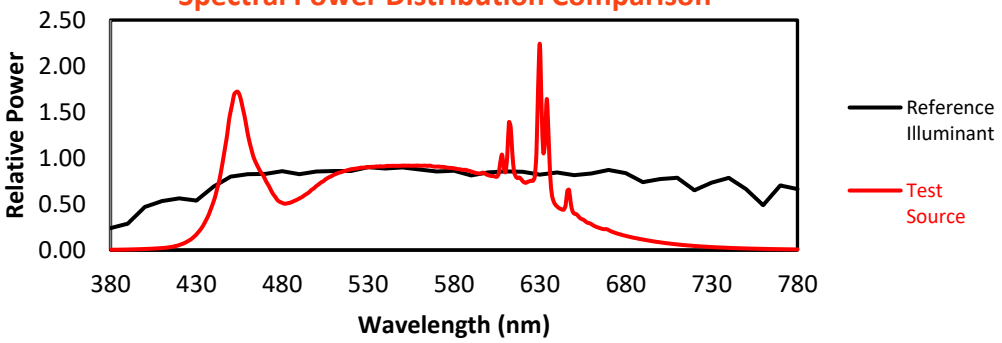


Color Vector Graphics

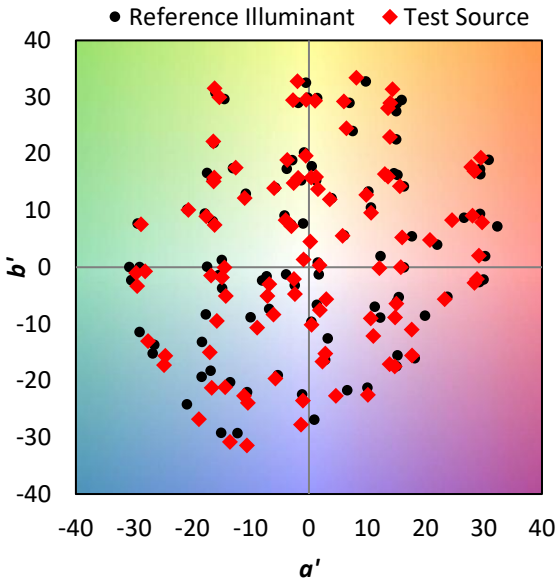

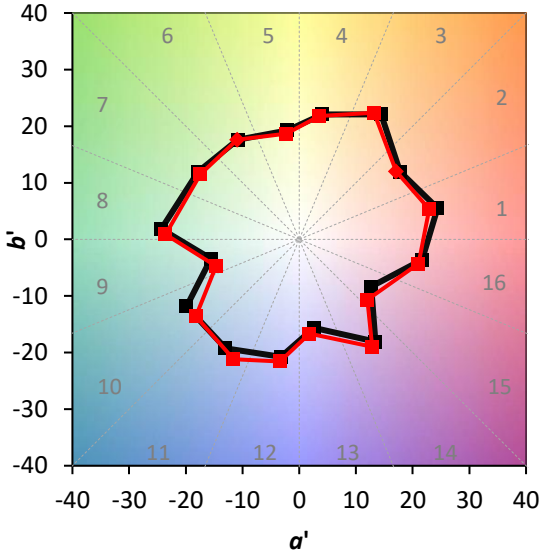

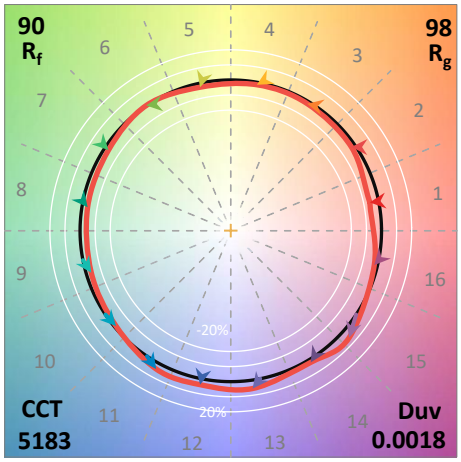

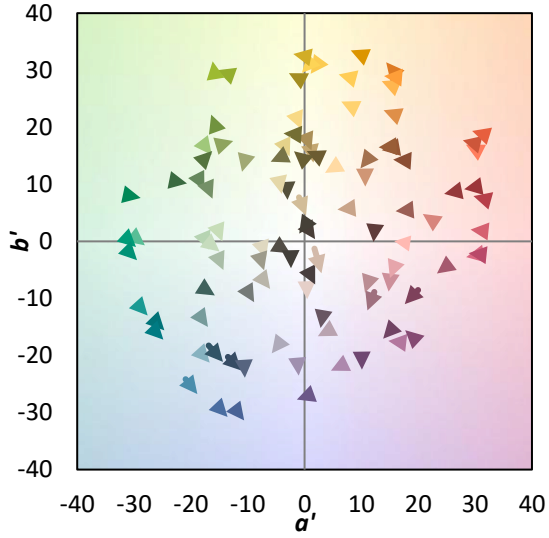


REPORT NUMBER: SP1-2512-631-24-R2

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 93	CES51 = 95	CES76 = 85
CES02 = 60	CES27 = 90	CES52 = 98	CES77 = 87
CES03 = 31	CES28 = 95	CES53 = 96	CES78 = 82
CES04 = 68	CES29 = 96	CES54 = 91	CES79 = 94
CES05 = 47	CES30 = 87	CES55 = 89	CES80 = 92
CES06 = 50	CES31 = 97	CES56 = 92	CES81 = 82
CES07 = 41	CES32 = 90	CES57 = 90	CES82 = 96
CES08 = 40	CES33 = 96	CES58 = 90	CES83 = 96
CES09 = 29	CES34 = 92	CES59 = 96	CES84 = 93
CES10 = 73	CES35 = 95	CES60 = 90	CES85 = 82
CES11 = 55	CES36 = 77	CES61 = 90	CES86 = 85
CES12 = 62	CES37 = 94	CES62 = 81	CES87 = 91
CES13 = 42	CES38 = 82	CES63 = 89	CES88 = 97
CES14 = 74	CES39 = 99	CES64 = 85	CES89 = 86
CES15 = 71	CES40 = 98	CES65 = 85	CES90 = 95
CES16 = 46	CES41 = 94	CES66 = 82	CES91 = 70
CES17 = 48	CES42 = 93	CES67 = 81	CES92 = 76
CES18 = 56	CES43 = 94	CES68 = 85	CES93 = 85
CES19 = 70	CES44 = 99	CES69 = 86	CES94 = 76
CES20 = 65	CES45 = 98	CES70 = 83	CES95 = 81
CES21 = 84	CES46 = 97	CES71 = 74	CES96 = 92
CES22 = 77	CES47 = 94	CES72 = 92	CES97 = 96
CES23 = 91	CES48 = 88	CES73 = 78	CES98 = 94
CES24 = 90	CES49 = 97	CES74 = 90	CES99 = 92
CES25 = 70	CES50 = 96	CES75 = 77	

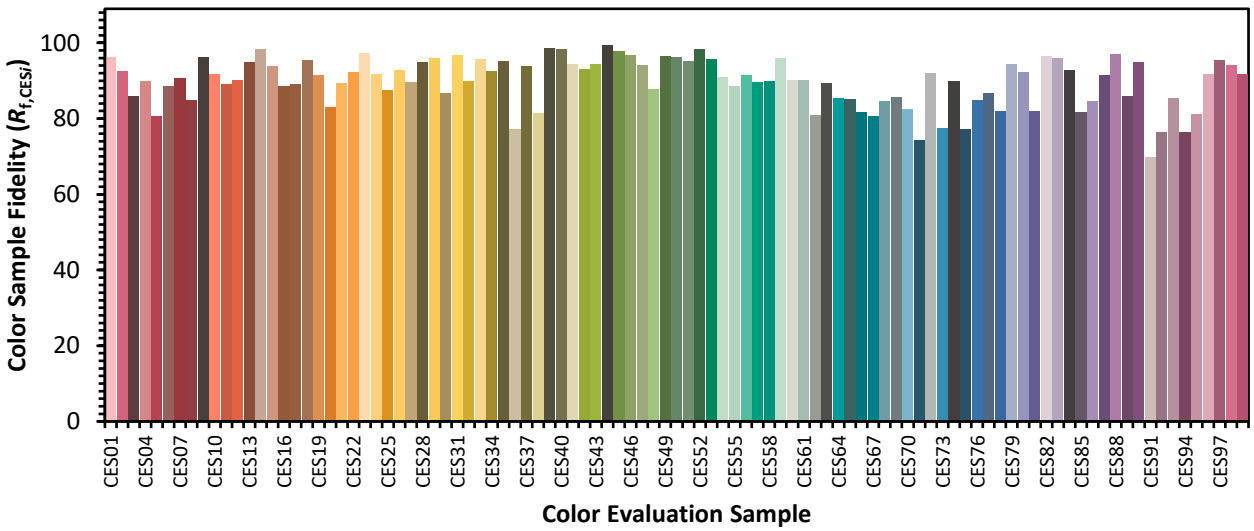



REPORT NUMBER: SP1-2512-631-24-R2

TM-30-18

Color Rendition by Hue-Angle Bin

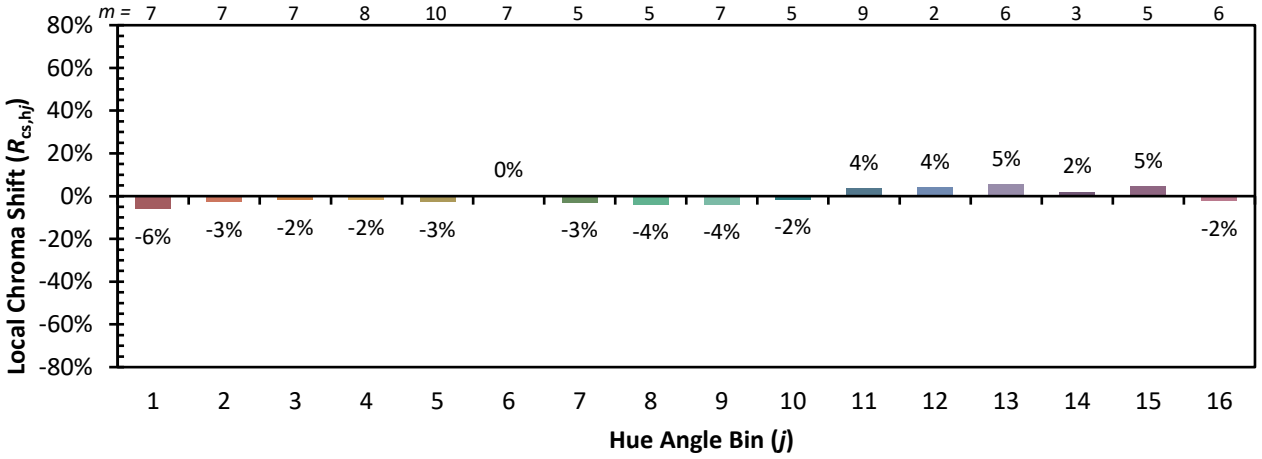

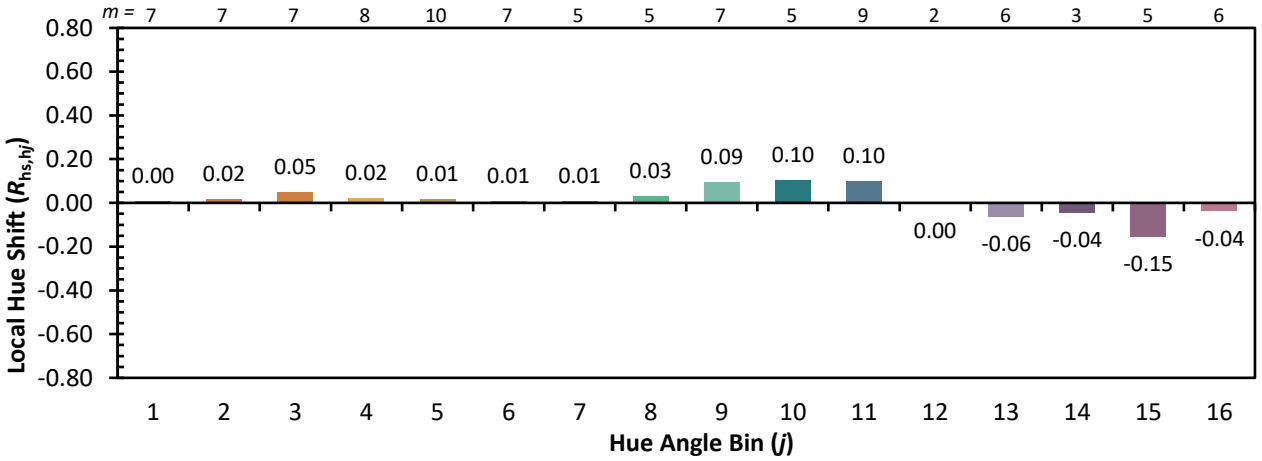


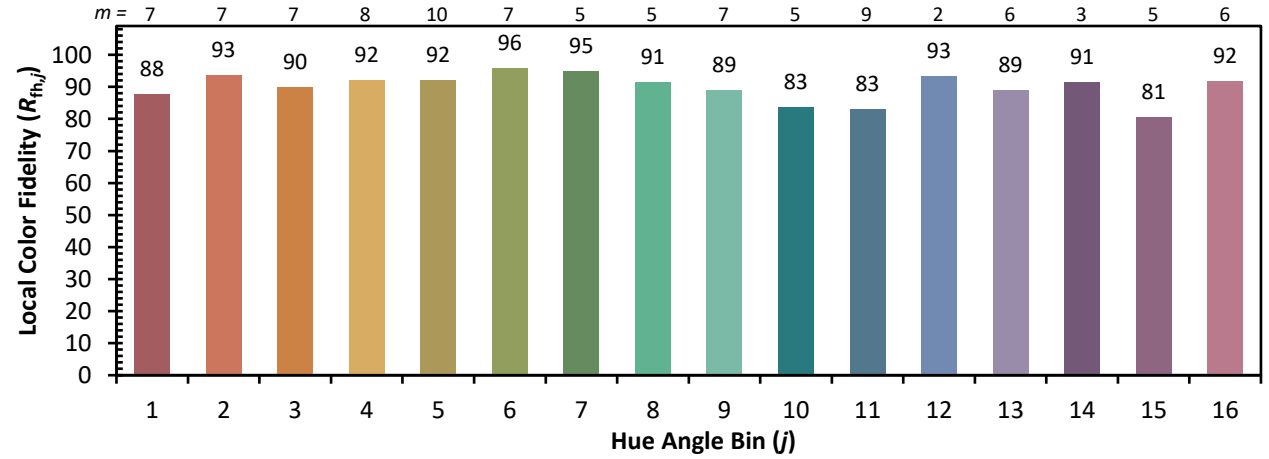


REPORT NUMBER: SP1-2512-631-24-R2

TM-30-18

Measure Comparisons

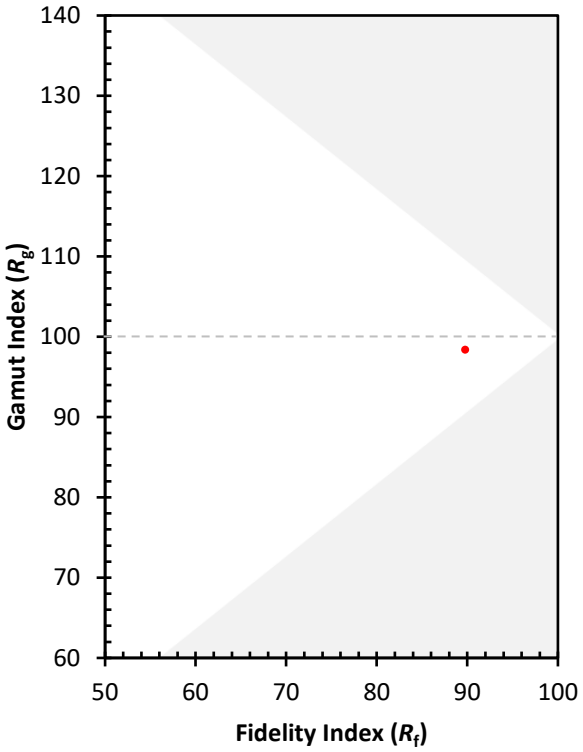

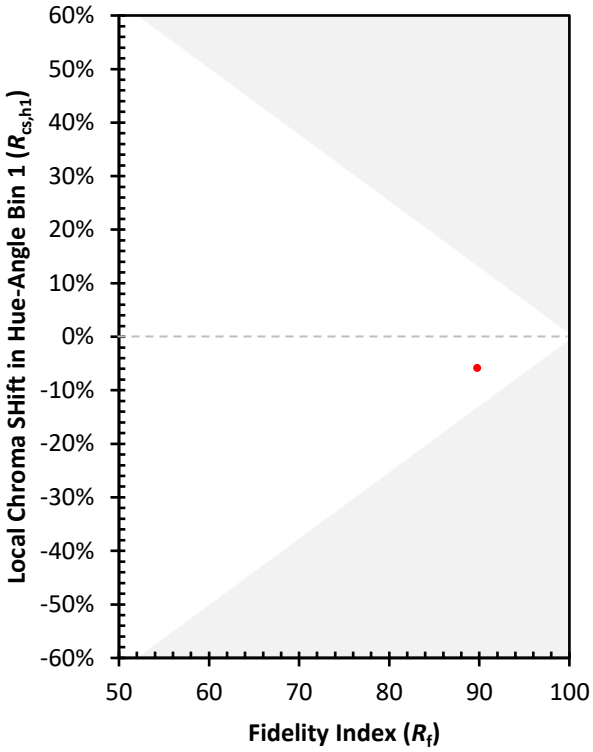

(END OF REPORT)