Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: METALUX

Report Number: P1590959

Luminaire Tested: 24CGTX-55-L93050-W2A2-4500K

Issue Date: 9/7/2026

Report Generated By 670265710 / DESKTOP-98SHLC4

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1590959
	TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G3-2512-631-19)
Test Lab:	COOPER LIGHTING SOLUTIONS
Issue Date:	9/7/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	METALUX
Catalog Number:	24CGTX-55-L93050-W2A2-4500K
Description:	2X4 5500 LUMEN CGTX TROFFER WITH VividTune LEDS AT 4500K CCT
Light Source:	4500K CCT, 90 CRI LEDS
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	6491.8 lumens
Efficiency:	N/A
Efficacy:	115.7 lumens/watt
Spacing Criteria (0/90/45):	1.28 / 1.27 / 1.39
Luminous Opening:	Rectangular (W 2' x L: 4' x H: 0')
CIE Type:	Direct
Input Watts (W):	56.1
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT

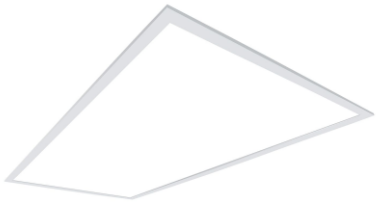


Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590959
CATALOG NUMBER: 24CGTX-55-L93050-W2A2-4500K

Luminous Intensity Polar Plot

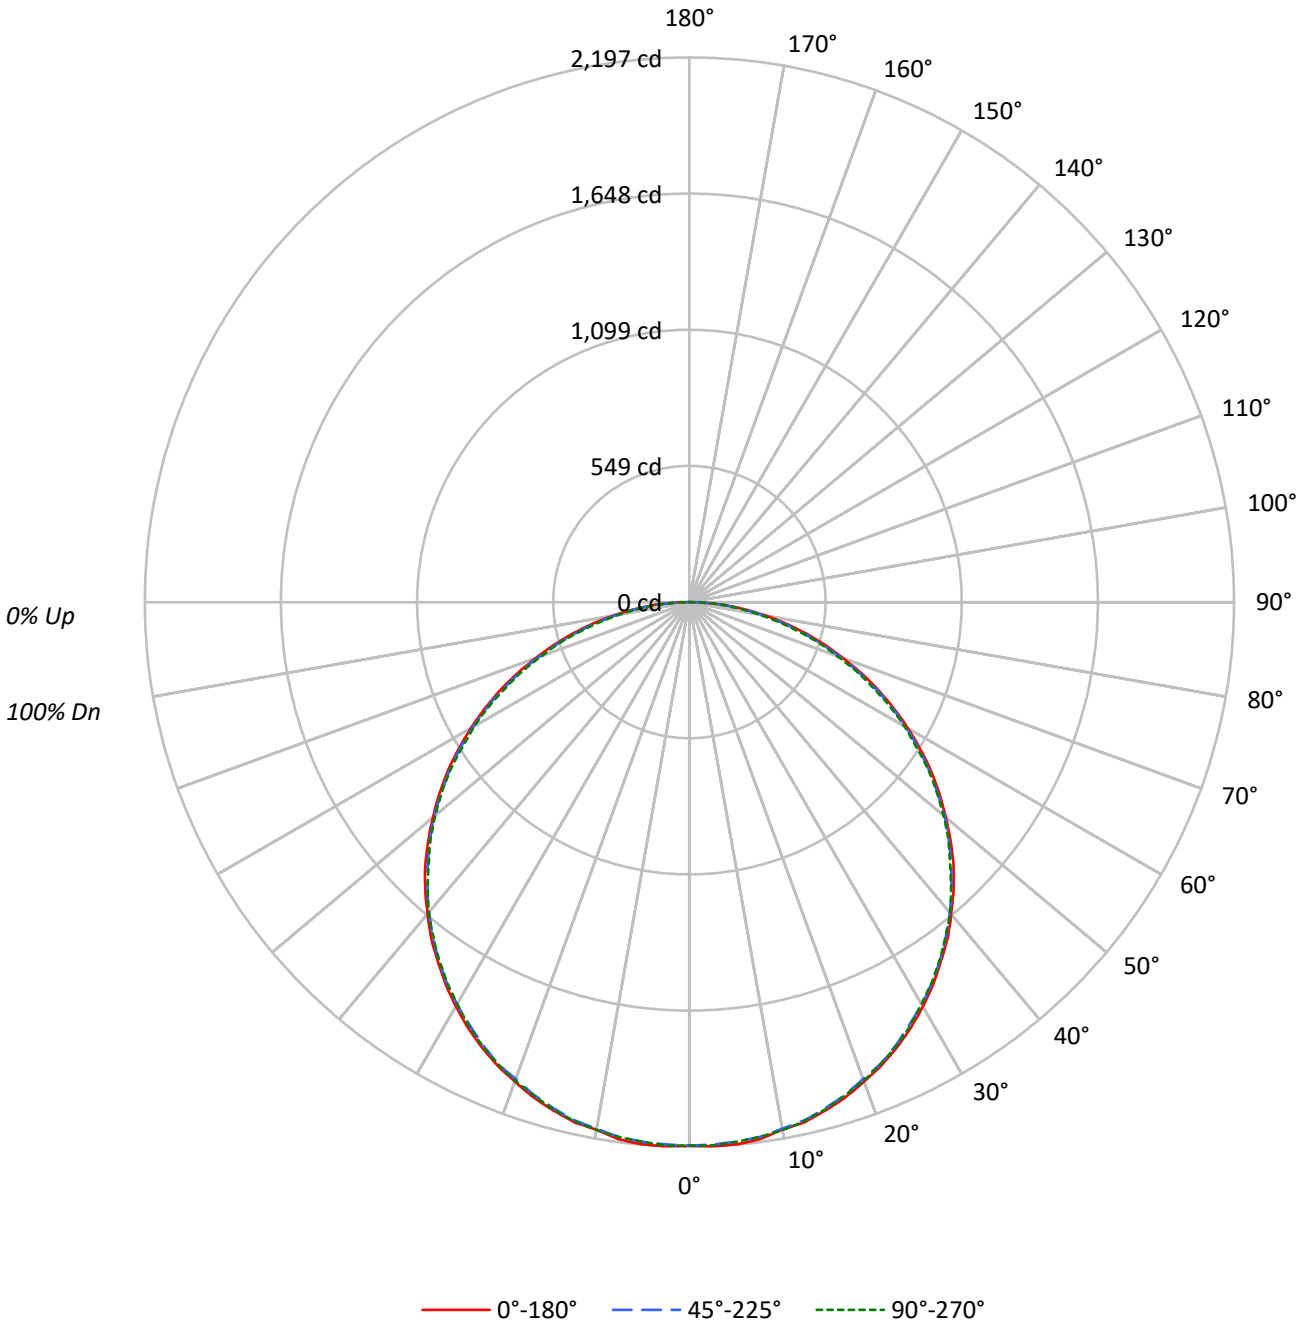

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590959
CATALOG NUMBER: 24CGTX-55-L93050-W2A2-4500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	106	101	97	93	97	94	90	93	90	88	89	87	85	83
2	98	90	83	77	96	88	81	76	84	79	74	81	76	72	78	74	71	69
3	89	79	70	64	87	77	69	63	74	67	62	71	66	61	69	64	60	58
4	82	70	61	54	79	68	60	53	66	58	53	63	57	52	61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	50	44	39	37
7	64	51	42	35	62	50	41	35	48	41	35	47	40	35	45	39	34	32
8	60	46	37	32	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	36	30	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2950	2950	2950
5°	2965	2951	2951
10°	2953	2947	2954
15°	2957	2945	2951
20°	2948	2932	2942
25°	2942	2927	2933
30°	2927	2912	2909
35°	2906	2895	2892
40°	2885	2871	2874
45°	2868	2840	2828
50°	2827	2812	2799
55°	2794	2767	2757
60°	2739	2711	2694
65°	2680	2647	2600
70°	2589	2544	2482
75°	2510	2413	2353
80°	2408	2295	2182
85°	2271	2126	2013

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2868 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590959
CATALOG NUMBER: 24CGTX-55-L93050-W2A2-4500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.8	3.2
10°-20°	597.4	9.2
20°-30°	909.4	14.0
30°-40°	1102.9	17.0
40°-50°	1153.3	17.8
50°-60°	1054.1	16.2
60°-70°	819.9	12.6
70°-80°	493.8	7.6
80°-90°	153.3	2.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1714.6	26.4
0°-40°	2817.4	43.4
0°-60°	5024.8	77.4
0°-90°	6491.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6491.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2192	2192	2192	2192	2192	
5°	2196	2184	2185	2181	2185	208
15°	2123	2116	2114	2113	2118	599
25°	1982	1971	1971	1972	1976	913
35°	1769	1763	1763	1762	1761	1108
45°	1507	1499	1493	1493	1486	1161
55°	1191	1185	1180	1176	1176	1063
65°	842	833	831	818	817	832
75°	483	477	464	455	453	509
85°	147	141	138	132	130	161
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590959
CATALOG NUMBER: 24CGTX-55-L93050-W2A2-4500K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2192.5	2192.5	2192.5	2192.5	2192.5
2.5°	2196.7	2192.5	2189.4	2189.4	2193.5
5°	2195.6	2184.1	2185.2	2181.0	2185.2
7.5°	2185.2	2174.8	2175.8	2170.6	2175.8
10°	2161.2	2162.2	2157.0	2158.1	2162.2
12.5°	2148.7	2140.3	2141.4	2141.4	2144.5
15°	2122.6	2116.3	2114.3	2113.2	2118.4
17.5°	2094.4	2087.1	2085.0	2086.1	2087.1
20°	2059.0	2052.7	2047.5	2051.7	2054.8
22.5°	2023.5	2017.3	2016.2	2012.0	2017.3
25°	1981.8	1971.4	1971.4	1972.4	1975.5
27.5°	1934.9	1925.5	1921.3	1925.5	1927.5
30°	1883.7	1877.5	1874.4	1871.2	1872.3
32.5°	1829.5	1821.2	1821.2	1820.1	1819.1
35°	1769.0	1762.7	1762.7	1761.7	1760.7
37.5°	1710.6	1704.3	1700.2	1696.0	1698.1
40°	1642.8	1636.5	1634.5	1630.3	1636.5
42.5°	1577.1	1571.9	1564.6	1566.7	1562.5
45°	1507.2	1498.9	1492.6	1492.6	1486.3
47.5°	1429.0	1422.7	1418.5	1416.5	1417.5
50°	1350.7	1345.5	1343.4	1337.2	1337.2
52.5°	1271.5	1266.3	1260.0	1259.0	1257.9
55°	1191.2	1184.9	1179.7	1175.5	1175.5
57.5°	1103.5	1100.4	1095.2	1086.9	1082.7
60°	1018.0	1012.8	1007.6	1002.4	1001.3
62.5°	931.4	928.3	920.0	911.6	911.6
65°	841.7	833.4	831.3	817.7	816.7
67.5°	751.0	745.8	737.4	728.0	730.1
70°	658.2	655.0	646.7	637.3	631.0
72.5°	570.5	565.3	554.9	547.6	548.6
75°	482.9	476.7	464.2	454.8	452.7
77.5°	393.2	388.0	379.7	369.2	366.1
80°	310.8	302.5	296.2	285.8	281.6
82.5°	223.2	218.0	214.9	208.6	203.4
85°	147.1	140.8	137.7	132.5	130.4
87.5°	66.8	65.7	64.7	62.6	63.6
90°	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

TEST NUMBER: P1590959
CATALOG NUMBER: 24CGTX-55-L93050-W2A2-4500K

CIE UGR TABLE:

Reflectances:											
	Ceiling	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
	Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
	Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.76	17.42	16.12	17.73	18.05	15.66	17.32	16.03	17.64	17.95
	3H	17.68	19.19	18.06	19.51	19.87	17.54	19.05	17.92	19.37	19.73
	4H	18.45	19.87	18.84	20.21	20.59	18.26	19.68	18.66	20.03	20.40
	6H	19.05	20.37	19.46	20.73	21.12	18.81	20.13	19.22	20.49	20.88
	8H	19.27	20.53	19.69	20.91	21.31	19.00	20.26	19.43	20.65	21.05
	12H	19.43	20.63	19.85	21.01	21.44	19.14	20.35	19.57	20.73	21.16
4H	2H	16.42	17.84	16.81	18.18	18.56	16.34	17.76	16.74	18.11	18.49
	3H	18.57	19.76	18.97	20.16	20.56	18.44	19.64	18.85	20.03	20.43
	4H	19.47	20.55	19.90	20.96	21.40	19.29	20.38	19.72	20.79	21.22
	6H	20.21	21.16	20.67	21.60	22.06	19.98	20.93	20.43	21.37	21.82
	8H	20.48	21.37	20.94	21.81	22.28	20.22	21.11	20.68	21.55	22.02
	12H	20.70	21.50	21.18	21.97	22.44	20.41	21.21	20.89	21.69	22.16
8H	4H	19.81	20.70	20.26	21.14	21.60	19.65	20.54	20.11	20.98	21.45
	6H	20.69	21.43	21.18	21.92	22.39	20.48	21.22	20.97	21.70	22.18
	8H	21.04	21.71	21.55	22.22	22.70	20.81	21.47	21.31	21.98	22.46
	12H	21.35	21.94	21.86	22.43	22.99	21.08	21.67	21.59	22.16	22.72
12H	4H	19.85	20.65	20.33	21.12	21.59	19.70	20.50	20.18	20.98	21.45
	6H	20.76	21.43	21.27	21.93	22.42	20.56	21.22	21.06	21.73	22.21
	8H	21.18	21.77	21.69	22.26	22.82	20.95	21.54	21.46	22.03	22.59

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2512-631-28-R2

Test Date: 02/05/2026

Luminaire Tested: 22CGTX-50-L93050-W2A-4500K

Data in this report applies to families of products including 22CGTX

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.05


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2512-631-28-R2
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	07/28/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Metalux
Catalog Number:	**22CGTX-50-L93050-W2A-4500K**
Description:	*THIS IS A REVISION OF REPORT SP1-2512-631-28-R2 TO UPDATE THE CATALOG INFORMATION* 2X2 5000 LUMEN HE CGTX TUNABLE WHITE FROM 3000K TO 5000K - 3 Volt

Spectral Parameters

CCT (K):	4556
CIE u':	0.2166
CIE v':	0.4916
Duv:	-0.0001
CIE x:	0.3588
CIE y:	0.3619
CIE z:	0.2793
Peak Wavelength (nm):	630
Dominant Wavelength (nm):	576
Purity:	16.26758
Rf:	90.4
Rg:	99.5

CRI (Ra):	93.8		
R1:	95.1	R9:	68.4
R2:	96.4	R10:	89.0
R3:	95.1	R11:	94.6
R4:	94.5	R12:	68.9
R5:	93.5	R13:	95.8
R6:	93.0	R14:	96.7
R7:	94.8	R15:	92.7
R8:	88.3		

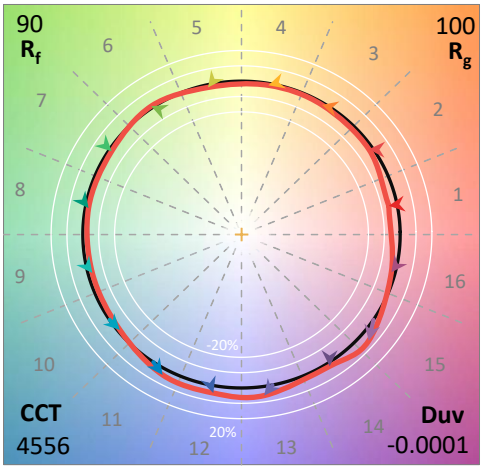

Test Conditions


Stabilization Time:	41M
Operation Time:	1H 41M
Sphere Temperature (°C):	25.1

REPORT NUMBER: SP1-2512-631-28-R2


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	12/16/2025	6/16/2026
Power Meter	XITRON INXT2011004	10/21/2025	10/21/2026
AC Power Source	CHROMA 61603 IN0063	10/21/2025	10/21/2026
DC Power Source	AGILENT E3634A IN0208	10/21/2025	10/21/2026
Sphere Thermometer	ONSET IN0085	10/21/2025	10/21/2026
Room Thermometer	ONSET IN0046	10/21/2025	10/21/2026

REPORT NUMBER: SP1-2512-631-28-R2

CIE 1931 Chromaticity Diagram

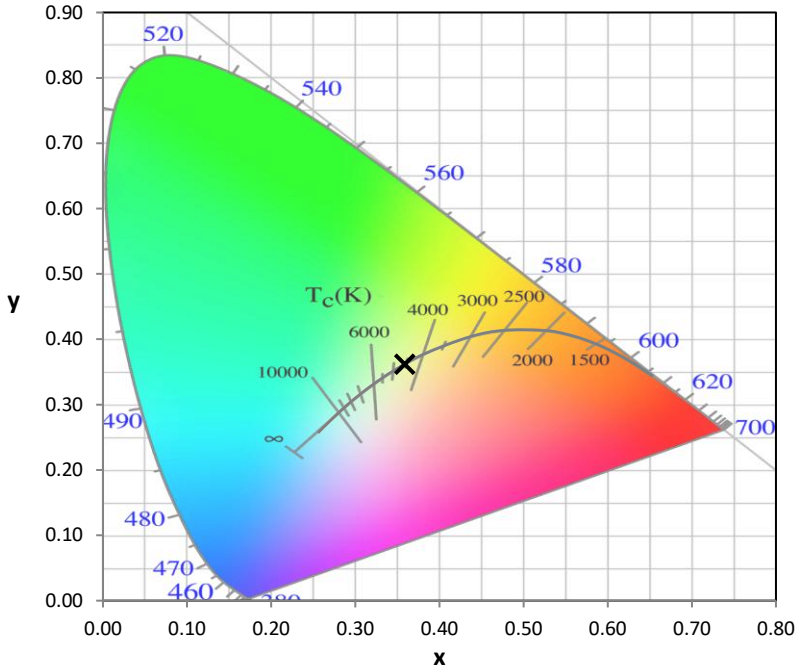

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

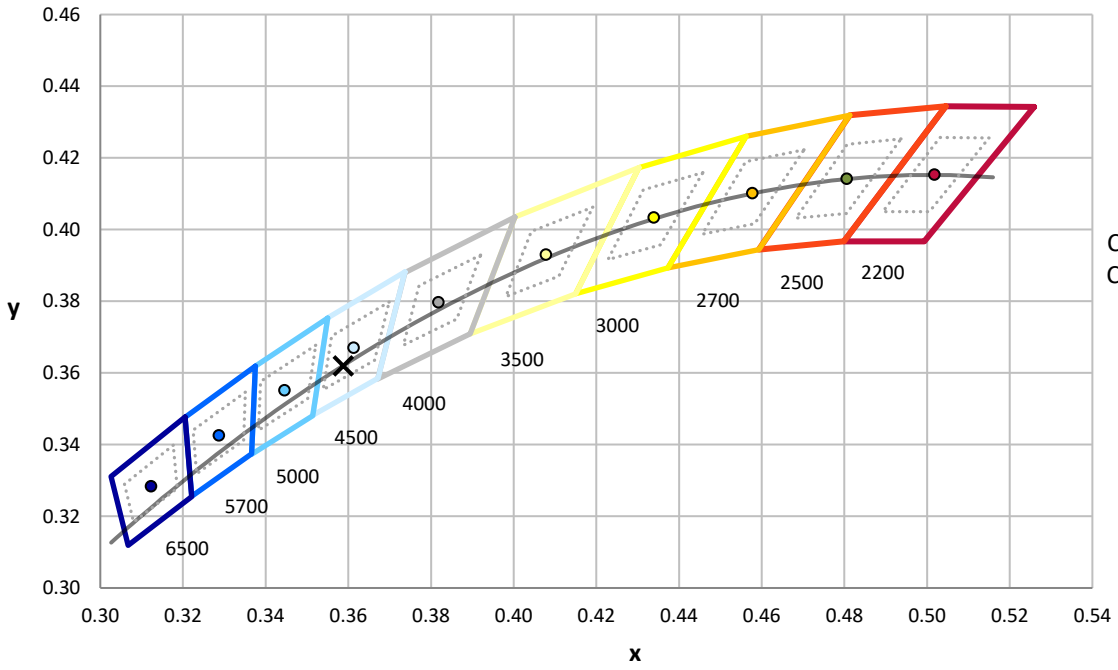


CCT = 4556K
CIE x = 0.3588
CIE y = 0.3619
Duv = -0.0001

Point lies inside the ANSI 4500K 4-step quadrangle

REPORT NUMBER: SP1-2512-631-28-R2

Photopic Flux vs. Wavelength

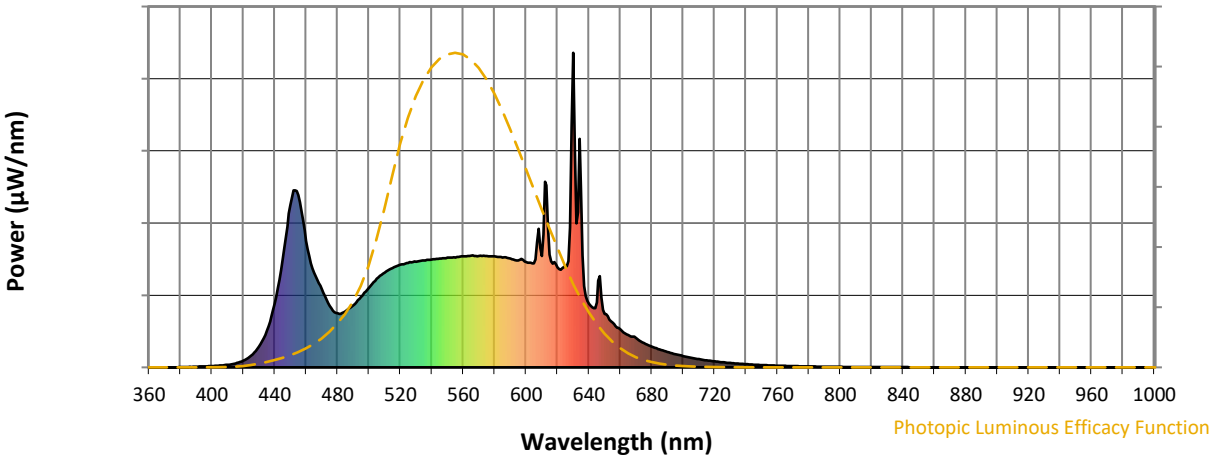


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	198	NR	620	318	NR	750	7	NR	880	0	NR
365	0	NR	495	223	NR	625	321	NR	755	6	NR	885	0	NR
370	0	NR	500	254	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	282	NR	635	572	NR	765	5	NR	895	0	NR
380	1	NR	510	301	NR	640	202	NR	770	4	NR	900	0	NR
385	1	NR	515	316	NR	645	207	NR	775	3	NR	905	0	NR
390	2	NR	520	327	NR	650	170	NR	780	3	NR	910	0	NR
395	3	NR	525	332	NR	655	143	NR	785	2	NR	915	0	NR
400	4	NR	530	336	NR	660	121	NR	790	2	NR	920	0	NR
405	6	NR	535	340	NR	665	102	NR	795	2	NR	925	0	NR
410	8	NR	540	343	NR	670	94	NR	800	2	NR	930	0	NR
415	12	NR	545	346	NR	675	77	NR	805	1	NR	935	0	NR
420	21	NR	550	349	NR	680	66	NR	810	1	NR	940	0	NR
425	37	NR	555	349	NR	685	57	NR	815	1	NR	945	0	NR
430	66	NR	560	353	NR	690	49	NR	820	1	NR	950	0	NR
435	117	NR	565	355	NR	695	42	NR	825	1	NR	955	0	NR
440	203	NR	570	354	NR	700	36	NR	830	1	NR	960	0	NR
445	343	NR	575	354	NR	705	31	NR	835	1	NR	965	0	NR
450	516	NR	580	353	NR	710	26	NR	840	1	NR	970	0	NR
455	547	NR	585	349	NR	715	22	NR	845	0	NR	975	0	NR
460	402	NR	590	346	NR	720	19	NR	850	0	NR	980	0	NR
465	301	NR	595	340	NR	725	16	NR	855	0	NR	985	0	NR
470	248	NR	600	335	NR	730	14	NR	860	0	NR	990	0	NR
475	195	NR	605	330	NR	735	12	NR	865	0	NR	995	0	NR
480	172	NR	610	354	NR	740	10	NR	870	0	NR	1000	0	NR
485	178	NR	615	358	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2512-631-28-R2

Scotopic Flux vs. Wavelength

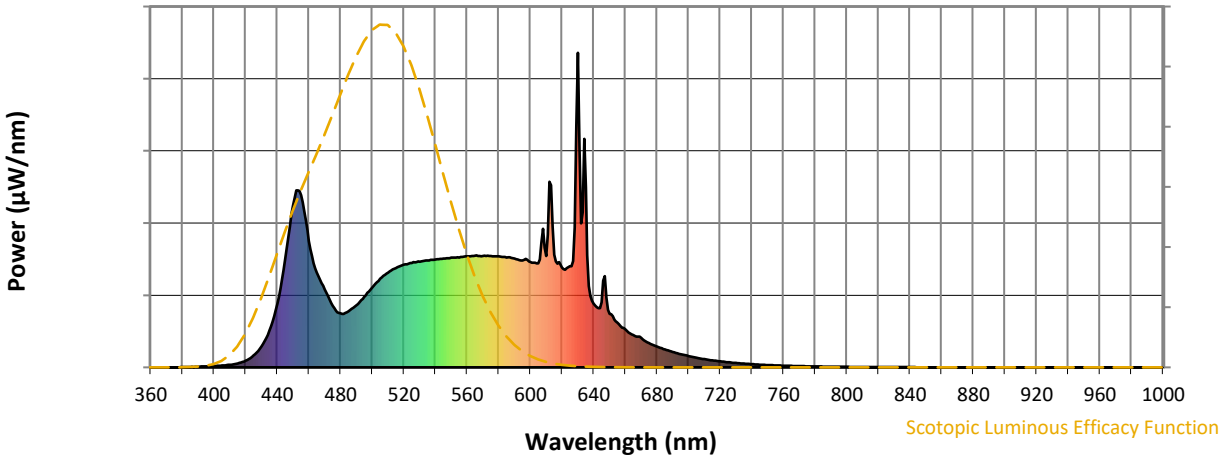


Scotopic Lumens: NR **S/P: 1.95**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	198	NR	620	318	NR	750	7	NR	880	0	NR
365	0	NR	495	223	NR	625	321	NR	755	6	NR	885	0	NR
370	0	NR	500	254	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	282	NR	635	572	NR	765	5	NR	895	0	NR
380	1	NR	510	301	NR	640	202	NR	770	4	NR	900	0	NR
385	1	NR	515	316	NR	645	207	NR	775	3	NR	905	0	NR
390	2	NR	520	327	NR	650	170	NR	780	3	NR	910	0	NR
395	3	NR	525	332	NR	655	143	NR	785	2	NR	915	0	NR
400	4	NR	530	336	NR	660	121	NR	790	2	NR	920	0	NR
405	6	NR	535	340	NR	665	102	NR	795	2	NR	925	0	NR
410	8	NR	540	343	NR	670	94	NR	800	2	NR	930	0	NR
415	12	NR	545	346	NR	675	77	NR	805	1	NR	935	0	NR
420	21	NR	550	349	NR	680	66	NR	810	1	NR	940	0	NR
425	37	NR	555	349	NR	685	57	NR	815	1	NR	945	0	NR
430	66	NR	560	353	NR	690	49	NR	820	1	NR	950	0	NR
435	117	NR	565	355	NR	695	42	NR	825	1	NR	955	0	NR
440	203	NR	570	354	NR	700	36	NR	830	1	NR	960	0	NR
445	343	NR	575	354	NR	705	31	NR	835	1	NR	965	0	NR
450	516	NR	580	353	NR	710	26	NR	840	1	NR	970	0	NR
455	547	NR	585	349	NR	715	22	NR	845	0	NR	975	0	NR
460	402	NR	590	346	NR	720	19	NR	850	0	NR	980	0	NR
465	301	NR	595	340	NR	725	16	NR	855	0	NR	985	0	NR
470	248	NR	600	335	NR	730	14	NR	860	0	NR	990	0	NR
475	195	NR	605	330	NR	735	12	NR	865	0	NR	995	0	NR
480	172	NR	610	354	NR	740	10	NR	870	0	NR	1000	0	NR
485	178	NR	615	358	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2512-631-28-R2

Melanopic Flux vs. Wavelength

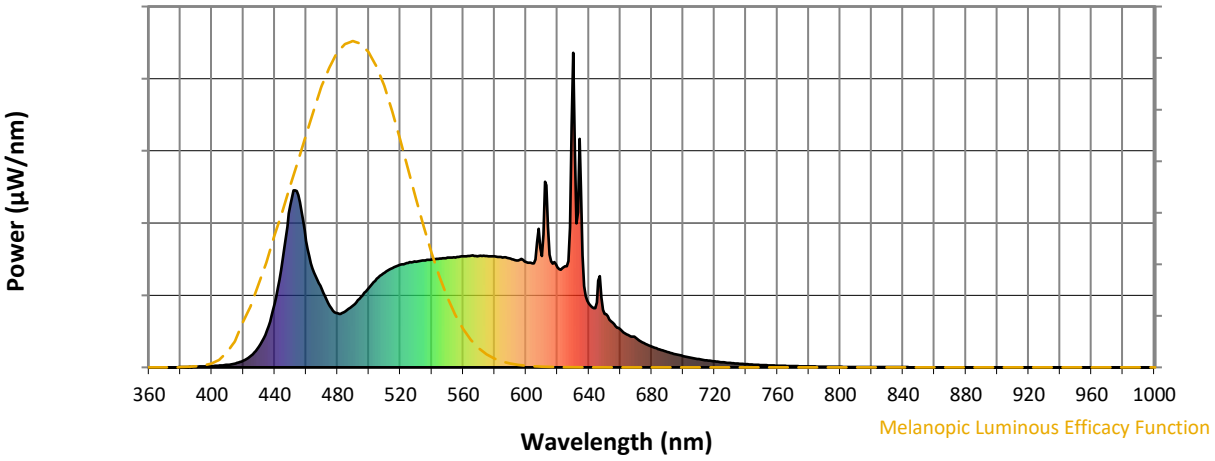

Melanopic Lumens: NR **M/P: 4.17**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	198	NR	620	318	NR	750	7	NR	880	0	NR
365	0	NR	495	223	NR	625	321	NR	755	6	NR	885	0	NR
370	0	NR	500	254	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	282	NR	635	572	NR	765	5	NR	895	0	NR
380	1	NR	510	301	NR	640	202	NR	770	4	NR	900	0	NR
385	1	NR	515	316	NR	645	207	NR	775	3	NR	905	0	NR
390	2	NR	520	327	NR	650	170	NR	780	3	NR	910	0	NR
395	3	NR	525	332	NR	655	143	NR	785	2	NR	915	0	NR
400	4	NR	530	336	NR	660	121	NR	790	2	NR	920	0	NR
405	6	NR	535	340	NR	665	102	NR	795	2	NR	925	0	NR
410	8	NR	540	343	NR	670	94	NR	800	2	NR	930	0	NR
415	12	NR	545	346	NR	675	77	NR	805	1	NR	935	0	NR
420	21	NR	550	349	NR	680	66	NR	810	1	NR	940	0	NR
425	37	NR	555	349	NR	685	57	NR	815	1	NR	945	0	NR
430	66	NR	560	353	NR	690	49	NR	820	1	NR	950	0	NR
435	117	NR	565	355	NR	695	42	NR	825	1	NR	955	0	NR
440	203	NR	570	354	NR	700	36	NR	830	1	NR	960	0	NR
445	343	NR	575	354	NR	705	31	NR	835	1	NR	965	0	NR
450	516	NR	580	353	NR	710	26	NR	840	1	NR	970	0	NR
455	547	NR	585	349	NR	715	22	NR	845	0	NR	975	0	NR
460	402	NR	590	346	NR	720	19	NR	850	0	NR	980	0	NR
465	301	NR	595	340	NR	725	16	NR	855	0	NR	985	0	NR
470	248	NR	600	335	NR	730	14	NR	860	0	NR	990	0	NR
475	195	NR	605	330	NR	735	12	NR	865	0	NR	995	0	NR
480	172	NR	610	354	NR	740	10	NR	870	0	NR	1000	0	NR
485	178	NR	615	358	NR	745	9	NR	875	0	NR			


REPORT NUMBER: SP1-2512-631-28-R2

TM-30-18


Summary


R_f = 90.4
R_g = 99.5
CIE R_a = 93.8
R_9 = 68.4


Spectral Power Distribution Comparison

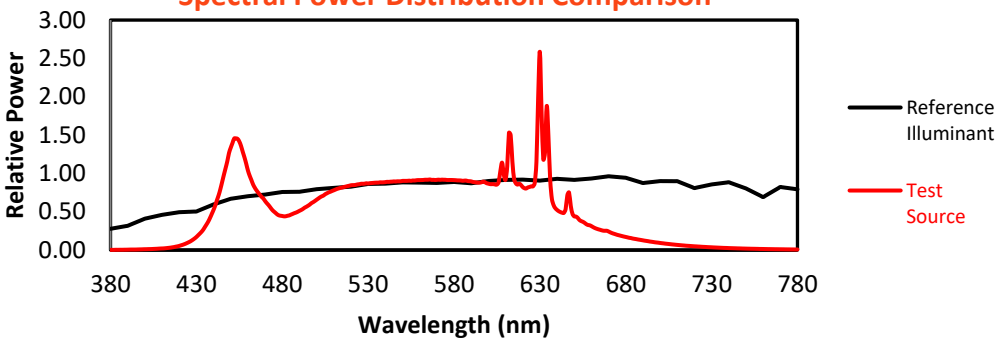


Color Vector Graphics

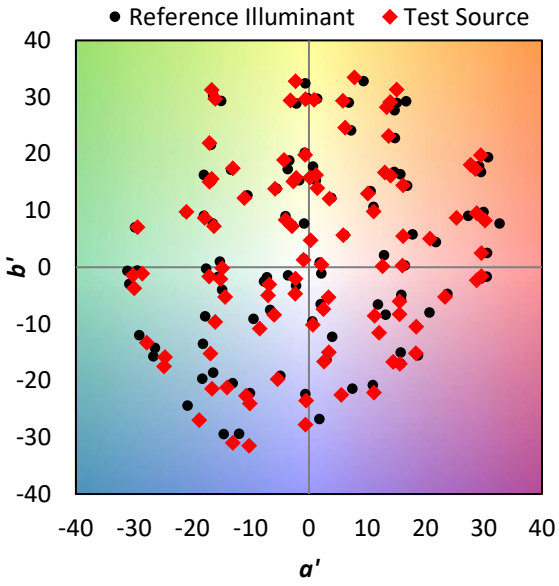

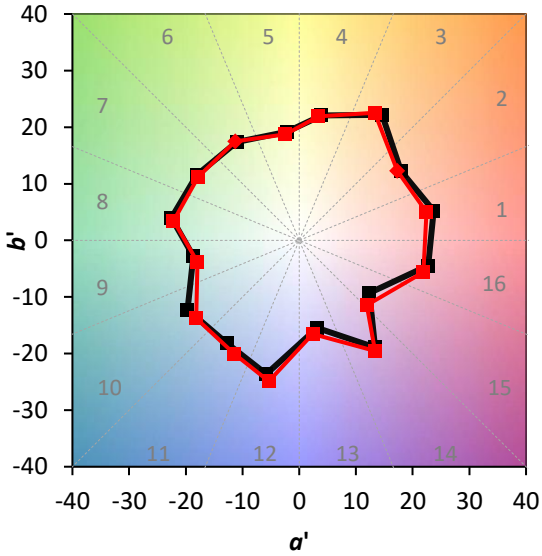

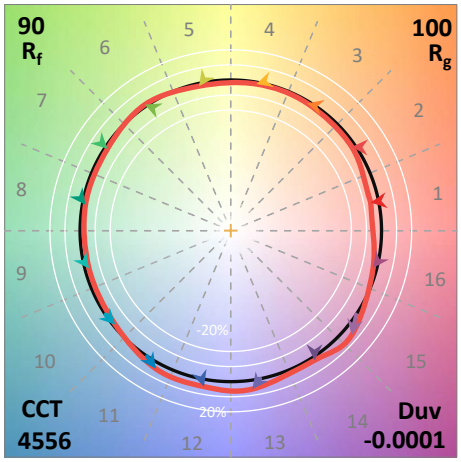

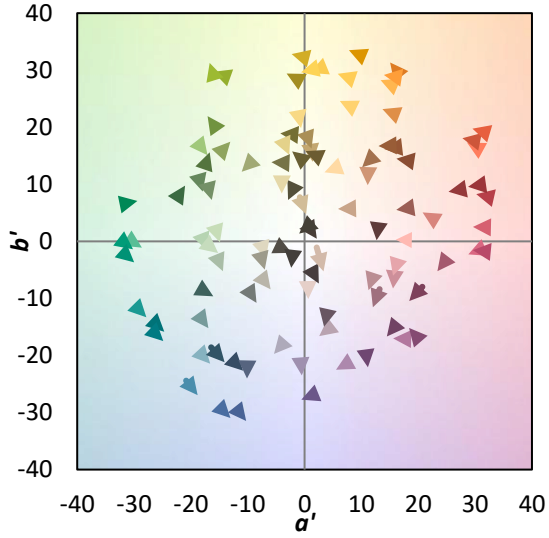


REPORT NUMBER: SP1-2512-631-28-R2

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 92	CES51 = 96	CES76 = 85
CES02 = 61	CES27 = 90	CES52 = 99	CES77 = 87
CES03 = 31	CES28 = 95	CES53 = 97	CES78 = 82
CES04 = 69	CES29 = 96	CES54 = 92	CES79 = 94
CES05 = 48	CES30 = 89	CES55 = 90	CES80 = 92
CES06 = 50	CES31 = 97	CES56 = 93	CES81 = 81
CES07 = 41	CES32 = 88	CES57 = 92	CES82 = 96
CES08 = 40	CES33 = 98	CES58 = 92	CES83 = 96
CES09 = 29	CES34 = 92	CES59 = 97	CES84 = 93
CES10 = 74	CES35 = 95	CES60 = 91	CES85 = 82
CES11 = 56	CES36 = 79	CES61 = 91	CES86 = 84
CES12 = 62	CES37 = 94	CES62 = 83	CES87 = 91
CES13 = 43	CES38 = 84	CES63 = 91	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 87	CES89 = 86
CES15 = 71	CES40 = 98	CES65 = 86	CES90 = 96
CES16 = 47	CES41 = 96	CES66 = 84	CES91 = 71
CES17 = 49	CES42 = 92	CES67 = 83	CES92 = 77
CES18 = 56	CES43 = 93	CES68 = 86	CES93 = 86
CES19 = 70	CES44 = 99	CES69 = 87	CES94 = 76
CES20 = 65	CES45 = 97	CES70 = 83	CES95 = 82
CES21 = 85	CES46 = 97	CES71 = 76	CES96 = 92
CES22 = 77	CES47 = 95	CES72 = 92	CES97 = 95
CES23 = 91	CES48 = 90	CES73 = 78	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 91	CES99 = 93
CES25 = 70	CES50 = 98	CES75 = 79	

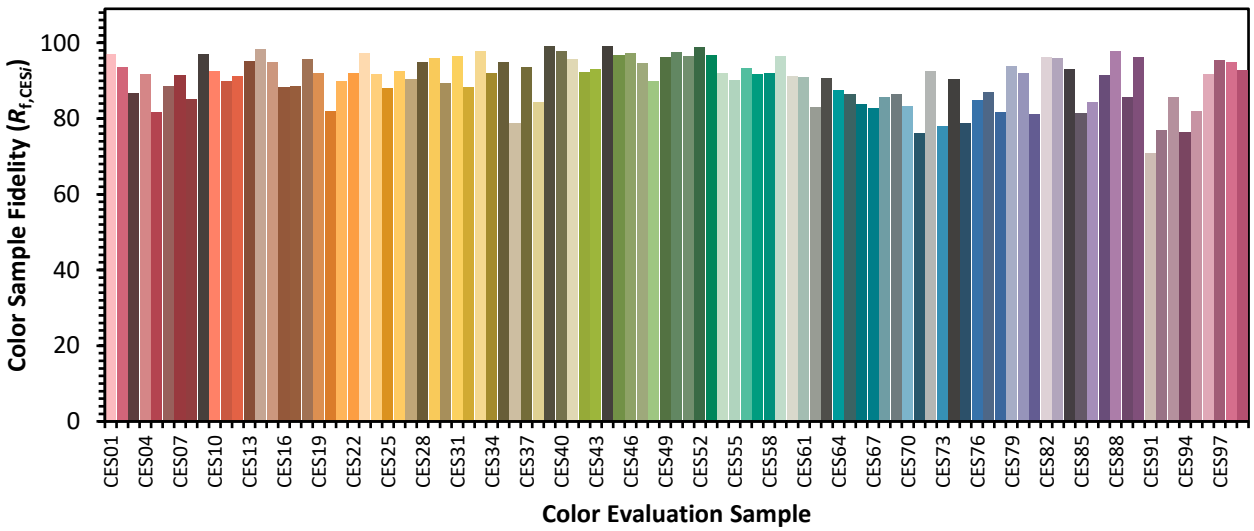



REPORT NUMBER: SP1-2512-631-28-R2

TM-30-18

Color Rendition by Hue-Angle Bin

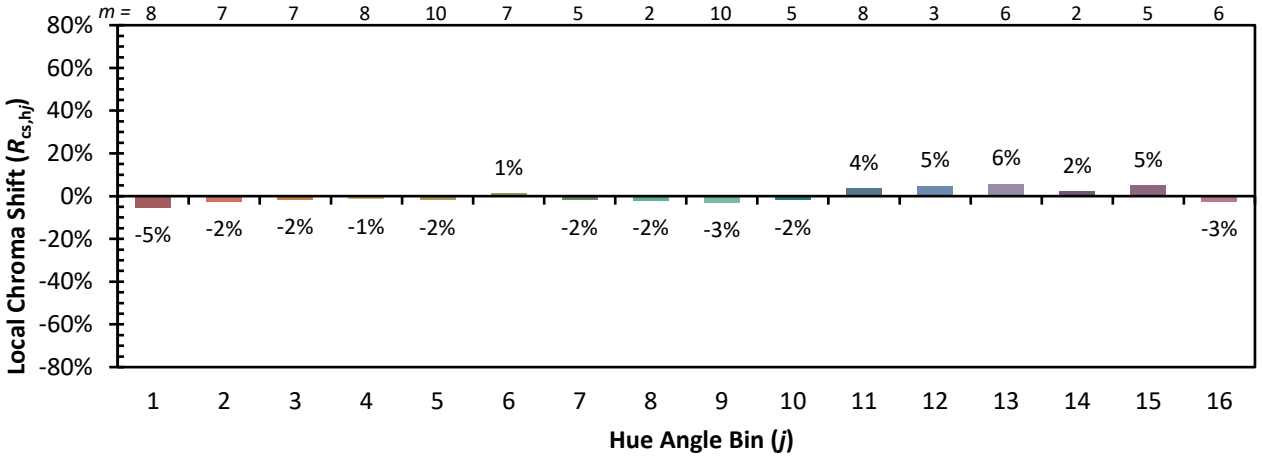

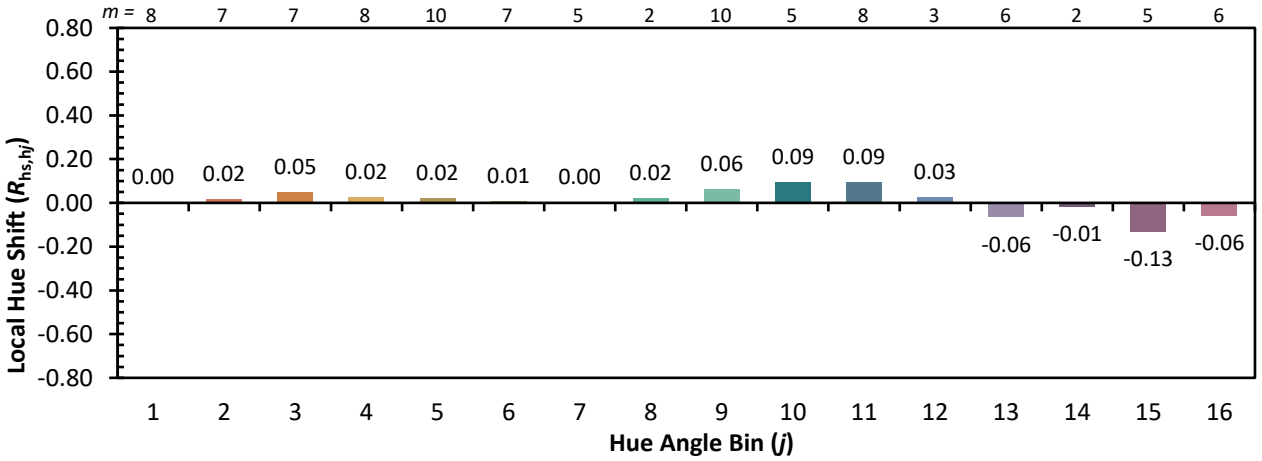


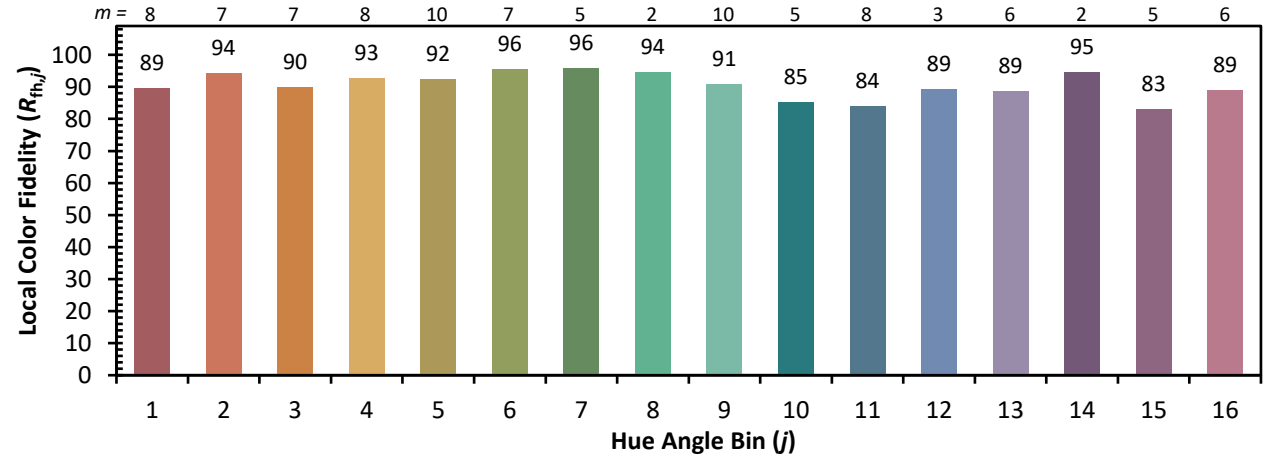


REPORT NUMBER: SP1-2512-631-28-R2

TM-30-18

Measure Comparisons

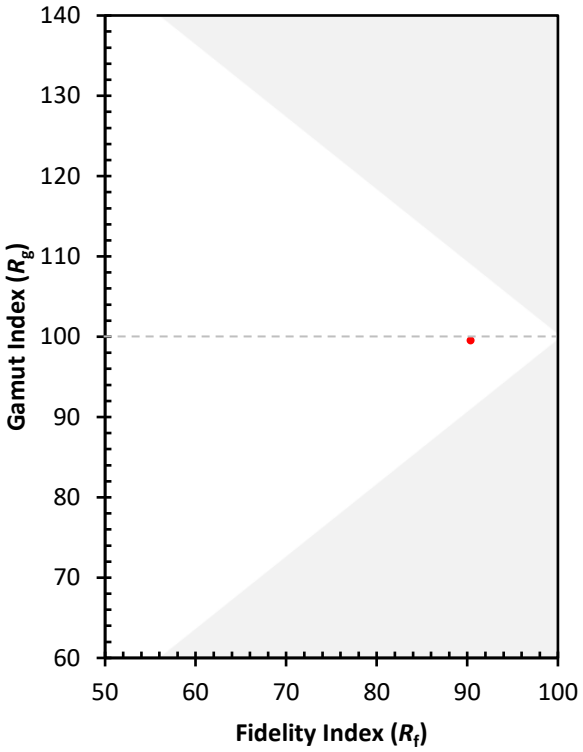

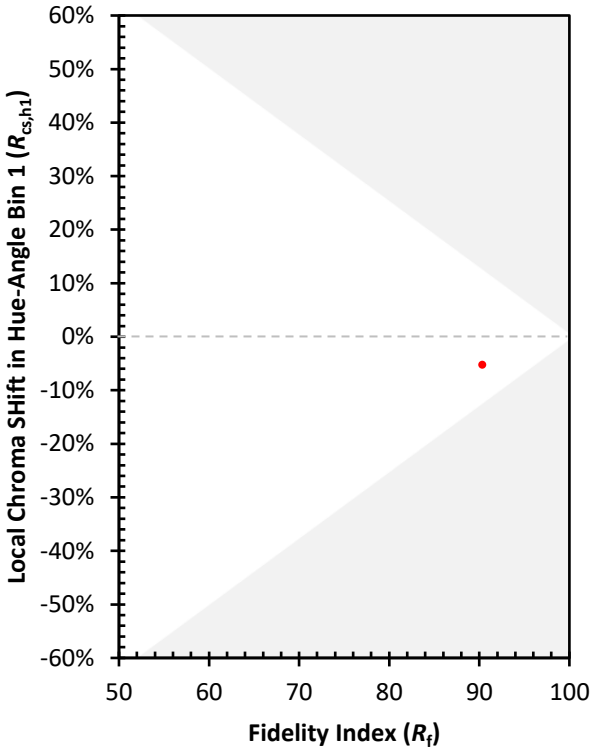

(END OF REPORT)