

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1432371

Luminaire Tested: EHBR1-30-UNV-N-L830-UPL12

Issue Date: 3/20/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1432371  
REPORT IS A COMBINATION OF REPORTS P1431748 AND P1431635  
Test Lab: INNOVATION CENTER  
Issue Date: 3/20/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: METALUX  
Catalog Number: EHBR1-30-UNV-N-L830-UPL12  
Description: Elevate Round Highbay at, 30000 lumens, 3000K 80CRI LEDs with N lens  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 30039.8 lumens  
Efficiency: N/A  
Efficacy: 179.7 lumens/watt  
Spacing Criteria (0/90/45): 0.82 / 0.82 / 0.8  
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')  
CIE Type: Direct  
  
Input Watts (W): 167.2  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1432371  
CATALOG NUMBER: EHBR1-30-UNV-N-L830-UPL12

### Luminous Intensity Polar Plot

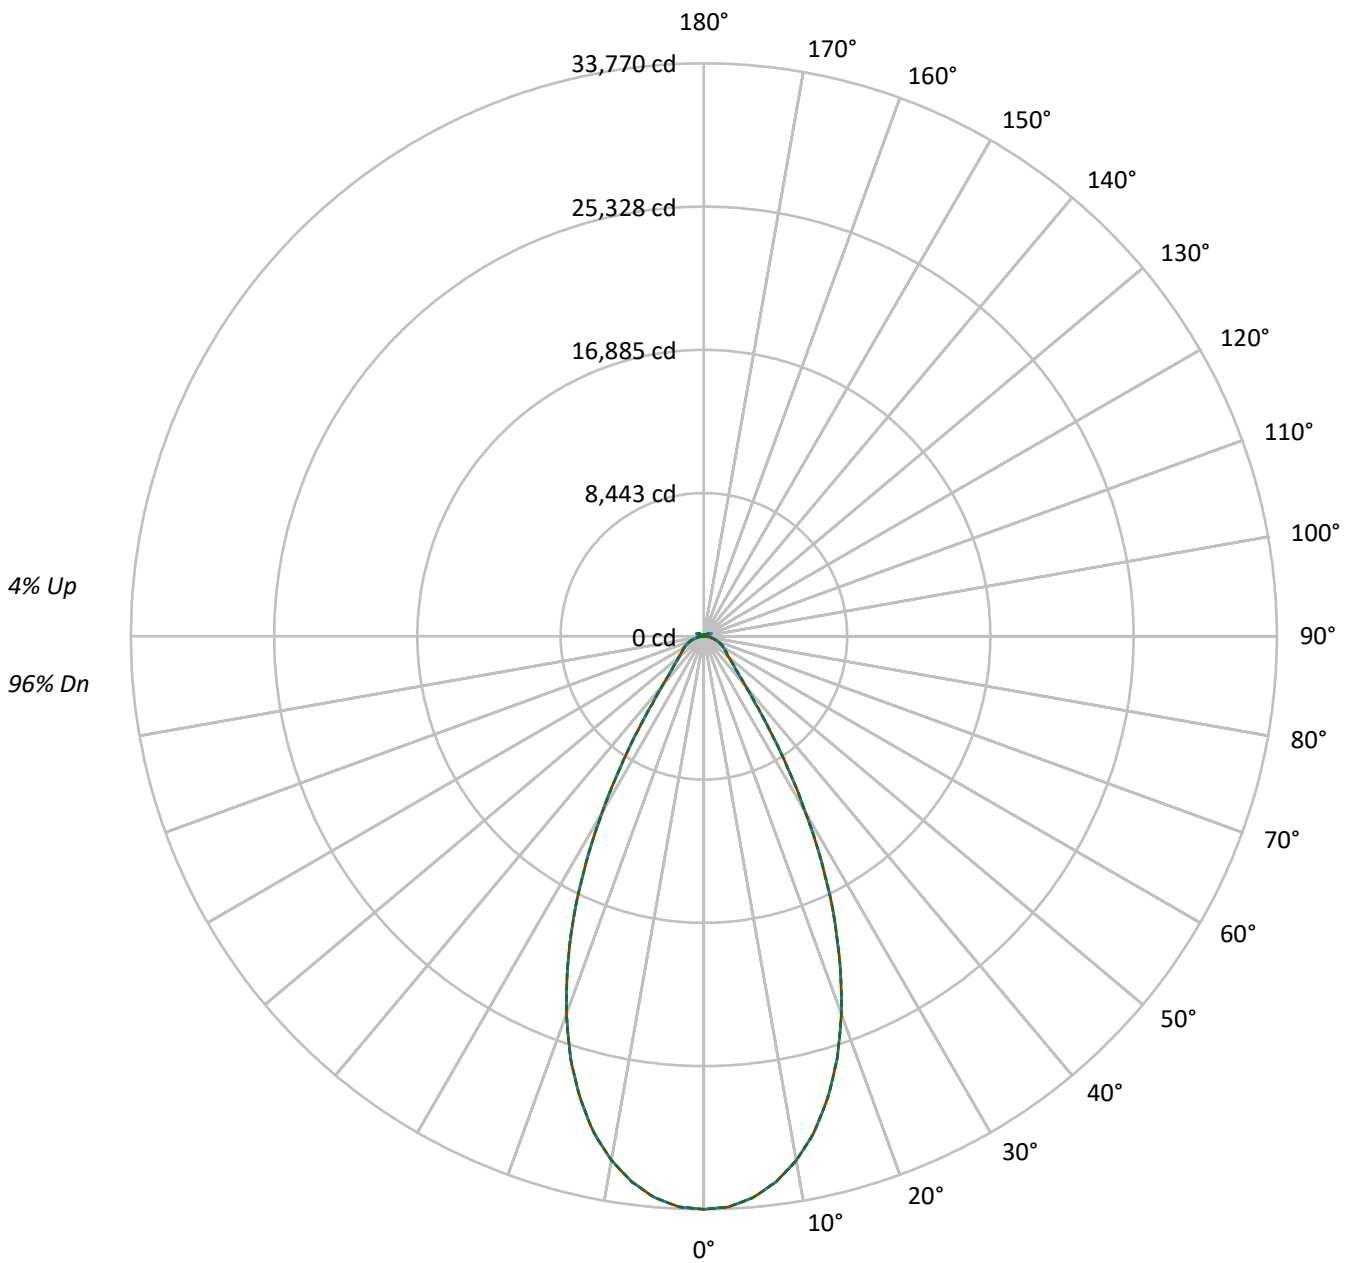

— 0°-180°    - - 45°-225°    - - - 90°-270°



TEST NUMBER: P1432371

CATALOG NUMBER: EHBR1-30-UNV-N-L830-UPL12

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	99	99	99	96
1	111	108	105	103	108	106	103	101	101	99	97	96	95	93	92	91	90	92	91	90	88
2	105	99	94	90	102	97	93	89	93	90	87	90	87	84	86	84	82	86	84	82	80
3	99	91	86	81	96	90	84	80	86	82	79	84	80	77	81	78	75	81	78	75	73
4	93	85	78	74	91	83	78	73	81	76	72	78	74	71	76	72	69	76	72	69	68
5	88	79	72	68	86	78	72	67	75	70	66	73	69	65	71	67	64	71	67	64	63
6	83	74	67	62	82	73	67	62	71	65	61	69	64	61	67	63	60	67	63	60	58
7	79	69	63	58	78	68	62	58	67	61	57	65	60	57	64	59	56	64	59	56	54
8	75	65	59	54	74	64	58	54	63	57	54	61	57	53	60	56	53	60	56	53	51
9	72	61	55	51	70	61	55	51	59	54	50	58	53	50	57	53	50	57	53	50	48
10	68	58	52	48	67	57	52	48	56	51	47	55	50	47	54	50	47	54	50	47	45

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	158589	158589	158589
5°	155510	155510	155510
10°	147597	147597	147597
15°	134294	134294	134294
20°	115195	115195	115195
25°	90619	90619	90619
30°	62188	62188	62188
35°	36942	36942	36942
40°	21858	21858	21858
45°	15691	15691	15691
50°	12897	12897	12897
55°	11722	11722	11722
60°	11221	11221	11221
65°	10703	10703	10703
70°	9953	9953	9953
75°	8997	8997	8997
80°	7469	7469	7469
85°	4728	4728	4728

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 15691 cd/sqm



TEST NUMBER: P1432371  
 CATALOG NUMBER: EHBR1-30-UNV-N-L830-UPL12

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	3110.8	10.4
10°-20°	7808.6	26.0
20°-30°	8164.7	27.2
30°-40°	4423.9	14.7
40°-50°	2035.2	6.8
50°-60°	1434.3	4.8
60°-70°	1103.8	3.7
70°-80°	669.1	2.2
80°-90°	190.4	0.6
90°-100°	31.4	0.1
100°-110°	196.4	0.7
110°-120°	351.1	1.2
120°-130°	206.0	0.7
130°-140°	126.4	0.4
140°-150°	87.7	0.3
150°-160°	56.9	0.2
160°-170°	32.4	0.1
170°-180°	10.7	0.0
0°-30°	19084.1	63.5
0°-40°	23507.9	78.3
0°-60°	26977.4	89.8
0°-90°	28940.7	96.3
90°-120°	578.9	1.9
90°-150°	999.0	3.3
90°-180°	1099.0	3.7
0°-180°	30039.8	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	33770	33770	33770	33770	33770	
5°	33204	33204	33204	33204	33204	3111
15°	28174	28174	28174	28174	28174	7809
25°	18097	18097	18097	18097	18097	8165
35°	6780	6780	6780	6780	6780	4424
45°	2539	2539	2539	2539	2539	2035
55°	1584	1584	1584	1584	1584	1434
65°	1117	1117	1117	1117	1117	1104
75°	634	634	634	634	634	669
85°	162	162	162	162	162	180
90°	9	14	24	15	9	12
95°	14	23	51	25	16	13
105°	69	135	345	149	91	92
115°	316	332	408	391	389	291
125°	228	213	218	221	248	208
135°	166	161	167	157	156	130
145°	136	135	143	141	140	86
155°	120	118	124	124	124	56
165°	112	112	115	115	114	32
175°	111	111	113	113	113	11
180°	112	112	112	112	112	



TEST NUMBER: P1432371

CATALOG NUMBER: EHBR1-30-UNV-N-L830-UPL12

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	33770.4	33770.4	33770.4	33770.4	33770.4
2.5°	33650.6	33650.6	33650.6	33650.6	33650.6
5°	33203.9	33203.9	33203.9	33203.9	33203.9
7.5°	32441.2	32441.2	32441.2	32441.2	32441.2
10°	31359.1	31359.1	31359.1	31359.1	31359.1
12.5°	29960.7	29960.7	29960.7	29960.7	29960.7
15°	28174.2	28174.2	28174.2	28174.2	28174.2
17.5°	26101.6	26101.6	26101.6	26101.6	26101.6
20°	23675.9	23675.9	23675.9	23675.9	23675.9
22.5°	20975.2	20975.2	20975.2	20975.2	20975.2
25°	18096.6	18096.6	18096.6	18096.6	18096.6
27.5°	15044.8	15044.8	15044.8	15044.8	15044.8
30°	11961.8	11961.8	11961.8	11961.8	11961.8
32.5°	9180.3	9180.3	9180.3	9180.3	9180.3
35°	6780.2	6780.2	6780.2	6780.2	6780.2
37.5°	4978.2	4978.2	4978.2	4978.2	4978.2
40°	3788.5	3788.5	3788.5	3788.5	3788.5
42.5°	3037.8	3037.8	3037.8	3037.8	3037.8
45°	2538.7	2538.7	2538.7	2538.7	2538.7
47.5°	2179.0	2179.0	2179.0	2179.0	2179.0
50°	1922.1	1922.1	1922.1	1922.1	1922.1
52.5°	1734.6	1734.6	1734.6	1734.6	1734.6
55°	1584.1	1584.1	1584.1	1584.1	1584.1
57.5°	1461.9	1461.9	1461.9	1461.9	1461.9
60°	1349.0	1349.0	1349.0	1349.0	1349.0
62.5°	1235.9	1235.9	1235.9	1235.9	1235.9
65°	1117.1	1117.1	1117.1	1117.1	1117.1
67.5°	995.9	995.9	995.9	995.9	995.9
70°	873.3	873.3	873.3	873.3	873.3
72.5°	754.1	754.1	754.1	754.1	754.1
75°	633.8	633.8	633.8	633.8	633.8
77.5°	516.0	516.0	516.0	516.0	516.0
80°	392.9	392.9	392.9	392.9	392.9
82.5°	275.1	275.1	275.1	275.1	275.1
85°	162.5	162.5	162.5	162.5	162.5
87.5°	58.2	58.2	58.2	58.2	58.2
90°	9.1	14.1	23.6	15.4	9.1
92.5°	12.0	20.1	36.5	18.8	10.7
95°	13.9	23.2	51.0	25.2	15.7
97.5°	17.6	25.8	58.5	30.8	24.5
100°	23.2	30.2	91.2	37.7	32.7
102.5°	39.6	64.2	193.8	71.1	49.7
105°	68.6	135.3	345.4	149.1	90.6
107.5°	118.9	242.2	455.4	264.2	171.8
110°	222.1	321.5	477.5	363.0	274.9



TEST NUMBER: P1432371

CATALOG NUMBER: EHBR1-30-UNV-N-L830-UPL12

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°
112.5°	300.1	345.4	457.4	400.7	357.9
115°	315.9	332.2	408.3	391.3	388.8
117.5°	305.1	303.2	346.7	351.6	375.6
120°	282.5	269.9	289.3	307.0	339.1
122.5°	254.1	239.0	247.9	261.1	293.2
125°	227.7	212.6	218.3	221.4	248.5
127.5°	204.5	194.4	197.6	193.8	210.8
130°	188.7	179.9	184.3	175.5	183.7
132.5°	175.5	169.8	174.9	164.2	166.7
135°	166.1	161.0	166.7	156.6	156.1
137.5°	157.9	153.5	159.1	151.7	149.7
140°	150.3	146.6	152.9	147.3	145.9
142.5°	142.2	139.7	147.3	143.4	142.2
145°	136.5	134.6	142.8	140.9	140.3
147.5°	131.5	130.2	137.8	137.1	137.1
150°	127.1	125.8	133.4	132.7	133.4
152.5°	122.7	121.4	128.3	127.7	128.3
155°	119.5	118.3	123.9	123.9	123.9
157.5°	117.0	116.3	120.8	120.8	120.8
160°	115.1	114.5	118.3	118.3	117.7
162.5°	113.2	112.6	117.0	116.3	116.3
165°	111.9	111.9	115.1	115.1	114.5
167.5°	111.9	111.4	114.5	114.5	113.9
170°	111.4	111.4	113.9	113.2	112.6
172.5°	111.4	111.4	113.9	113.2	112.6
175°	110.7	110.7	112.6	112.6	112.6
177.5°	111.4	111.4	112.6	112.6	111.9
180°	111.9	111.9	111.9	111.9	111.9



TEST NUMBER: P1432371  
 CATALOG NUMBER: EHBR1-30-UNV-N-L830-UPL12

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.73	17.84	17.17	18.23	18.64	16.73	17.84	17.17	18.23	18.64
	3H	18.51	19.50	18.96	19.91	20.37	18.51	19.50	18.96	19.91	20.37
	4H	19.17	20.09	19.64	20.52	20.99	19.17	20.09	19.64	20.52	20.99
	6H	19.63	20.47	20.11	20.92	21.41	19.63	20.47	20.11	20.92	21.41
	8H	19.76	20.55	20.25	21.02	21.51	19.76	20.55	20.25	21.02	21.51
	12H	19.81	20.57	20.31	21.03	21.55	19.81	20.57	20.31	21.03	21.55
4H	2H	17.28	18.19	17.75	18.62	19.10	17.28	18.19	17.75	18.62	19.10
	3H	19.25	20.00	19.73	20.48	20.98	19.25	20.00	19.73	20.48	20.98
	4H	20.02	20.70	20.52	21.19	21.72	20.02	20.70	20.52	21.19	21.72
	6H	20.59	21.18	21.12	21.70	22.25	20.59	21.18	21.12	21.70	22.25
	8H	20.75	21.30	21.29	21.81	22.37	20.75	21.30	21.29	21.81	22.37
	12H	20.83	21.31	21.38	21.86	22.42	20.83	21.31	21.38	21.86	22.42
8H	4H	20.25	20.80	20.79	21.31	21.87	20.25	20.80	20.79	21.31	21.87
	6H	20.93	21.37	21.50	21.94	22.51	20.93	21.37	21.50	21.94	22.51
	8H	21.16	21.55	21.74	22.13	22.71	21.16	21.55	21.74	22.13	22.71
	12H	21.30	21.64	21.88	22.20	22.85	21.30	21.64	21.88	22.20	22.85
12H	4H	20.25	20.73	20.80	21.28	21.84	20.25	20.73	20.80	21.28	21.84
	6H	20.96	21.35	21.54	21.93	22.51	20.96	21.35	21.54	21.93	22.51
	8H	21.22	21.56	21.80	22.12	22.78	21.22	21.56	21.80	22.12	22.78

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-2

Test Date: 07/31/2025

Luminaire Tested: EHBR-60-L830-N

Data in this report applies to families of products including EHBR-60-L830-N

**Test Information**

Test Method: LM-79-2019  
 Report Number: SP1-2506-472-2  
 Test Lab: COOPER LIGHTING SOLUTIONS  
 Photometer: SP1 - 76IN SPHERE  
 Measurement Geometry: 4π  
 Issue Date: 08/05/2025  
 Manufacturer: COOPER LIGHTING SOLUTIONS  
 Product Line: Metalux  
 Catalog Number: **EHBR-60-L830-N**  
 Description: Elevate Round Highbay at, 60000 lumens, 3000K 80CRI LEDs with N lens

**Spectral Parameters**

CCT (K): 2983  
 CIE u': 0.2516  
 CIE v': 0.5201  
 Duv: -0.0012  
 CIE x: 0.4364  
 CIE y: 0.4010  
 CIE z: 0.1626  
 Peak Wavelength (nm): 630  
 Dominant Wavelength (nm): 583  
 Purity: 51.34918  
 Rf: 81.2  
 Rg: 101.5

CRI (Ra):	83.4		
R1:	84.0	R9:	29.4
R2:	87.5	R10:	68.6
R3:	88.9	R11:	82.2
R4:	83.8	R12:	61.6
R5:	81.9	R13:	83.9
R6:	83.1	R14:	92.5
R7:	87.1	R15:	79.8
R8:	70.9		



**Test Conditions**

Stabilization Time: 38M  
 Operation Time: 1H 38M  
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-2

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-2

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-2

**Photopic Flux vs. Wavelength**



**Photopic Lumens: NR**

$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-2

**Scotopic Flux vs. Wavelength**



**Scotopic Lumens: NR**

**S/P: 1.27**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-2

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.34

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

**Summary**

$R_f = 81.2$   
 $R_g = 101.5$   
 CIE  $R_a = 83.4$   
 $R_9 = 29.4$



**Color Vector Graphics**



**Individual Sample Fidelity Index ( $R_{f,i}$ )**

CES01 = 86	CES26 = 71	CES51 = 89	CES76 = 65
CES02 = 63	CES27 = 89	CES52 = 89	CES77 = 82
CES03 = 31	CES28 = 86	CES53 = 80	CES78 = 67
CES04 = 70	CES29 = 68	CES54 = 92	CES79 = 89
CES05 = 50	CES30 = 77	CES55 = 90	CES80 = 85
CES06 = 51	CES31 = 70	CES56 = 81	CES81 = 75
CES07 = 43	CES32 = 64	CES57 = 79	CES82 = 93
CES08 = 41	CES33 = 74	CES58 = 81	CES83 = 89
CES09 = 29	CES34 = 76	CES59 = 92	CES84 = 91
CES10 = 76	CES35 = 87	CES60 = 96	CES85 = 81
CES11 = 59	CES36 = 99	CES61 = 91	CES86 = 74
CES12 = 65	CES37 = 81	CES62 = 93	CES87 = 83
CES13 = 44	CES38 = 83	CES63 = 79	CES88 = 86
CES14 = 74	CES39 = 94	CES64 = 81	CES89 = 74
CES15 = 72	CES40 = 89	CES65 = 78	CES90 = 85
CES16 = 48	CES41 = 88	CES66 = 76	CES91 = 87
CES17 = 50	CES42 = 80	CES67 = 74	CES92 = 73
CES18 = 57	CES43 = 75	CES68 = 79	CES93 = 84
CES19 = 72	CES44 = 99	CES69 = 83	CES94 = 64
CES20 = 67	CES45 = 83	CES70 = 72	CES95 = 80
CES21 = 87	CES46 = 82	CES71 = 70	CES96 = 86
CES22 = 79	CES47 = 79	CES72 = 90	CES97 = 85
CES23 = 92	CES48 = 78	CES73 = 65	CES98 = 83
CES24 = 91	CES49 = 79	CES74 = 94	CES99 = 82
CES25 = 72	CES50 = 88	CES75 = 70	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)