

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1432325

Luminaire Tested: EHBR1-24-UNV-A1-L830-UPL18

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number: P1432325
REPORT IS A COMBINATION OF REPORTS P1431702 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-24-UNV-A1-L830-UPL18
Description: Elevate Round Highbay at, 24000 lumens, 3000K 80CRI LEDs with A lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 24891.2 lumens
Efficiency: N/A
Efficacy: 177.5 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 1.07 / 0.95
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 140.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1432325
CATALOG NUMBER: EHBR1-24-UNV-A1-L830-UPL18

Luminous Intensity Polar Plot

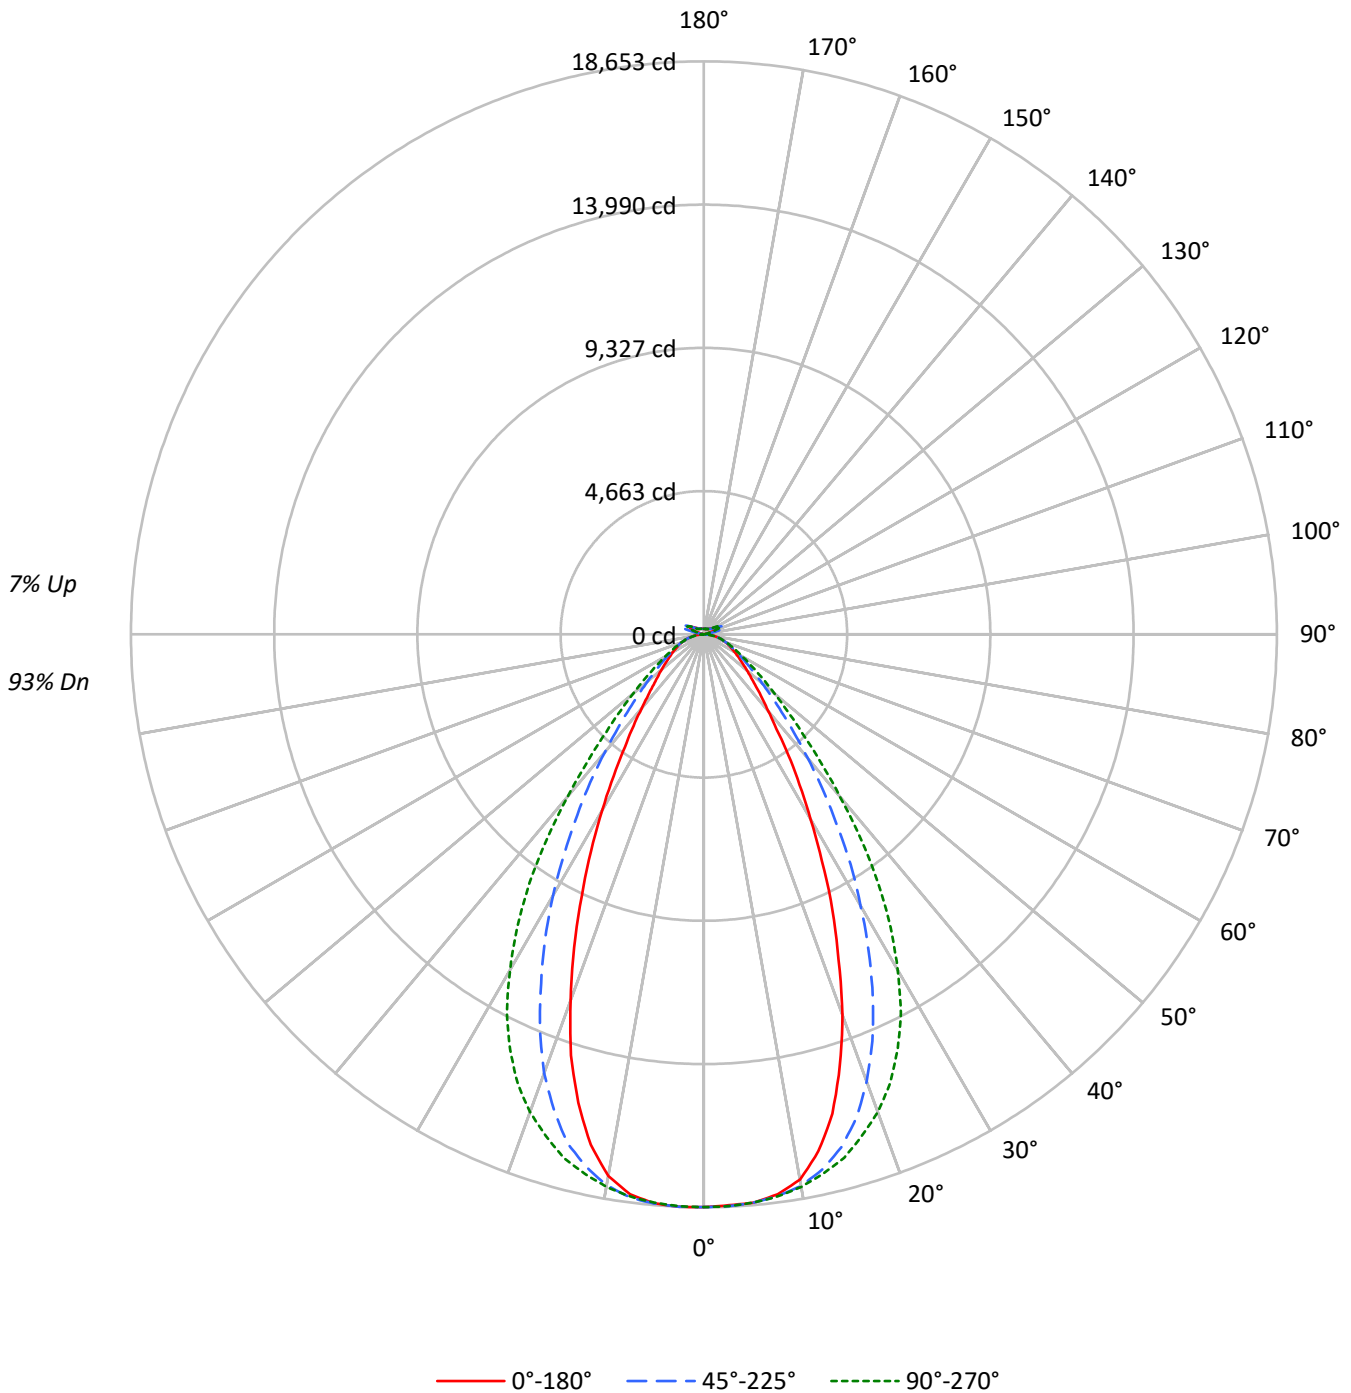



TEST NUMBER: P1432325
 CATALOG NUMBER: EHBR1-24-UNV-A1-L830-UPL18

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	117	117	117	117	114	114	114	114	107	107	107	101	101	101	96	96	96	96	96	96	93
1	110	106	103	100	107	103	101	98	98	96	94	93	91	90	89	87	86	86	86	86	83
2	103	96	91	87	100	94	89	85	90	86	82	85	82	80	82	79	77	77	77	77	75
3	96	88	82	77	93	86	80	75	82	77	73	79	75	71	75	72	69	69	69	69	67
4	90	80	74	68	87	79	72	67	75	70	66	73	68	64	70	66	63	63	63	63	61
5	84	74	67	62	82	72	66	61	70	64	60	67	62	58	65	61	57	57	57	57	55
6	79	68	61	56	77	67	60	55	65	59	54	62	57	53	60	56	53	53	53	53	51
7	74	63	56	51	72	62	55	51	60	54	50	58	53	49	56	52	48	48	48	48	47
8	70	59	52	47	68	58	51	47	56	50	46	55	49	45	53	48	45	45	45	45	43
9	66	55	48	43	65	54	48	43	53	47	43	51	46	42	50	45	42	42	42	42	40
10	63	51	45	40	61	51	44	40	49	44	40	48	43	39	47	42	39	39	39	39	37

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°	135°	180°
0°	87558	87558	87558	87558	87558
5°	86980	86967	86971	87124	87071
10°	84830	85818	85955	85712	84275
15°	77011	82385	84081	81724	75243
20°	64175	75372	80521	73953	61677
25°	49630	65171	74698	62791	47059
30°	36176	53074	65617	51060	34337
35°	26077	40908	53927	39146	24375
40°	18761	30214	39741	28938	18183
45°	14783	22104	27757	21145	14272
50°	12266	16608	20089	16060	12080
55°	10712	13114	15215	12894	10568
60°	9661	10947	12123	10879	9729
65°	9035	9656	10188	9686	9122
70°	8581	8786	9057	8834	8665
75°	8005	7954	8005	7977	8082
80°	7231	6710	6562	6815	7231
85°	5013	4248	4204	4318	5159

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 67.5°
 Vertical Angle: 45°
 Luminance: 29082 cd/sqm



TEST NUMBER: P1432325
 CATALOG NUMBER: EHBR1-24-UNV-A1-L830-UPL18

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1760.7	7.1
10°-20°	4732.2	19.0
20°-30°	5754.3	23.1
30°-40°	4687.3	18.8
40°-50°	2814.3	11.3
50°-60°	1619.6	6.5
60°-70°	1013.6	4.1
70°-80°	597.0	2.4
80°-90°	177.6	0.7
90°-100°	45.5	0.2
100°-110°	301.4	1.2
110°-120°	557.4	2.2
120°-130°	330.9	1.3
130°-140°	200.2	0.8
140°-150°	139.0	0.6
150°-160°	90.8	0.4
160°-170°	52.0	0.2
170°-180°	17.3	0.1
0°-30°	12247.3	49.2
0°-40°	16934.6	68.0
0°-60°	21368.5	85.8
0°-90°	23156.8	93.0
90°-120°	904.3	3.6
90°-150°	1574.4	6.3
90°-180°	1734.0	7.0
0°-180°	24891.2	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	18645	18645	18645	18645	18645	
5°	18572	18569	18570	18602	18591	1755
15°	16157	17284	17640	17145	15786	4445
25°	9911	13014	14917	12539	9398	4516
35°	4786	7508	9898	7185	4474	3028
45°	2392	3576	4491	3421	2309	1887
55°	1448	1772	2056	1742	1428	1309
65°	943	1008	1063	1011	952	938
75°	564	560	564	562	569	597
85°	172	146	144	148	177	184
90°	13	35	12	36	13	15
95°	22	78	24	66	22	21
105°	105	527	138	562	69	141
115°	483	623	593	689	506	445
125°	349	333	379	369	397	318
135°	255	256	240	268	276	200
145°	212	221	217	223	228	134
155°	188	194	193	194	203	88
165°	180	183	181	182	188	51
175°	181	182	180	180	184	17
180°	181	181	181	181	181	



TEST NUMBER: P1432325
 CATALOG NUMBER: EHBR1-24-UNV-A1-L830-UPL18

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	18644.9	18644.9	18644.9	18644.9	18644.9	18644.9	18644.9	18644.9	18644.9
2.5°	18604.0	18620.7	18627.8	18631.7	18635.9	18647.7	18652.8	18644.5	18651.6
5°	18571.6	18572.7	18568.8	18586.4	18569.6	18581.3	18602.4	18594.1	18591.1
7.5°	18382.5	18421.6	18444.6	18450.5	18453.6	18468.1	18482.9	18398.9	18386.4
10°	18023.2	18088.5	18233.3	18274.7	18262.3	18285.7	18210.7	17991.2	17905.3
12.5°	17235.6	17464.8	17841.3	18008.8	17978.3	17999.1	17743.6	17280.5	17014.2
15°	16156.6	16492.8	17284.0	17614.3	17639.7	17614.3	17145.3	16242.9	15785.6
17.5°	14722.3	15343.2	16508.1	17149.3	17112.5	17124.7	16234.3	14900.3	14377.1
20°	13189.9	13851.8	15491.2	16560.8	16549.5	16481.5	15199.5	13440.2	12676.4
22.5°	11456.8	12310.5	14325.9	15837.1	15832.9	15719.7	13939.3	11845.7	11023.4
25°	9911.1	10748.5	13014.5	14950.7	14917.1	14788.3	12539.3	10255.2	9397.6
27.5°	8313.2	9183.7	11614.5	13911.9	13888.9	13748.4	11201.0	8768.5	7952.4
30°	6958.5	7754.4	10208.7	12768.9	12621.3	12605.3	9821.4	7391.9	6604.7
32.5°	5797.9	6480.2	8883.4	11573.6	11312.4	11386.9	8446.4	6240.7	5460.5
35°	4786.1	5387.1	7508.0	10191.2	9897.5	9993.9	7184.7	5120.8	4473.7
37.5°	3884.4	4462.4	6342.3	8846.7	8397.5	8579.5	6074.7	4276.5	3757.9
40°	3251.8	3710.2	5236.8	7371.2	6888.2	7184.7	5015.7	3566.9	3151.5
42.5°	2801.9	3101.1	4322.2	5962.7	5592.2	5802.3	4134.0	2981.9	2671.1
45°	2391.9	2630.5	3576.3	4705.3	4490.9	4685.7	3421.2	2542.6	2309.1
47.5°	2089.2	2273.2	2944.1	3799.7	3666.5	3728.2	2857.3	2218.9	2029.1
50°	1828.0	1970.1	2475.1	3066.7	2994.0	3031.9	2393.5	1930.7	1800.3
52.5°	1624.9	1729.2	2075.9	2520.4	2484.4	2490.3	2039.7	1698.3	1603.8
55°	1447.6	1520.3	1772.2	2064.6	2056.1	2057.6	1742.5	1505.0	1428.1
57.5°	1292.6	1352.7	1523.0	1734.2	1721.8	1724.5	1508.9	1336.7	1287.1
60°	1161.4	1201.6	1316.0	1465.6	1457.4	1453.9	1307.8	1186.7	1169.6
62.5°	1045.0	1070.8	1150.1	1256.3	1240.7	1244.1	1149.6	1072.0	1046.6
65°	943.1	952.1	1007.9	1073.5	1063.4	1072.0	1011.0	957.9	952.1
67.5°	843.5	852.5	885.3	929.4	917.7	924.7	886.0	854.8	849.8
70°	752.9	752.6	770.9	794.7	794.7	795.8	775.1	756.4	760.3
72.5°	659.2	656.8	662.3	678.3	674.1	688.9	667.0	661.1	661.9
75°	563.9	557.2	560.3	568.6	563.9	571.7	561.9	569.3	569.3
77.5°	474.1	461.6	457.7	458.9	450.3	462.0	464.3	469.4	481.1
80°	380.4	362.8	353.0	352.7	345.2	352.7	358.5	369.1	380.4
82.5°	282.3	267.1	250.7	247.6	242.9	247.2	255.0	267.5	285.9
85°	172.3	156.2	146.0	140.6	144.5	144.5	148.4	166.0	177.3
87.5°	62.1	54.2	44.5	44.9	46.1	47.7	49.6	62.5	68.4
90°	13.2	20.1	34.6	22.1	12.5	21.1	36.4	19.2	12.8
92.5°	18.6	30.7	55.6	28.8	16.3	28.8	51.8	25.9	17.6
95°	21.8	35.5	77.7	38.4	24.0	35.5	66.2	28.8	21.5
97.5°	27.6	39.3	89.3	47.0	37.5	44.1	74.8	30.7	26.3
100°	36.3	46.1	139.2	57.6	49.9	49.9	137.3	35.5	30.5
102.5°	61.3	97.9	295.7	108.5	75.9	97.9	318.8	72.0	37.2
105°	105.4	206.5	527.1	227.5	138.3	224.6	561.7	188.2	68.9
107.5°	182.2	369.6	695.0	403.3	262.1	419.6	723.9	372.5	162.1
110°	339.7	490.6	728.7	554.0	419.6	586.6	790.1	510.8	329.1



TEST NUMBER: P1432325
 CATALOG NUMBER: EHBR1-24-UNV-A1-L830-UPL18

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
112.5°	458.7	527.1	697.9	611.6	546.3	653.8	771.8	566.4	455.8
115°	482.7	506.9	623.1	597.2	593.3	644.2	689.3	564.6	505.7
117.5°	466.9	462.7	529.0	536.6	573.2	589.5	595.3	530.0	508.6
120°	431.8	411.9	441.7	468.5	517.4	510.8	501.1	479.4	479.8
122.5°	389.1	365.2	378.2	398.4	447.4	432.9	423.4	427.6	440.9
125°	348.7	324.9	333.1	338.0	379.2	364.8	369.1	383.4	396.8
127.5°	313.2	297.0	301.4	295.7	321.6	314.9	329.6	346.4	357.4
130°	289.3	275.3	281.7	267.9	280.7	282.6	302.2	315.7	322.8
132.5°	269.5	260.4	268.1	251.3	255.2	263.3	281.6	293.5	297.3
135°	255.4	247.4	256.0	240.3	239.7	251.2	267.5	275.2	276.5
137.5°	243.0	236.2	244.9	233.3	230.4	242.0	254.5	260.2	258.7
140°	232.2	226.0	235.7	227.0	225.1	236.6	242.3	249.4	247.6
142.5°	220.0	216.2	227.3	221.6	219.7	230.6	233.5	238.3	236.9
145°	211.9	209.0	221.1	218.2	217.2	225.4	223.4	230.5	227.6
147.5°	205.3	203.1	213.9	212.8	212.8	218.6	216.1	222.3	219.8
150°	199.0	196.7	207.5	206.5	207.5	211.3	207.9	215.3	214.7
152.5°	192.7	190.3	200.2	198.9	199.8	203.6	200.5	208.6	208.5
155°	188.3	185.9	193.8	193.1	193.1	195.4	194.2	202.7	203.1
157.5°	185.6	183.9	189.8	189.0	189.0	190.3	190.2	197.7	198.1
160°	183.5	181.7	186.8	185.9	185.0	187.3	187.2	193.6	194.0
162.5°	181.4	179.7	185.2	183.9	183.5	183.9	183.7	190.6	191.0
165°	179.8	179.1	183.1	182.4	181.3	182.4	181.5	186.2	187.5
167.5°	180.2	178.9	182.5	181.7	180.8	179.8	181.1	184.7	186.0
170°	179.7	179.3	182.0	180.2	178.9	179.3	179.5	183.1	184.4
172.5°	180.5	180.0	182.8	181.1	179.7	180.1	179.3	182.0	184.3
175°	180.7	179.9	182.0	180.9	180.5	179.8	180.0	181.8	184.5
177.5°	182.0	181.3	182.5	181.3	179.8	180.2	181.4	183.2	186.8
180°	181.4	181.4	181.4	181.4	181.4	181.4	181.4	181.4	181.4



TEST NUMBER: P1432325
 CATALOG NUMBER: EHBR1-24-UNV-A1-L830-UPL18

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.90	18.05	17.38	18.51	19.00	17.88	19.03	18.36	19.49	19.98
	3H	18.37	19.40	18.87	19.87	20.41	19.14	20.16	19.64	20.64	21.17
	4H	18.97	19.93	19.50	20.42	20.97	19.64	20.59	20.16	21.08	21.64
	6H	19.44	20.32	19.97	20.82	21.39	19.99	20.87	20.53	21.38	21.94
	8H	19.59	20.42	20.14	20.94	21.52	20.09	20.92	20.64	21.45	22.02
	12H	19.66	20.46	20.21	20.97	21.57	20.13	20.92	20.68	21.44	22.04
4H	2H	17.41	18.37	17.94	18.86	19.41	18.19	19.15	18.72	19.64	20.19
	3H	19.10	19.88	19.63	20.42	20.99	19.68	20.47	20.22	21.01	21.58
	4H	19.81	20.52	20.37	21.07	21.67	20.30	21.01	20.86	21.56	22.17
	6H	20.39	21.00	20.97	21.57	22.20	20.78	21.39	21.36	21.96	22.59
	8H	20.58	21.15	21.16	21.72	22.35	20.91	21.48	21.50	22.06	22.69
	12H	20.68	21.19	21.29	21.79	22.43	20.98	21.49	21.58	22.09	22.72
8H	4H	20.04	20.61	20.62	21.18	21.81	20.48	21.05	21.07	21.62	22.25
	6H	20.73	21.19	21.34	21.81	22.45	21.06	21.53	21.68	22.15	22.79
	8H	20.98	21.39	21.61	22.02	22.67	21.26	21.67	21.89	22.30	22.96
	12H	21.14	21.51	21.77	22.12	22.84	21.38	21.74	22.01	22.36	23.08
12H	4H	20.04	20.54	20.64	21.14	21.78	20.48	20.98	21.08	21.59	22.22
	6H	20.75	21.17	21.38	21.80	22.45	21.09	21.50	21.72	22.13	22.78
	8H	21.04	21.41	21.67	22.02	22.74	21.32	21.69	21.95	22.30	23.02

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-2

Test Date: 07/31/2025

Luminaire Tested: EHBR-60-L830-N

Data in this report applies to families of products including EHBR-60-L830-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-2
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L830-N**
 Description: Elevate Round Highbay at, 60000 lumens, 3000K 80CRI LEDs with N lens

Spectral Parameters

CCT (K): 2983
 CIE u': 0.2516
 CIE v': 0.5201
 Duv: -0.0012
 CIE x: 0.4364
 CIE y: 0.4010
 CIE z: 0.1626
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 583
 Purity: 51.34918
 Rf: 81.2
 Rg: 101.5

CRI (Ra):	83.4		
R1:	84.0	R9:	29.4
R2:	87.5	R10:	68.6
R3:	88.9	R11:	82.2
R4:	83.8	R12:	61.6
R5:	81.9	R13:	83.9
R6:	83.1	R14:	92.5
R7:	87.1	R15:	79.8
R8:	70.9		



Test Conditions

Stabilization Time: 38M
 Operation Time: 1H 38M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-2

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-2

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



CCT = 2983K
 CIE x = 0.4364
 CIE y = 0.4010
 Duv = -0.0012

Point lies inside the ANSI 3000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-2

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-2

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.27

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-2

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.34

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

Summary

$R_f = 81.2$
 $R_g = 101.5$
 $CIE R_a = 83.4$
 $R_9 = 29.4$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 71	CES51 = 89	CES76 = 65
CES02 = 63	CES27 = 89	CES52 = 89	CES77 = 82
CES03 = 31	CES28 = 86	CES53 = 80	CES78 = 67
CES04 = 70	CES29 = 68	CES54 = 92	CES79 = 89
CES05 = 50	CES30 = 77	CES55 = 90	CES80 = 85
CES06 = 51	CES31 = 70	CES56 = 81	CES81 = 75
CES07 = 43	CES32 = 64	CES57 = 79	CES82 = 93
CES08 = 41	CES33 = 74	CES58 = 81	CES83 = 89
CES09 = 29	CES34 = 76	CES59 = 92	CES84 = 91
CES10 = 76	CES35 = 87	CES60 = 96	CES85 = 81
CES11 = 59	CES36 = 99	CES61 = 91	CES86 = 74
CES12 = 65	CES37 = 81	CES62 = 93	CES87 = 83
CES13 = 44	CES38 = 83	CES63 = 79	CES88 = 86
CES14 = 74	CES39 = 94	CES64 = 81	CES89 = 74
CES15 = 72	CES40 = 89	CES65 = 78	CES90 = 85
CES16 = 48	CES41 = 88	CES66 = 76	CES91 = 87
CES17 = 50	CES42 = 80	CES67 = 74	CES92 = 73
CES18 = 57	CES43 = 75	CES68 = 79	CES93 = 84
CES19 = 72	CES44 = 99	CES69 = 83	CES94 = 64
CES20 = 67	CES45 = 83	CES70 = 72	CES95 = 80
CES21 = 87	CES46 = 82	CES71 = 70	CES96 = 86
CES22 = 79	CES47 = 79	CES72 = 90	CES97 = 85
CES23 = 92	CES48 = 78	CES73 = 65	CES98 = 83
CES24 = 91	CES49 = 79	CES74 = 94	CES99 = 82
CES25 = 72	CES50 = 88	CES75 = 70	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)