

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1432464

Luminaire Tested: EHBR1-48-UNV-TASM-L830-UPL36

Issue Date: 3/20/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1432464  
REPORT IS A COMBINATION OF REPORTS P1431841 AND P1431635  
Test Lab: INNOVATION CENTER  
Issue Date: 3/20/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: METALUX  
Catalog Number: EHBR1-48-UNV-TASM-L830-UPL36  
Description: Elevate Round Highbay at, 48000 lumens, 3000K 80CRI LEDs with TASM lens  
Light Source: -  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 47917.5 lumens  
Efficiency: N/A  
Efficacy: 167.0 lumens/watt  
Spacing Criteria (0/90/45): 0.99 / 0.84 / 0.9  
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')  
CIE Type: Direct

Input Watts (W): 287  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1432464  
CATALOG NUMBER: EHBR1-48-UNV-TASM-L830-UPL36

### Luminous Intensity Polar Plot

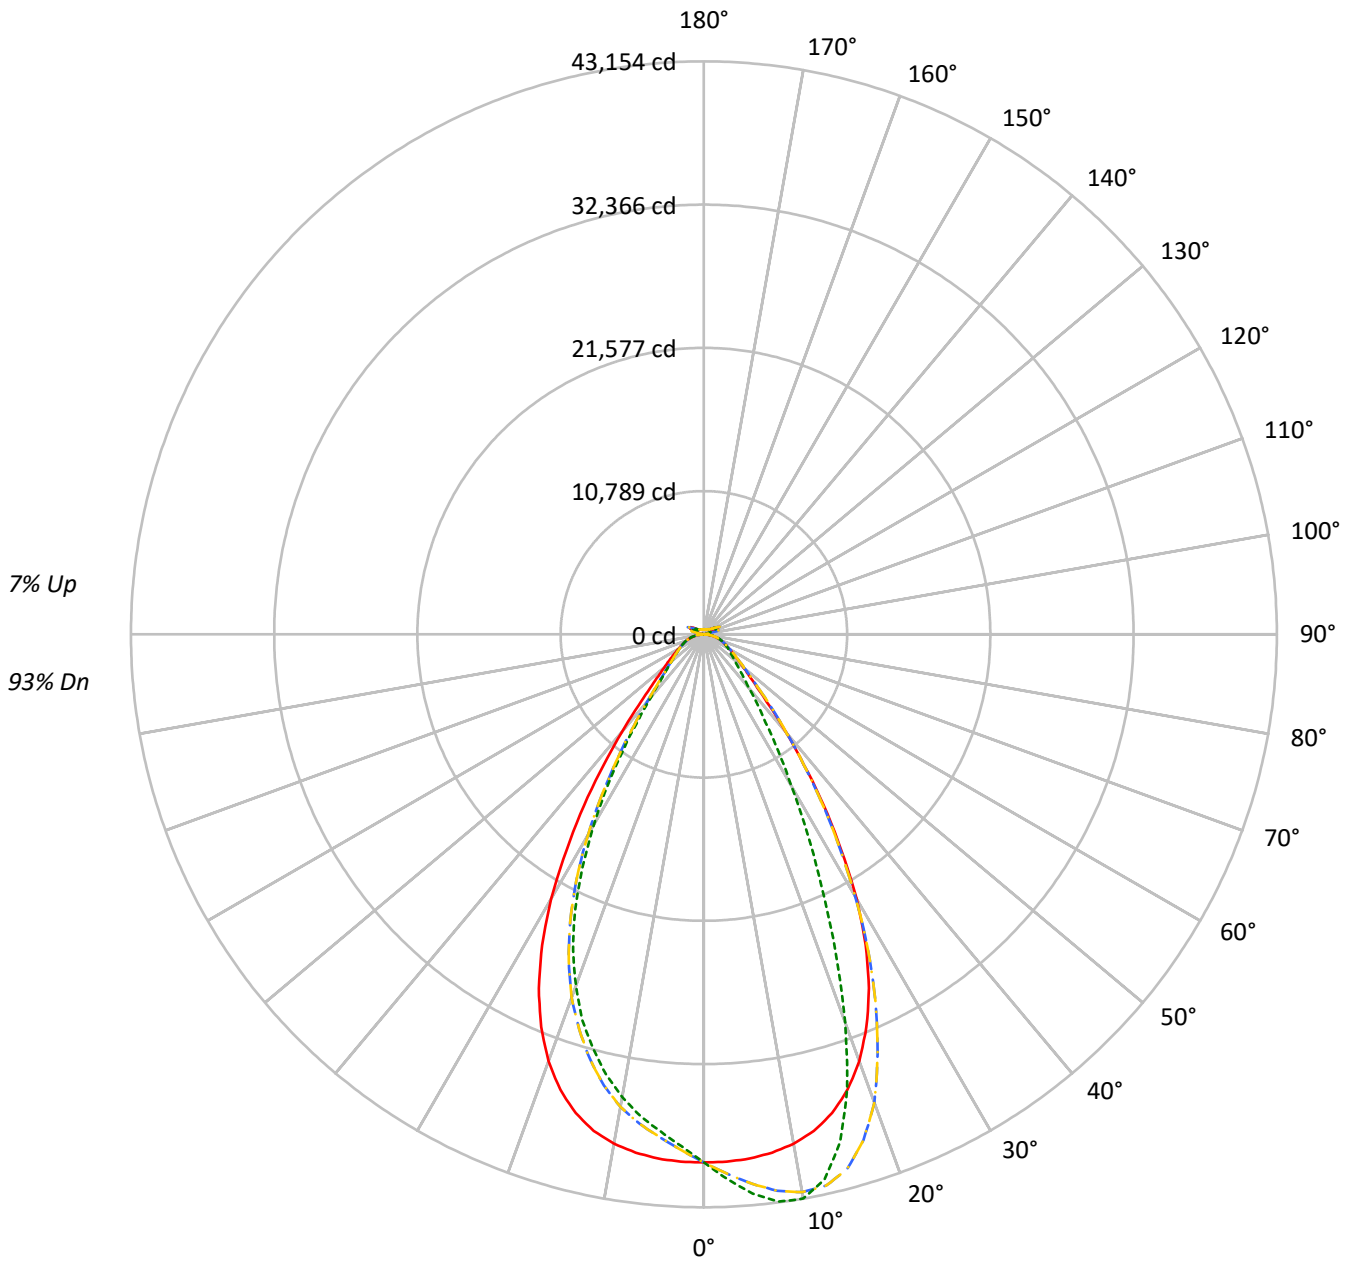

— 0°-180°    - - 45°-225°    - · - · 90°-270°    - · - · 135°-315°



TEST NUMBER: P1432464  
 CATALOG NUMBER: EHBR1-48-UNV-TASM-L830-UPL36

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	117	117	117	117	114	114	114	114	107	107	107	101	101	101	95	95	95	95	95	95	93
1	110	107	104	101	107	104	101	98	98	96	94	93	92	90	89	87	86	86	86	86	84
2	103	97	92	88	100	95	90	86	90	87	83	86	83	81	82	80	78	78	78	78	76
3	97	89	83	78	94	87	81	77	83	79	75	80	76	73	76	73	71	71	71	71	69
4	91	82	75	70	88	80	74	69	77	72	68	74	70	66	71	68	65	65	65	65	63
5	85	76	69	64	83	74	68	63	71	66	62	69	64	61	67	63	59	59	59	59	58
6	80	70	63	58	78	69	62	58	67	61	57	64	60	56	62	58	55	55	55	55	53
7	76	65	58	54	74	64	58	53	62	57	52	60	55	52	59	54	51	51	51	51	49
8	72	61	54	50	70	60	54	49	58	53	49	57	52	48	55	51	47	47	47	47	46
9	68	57	51	46	66	56	50	46	55	49	45	53	48	45	52	48	44	44	44	44	43
10	65	54	47	43	63	53	47	43	52	46	42	50	45	42	49	45	41	41	41	41	40

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°	270°
0°	186761	186761	186761	186761
5°	185625	198027	185625	175992
10°	183343	203111	183343	166562
15°	177930	188754	177930	153858
20°	166409	151354	166409	137044
25°	147285	104867	147285	114849
30°	119590	68223	119590	85930
35°	85773	44183	85773	57206
40°	55456	30454	55456	36077
45°	35186	23590	35186	25705
50°	26130	20045	26130	21411
55°	21333	18260	21333	18900
60°	18473	17394	18473	17500
65°	16840	16776	16840	16704
70°	15961	16437	15961	16224
75°	14927	15901	14927	15425
80°	13112	15011	13112	14034
85°	8484	10719	8484	10221

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 22.5°  
 Vertical Angle: 45°  
 Luminance: 49470 cd/sqm



TEST NUMBER: P1432464  
 CATALOG NUMBER: EHBR1-48-UNV-TASM-L830-UPL36

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	3781.5	7.9
10°-20°	10287.7	21.5
20°-30°	12065.4	25.2
30°-40°	8390.7	17.5
40°-50°	4169.8	8.7
50°-60°	2494.0	5.2
60°-70°	1755.4	3.7
70°-80°	1130.8	2.4
80°-90°	365.3	0.8
90°-100°	92.9	0.2
100°-110°	603.7	1.3
110°-120°	1114.8	2.3
120°-130°	663.0	1.4
130°-140°	401.5	0.8
140°-150°	278.3	0.6
150°-160°	182.3	0.4
160°-170°	105.3	0.2
170°-180°	35.1	0.1
0°-30°	26134.6	54.5
0°-40°	34525.4	72.1
0°-60°	41189.1	86.0
0°-90°	44440.5	92.7
90°-120°	1811.4	3.8
90°-150°	3154.3	6.6
90°-180°	3477.0	7.3
0°-180°	47917.5	100.0

**CANDELA DISTRIBUTION:**

	0°	90°	180°	270°	360°	Flux
0°	39770	39770	39770	39770	39770	
5°	39634	42282	39634	37577	39634	3761
15°	37329	39600	37329	32279	37329	10432
25°	29413	20942	29413	22935	29413	13316
35°	15742	8109	15742	10499	15742	9828
45°	5693	3817	5693	4159	5693	4659
55°	2883	2468	2883	2554	2883	2636
65°	1758	1751	1758	1744	1758	1765
75°	1052	1120	1052	1087	1052	1104
85°	292	368	292	351	292	324
90°	26	31	26	26	26	26
95°	49	48	49	43	49	52
105°	277	143	277	210	277	374
115°	1186	1014	1186	963	1186	1081
125°	760	797	760	696	760	700
135°	481	556	481	509	481	382
145°	436	456	436	424	436	273
155°	389	406	389	378	389	182
165°	369	381	369	362	369	105
175°	369	377	369	363	369	35
180°	369	369	369	369	369	



TEST NUMBER: P1432464  
 CATALOG NUMBER: EHBR1-48-UNV-TASM-L830-UPL36

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°	202.5°	225°
0°	39769.5	39769.5	39769.5	39769.5	39769.5	39769.5	39769.5	39769.5	39769.5	39769.5	39769.5
2.5°	39746.4	40260.2	40676.3	40950.8	41086.5	40950.8	40676.3	40260.2	39746.4	39235.6	38884.3
5°	39633.8	40662.9	41534.7	42105.2	42281.9	42105.2	41534.7	40662.9	39633.8	38661.4	38016.3
7.5°	39364.5	40967.9	42263.3	42929.2	43091.8	42929.2	42263.3	40967.9	39364.5	37988.0	37172.8
10°	38953.7	41160.3	42657.0	43134.3	43153.7	43134.3	42657.0	41160.3	38953.7	37099.0	36137.8
12.5°	38298.2	41091.7	42525.0	42368.4	42012.7	42368.4	42525.0	41091.7	38298.2	36013.3	34800.7
15°	37328.7	40685.3	41689.1	40414.6	39599.5	40414.6	41689.1	40685.3	37328.7	34547.1	33140.7
17.5°	35962.5	39924.6	39944.0	37422.6	35884.9	37422.6	39944.0	39924.6	35962.5	32754.4	31205.4
20°	34201.9	38704.6	37541.2	32929.6	31107.7	32929.6	37541.2	38704.6	34201.9	30635.0	29115.2
22.5°	31994.4	37059.5	34195.1	28409.6	25924.2	28409.6	34195.1	37059.5	31994.4	28170.3	26588.6
25°	29412.7	35043.8	30595.4	23484.8	20941.8	23484.8	30595.4	35043.8	29412.7	25233.5	23803.3
27.5°	26376.0	32488.9	26762.3	19190.8	16844.7	19190.8	26762.3	32488.9	26376.0	22201.4	20740.5
30°	23003.0	29213.6	22773.4	15283.2	13122.7	15283.2	22773.4	29213.6	23003.0	18794.9	17486.9
32.5°	19226.6	26003.1	18942.5	12245.8	10415.7	12245.8	18942.5	26003.1	19226.6	15544.2	14177.3
35°	15742.5	21986.6	15488.3	9622.2	8109.2	9622.2	15488.3	21986.6	15742.5	12475.5	11133.2
37.5°	12354.6	18191.5	12346.5	7748.3	6577.4	7748.3	12346.5	18191.5	12354.6	9699.1	8609.6
40°	9611.9	14224.2	9673.8	6185.2	5278.4	6185.2	9673.8	14224.2	9611.9	7379.9	6682.6
42.5°	7282.9	10876.6	7603.5	5076.2	4483.4	5076.2	7603.5	10876.6	7282.9	5814.5	5292.5
45°	5692.9	8004.0	5937.6	4282.8	3816.7	4282.8	5937.6	8004.0	5692.9	4682.5	4332.0
47.5°	4636.2	6185.9	4812.2	3673.5	3346.9	3673.5	4812.2	6185.9	4636.2	3960.6	3698.1
50°	3894.3	4746.6	3995.6	3206.6	2987.4	3206.6	3995.6	4746.6	3894.3	3391.6	3216.4
52.5°	3345.4	3871.1	3402.8	2857.7	2710.0	2857.7	3402.8	3871.1	3345.4	2967.3	2858.5
55°	2883.0	3254.4	2959.1	2569.9	2467.7	2569.9	2959.1	3254.4	2883.0	2640.7	2560.1
57.5°	2531.8	2760.8	2569.9	2324.4	2256.6	2324.4	2569.9	2760.8	2531.8	2349.8	2306.6
60°	2220.8	2390.9	2267.8	2110.4	2091.0	2110.4	2267.8	2390.9	2220.8	2114.2	2085.9
62.5°	1981.4	2088.9	2005.3	1918.0	1900.9	1918.0	2005.3	2088.9	1981.4	1899.4	1904.6
65°	1757.7	1857.7	1792.0	1745.0	1751.0	1745.0	1792.0	1857.7	1757.7	1719.7	1727.9
67.5°	1584.7	1636.9	1608.5	1581.7	1588.5	1581.7	1608.5	1636.9	1584.7	1547.4	1560.1
70°	1400.5	1456.4	1427.4	1431.1	1442.3	1431.1	1427.4	1456.4	1400.5	1389.3	1399.0
72.5°	1224.5	1267.7	1258.1	1267.0	1279.0	1267.0	1258.1	1267.7	1224.5	1223.0	1223.7
75°	1051.5	1084.3	1088.7	1101.5	1120.1	1101.5	1088.7	1084.3	1051.5	1040.3	1053.7
77.5°	862.8	900.1	914.3	931.5	959.0	931.5	914.3	900.1	862.8	870.3	876.9
80°	689.8	706.9	738.3	751.0	789.7	751.0	738.3	706.9	689.8	677.1	686.8
82.5°	504.9	520.5	547.4	571.2	593.6	571.2	547.4	520.5	504.9	498.9	499.6
85°	291.6	315.5	333.4	361.7	368.4	361.7	333.4	315.5	291.6	298.3	291.6
87.5°	102.2	109.6	125.2	136.5	137.2	136.5	125.2	109.6	102.2	104.4	94.7
90°	25.7	43.7	75.0	42.8	30.9	42.8	75.0	43.7	25.7	44.8	69.7
92.5°	33.3	59.0	105.8	56.2	40.5	56.2	105.8	59.0	33.3	58.3	111.8
95°	49.4	72.4	134.4	62.0	48.1	62.0	134.4	72.4	49.4	77.4	156.0
97.5°	76.2	89.6	151.7	65.9	57.7	65.9	151.7	89.6	76.2	94.6	178.9
100°	101.2	101.2	276.2	75.4	65.4	75.4	276.2	101.2	101.2	116.4	278.6
102.5°	152.9	197.6	639.1	148.9	78.8	148.9	639.1	197.6	152.9	218.0	590.9
105°	277.4	450.6	1123.9	380.8	142.8	380.8	1123.9	450.6	277.4	455.6	1052.6
107.5°	524.6	839.5	1447.6	748.6	328.6	748.6	1447.6	839.5	524.6	806.2	1388.7
110°	838.7	1172.9	1579.9	1024.6	662.0	1024.6	1579.9	1172.9	838.7	1107.0	1455.7



TEST NUMBER: P1432464

CATALOG NUMBER: EHBR1-48-UNV-TASM-L830-UPL36

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°	202.5°	225°
112.5°	1091.6	1307.0	1543.4	1135.7	914.9	1135.7	1543.4	1307.0	1091.6	1221.9	1394.4
115°	1186.3	1287.9	1378.6	1131.8	1014.5	1131.8	1378.6	1287.9	1186.3	1193.2	1245.0
117.5°	1146.1	1178.7	1190.8	1062.9	1020.3	1062.9	1190.8	1178.7	1146.1	1073.3	1057.2
120°	1035.0	1021.6	1003.9	961.3	962.8	961.3	1003.9	1021.6	1035.0	937.3	882.8
122.5°	895.9	867.1	848.7	858.6	884.3	858.6	848.7	867.1	895.9	798.1	757.1
125°	759.8	731.1	740.2	770.4	796.9	770.4	740.2	731.1	759.8	678.2	667.9
127.5°	645.6	632.2	661.7	695.7	718.3	695.7	661.7	632.2	645.6	593.9	604.6
130°	564.0	567.0	606.1	635.2	649.3	635.2	606.1	567.0	564.0	539.1	565.1
132.5°	512.9	527.6	564.7	589.9	598.4	589.9	564.7	527.6	512.9	506.0	537.9
135°	481.2	502.6	536.7	552.8	556.2	552.8	536.7	502.6	481.2	483.8	512.9
137.5°	462.7	484.2	509.9	522.9	519.8	522.9	509.9	484.2	462.7	469.2	491.5
140°	452.0	473.5	484.9	499.9	497.6	499.9	484.9	473.5	452.0	455.8	473.0
142.5°	441.3	460.9	466.6	477.6	474.5	477.6	466.6	460.9	441.3	445.1	456.6
145°	436.2	450.8	446.2	460.4	456.1	460.4	446.2	450.8	436.2	437.4	443.9
147.5°	426.7	437.4	431.6	443.9	439.6	443.9	431.6	437.4	426.7	426.7	429.2
150°	415.8	423.5	415.1	429.2	428.8	429.2	415.1	423.5	415.8	413.9	416.6
152.5°	401.3	408.9	401.3	417.3	416.2	417.3	401.3	408.9	401.3	399.3	402.0
155°	389.3	393.1	389.3	405.4	406.2	405.4	389.3	393.1	389.3	388.5	390.0
157.5°	381.2	384.0	382.0	396.1	396.9	396.1	382.0	384.0	381.2	381.2	382.0
160°	374.7	378.5	377.3	389.6	390.3	389.6	377.3	378.5	374.7	375.8	376.6
162.5°	372.3	372.3	372.0	384.1	385.6	384.1	372.0	372.3	372.3	372.3	374.2
165°	368.9	370.7	368.4	377.6	381.0	377.6	368.4	370.7	368.9	370.0	370.0
167.5°	368.4	366.5	368.0	376.0	379.5	376.0	368.0	366.5	368.4	369.6	369.6
170°	365.3	366.1	365.7	373.7	377.1	373.7	365.7	366.1	365.3	367.3	368.4
172.5°	367.6	367.6	366.0	372.0	377.3	372.0	366.0	367.6	367.6	368.8	370.7
175°	369.1	367.9	367.5	371.6	376.9	371.6	367.5	367.9	369.1	368.3	368.3
177.5°	367.2	368.7	370.1	374.2	381.5	374.2	370.1	368.7	367.2	368.3	368.3
180°	368.7	368.7	368.7	368.7	368.7	368.7	368.7	368.7	368.7	368.7	368.7



TEST NUMBER: P1432464

CATALOG NUMBER: EHBR1-48-UNV-TASM-L830-UPL36

**CANDELA DISTRIBUTION (continued):**

	247.5°	270°	292.5°	315°	337.5°	360°
0°	39769.5	39769.5	39769.5	39769.5	39769.5	39769.5
2.5°	38614.3	38589.0	38614.3	38884.3	39235.6	39746.4
5°	37717.2	37577.0	37717.2	38016.3	38661.4	39633.8
7.5°	36672.4	36591.2	36672.4	37172.8	37988.0	39364.5
10°	35572.5	35388.3	35572.5	36137.8	37099.0	38953.7
12.5°	34216.8	33972.9	34216.8	34800.7	36013.3	38298.2
15°	32492.6	32278.6	32492.6	33140.7	34547.1	37328.7
17.5°	30642.5	30448.6	30642.5	31205.4	32754.4	35962.5
20°	28318.7	28166.6	28318.7	29115.2	30635.0	34201.9
22.5°	25880.9	25738.4	25880.9	26588.6	28170.3	31994.4
25°	23012.8	22935.2	23012.8	23803.3	25233.5	29412.7
27.5°	19913.5	19781.5	19913.5	20740.5	22201.4	26376.0
30°	16747.0	16528.6	16747.0	17486.9	18794.9	23003.0
32.5°	13650.0	13492.6	13650.0	14177.3	15544.2	19226.6
35°	10656.7	10499.3	10656.7	11133.2	12475.5	15742.5
37.5°	8303.8	8025.6	8303.8	8609.6	9699.1	12354.6
40°	6297.8	6253.0	6297.8	6682.6	7379.9	9611.9
42.5°	5127.0	5005.4	5127.0	5292.5	5814.5	7282.9
45°	4206.8	4159.0	4206.8	4332.0	4682.5	5692.9
47.5°	3617.6	3638.5	3617.6	3698.1	3960.6	4636.2
50°	3178.3	3191.0	3178.3	3216.4	3391.6	3894.3
52.5°	2854.7	2843.5	2854.7	2858.5	2967.3	3345.4
55°	2568.4	2554.1	2568.4	2560.1	2640.7	2883.0
57.5°	2317.8	2328.2	2317.8	2306.6	2349.8	2531.8
60°	2094.0	2103.8	2094.0	2085.9	2114.2	2220.8
62.5°	1905.4	1911.4	1905.4	1904.6	1899.4	1981.4
65°	1736.8	1743.5	1736.8	1727.9	1719.7	1757.7
67.5°	1575.7	1575.7	1575.7	1560.1	1547.4	1584.7
70°	1424.4	1423.6	1424.4	1399.0	1389.3	1400.5
72.5°	1242.4	1260.3	1242.4	1223.7	1223.0	1224.5
75°	1065.7	1086.6	1065.7	1053.7	1040.3	1051.5
77.5°	886.7	918.7	886.7	876.9	870.3	862.8
80°	703.2	738.3	703.2	686.8	677.1	689.8
82.5°	519.8	545.9	519.8	499.6	498.9	504.9
85°	309.5	351.3	309.5	291.6	298.3	291.6
87.5°	99.2	126.7	99.2	94.7	104.4	102.2
90°	41.0	25.7	41.0	69.7	44.8	25.7
92.5°	62.1	37.2	62.1	111.8	58.3	33.3
95°	71.7	42.9	71.7	156.0	77.4	49.4
97.5°	79.3	55.2	79.3	178.9	94.6	76.2
100°	92.7	72.4	92.7	278.6	116.4	101.2
102.5°	196.1	122.2	196.1	590.9	218.0	152.9
105°	412.7	210.3	412.7	1052.6	455.6	277.4
107.5°	738.4	363.6	738.4	1388.7	806.2	524.6
110°	979.8	677.8	979.8	1455.7	1107.0	838.7



TEST NUMBER: P1432464  
 CATALOG NUMBER: EHBR1-48-UNV-TASM-L830-UPL36

**CANDELA DISTRIBUTION (continued):**

	247.5°	270°	292.5°	315°	337.5°	360°
112.5°	1052.6	915.4	1052.6	1394.4	1221.9	1091.6
115°	1012.4	963.3	1012.4	1245.0	1193.2	1186.3
117.5°	924.3	930.7	924.3	1057.2	1073.3	1146.1
120°	822.7	861.8	822.7	882.8	937.3	1035.0
122.5°	729.6	775.5	729.6	757.1	798.1	895.9
125°	649.0	695.8	649.0	667.9	678.2	759.8
127.5°	593.5	625.0	593.5	604.6	593.9	645.6
130°	550.2	577.0	550.2	565.1	539.1	564.0
132.5°	520.3	537.6	520.3	537.9	506.0	512.9
135°	494.2	508.8	494.2	512.9	483.8	481.2
137.5°	472.0	484.7	472.0	491.5	469.2	462.7
140°	452.4	463.2	452.4	473.0	455.8	452.0
142.5°	432.1	439.8	432.1	456.6	445.1	441.3
145°	418.2	424.0	418.2	443.9	437.4	436.2
147.5°	406.3	410.1	406.3	429.2	426.7	426.7
150°	394.4	398.2	394.4	416.6	413.9	415.8
152.5°	381.7	386.3	381.7	402.0	399.3	401.3
155°	373.6	378.1	373.6	390.0	388.5	389.3
157.5°	369.3	372.7	369.3	382.0	381.2	381.2
160°	365.9	368.5	365.9	376.6	375.8	374.7
162.5°	361.6	364.3	361.6	374.2	372.3	372.3
165°	361.2	361.9	361.2	370.0	370.0	368.9
167.5°	360.0	361.9	360.0	369.6	369.6	368.4
170°	360.7	361.5	360.7	368.4	367.3	365.3
172.5°	362.2	363.0	362.2	370.7	368.8	367.6
175°	361.9	362.6	361.9	368.3	368.3	369.1
177.5°	364.5	365.2	364.5	368.3	368.3	367.2
180°	368.7	368.7	368.7	368.7	368.7	368.7



TEST NUMBER: P1432464  
 CATALOG NUMBER: EHBR1-48-UNV-TASM-L830-UPL36

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	18.76	19.86	19.26	20.32	20.82	18.08	19.18	18.57	19.64	20.14
	3H	20.31	21.29	20.82	21.77	22.31	19.93	20.90	20.44	21.38	21.93
	4H	20.95	21.86	21.48	22.35	22.91	20.71	21.62	21.24	22.12	22.68
	6H	21.43	22.26	21.97	22.78	23.35	21.35	22.19	21.89	22.70	23.27
	8H	21.58	22.37	22.13	22.90	23.48	21.57	22.37	22.13	22.90	23.48
	12H	21.65	22.41	22.21	22.93	23.53	21.70	22.46	22.26	22.98	23.58
4H	2H	19.18	20.09	19.71	20.58	21.15	18.66	19.57	19.19	20.06	20.62
	3H	20.97	21.73	21.51	22.27	22.85	20.71	21.47	21.25	22.01	22.59
	4H	21.75	22.43	22.31	22.98	23.59	21.62	22.30	22.18	22.85	23.46
	6H	22.36	22.95	22.95	23.52	24.16	22.39	22.97	22.98	23.55	24.19
	8H	22.56	23.10	23.15	23.68	24.32	22.66	23.21	23.25	23.78	24.42
	12H	22.66	23.14	23.27	23.75	24.39	22.83	23.31	23.44	23.92	24.56
8H	4H	22.00	22.54	22.59	23.12	23.76	21.90	22.44	22.49	23.02	23.66
	6H	22.74	23.18	23.36	23.81	24.45	22.80	23.25	23.42	23.87	24.51
	8H	23.01	23.40	23.65	24.04	24.70	23.16	23.55	23.80	24.19	24.84
	12H	23.18	23.53	23.81	24.14	24.87	23.40	23.75	24.04	24.37	25.10
12H	4H	22.01	22.49	22.61	23.09	23.74	21.91	22.39	22.52	23.00	23.64
	6H	22.78	23.18	23.42	23.81	24.47	22.85	23.24	23.49	23.88	24.54
	8H	23.10	23.44	23.73	24.06	24.79	23.25	23.60	23.89	24.21	24.95

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-2

Test Date: 07/31/2025

Luminaire Tested: EHBR-60-L830-N

Data in this report applies to families of products including EHBR-60-L830-N

**Test Information**

Test Method: LM-79-2019  
 Report Number: SP1-2506-472-2  
 Test Lab: COOPER LIGHTING SOLUTIONS  
 Photometer: SP1 - 76IN SPHERE  
 Measurement Geometry: 4π  
 Issue Date: 08/05/2025  
 Manufacturer: COOPER LIGHTING SOLUTIONS  
 Product Line: Metalux  
 Catalog Number: **EHBR-60-L830-N**  
 Description: Elevate Round Highbay at, 60000 lumens, 3000K 80CRI LEDs with N lens

**Spectral Parameters**

CCT (K): 2983  
 CIE u': 0.2516  
 CIE v': 0.5201  
 Duv: -0.0012  
 CIE x: 0.4364  
 CIE y: 0.4010  
 CIE z: 0.1626  
 Peak Wavelength (nm): 630  
 Dominant Wavelength (nm): 583  
 Purity: 51.34918  
 Rf: 81.2  
 Rg: 101.5

CRI (Ra):	83.4		
R1:	84.0	R9:	29.4
R2:	87.5	R10:	68.6
R3:	88.9	R11:	82.2
R4:	83.8	R12:	61.6
R5:	81.9	R13:	83.9
R6:	83.1	R14:	92.5
R7:	87.1	R15:	79.8
R8:	70.9		



**Test Conditions**  
 Stabilization Time: 38M  
 Operation Time: 1H 38M  
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-2


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-2

CIE 1931 Chromaticity Diagram




CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

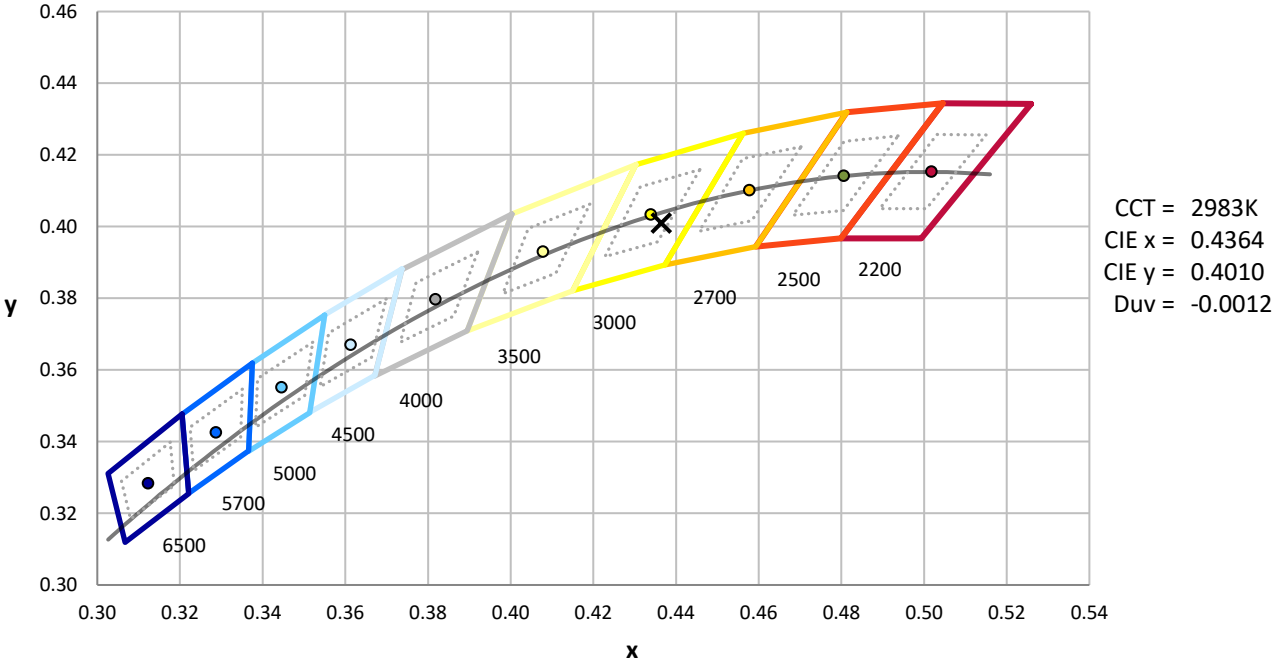

Point lies inside the ANSI 3000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-2

**Photopic Flux vs. Wavelength**

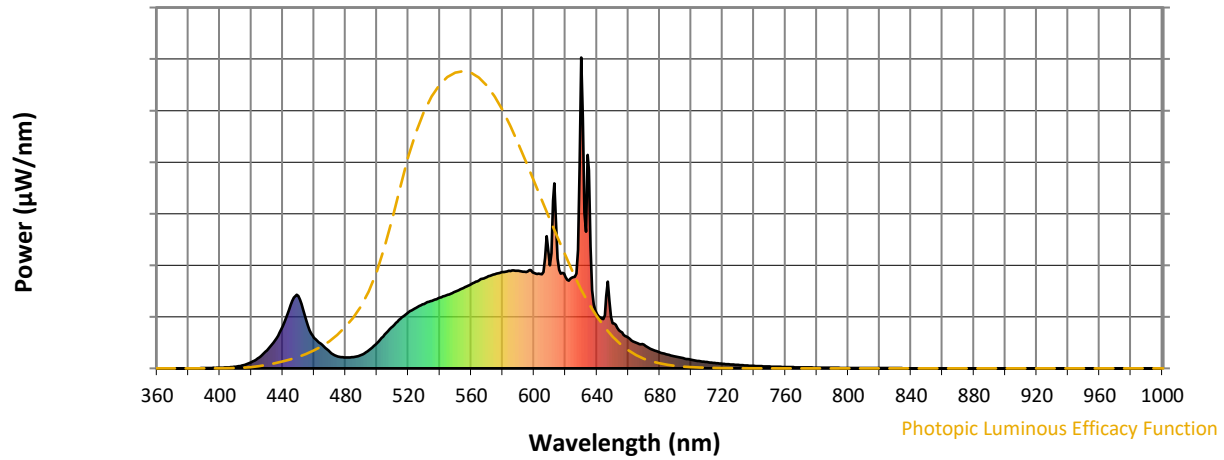

**Photopic Lumens: NR**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-2

**Scotopic Flux vs. Wavelength**



**Scotopic Lumens: NR**

**S/P: 1.27**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-2

**Melanopic Flux vs. Wavelength**



**Melanopic Lumens: NR**

**M/P: 2.34**


λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

**Summary**

$R_f = 81.2$   
 $R_g = 101.5$   
 CIE  $R_a = 83.4$   
 $R_9 = 29.4$



**Color Vector Graphics**



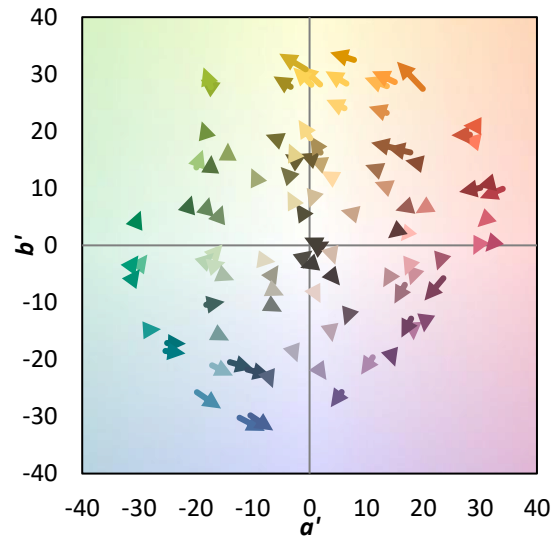


**Individual Sample Fidelity Index ( $R_{f,i}$ )**

CES01 = 86	CES26 = 71	CES51 = 89	CES76 = 65
CES02 = 63	CES27 = 89	CES52 = 89	CES77 = 82
CES03 = 31	CES28 = 86	CES53 = 80	CES78 = 67
CES04 = 70	CES29 = 68	CES54 = 92	CES79 = 89
CES05 = 50	CES30 = 77	CES55 = 90	CES80 = 85
CES06 = 51	CES31 = 70	CES56 = 81	CES81 = 75
CES07 = 43	CES32 = 64	CES57 = 79	CES82 = 93
CES08 = 41	CES33 = 74	CES58 = 81	CES83 = 89
CES09 = 29	CES34 = 76	CES59 = 92	CES84 = 91
CES10 = 76	CES35 = 87	CES60 = 96	CES85 = 81
CES11 = 59	CES36 = 99	CES61 = 91	CES86 = 74
CES12 = 65	CES37 = 81	CES62 = 93	CES87 = 83
CES13 = 44	CES38 = 83	CES63 = 79	CES88 = 86
CES14 = 74	CES39 = 94	CES64 = 81	CES89 = 74
CES15 = 72	CES40 = 89	CES65 = 78	CES90 = 85
CES16 = 48	CES41 = 88	CES66 = 76	CES91 = 87
CES17 = 50	CES42 = 80	CES67 = 74	CES92 = 73
CES18 = 57	CES43 = 75	CES68 = 79	CES93 = 84
CES19 = 72	CES44 = 99	CES69 = 83	CES94 = 64
CES20 = 67	CES45 = 83	CES70 = 72	CES95 = 80
CES21 = 87	CES46 = 82	CES71 = 70	CES96 = 86
CES22 = 79	CES47 = 79	CES72 = 90	CES97 = 85
CES23 = 92	CES48 = 78	CES73 = 65	CES98 = 83
CES24 = 91	CES49 = 79	CES74 = 94	CES99 = 82
CES25 = 72	CES50 = 88	CES75 = 70	



Color Rendition by Hue-Angle Bin

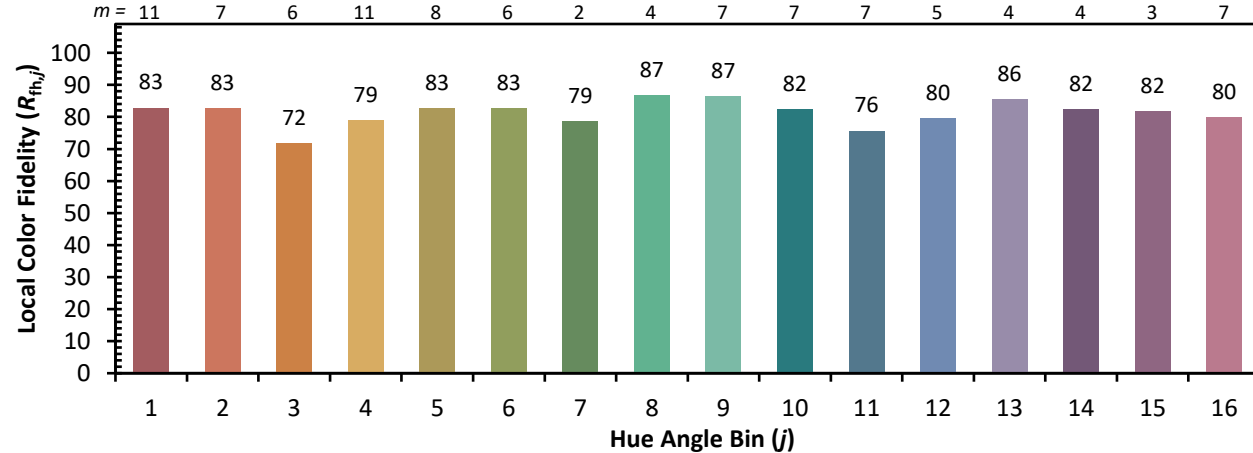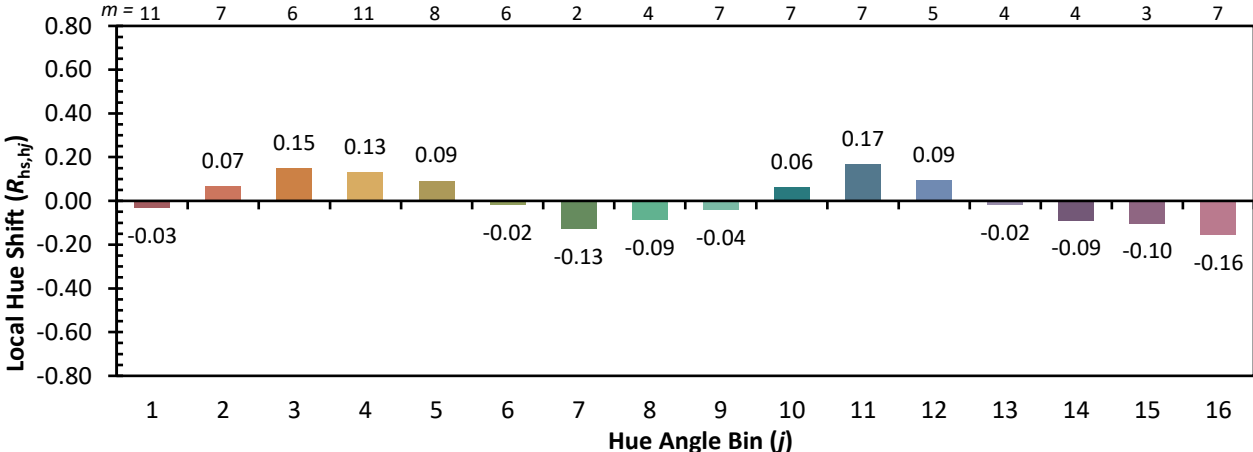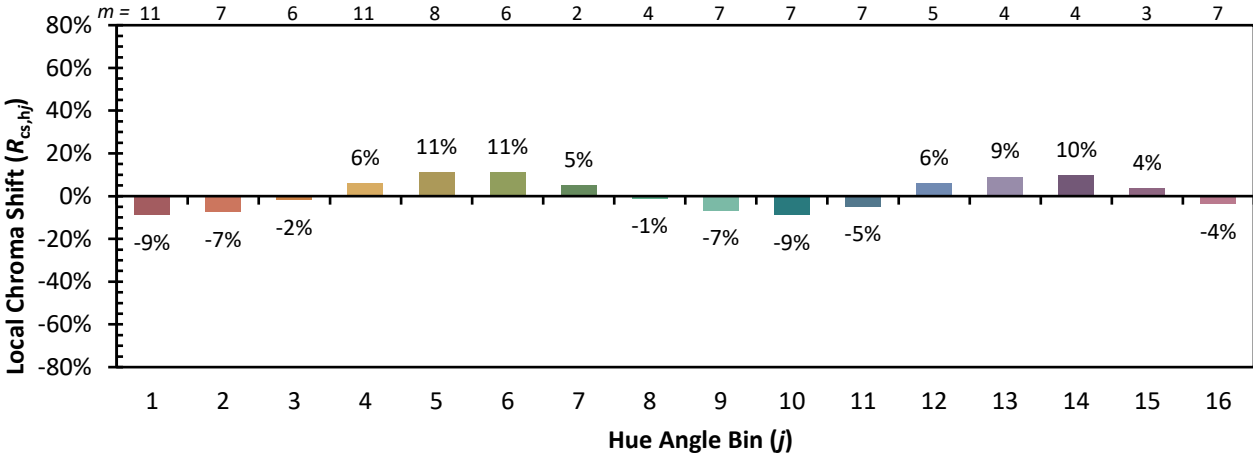

Measure Comparisons



(END OF REPORT)