

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1432504

Luminaire Tested: EHBR1-54-UNV-N-L830-UPL36

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number: P1432504
REPORT IS A COMBINATION OF REPORTS P1431881 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-54-UNV-N-L830-UPL36
Description: Elevate Round Highbay at, 53000 lumens, 3000K 80CRI LEDs with N lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 54372.1 lumens
Efficiency: N/A
Efficacy: 167.6 lumens/watt
Spacing Criteria (0/90/45): 0.82 / 0.82 / 0.8
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 324.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1432504
CATALOG NUMBER: EHBR1-54-UNV-N-L830-UPL36

Luminous Intensity Polar Plot

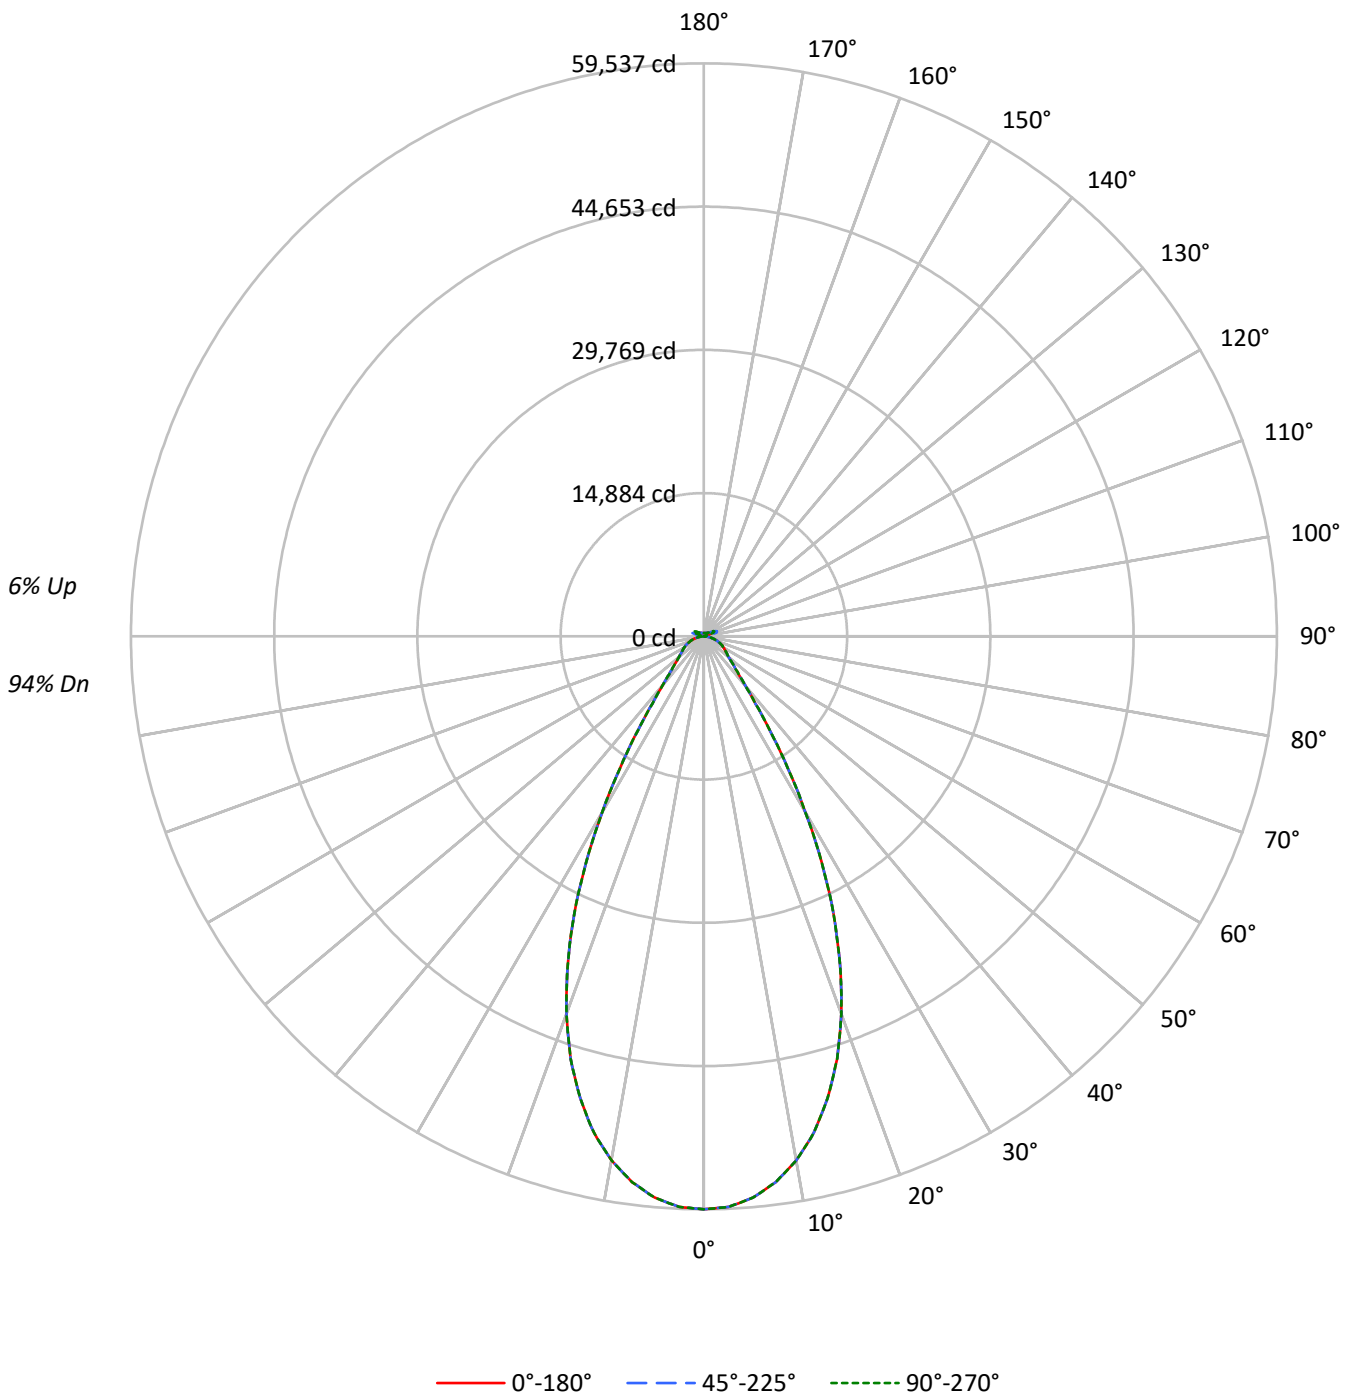



TEST NUMBER: P1432504

CATALOG NUMBER: EHBR1-54-UNV-N-L830-UPL36

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	118	118	118	118	114	114	114	114	108	108	108	102	102	102	96	96	96	96	96	96	94
1	111	107	104	102	108	105	102	100	99	97	95	95	93	91	90	89	88	88	88	88	85
2	104	98	94	90	101	96	92	88	92	88	85	88	85	83	84	82	80	80	80	80	78
3	98	91	85	80	95	89	84	79	85	81	77	82	78	75	79	76	73	73	73	73	71
4	92	84	78	73	90	82	77	72	79	74	71	77	72	69	74	71	68	68	68	68	66
5	87	78	72	67	85	77	71	66	74	69	65	72	67	64	70	66	63	63	63	63	61
6	83	73	66	62	81	72	66	61	70	64	60	68	63	59	66	62	58	58	58	58	57
7	78	68	62	57	77	67	61	57	65	60	56	64	59	55	62	58	55	55	55	55	53
8	74	64	58	53	73	63	57	53	62	56	53	60	55	52	59	55	51	51	51	51	50
9	71	61	54	50	69	60	54	50	58	53	49	57	52	49	56	51	48	48	48	48	47
10	68	57	51	47	66	57	51	47	55	50	46	54	49	46	53	49	46	46	46	46	44

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	279591	279591	279591
5°	274164	274164	274164
10°	260214	260214	260214
15°	236760	236760	236760
20°	203088	203088	203088
25°	159761	159761	159761
30°	109637	109637	109637
35°	65128	65128	65128
40°	38535	38535	38535
45°	27662	27662	27662
50°	22738	22738	22738
55°	20665	20665	20665
60°	19782	19782	19782
65°	18868	18868	18868
70°	17548	17548	17548
75°	15862	15862	15862
80°	13167	13167	13167
85°	8336	8336	8336

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 27662 cd/sqm



TEST NUMBER: P1432504
 CATALOG NUMBER: EHBR1-54-UNV-N-L830-UPL36

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	5484.3	10.1
10°-20°	13766.5	25.3
20°-30°	14394.3	26.5
30°-40°	7799.2	14.3
40°-50°	3588.0	6.6
50°-60°	2528.6	4.7
60°-70°	1946.0	3.6
70°-80°	1179.7	2.2
80°-90°	338.2	0.6
90°-100°	95.7	0.2
100°-110°	598.0	1.1
110°-120°	1069.4	2.0
120°-130°	627.5	1.2
130°-140°	384.9	0.7
140°-150°	267.0	0.5
150°-160°	173.5	0.3
160°-170°	98.8	0.2
170°-180°	32.7	0.1
0°-30°	33645.1	61.9
0°-40°	41444.4	76.2
0°-60°	47561.0	87.5
0°-90°	51024.9	93.8
90°-120°	1763.0	3.2
90°-150°	3042.3	5.6
90°-180°	3347.0	6.2
0°-180°	54372.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	59537	59537	59537	59537	59537	
5°	58538	58538	58538	58538	58538	5484
15°	49671	49671	49671	49671	49671	13767
25°	31904	31904	31904	31904	31904	14394
35°	11953	11953	11953	11953	11953	7799
45°	4476	4476	4476	4476	4476	3588
55°	2793	2793	2793	2793	2793	2529
65°	1969	1969	1969	1969	1969	1946
75°	1117	1117	1117	1117	1117	1180
85°	286	286	286	286	286	318
90°	27	42	71	46	27	26
95°	42	71	155	77	48	41
105°	209	412	1052	454	276	280
115°	962	1012	1244	1192	1184	886
125°	694	648	665	674	757	632
135°	506	490	508	477	475	396
145°	416	410	435	429	427	263
155°	364	360	377	377	377	170
165°	341	341	351	351	349	97
175°	337	337	343	343	343	32
180°	341	341	341	341	341	



TEST NUMBER: P1432504

CATALOG NUMBER: EHBR1-54-UNV-N-L830-UPL36

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	59537.0	59537.0	59537.0	59537.0	59537.0
2.5°	59326.0	59326.0	59326.0	59326.0	59326.0
5°	58538.3	58538.3	58538.3	58538.3	58538.3
7.5°	57193.7	57193.7	57193.7	57193.7	57193.7
10°	55286.1	55286.1	55286.1	55286.1	55286.1
12.5°	52820.6	52820.6	52820.6	52820.6	52820.6
15°	49671.1	49671.1	49671.1	49671.1	49671.1
17.5°	46017.0	46017.0	46017.0	46017.0	46017.0
20°	41740.5	41740.5	41740.5	41740.5	41740.5
22.5°	36979.2	36979.2	36979.2	36979.2	36979.2
25°	31904.2	31904.2	31904.2	31904.2	31904.2
27.5°	26523.9	26523.9	26523.9	26523.9	26523.9
30°	21088.6	21088.6	21088.6	21088.6	21088.6
32.5°	16184.8	16184.8	16184.8	16184.8	16184.8
35°	11953.3	11953.3	11953.3	11953.3	11953.3
37.5°	8776.6	8776.6	8776.6	8776.6	8776.6
40°	6679.1	6679.1	6679.1	6679.1	6679.1
42.5°	5355.6	5355.6	5355.6	5355.6	5355.6
45°	4475.6	4475.6	4475.6	4475.6	4475.6
47.5°	3841.4	3841.4	3841.4	3841.4	3841.4
50°	3388.7	3388.7	3388.7	3388.7	3388.7
52.5°	3058.1	3058.1	3058.1	3058.1	3058.1
55°	2792.7	2792.7	2792.7	2792.7	2792.7
57.5°	2577.4	2577.4	2577.4	2577.4	2577.4
60°	2378.1	2378.1	2378.1	2378.1	2378.1
62.5°	2178.9	2178.9	2178.9	2178.9	2178.9
65°	1969.4	1969.4	1969.4	1969.4	1969.4
67.5°	1755.9	1755.9	1755.9	1755.9	1755.9
70°	1539.7	1539.7	1539.7	1539.7	1539.7
72.5°	1329.4	1329.4	1329.4	1329.4	1329.4
75°	1117.4	1117.4	1117.4	1117.4	1117.4
77.5°	909.7	909.7	909.7	909.7	909.7
80°	692.7	692.7	692.7	692.7	692.7
82.5°	484.9	484.9	484.9	484.9	484.9
85°	286.5	286.5	286.5	286.5	286.5
87.5°	102.6	102.6	102.6	102.6	102.6
90°	26.6	42.0	70.6	45.7	26.6
92.5°	36.4	61.4	111.1	57.5	32.6
95°	42.2	70.9	155.2	76.6	47.9
97.5°	53.7	78.6	178.2	93.9	74.7
100°	70.9	92.0	277.8	114.9	99.7
102.5°	120.7	195.4	590.1	216.5	151.4
105°	208.8	412.0	1051.8	454.1	275.9
107.5°	362.1	737.7	1387.2	804.7	523.1
110°	676.3	979.0	1454.2	1105.5	837.2



TEST NUMBER: P1432504

CATALOG NUMBER: EHBR1-54-UNV-N-L830-UPL36

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	913.9	1051.8	1392.9	1220.4	1090.1
115°	961.8	1011.6	1243.5	1191.7	1184.1
117.5°	929.2	923.5	1055.7	1071.0	1143.8
120°	860.3	822.0	881.3	935.0	1032.7
122.5°	774.0	728.1	754.9	795.1	892.9
125°	693.5	647.5	664.9	674.4	756.8
127.5°	622.7	592.0	601.6	590.1	641.8
130°	574.8	548.0	561.4	534.6	559.5
132.5°	534.6	517.3	532.6	500.0	507.7
135°	505.8	490.5	507.7	477.1	475.2
137.5°	480.9	467.5	484.7	461.7	456.0
140°	458.0	446.4	465.5	448.3	444.5
142.5°	433.0	425.4	448.3	436.9	433.0
145°	415.8	410.0	434.9	429.2	427.2
147.5°	400.4	396.6	419.6	417.7	417.7
150°	387.0	383.2	406.2	404.3	406.2
152.5°	373.7	369.8	390.9	388.9	390.9
155°	364.0	360.2	377.4	377.4	377.4
157.5°	356.3	354.5	367.8	367.8	367.8
160°	350.6	348.7	360.2	360.2	358.3
162.5°	344.9	342.9	356.3	354.5	354.5
165°	341.1	341.1	350.6	350.6	348.7
167.5°	341.1	339.1	348.7	348.7	346.8
170°	339.1	339.1	346.8	344.9	342.9
172.5°	339.1	339.1	346.8	344.9	342.9
175°	337.2	337.2	342.9	342.9	342.9
177.5°	339.1	339.1	342.9	342.9	341.1
180°	341.1	341.1	341.1	341.1	341.1



TEST NUMBER: P1432504
 CATALOG NUMBER: EHBR1-54-UNV-N-L830-UPL36

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	18.50	19.57	18.98	20.02	20.49	18.50	19.57	18.98	20.02	20.49
	3H	20.28	21.23	20.77	21.69	22.21	20.28	21.23	20.77	21.69	22.21
	4H	20.94	21.83	21.45	22.30	22.84	20.94	21.83	21.45	22.30	22.84
	6H	21.40	22.21	21.92	22.71	23.25	21.40	22.21	21.92	22.71	23.25
	8H	21.52	22.29	22.06	22.80	23.36	21.52	22.29	22.06	22.80	23.36
	12H	21.57	22.31	22.11	22.81	23.39	21.57	22.31	22.11	22.81	23.39
4H	2H	19.04	19.93	19.56	20.41	20.94	19.04	19.93	19.56	20.41	20.94
	3H	21.01	21.75	21.54	22.27	22.82	21.01	21.75	21.54	22.27	22.82
	4H	21.78	22.44	22.33	22.98	23.57	21.78	22.44	22.33	22.98	23.57
	6H	22.36	22.92	22.93	23.48	24.10	22.36	22.92	22.93	23.48	24.10
	8H	22.51	23.04	23.09	23.60	24.22	22.51	23.04	23.09	23.60	24.22
	12H	22.59	23.06	23.19	23.65	24.27	22.59	23.06	23.19	23.65	24.27
8H	4H	22.01	22.54	22.59	23.10	23.72	22.01	22.54	22.59	23.10	23.72
	6H	22.70	23.12	23.30	23.73	24.35	22.70	23.12	23.30	23.73	24.35
	8H	22.92	23.30	23.54	23.92	24.55	22.92	23.30	23.54	23.92	24.55
	12H	23.06	23.39	23.68	23.99	24.70	23.06	23.39	23.68	23.99	24.70
12H	4H	22.01	22.48	22.60	23.07	23.69	22.01	22.48	22.60	23.07	23.69
	6H	22.72	23.10	23.35	23.72	24.36	22.72	23.10	23.35	23.72	24.36
	8H	22.98	23.32	23.60	23.92	24.63	22.98	23.32	23.60	23.92	24.63

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-2

Test Date: 07/31/2025

Luminaire Tested: EHBR-60-L830-N

Data in this report applies to families of products including EHBR-60-L830-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-2
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L830-N**
 Description: Elevate Round Highbay at, 60000 lumens, 3000K 80CRI LEDs with N lens

Spectral Parameters

CCT (K): 2983
 CIE u': 0.2516
 CIE v': 0.5201
 Duv: -0.0012
 CIE x: 0.4364
 CIE y: 0.4010
 CIE z: 0.1626
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 583
 Purity: 51.34918
 Rf: 81.2
 Rg: 101.5

CRI (Ra):	83.4		
R1:	84.0	R9:	29.4
R2:	87.5	R10:	68.6
R3:	88.9	R11:	82.2
R4:	83.8	R12:	61.6
R5:	81.9	R13:	83.9
R6:	83.1	R14:	92.5
R7:	87.1	R15:	79.8
R8:	70.9		



Test Conditions

Stabilization Time: 38M
 Operation Time: 1H 38M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-2

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-2

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



CCT = 2983K
 CIE x = 0.4364
 CIE y = 0.4010
 Duv = -0.0012

Point lies inside the ANSI 3000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-2

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-2

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.27

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-2

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.34

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	43	NR	620	294	NR	750	6	NR	880	0	NR
365	0	NR	495	59	NR	625	294	NR	755	5	NR	885	0	NR
370	0	NR	500	81	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	109	NR	635	637	NR	765	4	NR	895	0	NR
380	0	NR	510	135	NR	640	175	NR	770	3	NR	900	0	NR
385	0	NR	515	160	NR	645	171	NR	775	3	NR	905	0	NR
390	1	NR	520	180	NR	650	146	NR	780	2	NR	910	0	NR
395	1	NR	525	195	NR	655	119	NR	785	2	NR	915	0	NR
400	2	NR	530	207	NR	660	99	NR	790	2	NR	920	0	NR
405	3	NR	535	218	NR	665	82	NR	795	2	NR	925	0	NR
410	5	NR	540	227	NR	670	76	NR	800	1	NR	930	0	NR
415	10	NR	545	237	NR	675	61	NR	805	1	NR	935	0	NR
420	20	NR	550	247	NR	680	52	NR	810	1	NR	940	0	NR
425	35	NR	555	259	NR	685	44	NR	815	1	NR	945	0	NR
430	58	NR	560	271	NR	690	38	NR	820	1	NR	950	0	NR
435	90	NR	565	283	NR	695	33	NR	825	1	NR	955	0	NR
440	135	NR	570	293	NR	700	27	NR	830	1	NR	960	0	NR
445	204	NR	575	303	NR	705	24	NR	835	1	NR	965	0	NR
450	233	NR	580	310	NR	710	20	NR	840	0	NR	970	0	NR
455	153	NR	585	313	NR	715	17	NR	845	0	NR	975	0	NR
460	98	NR	590	314	NR	720	15	NR	850	0	NR	980	0	NR
465	76	NR	595	310	NR	725	13	NR	855	0	NR	985	0	NR
470	53	NR	600	307	NR	730	11	NR	860	0	NR	990	0	NR
475	39	NR	605	303	NR	735	9	NR	865	0	NR	995	0	NR
480	35	NR	610	331	NR	740	8	NR	870	0	NR	1000	0	NR
485	36	NR	615	353	NR	745	7	NR	875	0	NR			

Summary

$R_f = 81.2$
 $R_g = 101.5$
 CIE $R_a = 83.4$
 $R_9 = 29.4$



Color Vector Graphics




Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 71	CES51 = 89	CES76 = 65
CES02 = 63	CES27 = 89	CES52 = 89	CES77 = 82
CES03 = 31	CES28 = 86	CES53 = 80	CES78 = 67
CES04 = 70	CES29 = 68	CES54 = 92	CES79 = 89
CES05 = 50	CES30 = 77	CES55 = 90	CES80 = 85
CES06 = 51	CES31 = 70	CES56 = 81	CES81 = 75
CES07 = 43	CES32 = 64	CES57 = 79	CES82 = 93
CES08 = 41	CES33 = 74	CES58 = 81	CES83 = 89
CES09 = 29	CES34 = 76	CES59 = 92	CES84 = 91
CES10 = 76	CES35 = 87	CES60 = 96	CES85 = 81
CES11 = 59	CES36 = 99	CES61 = 91	CES86 = 74
CES12 = 65	CES37 = 81	CES62 = 93	CES87 = 83
CES13 = 44	CES38 = 83	CES63 = 79	CES88 = 86
CES14 = 74	CES39 = 94	CES64 = 81	CES89 = 74
CES15 = 72	CES40 = 89	CES65 = 78	CES90 = 85
CES16 = 48	CES41 = 88	CES66 = 76	CES91 = 87
CES17 = 50	CES42 = 80	CES67 = 74	CES92 = 73
CES18 = 57	CES43 = 75	CES68 = 79	CES93 = 84
CES19 = 72	CES44 = 99	CES69 = 83	CES94 = 64
CES20 = 67	CES45 = 83	CES70 = 72	CES95 = 80
CES21 = 87	CES46 = 82	CES71 = 70	CES96 = 86
CES22 = 79	CES47 = 79	CES72 = 90	CES97 = 85
CES23 = 92	CES48 = 78	CES73 = 65	CES98 = 83
CES24 = 91	CES49 = 79	CES74 = 94	CES99 = 82
CES25 = 72	CES50 = 88	CES75 = 70	



Color Rendition by Hue-Angle Bin

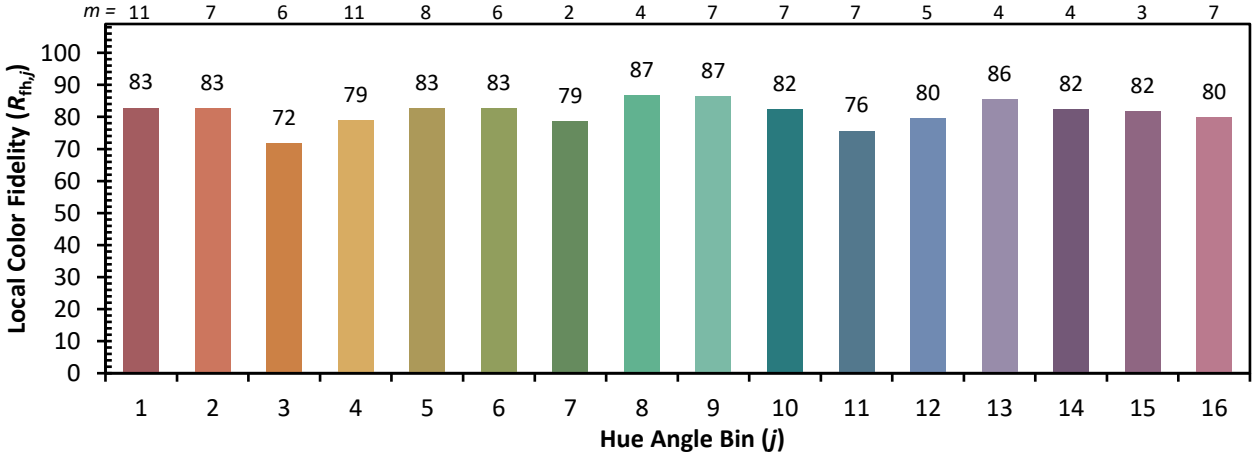

Measure Comparisons



(END OF REPORT)