

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1432729

Luminaire Tested: EHBR1-42-UNV-N-L835-UPL40

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number: P1432729
REPORT IS A COMBINATION OF REPORTS P1431818 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-42-UNV-N-L835-UPL40
Description: Elevate Round Highbay at, 42000 lumens, 3500K 80CRI LEDs with N lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 44414.0 lumens
Efficiency: N/A
Efficacy: 174.2 lumens/watt
Spacing Criteria (0/90/45): 0.82 / 0.82 / 0.8
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 255
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1432729
CATALOG NUMBER: EHBR1-42-UNV-N-L835-UPL40

Luminous Intensity Polar Plot

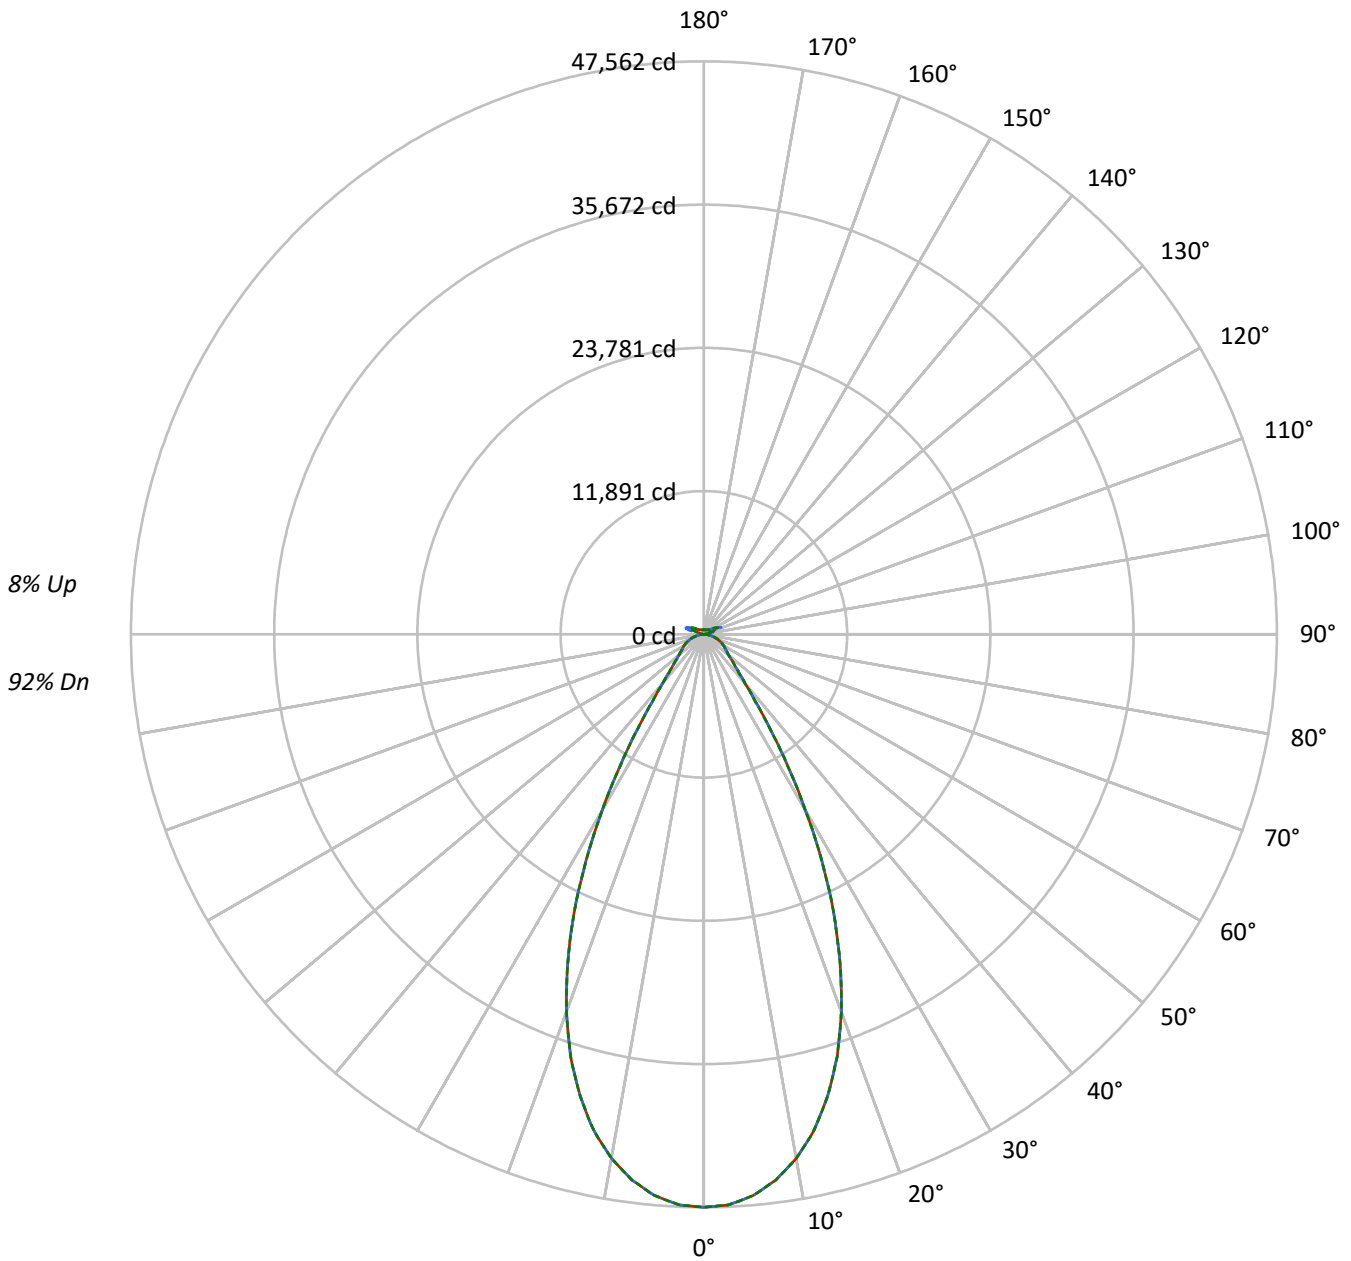

— 0°-180° - - - 45°-225° - · - · 90°-270°



TEST NUMBER: P1432729

CATALOG NUMBER: EHBR1-42-UNV-N-L835-UPL40

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	117	117	117	117	113	113	113	113	107	107	107	100	100	100	94	94	94	94	94	94	92
1	110	107	104	101	107	104	101	99	98	96	94	93	92	90	88	87	86	86	86	86	84
2	104	98	93	89	101	95	91	87	91	87	84	86	84	81	83	80	78	78	78	78	76
3	97	90	84	80	95	88	83	79	84	80	76	81	77	74	77	74	72	72	72	72	70
4	92	83	77	72	89	82	76	71	78	73	70	75	71	68	72	69	66	66	66	66	64
5	87	77	71	66	84	76	70	65	73	68	64	71	66	63	68	64	61	61	61	61	60
6	82	72	66	61	80	71	65	60	69	63	59	66	62	58	64	60	57	57	57	57	56
7	78	68	61	57	76	67	60	56	65	59	55	63	58	54	61	57	54	54	54	54	52
8	74	64	57	53	72	63	57	52	61	55	52	59	54	51	58	53	50	50	50	50	49
9	70	60	54	49	69	59	53	49	58	52	48	56	51	48	55	50	47	47	47	47	46
10	67	57	51	46	65	56	50	46	55	49	46	53	48	45	52	48	45	45	45	45	43

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	223355	223355	223355
5°	219019	219019	219019
10°	207875	207875	207875
15°	189138	189138	189138
20°	162239	162239	162239
25°	127627	127627	127627
30°	87585	87585	87585
35°	52028	52028	52028
40°	30784	30784	30784
45°	22098	22098	22098
50°	18164	18164	18164
55°	16509	16509	16509
60°	15803	15803	15803
65°	15074	15074	15074
70°	14018	14018	14018
75°	12671	12671	12671
80°	10518	10518	10518
85°	6660	6660	6660

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 22098 cd/sqm



TEST NUMBER: P1432729

CATALOG NUMBER: EHBR1-42-UNV-N-L835-UPL40

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	4381.2	9.9
10°-20°	10997.5	24.8
20°-30°	11499.1	25.9
30°-40°	6230.5	14.0
40°-50°	2866.3	6.5
50°-60°	2020.0	4.5
60°-70°	1554.6	3.5
70°-80°	942.4	2.1
80°-90°	272.0	0.6
90°-100°	104.3	0.2
100°-110°	652.2	1.5
110°-120°	1166.3	2.6
120°-130°	684.3	1.5
130°-140°	419.8	0.9
140°-150°	291.2	0.7
150°-160°	189.2	0.4
160°-170°	107.8	0.2
170°-180°	35.6	0.1
0°-30°	26877.8	60.5
0°-40°	33108.3	74.5
0°-60°	37994.6	85.5
0°-90°	40763.5	91.8
90°-120°	1922.7	4.3
90°-150°	3317.9	7.5
90°-180°	3650.0	8.2
0°-180°	44414.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	47562	47562	47562	47562	47562	
5°	46764	46764	46764	46764	46764	4381
15°	39680	39680	39680	39680	39680	10998
25°	25487	25487	25487	25487	25487	11499
35°	9549	9549	9549	9549	9549	6231
45°	3575	3575	3575	3575	3575	2866
55°	2231	2231	2231	2231	2231	2020
65°	1573	1573	1573	1573	1573	1555
75°	893	893	893	893	893	942
85°	229	229	229	229	229	254
90°	28	45	77	50	28	24
95°	46	77	169	84	52	44
105°	228	449	1147	495	301	305
115°	1049	1103	1356	1300	1291	966
125°	756	706	725	736	825	690
135°	552	535	554	520	518	432
145°	453	447	474	468	466	287
155°	397	393	412	412	412	185
165°	372	372	382	382	380	106
175°	368	368	374	374	374	35
180°	372	372	372	372	372	



TEST NUMBER: P1432729

CATALOG NUMBER: EHBR1-42-UNV-N-L835-UPL40

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	47561.9	47561.9	47561.9	47561.9	47561.9
2.5°	47393.2	47393.2	47393.2	47393.2	47393.2
5°	46764.0	46764.0	46764.0	46764.0	46764.0
7.5°	45689.8	45689.8	45689.8	45689.8	45689.8
10°	44165.9	44165.9	44165.9	44165.9	44165.9
12.5°	42196.3	42196.3	42196.3	42196.3	42196.3
15°	39680.2	39680.2	39680.2	39680.2	39680.2
17.5°	36761.1	36761.1	36761.1	36761.1	36761.1
20°	33344.8	33344.8	33344.8	33344.8	33344.8
22.5°	29541.2	29541.2	29541.2	29541.2	29541.2
25°	25487.0	25487.0	25487.0	25487.0	25487.0
27.5°	21188.9	21188.9	21188.9	21188.9	21188.9
30°	16846.9	16846.9	16846.9	16846.9	16846.9
32.5°	12929.4	12929.4	12929.4	12929.4	12929.4
35°	9549.0	9549.0	9549.0	9549.0	9549.0
37.5°	7011.3	7011.3	7011.3	7011.3	7011.3
40°	5335.6	5335.6	5335.6	5335.6	5335.6
42.5°	4278.5	4278.5	4278.5	4278.5	4278.5
45°	3575.4	3575.4	3575.4	3575.4	3575.4
47.5°	3068.7	3068.7	3068.7	3068.7	3068.7
50°	2707.1	2707.1	2707.1	2707.1	2707.1
52.5°	2443.0	2443.0	2443.0	2443.0	2443.0
55°	2231.0	2231.0	2231.0	2231.0	2231.0
57.5°	2059.0	2059.0	2059.0	2059.0	2059.0
60°	1899.8	1899.8	1899.8	1899.8	1899.8
62.5°	1740.6	1740.6	1740.6	1740.6	1740.6
65°	1573.4	1573.4	1573.4	1573.4	1573.4
67.5°	1402.7	1402.7	1402.7	1402.7	1402.7
70°	1230.0	1230.0	1230.0	1230.0	1230.0
72.5°	1062.0	1062.0	1062.0	1062.0	1062.0
75°	892.6	892.6	892.6	892.6	892.6
77.5°	726.7	726.7	726.7	726.7	726.7
80°	553.3	553.3	553.3	553.3	553.3
82.5°	387.4	387.4	387.4	387.4	387.4
85°	228.9	228.9	228.9	228.9	228.9
87.5°	81.9	81.9	81.9	81.9	81.9
90°	28.5	45.3	76.6	49.5	28.5
92.5°	39.7	66.9	121.2	62.6	35.5
95°	46.0	77.3	169.2	83.6	52.3
97.5°	58.5	85.6	194.3	102.4	81.5
100°	77.3	100.3	303.0	125.4	108.7
102.5°	131.7	213.1	643.6	236.1	165.0
105°	227.8	449.3	1147.2	495.2	300.9
107.5°	395.0	804.5	1512.8	877.6	570.5
110°	737.7	1067.7	1586.0	1205.6	913.2



TEST NUMBER: P1432729

CATALOG NUMBER: EHBR1-42-UNV-N-L835-UPL40

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	996.8	1147.2	1519.1	1331.0	1189.0
115°	1048.9	1103.3	1356.1	1299.7	1291.4
117.5°	1013.4	1007.1	1151.3	1168.1	1247.4
120°	938.2	896.4	961.2	1019.7	1126.3
122.5°	844.2	794.0	823.3	867.2	973.8
125°	756.4	706.2	725.1	735.5	825.4
127.5°	679.1	645.6	656.1	643.6	700.0
130°	626.9	597.6	612.3	583.0	610.1
132.5°	583.0	564.2	580.9	545.4	553.7
135°	551.7	534.9	553.7	520.3	518.2
137.5°	524.5	509.9	528.7	503.6	497.4
140°	499.4	486.9	507.7	488.9	484.8
142.5°	472.2	463.9	488.9	476.4	472.2
145°	453.4	447.1	474.3	468.1	465.9
147.5°	436.8	432.6	457.6	455.6	455.6
150°	422.1	417.9	443.0	440.9	443.0
152.5°	407.5	403.3	426.3	424.2	426.3
155°	397.0	392.8	411.6	411.6	411.6
157.5°	388.7	386.5	401.2	401.2	401.2
160°	382.4	380.3	392.8	392.8	390.8
162.5°	376.2	374.0	388.7	386.5	386.5
165°	372.0	372.0	382.4	382.4	380.3
167.5°	372.0	369.8	380.3	380.3	378.2
170°	369.8	369.8	378.2	376.2	374.0
172.5°	369.8	369.8	378.2	376.2	374.0
175°	367.8	367.8	374.0	374.0	374.0
177.5°	369.8	369.8	374.0	374.0	372.0
180°	372.0	372.0	372.0	372.0	372.0



TEST NUMBER: P1432729
 CATALOG NUMBER: EHBR1-42-UNV-N-L835-UPL40

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.55	18.60	18.07	19.08	19.60	17.55	18.60	18.07	19.08	19.60
	3H	19.33	20.26	19.86	20.76	21.33	19.33	20.26	19.86	20.76	21.33
	4H	19.99	20.86	20.54	21.37	21.95	19.99	20.86	20.54	21.37	21.95
	6H	20.45	21.24	21.01	21.77	22.37	20.45	21.24	21.01	21.77	22.37
	8H	20.57	21.32	21.14	21.87	22.47	20.57	21.32	21.14	21.87	22.47
	12H	20.62	21.34	21.20	21.88	22.51	20.62	21.34	21.20	21.88	22.51
4H	2H	18.09	18.96	18.64	19.48	20.06	18.09	18.96	18.64	19.48	20.06
	3H	20.06	20.78	20.62	21.34	21.94	20.06	20.78	20.62	21.34	21.94
	4H	20.83	21.48	21.41	22.05	22.69	20.83	21.48	21.41	22.05	22.69
	6H	21.41	21.96	22.01	22.55	23.21	21.41	21.96	22.01	22.55	23.21
	8H	21.56	22.08	22.17	22.67	23.33	21.56	22.08	22.17	22.67	23.33
	12H	21.64	22.10	22.27	22.72	23.38	21.64	22.10	22.27	22.72	23.38
8H	4H	21.06	21.58	21.67	22.17	22.83	21.06	21.58	21.67	22.17	22.83
	6H	21.75	22.16	22.38	22.80	23.47	21.75	22.16	22.38	22.80	23.47
	8H	21.97	22.34	22.62	22.99	23.67	21.97	22.34	22.62	22.99	23.67
	12H	22.11	22.43	22.76	23.06	23.81	22.11	22.43	22.76	23.06	23.81
12H	4H	21.06	21.51	21.68	22.14	22.80	21.06	21.51	21.68	22.14	22.80
	6H	21.77	22.14	22.43	22.79	23.47	21.77	22.14	22.43	22.79	23.47
	8H	22.03	22.36	22.68	22.99	23.74	22.03	22.36	22.68	22.99	23.74

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-3

Test Date: 07/31/2025

Luminaire Tested: EHBR-60-L835-N

Data in this report applies to families of products including EHBR-60-L835-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-3
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L835-N**
 Description: Elevate Round Highbay at, 60000 lumens, 3500K 80CRI LEDs with N lens

Spectral Parameters

CCT (K): 3468
 CIE u': 0.2375
 CIE v': 0.5091
 Duv: -0.0021
 CIE x: 0.4049
 CIE y: 0.3856
 CIE z: 0.2095
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 581
 Purity: 37.24544
 R_f: 80.1
 R_g: 101

CRI (Ra):	82.1		
R1:	82.9	R9:	27.6
R2:	85.6	R10:	63.8
R3:	85.9	R11:	81.2
R4:	82.8	R12:	57.2
R5:	81.0	R13:	82.6
R6:	79.7	R14:	91.0
R7:	86.5	R15:	79.4
R8:	72.1		



Test Conditions

Stabilization Time: 39M
 Operation Time: 1H 39M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-3

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-3

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



CCT = 3468K
 CIE x = 0.4049
 CIE y = 0.3856
 Duv = -0.0021

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-3

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	60	NR	620	327	NR	750	7	NR	880	0	NR
365	0	NR	495	82	NR	625	322	NR	755	6	NR	885	0	NR
370	0	NR	500	114	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	152	NR	635	645	NR	765	4	NR	895	0	NR
380	0	NR	510	189	NR	640	197	NR	770	4	NR	900	0	NR
385	1	NR	515	222	NR	645	189	NR	775	3	NR	905	0	NR
390	2	NR	520	248	NR	650	163	NR	780	3	NR	910	0	NR
395	3	NR	525	268	NR	655	134	NR	785	2	NR	915	0	NR
400	4	NR	530	283	NR	660	113	NR	790	2	NR	920	0	NR
405	6	NR	535	294	NR	665	94	NR	795	2	NR	925	0	NR
410	9	NR	540	305	NR	670	87	NR	800	2	NR	930	0	NR
415	18	NR	545	314	NR	675	70	NR	805	1	NR	935	0	NR
420	34	NR	550	323	NR	680	60	NR	810	1	NR	940	0	NR
425	62	NR	555	335	NR	685	51	NR	815	1	NR	945	0	NR
430	102	NR	560	346	NR	690	44	NR	820	1	NR	950	0	NR
435	159	NR	565	356	NR	695	38	NR	825	1	NR	955	0	NR
440	241	NR	570	364	NR	700	32	NR	830	1	NR	960	0	NR
445	363	NR	575	371	NR	705	28	NR	835	1	NR	965	0	NR
450	389	NR	580	375	NR	710	24	NR	840	1	NR	970	0	NR
455	245	NR	585	375	NR	715	20	NR	845	0	NR	975	0	NR
460	158	NR	590	373	NR	720	17	NR	850	0	NR	980	0	NR
465	120	NR	595	364	NR	725	15	NR	855	0	NR	985	0	NR
470	79	NR	600	357	NR	730	13	NR	860	0	NR	990	0	NR
475	57	NR	605	349	NR	735	11	NR	865	0	NR	995	0	NR
480	51	NR	610	371	NR	740	9	NR	870	0	NR	1000	0	NR
485	51	NR	615	387	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-3

Scotopic Flux vs. Wavelength




Scotopic Lumens: NR

S/P: 1.43

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	60	NR	620	327	NR	750	7	NR	880	0	NR
365	0	NR	495	82	NR	625	322	NR	755	6	NR	885	0	NR
370	0	NR	500	114	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	152	NR	635	645	NR	765	4	NR	895	0	NR
380	0	NR	510	189	NR	640	197	NR	770	4	NR	900	0	NR
385	1	NR	515	222	NR	645	189	NR	775	3	NR	905	0	NR
390	2	NR	520	248	NR	650	163	NR	780	3	NR	910	0	NR
395	3	NR	525	268	NR	655	134	NR	785	2	NR	915	0	NR
400	4	NR	530	283	NR	660	113	NR	790	2	NR	920	0	NR
405	6	NR	535	294	NR	665	94	NR	795	2	NR	925	0	NR
410	9	NR	540	305	NR	670	87	NR	800	2	NR	930	0	NR
415	18	NR	545	314	NR	675	70	NR	805	1	NR	935	0	NR
420	34	NR	550	323	NR	680	60	NR	810	1	NR	940	0	NR
425	62	NR	555	335	NR	685	51	NR	815	1	NR	945	0	NR
430	102	NR	560	346	NR	690	44	NR	820	1	NR	950	0	NR
435	159	NR	565	356	NR	695	38	NR	825	1	NR	955	0	NR
440	241	NR	570	364	NR	700	32	NR	830	1	NR	960	0	NR
445	363	NR	575	371	NR	705	28	NR	835	1	NR	965	0	NR
450	389	NR	580	375	NR	710	24	NR	840	1	NR	970	0	NR
455	245	NR	585	375	NR	715	20	NR	845	0	NR	975	0	NR
460	158	NR	590	373	NR	720	17	NR	850	0	NR	980	0	NR
465	120	NR	595	364	NR	725	15	NR	855	0	NR	985	0	NR
470	79	NR	600	357	NR	730	13	NR	860	0	NR	990	0	NR
475	57	NR	605	349	NR	735	11	NR	865	0	NR	995	0	NR
480	51	NR	610	371	NR	740	9	NR	870	0	NR	1000	0	NR
485	51	NR	615	387	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-3

Melanopic Flux vs. Wavelength

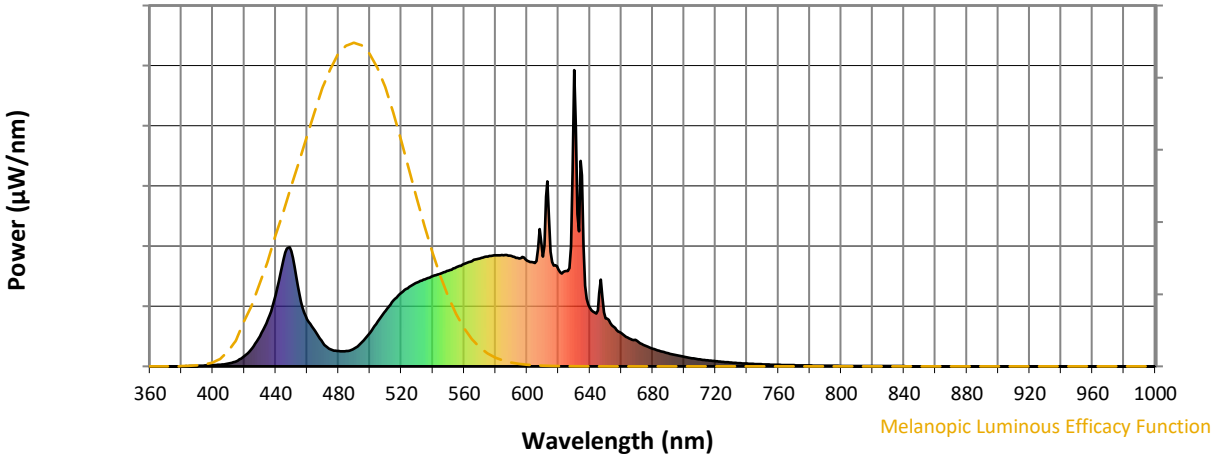

Melanopic Lumens: NR

M/P: 2.75

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	60	NR	620	327	NR	750	7	NR	880	0	NR
365	0	NR	495	82	NR	625	322	NR	755	6	NR	885	0	NR
370	0	NR	500	114	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	152	NR	635	645	NR	765	4	NR	895	0	NR
380	0	NR	510	189	NR	640	197	NR	770	4	NR	900	0	NR
385	1	NR	515	222	NR	645	189	NR	775	3	NR	905	0	NR
390	2	NR	520	248	NR	650	163	NR	780	3	NR	910	0	NR
395	3	NR	525	268	NR	655	134	NR	785	2	NR	915	0	NR
400	4	NR	530	283	NR	660	113	NR	790	2	NR	920	0	NR
405	6	NR	535	294	NR	665	94	NR	795	2	NR	925	0	NR
410	9	NR	540	305	NR	670	87	NR	800	2	NR	930	0	NR
415	18	NR	545	314	NR	675	70	NR	805	1	NR	935	0	NR
420	34	NR	550	323	NR	680	60	NR	810	1	NR	940	0	NR
425	62	NR	555	335	NR	685	51	NR	815	1	NR	945	0	NR
430	102	NR	560	346	NR	690	44	NR	820	1	NR	950	0	NR
435	159	NR	565	356	NR	695	38	NR	825	1	NR	955	0	NR
440	241	NR	570	364	NR	700	32	NR	830	1	NR	960	0	NR
445	363	NR	575	371	NR	705	28	NR	835	1	NR	965	0	NR
450	389	NR	580	375	NR	710	24	NR	840	1	NR	970	0	NR
455	245	NR	585	375	NR	715	20	NR	845	0	NR	975	0	NR
460	158	NR	590	373	NR	720	17	NR	850	0	NR	980	0	NR
465	120	NR	595	364	NR	725	15	NR	855	0	NR	985	0	NR
470	79	NR	600	357	NR	730	13	NR	860	0	NR	990	0	NR
475	57	NR	605	349	NR	735	11	NR	865	0	NR	995	0	NR
480	51	NR	610	371	NR	740	9	NR	870	0	NR	1000	0	NR
485	51	NR	615	387	NR	745	8	NR	875	0	NR			

Summary

$R_f = 80.1$
 $R_g = 101$
 $CIE R_a = 82.1$
 $R_9 = 27.6$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 68	CES51 = 90	CES76 = 59
CES02 = 62	CES27 = 89	CES52 = 90	CES77 = 78
CES03 = 31	CES28 = 84	CES53 = 81	CES78 = 61
CES04 = 70	CES29 = 66	CES54 = 91	CES79 = 86
CES05 = 49	CES30 = 77	CES55 = 90	CES80 = 82
CES06 = 51	CES31 = 69	CES56 = 80	CES81 = 79
CES07 = 42	CES32 = 62	CES57 = 79	CES82 = 92
CES08 = 41	CES33 = 74	CES58 = 81	CES83 = 89
CES09 = 29	CES34 = 72	CES59 = 92	CES84 = 89
CES10 = 75	CES35 = 85	CES60 = 94	CES85 = 82
CES11 = 58	CES36 = 97	CES61 = 90	CES86 = 78
CES12 = 64	CES37 = 79	CES62 = 92	CES87 = 82
CES13 = 43	CES38 = 85	CES63 = 78	CES88 = 86
CES14 = 74	CES39 = 94	CES64 = 79	CES89 = 76
CES15 = 71	CES40 = 89	CES65 = 76	CES90 = 85
CES16 = 47	CES41 = 89	CES66 = 73	CES91 = 83
CES17 = 49	CES42 = 77	CES67 = 70	CES92 = 73
CES18 = 56	CES43 = 74	CES68 = 76	CES93 = 84
CES19 = 72	CES44 = 99	CES69 = 81	CES94 = 65
CES20 = 66	CES45 = 83	CES70 = 68	CES95 = 79
CES21 = 86	CES46 = 82	CES71 = 64	CES96 = 85
CES22 = 78	CES47 = 81	CES72 = 88	CES97 = 85
CES23 = 92	CES48 = 80	CES73 = 60	CES98 = 82
CES24 = 91	CES49 = 80	CES74 = 97	CES99 = 81
CES25 = 72	CES50 = 89	CES75 = 64	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)