

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1436286

Luminaire Tested: EHBR1-24-UNV-M-L840-UPL24

Issue Date: 3/25/2026

Test Information

Test Method: LM-79-2019
Report Number: P1436286
REPORT IS A COMBINATION OF REPORTS P1436070 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/25/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-24-UNV-M-L840-UPL24
Description: Elevate Round Highbay at, 24000 lumens, 4000K 80CRI LEDs with M lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 27272.4 lumens
Efficiency: N/A
Efficacy: 188.3 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.15
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 144.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1436286
CATALOG NUMBER: EHBR1-24-UNV-M-L840-UPL24

Luminous Intensity Polar Plot

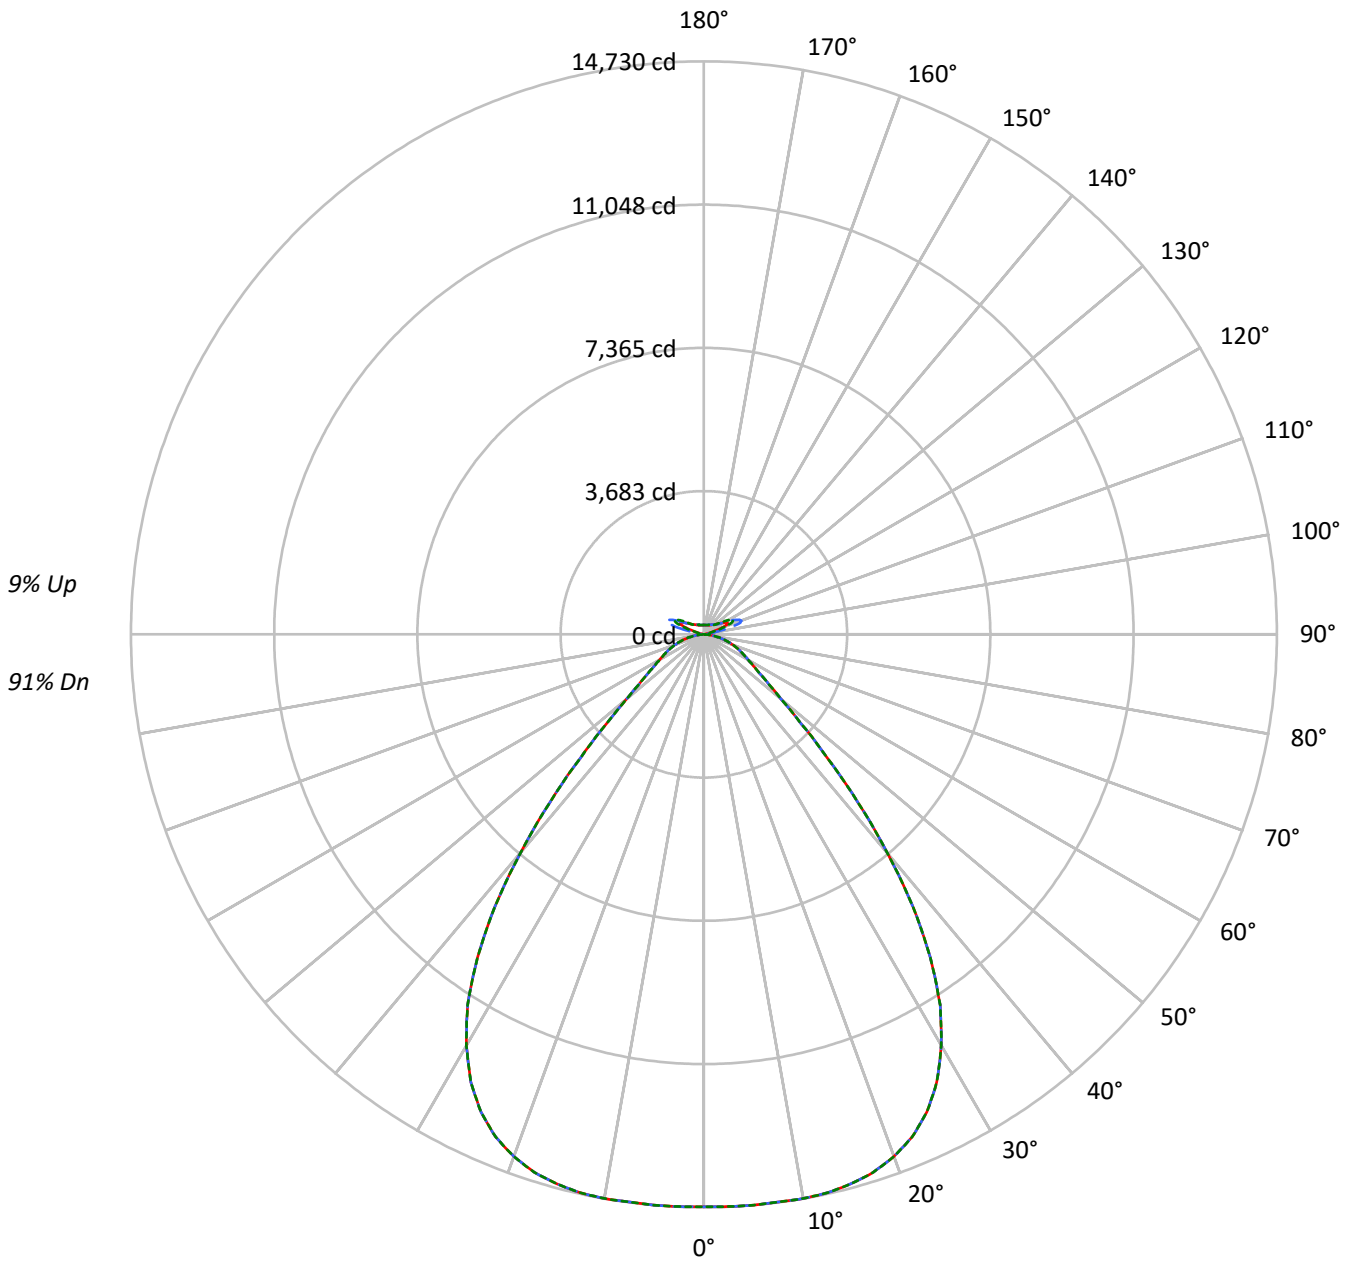

— 0°-180° - - 45°-225° - - - 90°-270°



TEST NUMBER: P1436286
 CATALOG NUMBER: EHBR1-24-UNV-M-L840-UPL24

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	117	117	117	117	113	113	113	113	106	106	106	100	100	100	94	94	94	94	94	94	91
1	109	106	103	100	106	103	100	97	97	95	93	92	90	88	87	86	84	87	86	84	82
2	102	96	90	86	99	93	88	84	88	84	81	84	81	78	80	77	75	80	77	75	73
3	95	87	80	75	92	85	79	74	81	76	72	77	73	69	73	70	67	73	70	67	65
4	88	79	72	67	86	77	71	66	74	68	64	71	66	62	68	64	61	68	64	61	58
5	83	72	65	59	80	71	64	59	68	62	57	65	60	56	62	58	55	62	58	55	53
6	77	66	59	54	75	65	58	53	62	56	52	60	55	51	58	53	50	58	53	50	48
7	72	61	54	49	70	60	53	48	58	52	47	56	50	46	54	49	45	54	49	45	44
8	68	56	49	44	66	55	49	44	53	47	43	52	46	42	50	45	42	50	45	42	40
9	64	52	45	41	62	51	45	40	50	44	40	48	43	39	47	42	38	47	42	38	37
10	60	49	42	37	59	48	41	37	46	41	37	45	40	36	44	39	35	44	39	35	34

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	69106	69106	69106
5°	68988	68988	68988
10°	69312	69312	69312
15°	69710	69710	69710
20°	69499	69499	69499
25°	67876	67876	67876
30°	63469	63469	63469
35°	55276	55276	55276
40°	42363	42363	42363
45°	27674	27674	27674
50°	17446	17446	17446
55°	13005	13005	13005
60°	10949	10949	10949
65°	9956	9956	9956
70°	9070	9070	9070
75°	7765	7765	7765
80°	5978	5978	5978
85°	3136	3136	3136

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 27674 cd/sqm



TEST NUMBER: P1436286
 CATALOG NUMBER: EHBR1-24-UNV-M-L840-UPL24

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1405.5	5.2
10°-20°	4127.5	15.1
20°-30°	6193.1	22.7
30°-40°	6230.9	22.8
40°-50°	3566.8	13.1
50°-60°	1631.4	6.0
60°-70°	1035.1	3.8
70°-80°	580.6	2.1
80°-90°	140.5	0.5
90°-100°	67.3	0.2
100°-110°	421.8	1.5
110°-120°	754.4	2.8
120°-130°	442.6	1.6
130°-140°	271.5	1.0
140°-150°	188.3	0.7
150°-160°	122.4	0.4
160°-170°	69.7	0.3
170°-180°	23.0	0.1
0°-30°	11726.1	43.0
0°-40°	17957.1	65.8
0°-60°	23155.2	84.9
0°-90°	24911.3	91.3
90°-120°	1243.5	4.6
90°-150°	2146.0	7.9
90°-180°	2361.0	8.7
0°-180°	27272.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	14716	14716	14716	14716	14716	
5°	14730	14730	14730	14730	14730	1405
15°	14625	14625	14625	14625	14625	4127
25°	13555	13555	13555	13555	13555	6193
35°	10145	10145	10145	10145	10145	6231
45°	4478	4478	4478	4478	4478	3567
55°	1758	1758	1758	1758	1758	1631
65°	1039	1039	1039	1039	1039	1035
75°	547	547	547	547	547	581
85°	108	108	108	108	108	132
90°	18	28	49	31	18	13
95°	30	50	110	54	34	29
105°	147	291	742	320	195	197
115°	678	714	877	841	835	625
125°	489	457	469	476	534	446
135°	357	346	358	336	335	279
145°	293	289	307	303	301	186
155°	257	254	266	266	266	120
165°	241	241	247	247	246	69
175°	238	238	242	242	242	23
180°	241	241	241	241	241	



TEST NUMBER: P1436286
 CATALOG NUMBER: EHBR1-24-UNV-M-L840-UPL24

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	14715.7	14715.7	14715.7	14715.7	14715.7
2.5°	14722.9	14722.9	14722.9	14722.9	14722.9
5°	14730.0	14730.0	14730.0	14730.0	14730.0
7.5°	14719.9	14719.9	14719.9	14719.9	14719.9
10°	14726.2	14726.2	14726.2	14726.2	14726.2
12.5°	14701.0	14701.0	14701.0	14701.0	14701.0
15°	14624.8	14624.8	14624.8	14624.8	14624.8
17.5°	14498.9	14498.9	14498.9	14498.9	14498.9
20°	14284.1	14284.1	14284.1	14284.1	14284.1
22.5°	13989.0	13989.0	13989.0	13989.0	13989.0
25°	13554.8	13554.8	13554.8	13554.8	13554.8
27.5°	12970.8	12970.8	12970.8	12970.8	12970.8
30°	12208.3	12208.3	12208.3	12208.3	12208.3
32.5°	11305.5	11305.5	11305.5	11305.5	11305.5
35°	10145.1	10145.1	10145.1	10145.1	10145.1
37.5°	8830.5	8830.5	8830.5	8830.5	8830.5
40°	7342.5	7342.5	7342.5	7342.5	7342.5
42.5°	5867.5	5867.5	5867.5	5867.5	5867.5
45°	4477.6	4477.6	4477.6	4477.6	4477.6
47.5°	3370.6	3370.6	3370.6	3370.6	3370.6
50°	2600.1	2600.1	2600.1	2600.1	2600.1
52.5°	2100.7	2100.7	2100.7	2100.7	2100.7
55°	1757.5	1757.5	1757.5	1757.5	1757.5
57.5°	1504.9	1504.9	1504.9	1504.9	1504.9
60°	1316.2	1316.2	1316.2	1316.2	1316.2
62.5°	1170.6	1170.6	1170.6	1170.6	1170.6
65°	1039.2	1039.2	1039.2	1039.2	1039.2
67.5°	918.3	918.3	918.3	918.3	918.3
70°	795.8	795.8	795.8	795.8	795.8
72.5°	672.4	672.4	672.4	672.4	672.4
75°	547.0	547.0	547.0	547.0	547.0
77.5°	427.8	427.8	427.8	427.8	427.8
80°	314.5	314.5	314.5	314.5	314.5
82.5°	205.1	205.1	205.1	205.1	205.1
85°	107.8	107.8	107.8	107.8	107.8
87.5°	30.7	30.7	30.7	30.7	30.7
90°	17.6	28.4	48.7	31.1	17.6
92.5°	25.7	43.3	78.4	40.5	23.0
95°	29.7	50.0	109.5	54.1	33.8
97.5°	37.8	55.4	125.7	66.2	52.7
100°	50.0	64.9	196.0	81.1	70.3
102.5°	85.1	137.9	416.3	152.7	106.8
105°	147.3	290.6	742.0	320.3	194.6
107.5°	255.4	520.4	978.5	567.7	369.0
110°	477.1	690.6	1025.8	779.9	590.6



TEST NUMBER: P1436286

CATALOG NUMBER: EHBR1-24-UNV-M-L840-UPL24

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	644.7	742.0	982.6	860.9	769.0
115°	678.5	713.6	877.2	840.7	835.3
117.5°	655.5	651.5	744.7	755.5	806.9
120°	606.9	579.8	621.7	659.6	728.5
122.5°	546.0	513.6	532.5	560.9	629.8
125°	489.3	456.8	469.0	475.8	533.9
127.5°	439.3	417.6	424.4	416.3	452.8
130°	405.5	386.5	396.0	377.1	394.7
132.5°	377.1	364.9	375.7	352.8	358.2
135°	356.8	346.0	358.2	336.5	335.2
137.5°	339.2	329.8	341.9	325.7	321.7
140°	323.0	314.9	328.4	316.3	313.6
142.5°	305.5	300.0	316.3	308.2	305.5
145°	293.3	289.2	306.8	302.8	301.4
147.5°	282.5	279.8	296.0	294.6	294.6
150°	273.0	270.3	286.5	285.2	286.5
152.5°	263.6	260.9	275.7	274.4	275.7
155°	256.8	254.1	266.3	266.3	266.3
157.5°	251.4	250.0	259.5	259.5	259.5
160°	247.3	246.0	254.1	254.1	252.7
162.5°	243.3	241.9	251.4	250.0	250.0
165°	240.6	240.6	247.3	247.3	246.0
167.5°	240.6	239.2	246.0	246.0	244.6
170°	239.2	239.2	244.6	243.3	241.9
172.5°	239.2	239.2	244.6	243.3	241.9
175°	237.9	237.9	241.9	241.9	241.9
177.5°	239.2	239.2	241.9	241.9	240.6
180°	240.6	240.6	240.6	240.6	240.6



TEST NUMBER: P1436286
 CATALOG NUMBER: EHBR1-24-UNV-M-L840-UPL24

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.91	18.04	17.42	18.53	19.06	16.91	18.04	17.42	18.53	19.06
	3H	18.39	19.40	18.92	19.90	20.48	18.39	19.40	18.92	19.90	20.48
	4H	18.91	19.85	19.46	20.37	20.96	18.91	19.85	19.46	20.37	20.96
	6H	19.24	20.10	19.80	20.64	21.24	19.24	20.10	19.80	20.64	21.24
	8H	19.31	20.12	19.88	20.68	21.29	19.31	20.12	19.88	20.68	21.29
	12H	19.32	20.10	19.90	20.65	21.28	19.32	20.10	19.90	20.65	21.28
4H	2H	17.34	18.28	17.90	18.80	19.39	17.34	18.28	17.90	18.80	19.39
	3H	19.04	19.81	19.60	20.38	20.98	19.04	19.81	19.60	20.38	20.98
	4H	19.67	20.36	20.25	20.94	21.58	19.67	20.36	20.25	20.94	21.58
	6H	20.09	20.69	20.70	21.29	21.95	20.09	20.69	20.70	21.29	21.95
	8H	20.19	20.74	20.79	21.34	22.01	20.19	20.74	20.79	21.34	22.01
	12H	20.21	20.71	20.84	21.34	22.01	20.21	20.71	20.84	21.34	22.01
8H	4H	19.84	20.40	20.45	21.00	21.67	19.84	20.40	20.45	21.00	21.67
	6H	20.35	20.81	20.99	21.45	22.13	20.35	20.81	20.99	21.45	22.13
	8H	20.49	20.90	21.15	21.55	22.24	20.49	20.90	21.15	21.55	22.24
	12H	20.56	20.91	21.21	21.55	22.31	20.56	20.91	21.21	21.55	22.31
12H	4H	19.83	20.32	20.46	20.95	21.62	19.83	20.32	20.46	20.95	21.62
	6H	20.36	20.76	21.01	21.42	22.10	20.36	20.76	21.01	21.42	22.10
	8H	20.53	20.88	21.18	21.52	22.28	20.53	20.88	21.18	21.52	22.28

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-1

Test Date: 07/30/2025

Luminaire Tested: EHBR-60-L840-N

Data in this report applies to families of products including EHBR-60-L840-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-1
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L840-N**
 Description: Elevate Round Highbay at, 60000 lumens, 4000K 80CRI LEDs with N lens

Spectral Parameters

CCT (K): 3898
 CIE u': 0.2263
 CIE v': 0.5052
 Duv: 0.0013
 CIE x: 0.3861
 CIE y: 0.3831
 CIE z: 0.2308
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 578
 Purity: 30.85729
 Rf: 80.7
 Rg: 102.1

CRI (Ra):	82.1		
R1:	84.4	R9:	38.5
R2:	83.5	R10:	58.9
R3:	80.8	R11:	83.6
R4:	83.9	R12:	54.2
R5:	82.1	R13:	82.8
R6:	77.3	R14:	88.2
R7:	86.4	R15:	81.2
R8:	78.3		



Test Conditions

Stabilization Time: 42M
 Operation Time: 1H 42M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-1

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-1

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-1

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	60	NR	620	277	NR	750	6	NR	880	0	NR
365	0	NR	495	87	NR	625	278	NR	755	5	NR	885	0	NR
370	0	NR	500	124	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	168	NR	635	623	NR	765	4	NR	895	0	NR
380	1	NR	510	209	NR	640	162	NR	770	3	NR	900	0	NR
385	1	NR	515	246	NR	645	158	NR	775	3	NR	905	0	NR
390	2	NR	520	273	NR	650	134	NR	780	2	NR	910	0	NR
395	4	NR	525	292	NR	655	109	NR	785	2	NR	915	0	NR
400	5	NR	530	305	NR	660	91	NR	790	2	NR	920	0	NR
405	7	NR	535	313	NR	665	75	NR	795	2	NR	925	0	NR
410	11	NR	540	319	NR	670	70	NR	800	1	NR	930	0	NR
415	21	NR	545	323	NR	675	56	NR	805	1	NR	935	0	NR
420	42	NR	550	326	NR	680	47	NR	810	1	NR	940	0	NR
425	76	NR	555	330	NR	685	41	NR	815	1	NR	945	0	NR
430	125	NR	560	333	NR	690	35	NR	820	1	NR	950	0	NR
435	193	NR	565	336	NR	695	30	NR	825	1	NR	955	0	NR
440	302	NR	570	336	NR	700	26	NR	830	1	NR	960	0	NR
445	432	NR	575	335	NR	705	22	NR	835	1	NR	965	0	NR
450	380	NR	580	332	NR	710	19	NR	840	0	NR	970	0	NR
455	213	NR	585	326	NR	715	16	NR	845	0	NR	975	0	NR
460	147	NR	590	319	NR	720	14	NR	850	0	NR	980	0	NR
465	104	NR	595	307	NR	725	12	NR	855	0	NR	985	0	NR
470	65	NR	600	299	NR	730	10	NR	860	0	NR	990	0	NR
475	50	NR	605	291	NR	735	9	NR	865	0	NR	995	0	NR
480	46	NR	610	317	NR	740	8	NR	870	0	NR	1000	0	NR
485	47	NR	615	336	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-1

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.55

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	60	NR	620	277	NR	750	6	NR	880	0	NR
365	0	NR	495	87	NR	625	278	NR	755	5	NR	885	0	NR
370	0	NR	500	124	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	168	NR	635	623	NR	765	4	NR	895	0	NR
380	1	NR	510	209	NR	640	162	NR	770	3	NR	900	0	NR
385	1	NR	515	246	NR	645	158	NR	775	3	NR	905	0	NR
390	2	NR	520	273	NR	650	134	NR	780	2	NR	910	0	NR
395	4	NR	525	292	NR	655	109	NR	785	2	NR	915	0	NR
400	5	NR	530	305	NR	660	91	NR	790	2	NR	920	0	NR
405	7	NR	535	313	NR	665	75	NR	795	2	NR	925	0	NR
410	11	NR	540	319	NR	670	70	NR	800	1	NR	930	0	NR
415	21	NR	545	323	NR	675	56	NR	805	1	NR	935	0	NR
420	42	NR	550	326	NR	680	47	NR	810	1	NR	940	0	NR
425	76	NR	555	330	NR	685	41	NR	815	1	NR	945	0	NR
430	125	NR	560	333	NR	690	35	NR	820	1	NR	950	0	NR
435	193	NR	565	336	NR	695	30	NR	825	1	NR	955	0	NR
440	302	NR	570	336	NR	700	26	NR	830	1	NR	960	0	NR
445	432	NR	575	335	NR	705	22	NR	835	1	NR	965	0	NR
450	380	NR	580	332	NR	710	19	NR	840	0	NR	970	0	NR
455	213	NR	585	326	NR	715	16	NR	845	0	NR	975	0	NR
460	147	NR	590	319	NR	720	14	NR	850	0	NR	980	0	NR
465	104	NR	595	307	NR	725	12	NR	855	0	NR	985	0	NR
470	65	NR	600	299	NR	730	10	NR	860	0	NR	990	0	NR
475	50	NR	605	291	NR	735	9	NR	865	0	NR	995	0	NR
480	46	NR	610	317	NR	740	8	NR	870	0	NR	1000	0	NR
485	47	NR	615	336	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-1

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.99

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	60	NR	620	277	NR	750	6	NR	880	0	NR
365	0	NR	495	87	NR	625	278	NR	755	5	NR	885	0	NR
370	0	NR	500	124	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	168	NR	635	623	NR	765	4	NR	895	0	NR
380	1	NR	510	209	NR	640	162	NR	770	3	NR	900	0	NR
385	1	NR	515	246	NR	645	158	NR	775	3	NR	905	0	NR
390	2	NR	520	273	NR	650	134	NR	780	2	NR	910	0	NR
395	4	NR	525	292	NR	655	109	NR	785	2	NR	915	0	NR
400	5	NR	530	305	NR	660	91	NR	790	2	NR	920	0	NR
405	7	NR	535	313	NR	665	75	NR	795	2	NR	925	0	NR
410	11	NR	540	319	NR	670	70	NR	800	1	NR	930	0	NR
415	21	NR	545	323	NR	675	56	NR	805	1	NR	935	0	NR
420	42	NR	550	326	NR	680	47	NR	810	1	NR	940	0	NR
425	76	NR	555	330	NR	685	41	NR	815	1	NR	945	0	NR
430	125	NR	560	333	NR	690	35	NR	820	1	NR	950	0	NR
435	193	NR	565	336	NR	695	30	NR	825	1	NR	955	0	NR
440	302	NR	570	336	NR	700	26	NR	830	1	NR	960	0	NR
445	432	NR	575	335	NR	705	22	NR	835	1	NR	965	0	NR
450	380	NR	580	332	NR	710	19	NR	840	0	NR	970	0	NR
455	213	NR	585	326	NR	715	16	NR	845	0	NR	975	0	NR
460	147	NR	590	319	NR	720	14	NR	850	0	NR	980	0	NR
465	104	NR	595	307	NR	725	12	NR	855	0	NR	985	0	NR
470	65	NR	600	299	NR	730	10	NR	860	0	NR	990	0	NR
475	50	NR	605	291	NR	735	9	NR	865	0	NR	995	0	NR
480	46	NR	610	317	NR	740	8	NR	870	0	NR	1000	0	NR
485	47	NR	615	336	NR	745	7	NR	875	0	NR			

Summary

$R_f = 80.7$
 $R_g = 102.1$
 CIE $R_a = 82.1$
 $R_9 = 38.5$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 69	CES51 = 90	CES76 = 58
CES02 = 61	CES27 = 89	CES52 = 90	CES77 = 76
CES03 = 31	CES28 = 83	CES53 = 80	CES78 = 60
CES04 = 69	CES29 = 66	CES54 = 91	CES79 = 85
CES05 = 48	CES30 = 76	CES55 = 89	CES80 = 79
CES06 = 50	CES31 = 69	CES56 = 79	CES81 = 81
CES07 = 41	CES32 = 62	CES57 = 77	CES82 = 91
CES08 = 40	CES33 = 74	CES58 = 79	CES83 = 88
CES09 = 29	CES34 = 72	CES59 = 93	CES84 = 89
CES10 = 74	CES35 = 84	CES60 = 95	CES85 = 84
CES11 = 57	CES36 = 98	CES61 = 92	CES86 = 82
CES12 = 63	CES37 = 77	CES62 = 89	CES87 = 81
CES13 = 43	CES38 = 83	CES63 = 80	CES88 = 86
CES14 = 74	CES39 = 94	CES64 = 80	CES89 = 79
CES15 = 71	CES40 = 88	CES65 = 77	CES90 = 85
CES16 = 47	CES41 = 89	CES66 = 74	CES91 = 83
CES17 = 49	CES42 = 74	CES67 = 72	CES92 = 77
CES18 = 56	CES43 = 73	CES68 = 78	CES93 = 86
CES19 = 71	CES44 = 98	CES69 = 83	CES94 = 69
CES20 = 65	CES45 = 82	CES70 = 69	CES95 = 80
CES21 = 86	CES46 = 82	CES71 = 64	CES96 = 86
CES22 = 78	CES47 = 80	CES72 = 88	CES97 = 83
CES23 = 91	CES48 = 79	CES73 = 60	CES98 = 81
CES24 = 90	CES49 = 80	CES74 = 98	CES99 = 83
CES25 = 71	CES50 = 89	CES75 = 62	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)