

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: METALUX

Report Number:

Luminaire Tested: EHBR1-42-UNV-A1-L840-UPL24

Issue Date: 3/20/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: REPORT IS A COMBINATION OF REPORTS P1431799 AND P1431635  
Test Lab: INNOVATION CENTER  
Issue Date: 3/20/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: METALUX  
Catalog Number: EHBR1-42-UNV-A1-L840-UPL24  
Description: Elevate Round Highbay at, 42000 lumens, 4000K 80CRI LEDs with A lens  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 43825.1 lumens  
Efficiency: N/A  
Efficacy: 181.9 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 1.07 / 0.95  
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')  
CIE Type: Direct  
  
Input Watts (W): 240.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER:  
CATALOG NUMBER: EHBR1-42-UNV-A1-L840-UPL24

### Luminous Intensity Polar Plot

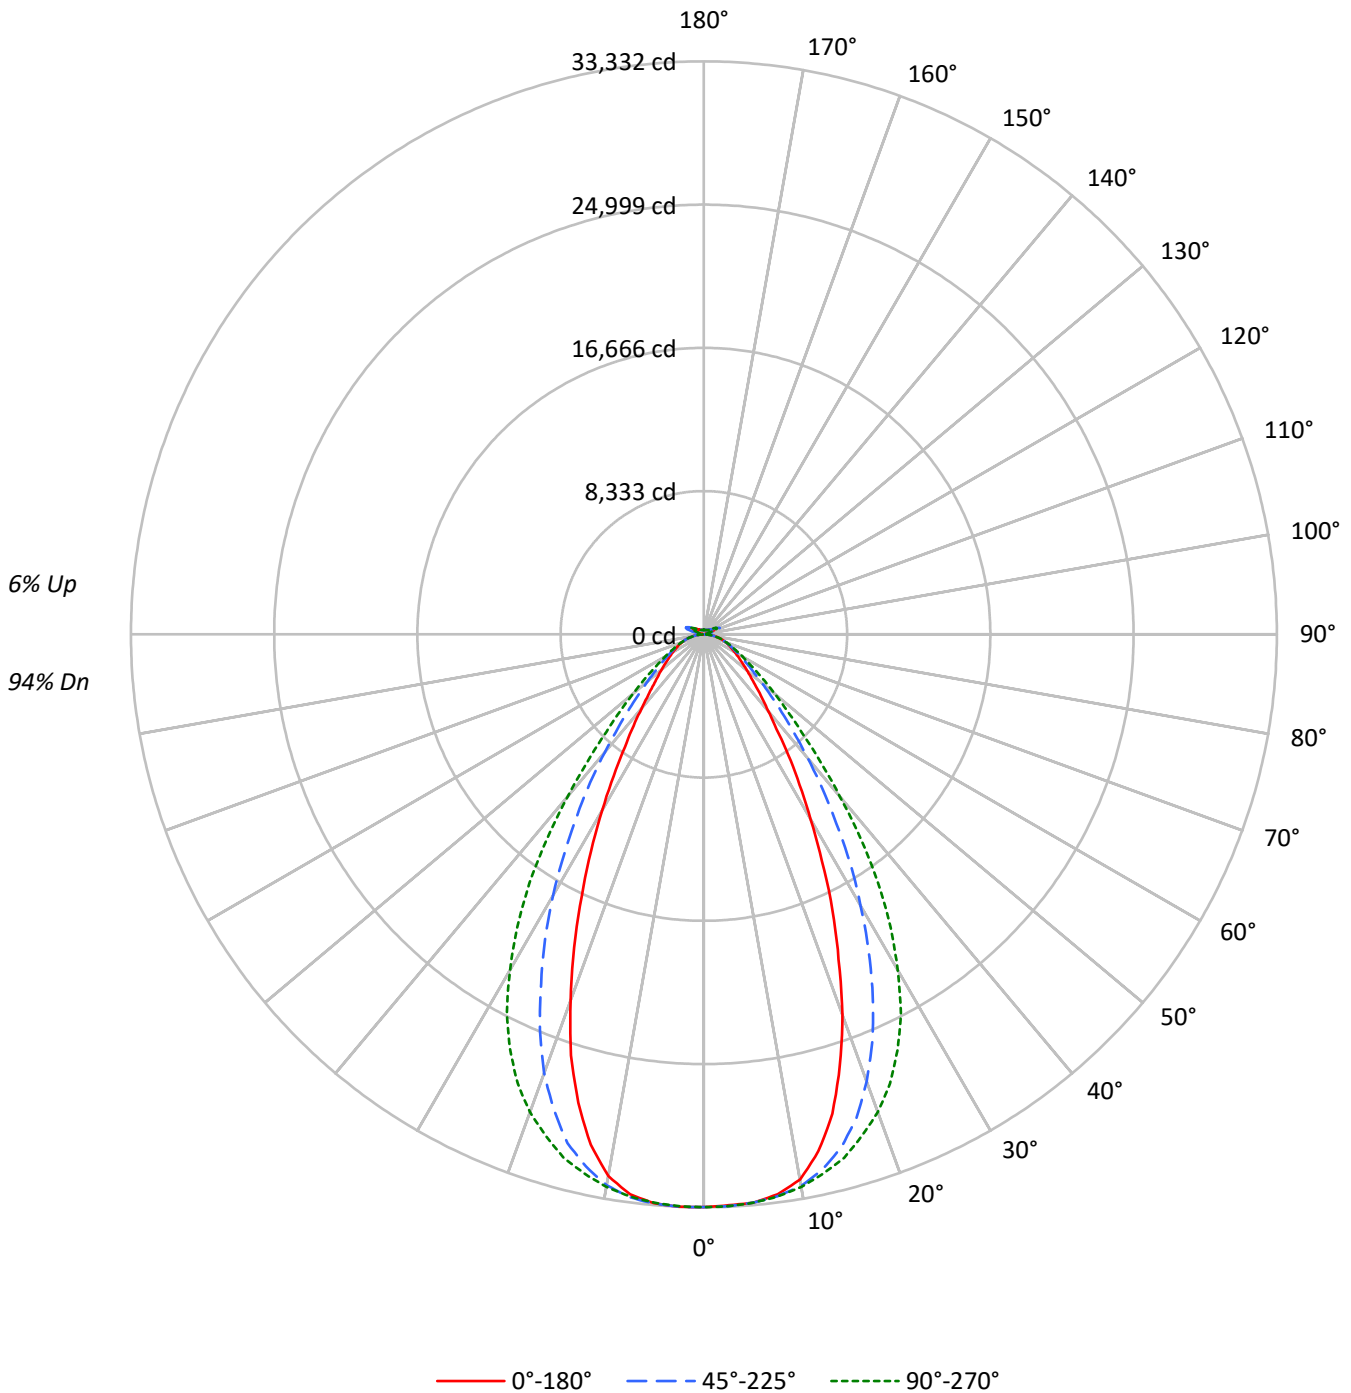



TEST NUMBER:

CATALOG NUMBER: EHBR1-42-UNV-A1-L840-UPL24

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	118	118	118	118	114	114	114	114	108	108	108	102	102	102	97	97	97	97	97	97	94
1	110	107	104	101	107	104	101	98	99	97	94	94	92	91	90	88	87	87	87	87	85
2	103	97	92	87	100	95	90	86	90	86	83	86	83	80	83	80	78	78	78	78	76
3	96	88	82	77	94	86	81	76	83	78	74	79	75	72	76	73	70	70	70	70	68
4	90	81	74	69	88	79	73	68	76	71	66	73	69	65	71	67	64	64	64	64	62
5	84	74	67	62	82	73	66	61	70	65	60	68	63	59	66	62	58	58	58	58	56
6	79	69	61	56	77	67	61	56	65	59	55	63	58	54	61	57	53	53	53	53	52
7	75	64	56	51	73	63	56	51	61	55	50	59	54	50	57	53	49	49	49	49	47
8	70	59	52	47	69	58	52	47	57	51	47	55	50	46	54	49	45	45	45	45	44
9	66	55	48	44	65	55	48	44	53	47	43	52	46	43	50	46	42	42	42	42	41
10	63	52	45	41	62	51	45	41	50	44	40	49	43	40	48	43	39	39	39	39	38

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°	135°	180°
0°	156466	156466	156466	156466	156466
5°	155432	155409	155416	155690	155595
10°	151590	153357	153600	153167	150598
15°	137619	147222	150252	146041	134459
20°	114681	134689	143891	132153	110216
25°	88689	116460	133485	112207	84094
30°	64647	94843	117256	91244	61360
35°	46600	73101	96367	69953	43558
40°	33526	53991	71018	51713	32491
45°	26418	39499	49601	37787	25503
50°	21918	29677	35900	28699	21586
55°	19142	23434	27187	23041	18884
60°	17264	19562	21663	19441	17385
65°	16146	17256	18205	17309	16299
70°	15333	15699	16184	15787	15485
75°	14305	14216	14305	14255	14444
80°	12920	11991	11727	12177	12920
85°	8953	7594	7512	7716	9217

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 67.5°

Vertical Angle: 45°

Luminance: 51969 cd/sqm



TEST NUMBER:

CATALOG NUMBER: EHBR1-42-UNV-A1-L840-UPL24

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	3146.4	7.2
10°-20°	8456.4	19.3
20°-30°	10282.9	23.5
30°-40°	8376.2	19.1
40°-50°	5029.1	11.5
50°-60°	2894.3	6.6
60°-70°	1811.3	4.1
70°-80°	1066.8	2.4
80°-90°	316.3	0.7
90°-100°	64.2	0.1
100°-110°	424.3	1.0
110°-120°	784.8	1.8
120°-130°	465.9	1.1
130°-140°	282.3	0.6
140°-150°	196.5	0.4
150°-160°	128.7	0.3
160°-170°	74.0	0.2
170°-180°	24.7	0.1
0°-30°	21885.8	49.9
0°-40°	30262.0	69.1
0°-60°	38185.4	87.1
0°-90°	41379.8	94.4
90°-120°	1273.3	2.9
90°-150°	2218.0	5.1
90°-180°	2445.0	5.6
0°-180°	43825.1	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	33318	33318	33318	33318	33318	
5°	33187	33182	33184	33242	33222	3136
15°	28872	30886	31522	30639	28209	7943
25°	17711	23257	26657	22408	16794	8069
35°	8553	13417	17687	12839	7994	5411
45°	4274	6391	8025	6114	4126	3372
55°	2587	3167	3674	3114	2552	2338
65°	1685	1801	1900	1807	1701	1676
75°	1008	1001	1008	1004	1018	1067
85°	308	261	258	265	317	328
90°	19	49	18	51	18	24
95°	31	110	34	93	30	30
105°	149	742	195	791	97	199
115°	680	877	835	970	712	627
125°	491	469	534	520	559	448
135°	360	361	338	377	390	282
145°	300	312	307	316	322	190
155°	267	275	273	275	288	125
165°	257	261	258	259	268	73
175°	259	260	257	257	264	25
180°	259	259	259	259	259	



TEST NUMBER:

CATALOG NUMBER: EHBR1-42-UNV-A1-L840-UPL24

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	33318.4	33318.4	33318.4	33318.4	33318.4	33318.4	33318.4	33318.4	33318.4
2.5°	33245.1	33275.1	33287.7	33294.6	33302.3	33323.3	33332.3	33317.7	33330.2
5°	33187.2	33189.3	33182.3	33213.7	33183.7	33204.6	33242.3	33227.7	33222.1
7.5°	32849.4	32919.2	32960.4	32970.8	32976.4	33002.3	33028.8	32878.7	32856.4
10°	32207.4	32324.0	32582.8	32656.8	32634.5	32676.4	32542.4	32150.2	31996.7
12.5°	30799.9	31209.5	31882.2	32181.6	32127.2	32164.1	31707.8	30880.1	30404.2
15°	28871.7	29472.6	30886.4	31476.8	31522.1	31476.8	30638.7	29026.0	28208.8
17.5°	26308.6	27418.1	29499.8	30645.6	30580.0	30601.7	29010.6	26626.8	25691.7
20°	23570.2	24753.1	27682.6	29594.0	29573.8	29452.3	27161.3	24017.6	22652.6
22.5°	20473.2	21998.7	25600.3	28300.9	28293.2	28090.9	24909.4	21168.3	19698.6
25°	17711.2	19207.3	23256.9	26716.8	26656.8	26426.5	22407.6	18326.0	16793.5
27.5°	14855.6	16411.1	20755.2	24860.6	24819.4	24568.2	20016.1	15669.3	14210.8
30°	12434.8	13857.0	18242.9	22818.0	22554.2	22525.6	17550.7	13209.4	11802.6
32.5°	10360.8	11580.0	15874.5	20681.9	20215.0	20348.3	15093.6	11152.2	9757.9
35°	8552.7	9626.7	13416.7	18211.5	17686.8	17859.1	12838.9	9150.8	7994.5
37.5°	6941.4	7974.2	11333.6	15808.9	15006.4	15331.5	10855.6	7642.0	6715.3
40°	5810.9	6630.2	9358.0	13172.4	12309.2	12838.9	8963.1	6374.1	5631.6
42.5°	5007.0	5541.5	7723.7	10655.3	9993.1	10368.5	7387.3	5328.7	4773.2
45°	4274.3	4700.7	6390.8	8408.3	8025.2	8373.4	6113.8	4543.6	4126.3
47.5°	3733.4	4062.1	5261.0	6790.0	6552.0	6662.3	5106.1	3965.1	3626.0
50°	3266.6	3520.6	4422.9	5480.1	5350.3	5418.0	4277.1	3450.1	3217.0
52.5°	2903.7	3090.0	3709.7	4503.9	4439.7	4450.1	3644.8	3034.9	2866.0
55°	2586.9	2716.7	3166.8	3689.5	3674.1	3676.9	3113.8	2689.5	2552.0
57.5°	2309.9	2417.3	2721.6	3099.1	3076.8	3081.7	2696.5	2388.7	2300.1
60°	2075.4	2147.3	2351.7	2619.0	2604.3	2598.1	2337.1	2120.7	2090.0
62.5°	1867.4	1913.5	2055.1	2245.0	2217.0	2223.3	2054.4	1915.6	1870.2
65°	1685.3	1701.3	1801.1	1918.4	1900.2	1915.6	1806.7	1711.8	1701.3
67.5°	1507.3	1523.4	1582.0	1660.9	1639.9	1652.5	1583.4	1527.6	1518.5
70°	1345.4	1344.7	1377.5	1420.1	1420.1	1422.2	1385.2	1351.7	1358.7
72.5°	1178.0	1173.8	1183.5	1212.1	1204.5	1231.0	1191.9	1181.4	1182.8
75°	1007.7	995.8	1001.4	1016.1	1007.7	1021.6	1004.2	1017.5	1017.5
77.5°	847.2	824.8	817.9	820.0	804.6	825.5	829.7	838.8	859.7
80°	679.7	648.3	630.8	630.1	616.9	630.1	640.6	659.5	679.7
82.5°	504.5	477.3	448.0	442.4	434.1	441.7	455.7	478.0	510.8
85°	307.7	279.1	261.0	251.2	258.2	258.2	265.2	296.6	316.8
87.5°	111.0	97.0	79.6	80.3	82.3	85.1	88.6	111.7	122.1
90°	19.0	28.4	48.7	31.1	17.6	29.7	51.4	27.0	18.3
92.5°	26.4	43.3	78.4	40.5	23.0	40.5	73.0	36.5	25.0
95°	31.1	50.0	109.5	54.1	33.8	50.0	93.3	40.5	30.4
97.5°	39.2	55.4	125.7	66.2	52.7	62.2	105.4	43.3	37.2
100°	51.4	64.9	196.0	81.1	70.3	70.3	193.3	50.0	43.3
102.5°	86.5	137.9	416.3	152.7	106.8	137.9	448.7	101.4	52.8
105°	148.7	290.6	742.0	320.3	194.6	316.3	790.7	264.9	97.4
107.5°	256.8	520.4	978.5	567.7	369.0	590.6	1019.1	524.4	228.5
110°	478.5	690.6	1025.8	779.9	590.6	825.8	1112.3	719.0	463.6



TEST NUMBER:

CATALOG NUMBER: EHBR1-42-UNV-A1-L840-UPL24

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
112.5°	646.1	742.0	982.6	860.9	769.0	920.4	1086.7	797.4	642.0
115°	679.9	713.6	877.2	840.7	835.3	906.9	970.4	794.7	712.3
117.5°	657.6	651.5	744.7	755.5	806.9	829.9	838.0	746.1	716.4
120°	608.3	579.8	621.7	659.6	728.5	719.0	705.5	675.1	675.8
122.5°	548.1	514.3	532.5	560.9	629.8	609.6	596.0	602.1	621.1
125°	491.4	457.5	469.0	475.8	533.9	513.6	519.7	540.0	558.9
127.5°	441.4	418.3	424.4	416.3	452.8	443.3	464.3	488.0	503.5
130°	407.6	387.9	396.7	377.1	395.4	398.1	425.8	444.7	454.9
132.5°	379.9	367.0	377.8	354.2	359.6	371.1	396.8	413.7	419.1
135°	360.3	348.8	361.0	338.6	338.0	354.2	377.2	388.0	390.0
137.5°	342.7	333.3	345.4	329.2	325.2	341.4	359.0	367.1	365.1
140°	327.9	319.1	332.6	320.5	317.8	334.0	342.1	352.3	349.5
142.5°	311.1	305.6	321.2	313.1	310.4	325.9	330.0	336.7	334.7
145°	299.6	295.5	312.4	308.4	307.0	318.5	315.8	326.0	321.9
147.5°	290.9	287.5	302.3	300.9	300.9	309.1	305.7	314.5	311.2
150°	282.1	278.7	293.5	292.2	293.5	298.9	294.2	305.1	304.4
152.5°	273.4	270.0	283.4	281.4	282.7	288.1	284.1	295.6	295.7
155°	267.3	263.9	274.7	273.3	273.3	276.7	275.4	287.6	288.3
157.5°	264.0	261.2	269.3	267.9	267.9	270.0	270.0	280.9	281.6
160°	261.3	258.6	265.3	263.9	262.5	265.9	266.0	275.5	276.2
162.5°	258.7	255.9	263.3	261.2	260.5	261.2	261.3	271.5	272.2
165°	256.7	255.3	260.6	259.2	257.9	259.2	258.6	265.4	267.5
167.5°	257.3	255.3	260.0	258.6	257.2	255.9	258.0	263.4	265.4
170°	256.6	255.9	259.3	256.6	254.5	255.2	256.0	261.3	263.4
172.5°	258.0	257.3	260.7	258.0	255.9	256.6	255.9	260.0	263.4
175°	258.8	257.4	260.0	258.0	257.3	256.7	257.3	260.1	264.2
177.5°	260.8	259.4	260.7	258.6	256.7	257.3	259.4	262.1	267.6
180°	259.4	259.4	259.4	259.4	259.4	259.4	259.4	259.4	259.4



TEST NUMBER: CATALOG  
 CATALOG NUMBER: EHBR1-42-UNV-A1-L840-UPL24

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.02	20.19	19.49	20.63	21.08	20.00	21.18	20.47	21.61	22.06
	3H	20.50	21.54	20.98	21.99	22.49	21.27	22.31	21.74	22.76	23.26
	4H	21.10	22.08	21.60	22.54	23.06	21.76	22.74	22.27	23.20	23.72
	6H	21.57	22.46	22.08	22.94	23.47	22.12	23.02	22.63	23.50	24.03
	8H	21.72	22.56	22.24	23.06	23.60	22.22	23.06	22.74	23.57	24.11
	12H	21.79	22.60	22.32	23.09	23.66	22.26	23.07	22.79	23.56	24.12
4H	2H	19.54	20.51	20.04	20.98	21.50	20.32	21.29	20.82	21.76	22.28
	3H	21.23	22.03	21.74	22.54	23.08	21.81	22.61	22.32	23.12	23.66
	4H	21.94	22.66	22.47	23.18	23.76	22.43	23.15	22.96	23.68	24.25
	6H	22.52	23.14	23.08	23.69	24.29	22.91	23.53	23.47	24.08	24.68
	8H	22.71	23.29	23.27	23.84	24.44	23.04	23.62	23.61	24.17	24.77
	12H	22.82	23.33	23.39	23.91	24.51	23.11	23.62	23.69	24.21	24.81
8H	4H	22.17	22.75	22.73	23.29	23.90	22.61	23.19	23.18	23.74	24.34
	6H	22.86	23.33	23.45	23.92	24.53	23.20	23.67	23.79	24.26	24.87
	8H	23.11	23.53	23.72	24.14	24.76	23.39	23.81	24.00	24.42	25.04
	12H	23.27	23.65	23.88	24.24	24.93	23.51	23.88	24.12	24.47	25.17
12H	4H	22.17	22.68	22.75	23.26	23.86	22.61	23.12	23.19	23.70	24.31
	6H	22.88	23.30	23.49	23.91	24.53	23.22	23.64	23.83	24.25	24.87
	8H	23.17	23.55	23.78	24.14	24.83	23.45	23.82	24.06	24.41	25.11

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-1

Test Date: 07/30/2025

Luminaire Tested: EHBR-60-L840-N

Data in this report applies to families of products including EHBR-60-L840-N

**Test Information**

Test Method: LM-79-2019  
 Report Number: SP1-2506-472-1  
 Test Lab: COOPER LIGHTING SOLUTIONS  
 Photometer: SP1 - 76IN SPHERE  
 Measurement Geometry: 4π  
 Issue Date: 08/05/2025  
 Manufacturer: COOPER LIGHTING SOLUTIONS  
 Product Line: Metalux  
 Catalog Number: **EHBR-60-L840-N**  
 Description: Elevate Round Highbay at, 60000 lumens, 4000K 80CRI LEDs with N lens

**Spectral Parameters**

CCT (K): 3898  
 CIE u': 0.2263  
 CIE v': 0.5052  
 Duv: 0.0013  
 CIE x: 0.3861  
 CIE y: 0.3831  
 CIE z: 0.2308  
 Peak Wavelength (nm): 630  
 Dominant Wavelength (nm): 578  
 Purity: 30.85729  
 Rf: 80.7  
 Rg: 102.1

CRI (Ra):	82.1		
R1:	84.4	R9:	38.5
R2:	83.5	R10:	58.9
R3:	80.8	R11:	83.6
R4:	83.9	R12:	54.2
R5:	82.1	R13:	82.8
R6:	77.3	R14:	88.2
R7:	86.4	R15:	81.2
R8:	78.3		



**Test Conditions**

Stabilization Time: 42M  
 Operation Time: 1H 42M  
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-1

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-1

**CIE 1931 Chromaticity Diagram**



**CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles**



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-1

**Photopic Flux vs. Wavelength**



**Photopic Lumens: NR**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	60	NR	620	277	NR	750	6	NR	880	0	NR
365	0	NR	495	87	NR	625	278	NR	755	5	NR	885	0	NR
370	0	NR	500	124	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	168	NR	635	623	NR	765	4	NR	895	0	NR
380	1	NR	510	209	NR	640	162	NR	770	3	NR	900	0	NR
385	1	NR	515	246	NR	645	158	NR	775	3	NR	905	0	NR
390	2	NR	520	273	NR	650	134	NR	780	2	NR	910	0	NR
395	4	NR	525	292	NR	655	109	NR	785	2	NR	915	0	NR
400	5	NR	530	305	NR	660	91	NR	790	2	NR	920	0	NR
405	7	NR	535	313	NR	665	75	NR	795	2	NR	925	0	NR
410	11	NR	540	319	NR	670	70	NR	800	1	NR	930	0	NR
415	21	NR	545	323	NR	675	56	NR	805	1	NR	935	0	NR
420	42	NR	550	326	NR	680	47	NR	810	1	NR	940	0	NR
425	76	NR	555	330	NR	685	41	NR	815	1	NR	945	0	NR
430	125	NR	560	333	NR	690	35	NR	820	1	NR	950	0	NR
435	193	NR	565	336	NR	695	30	NR	825	1	NR	955	0	NR
440	302	NR	570	336	NR	700	26	NR	830	1	NR	960	0	NR
445	432	NR	575	335	NR	705	22	NR	835	1	NR	965	0	NR
450	380	NR	580	332	NR	710	19	NR	840	0	NR	970	0	NR
455	213	NR	585	326	NR	715	16	NR	845	0	NR	975	0	NR
460	147	NR	590	319	NR	720	14	NR	850	0	NR	980	0	NR
465	104	NR	595	307	NR	725	12	NR	855	0	NR	985	0	NR
470	65	NR	600	299	NR	730	10	NR	860	0	NR	990	0	NR
475	50	NR	605	291	NR	735	9	NR	865	0	NR	995	0	NR
480	46	NR	610	317	NR	740	8	NR	870	0	NR	1000	0	NR
485	47	NR	615	336	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-1

**Scotopic Flux vs. Wavelength**



**Scotopic Lumens: NR**

**S/P: 1.55**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	60	NR	620	277	NR	750	6	NR	880	0	NR
365	0	NR	495	87	NR	625	278	NR	755	5	NR	885	0	NR
370	0	NR	500	124	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	168	NR	635	623	NR	765	4	NR	895	0	NR
380	1	NR	510	209	NR	640	162	NR	770	3	NR	900	0	NR
385	1	NR	515	246	NR	645	158	NR	775	3	NR	905	0	NR
390	2	NR	520	273	NR	650	134	NR	780	2	NR	910	0	NR
395	4	NR	525	292	NR	655	109	NR	785	2	NR	915	0	NR
400	5	NR	530	305	NR	660	91	NR	790	2	NR	920	0	NR
405	7	NR	535	313	NR	665	75	NR	795	2	NR	925	0	NR
410	11	NR	540	319	NR	670	70	NR	800	1	NR	930	0	NR
415	21	NR	545	323	NR	675	56	NR	805	1	NR	935	0	NR
420	42	NR	550	326	NR	680	47	NR	810	1	NR	940	0	NR
425	76	NR	555	330	NR	685	41	NR	815	1	NR	945	0	NR
430	125	NR	560	333	NR	690	35	NR	820	1	NR	950	0	NR
435	193	NR	565	336	NR	695	30	NR	825	1	NR	955	0	NR
440	302	NR	570	336	NR	700	26	NR	830	1	NR	960	0	NR
445	432	NR	575	335	NR	705	22	NR	835	1	NR	965	0	NR
450	380	NR	580	332	NR	710	19	NR	840	0	NR	970	0	NR
455	213	NR	585	326	NR	715	16	NR	845	0	NR	975	0	NR
460	147	NR	590	319	NR	720	14	NR	850	0	NR	980	0	NR
465	104	NR	595	307	NR	725	12	NR	855	0	NR	985	0	NR
470	65	NR	600	299	NR	730	10	NR	860	0	NR	990	0	NR
475	50	NR	605	291	NR	735	9	NR	865	0	NR	995	0	NR
480	46	NR	610	317	NR	740	8	NR	870	0	NR	1000	0	NR
485	47	NR	615	336	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-1

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.99

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	60	NR	620	277	NR	750	6	NR	880	0	NR
365	0	NR	495	87	NR	625	278	NR	755	5	NR	885	0	NR
370	0	NR	500	124	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	168	NR	635	623	NR	765	4	NR	895	0	NR
380	1	NR	510	209	NR	640	162	NR	770	3	NR	900	0	NR
385	1	NR	515	246	NR	645	158	NR	775	3	NR	905	0	NR
390	2	NR	520	273	NR	650	134	NR	780	2	NR	910	0	NR
395	4	NR	525	292	NR	655	109	NR	785	2	NR	915	0	NR
400	5	NR	530	305	NR	660	91	NR	790	2	NR	920	0	NR
405	7	NR	535	313	NR	665	75	NR	795	2	NR	925	0	NR
410	11	NR	540	319	NR	670	70	NR	800	1	NR	930	0	NR
415	21	NR	545	323	NR	675	56	NR	805	1	NR	935	0	NR
420	42	NR	550	326	NR	680	47	NR	810	1	NR	940	0	NR
425	76	NR	555	330	NR	685	41	NR	815	1	NR	945	0	NR
430	125	NR	560	333	NR	690	35	NR	820	1	NR	950	0	NR
435	193	NR	565	336	NR	695	30	NR	825	1	NR	955	0	NR
440	302	NR	570	336	NR	700	26	NR	830	1	NR	960	0	NR
445	432	NR	575	335	NR	705	22	NR	835	1	NR	965	0	NR
450	380	NR	580	332	NR	710	19	NR	840	0	NR	970	0	NR
455	213	NR	585	326	NR	715	16	NR	845	0	NR	975	0	NR
460	147	NR	590	319	NR	720	14	NR	850	0	NR	980	0	NR
465	104	NR	595	307	NR	725	12	NR	855	0	NR	985	0	NR
470	65	NR	600	299	NR	730	10	NR	860	0	NR	990	0	NR
475	50	NR	605	291	NR	735	9	NR	865	0	NR	995	0	NR
480	46	NR	610	317	NR	740	8	NR	870	0	NR	1000	0	NR
485	47	NR	615	336	NR	745	7	NR	875	0	NR			

**Summary**

$R_f = 80.7$   
 $R_g = 102.1$   
 CIE  $R_a = 82.1$   
 $R_9 = 38.5$



**Color Vector Graphics**




**Individual Sample Fidelity Index ( $R_{f,i}$ )**

CES01 = 85	CES26 = 69	CES51 = 90	CES76 = 58
CES02 = 61	CES27 = 89	CES52 = 90	CES77 = 76
CES03 = 31	CES28 = 83	CES53 = 80	CES78 = 60
CES04 = 69	CES29 = 66	CES54 = 91	CES79 = 85
CES05 = 48	CES30 = 76	CES55 = 89	CES80 = 79
CES06 = 50	CES31 = 69	CES56 = 79	CES81 = 81
CES07 = 41	CES32 = 62	CES57 = 77	CES82 = 91
CES08 = 40	CES33 = 74	CES58 = 79	CES83 = 88
CES09 = 29	CES34 = 72	CES59 = 93	CES84 = 89
CES10 = 74	CES35 = 84	CES60 = 95	CES85 = 84
CES11 = 57	CES36 = 98	CES61 = 92	CES86 = 82
CES12 = 63	CES37 = 77	CES62 = 89	CES87 = 81
CES13 = 43	CES38 = 83	CES63 = 80	CES88 = 86
CES14 = 74	CES39 = 94	CES64 = 80	CES89 = 79
CES15 = 71	CES40 = 88	CES65 = 77	CES90 = 85
CES16 = 47	CES41 = 89	CES66 = 74	CES91 = 83
CES17 = 49	CES42 = 74	CES67 = 72	CES92 = 77
CES18 = 56	CES43 = 73	CES68 = 78	CES93 = 86
CES19 = 71	CES44 = 98	CES69 = 83	CES94 = 69
CES20 = 65	CES45 = 82	CES70 = 69	CES95 = 80
CES21 = 86	CES46 = 82	CES71 = 64	CES96 = 86
CES22 = 78	CES47 = 80	CES72 = 88	CES97 = 83
CES23 = 91	CES48 = 79	CES73 = 60	CES98 = 81
CES24 = 90	CES49 = 80	CES74 = 98	CES99 = 83
CES25 = 71	CES50 = 89	CES75 = 62	



Color Rendition by Hue-Angle Bin

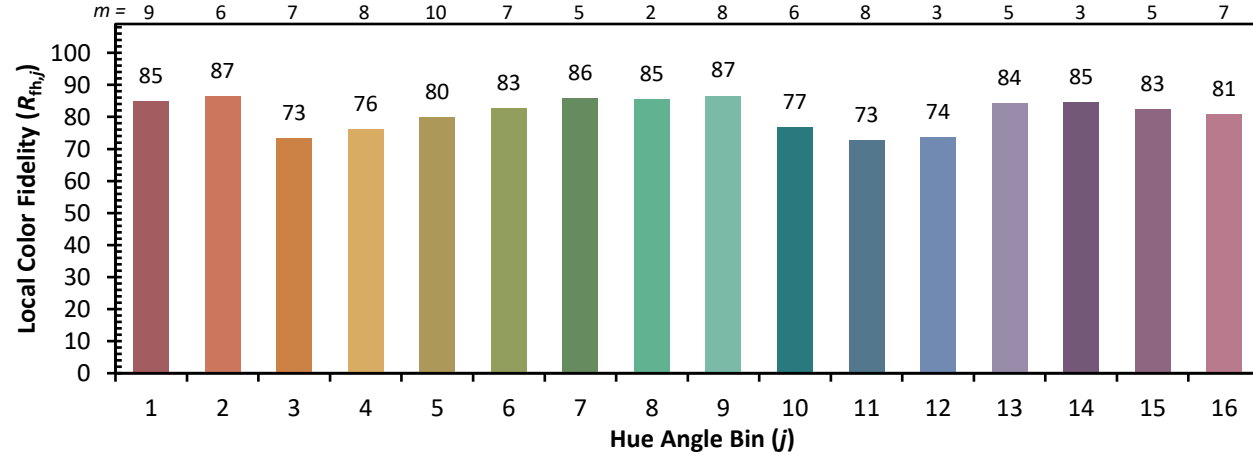

Measure Comparisons



(END OF REPORT)