

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1432878

Luminaire Tested: EHBR1-18-UNV-TASM-L850-UPL24

Issue Date: 3/20/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1432878  
REPORT IS A COMBINATION OF REPORTS P1431679 AND P1431635  
Test Lab: INNOVATION CENTER  
Issue Date: 3/20/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: METALUX  
Catalog Number: EHBR1-18-UNV-TASM-L850-UPL24  
Description: Elevate Round Highbay at, 18000 lumens, 5000K 80CRI LEDs with TASM lens  
Light Source: -  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 20417.1 lumens  
Efficiency: N/A  
Efficacy: 183.6 lumens/watt  
Spacing Criteria (0/90/45): 0.99 / 0.84 / 0.9  
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')  
CIE Type: Semi-Direct

Input Watts (W): 111.2  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1432878  
CATALOG NUMBER: EHBR1-18-UNV-TASM-L850-UPL24

### Luminous Intensity Polar Plot

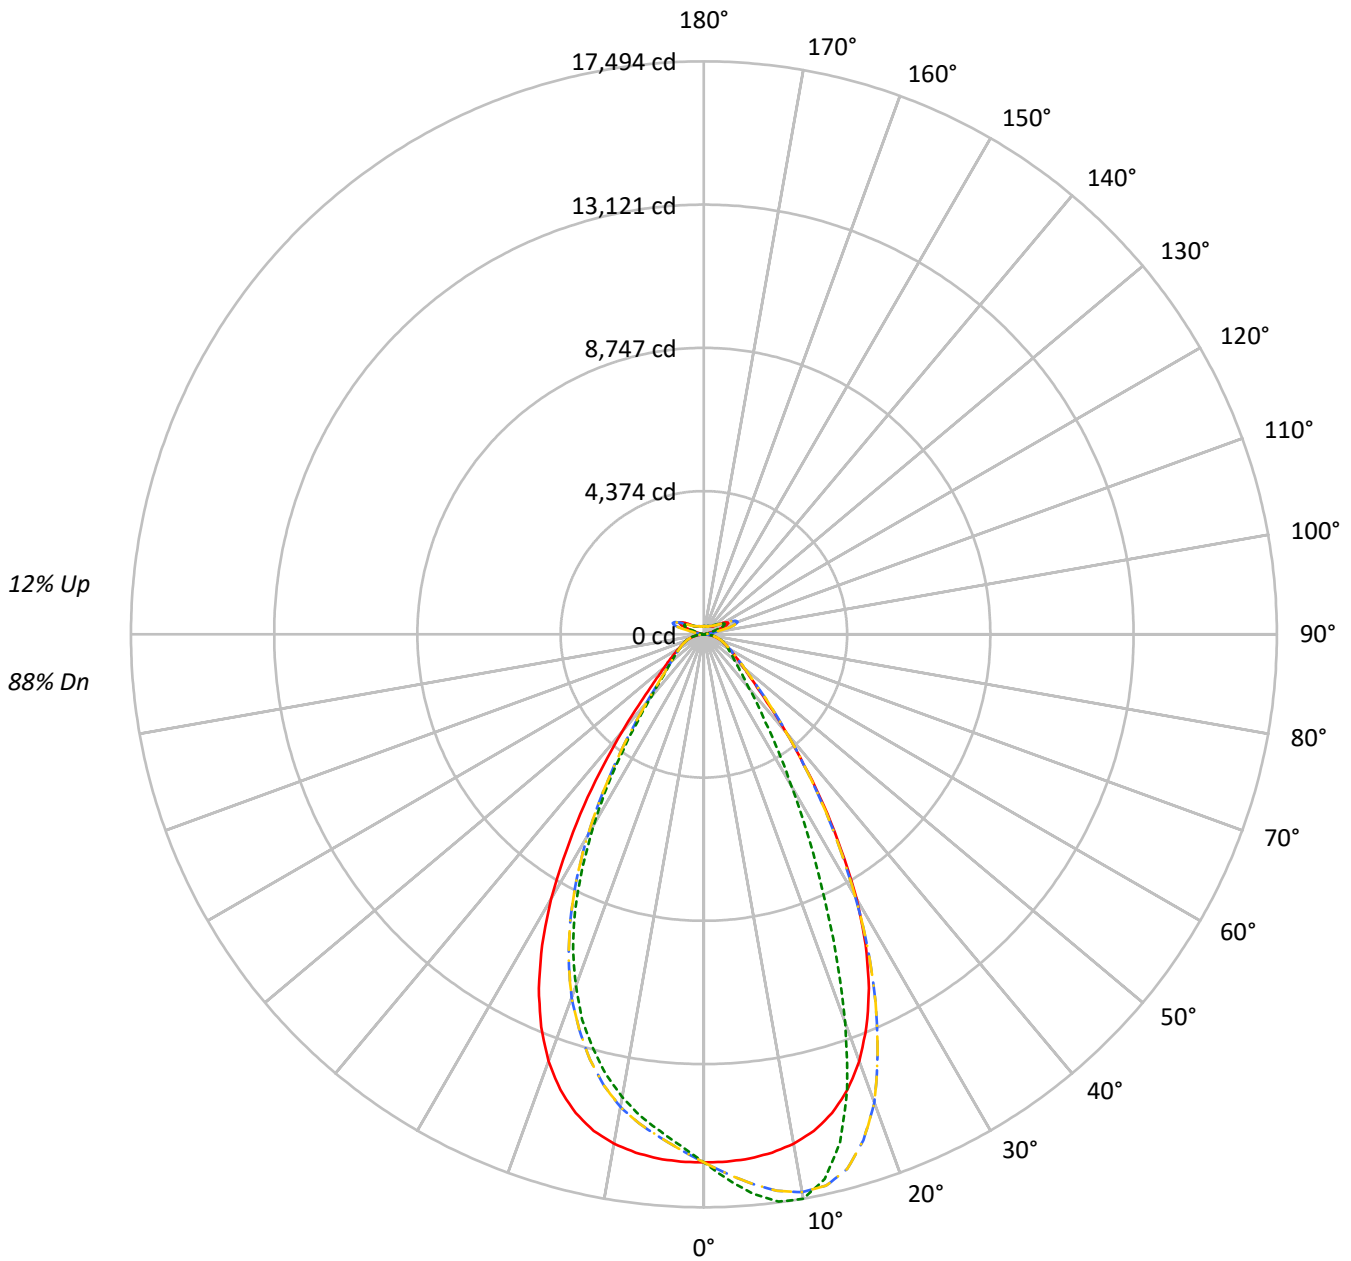

— 0°-180°    - - 45°-225°    - · - 90°-270°    - · - 135°-315°



TEST NUMBER: P1432878

CATALOG NUMBER: EHBR1-18-UNV-TASM-L850-UPL24

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	116	116	116	116	112	112	112	112	105	105	105	98	98	98	91	91	91	88			88
1	109	105	102	99	105	102	99	97	96	94	92	90	88	87	85	84	82				80
2	102	96	91	87	98	93	89	85	88	84	81	83	80	78	79	76	74				72
3	95	88	82	77	92	85	80	75	81	76	73	77	73	70	73	70	68				65
4	90	80	74	69	87	79	72	68	75	70	66	71	67	64	68	65	62				60
5	84	74	67	62	81	73	66	62	69	64	60	66	62	58	64	60	57				55
6	79	69	62	57	77	67	61	56	65	59	55	62	57	54	60	56	52				50
7	75	64	57	52	72	63	56	52	60	55	51	58	53	50	56	52	49				47
8	71	60	53	48	69	59	52	48	57	51	47	55	50	46	53	48	45				44
9	67	56	49	45	65	55	49	44	53	48	44	51	46	43	50	45	42				41
10	63	53	46	42	62	52	46	42	50	45	41	48	44	40	47	43	40				38

**AVERAGE LUMINANCE (cd/sqm):**

	0°	90°	180°	270°
0°	75712	75712	75712	75712
5°	75251	80278	75251	71346
10°	74326	82340	74326	67523
15°	72131	76519	72131	62373
20°	67461	61358	67461	55557
25°	59708	42512	59708	46559
30°	48481	27657	48481	34836
35°	34772	17911	34772	23191
40°	22481	12346	22481	14625
45°	14264	9563	14264	10421
50°	10593	8126	10593	8680
55°	8648	7403	8648	7662
60°	7489	7051	7489	7094
65°	6827	6800	6827	6773
70°	6471	6664	6471	6577
75°	6050	6446	6050	6253
80°	5317	6085	5317	5689
85°	3439	4344	3439	4143

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 22.5°  
 Vertical Angle: 45°  
 Luminance: 20054 cd/sqm



TEST NUMBER: P1432878

CATALOG NUMBER: EHBR1-18-UNV-TASM-L850-UPL24

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1533.0	7.5
10°-20°	4170.6	20.4
20°-30°	4891.2	24.0
30°-40°	3401.6	16.7
40°-50°	1690.4	8.3
50°-60°	1011.0	5.0
60°-70°	711.6	3.5
70°-80°	458.4	2.2
80°-90°	149.8	0.7
90°-100°	63.7	0.3
100°-110°	417.6	2.0
110°-120°	771.7	3.8
120°-130°	458.5	2.2
130°-140°	277.0	1.4
140°-150°	191.4	0.9
150°-160°	124.6	0.6
160°-170°	71.3	0.3
170°-180°	23.6	0.1
0°-30°	10594.8	51.9
0°-40°	13996.3	68.6
0°-60°	16697.8	81.8
0°-90°	18017.6	88.2
90°-120°	1253.1	6.1
90°-150°	2179.9	10.7
90°-180°	2399.0	11.7
0°-180°	20417.1	100.0

**CANDELA DISTRIBUTION:**

	0°	90°	180°	270°	360°	Flux
0°	16122	16122	16122	16122	16122	
5°	16067	17141	16067	15234	16067	1525
15°	15133	16053	15133	13086	15133	4229
25°	11924	8490	11924	9298	11924	5398
35°	6382	3287	6382	4256	6382	3984
45°	2308	1547	2308	1686	2308	1889
55°	1169	1000	1169	1035	1169	1069
65°	713	710	713	707	713	716
75°	426	454	426	440	426	447
85°	118	149	118	142	118	131
90°	18	20	18	18	18	14
95°	34	32	34	30	34	36
105°	192	97	192	145	192	259
115°	821	701	821	667	821	749
125°	526	550	526	482	526	484
135°	332	383	332	352	332	263
145°	300	313	300	291	300	188
155°	266	278	266	258	266	124
165°	250	257	250	245	250	71
175°	248	252	248	244	248	24
180°	248	248	248	248	248	



TEST NUMBER: P1432878  
 CATALOG NUMBER: EHBR1-18-UNV-TASM-L850-UPL24

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°	202.5°	225°
0°	16122.3	16122.3	16122.3	16122.3	16122.3	16122.3	16122.3	16122.3	16122.3	16122.3	16122.3
2.5°	16112.9	16321.2	16489.9	16601.2	16656.2	16601.2	16489.9	16321.2	16112.9	15905.8	15763.5
5°	16067.3	16484.5	16837.9	17069.1	17140.7	17069.1	16837.9	16484.5	16067.3	15673.1	15411.5
7.5°	15958.2	16608.1	17133.3	17403.2	17469.1	17403.2	17133.3	16608.1	15958.2	15400.0	15069.7
10°	15791.6	16686.1	17292.9	17486.3	17494.2	17486.3	17292.9	16686.1	15791.6	15039.7	14650.0
12.5°	15525.8	16658.3	17239.4	17175.9	17031.6	17175.9	17239.4	16658.3	15525.8	14599.5	14108.0
15°	15132.8	16493.5	16900.5	16383.8	16053.3	16383.8	16900.5	16493.5	15132.8	14005.1	13435.0
17.5°	14579.0	16185.2	16193.0	15170.9	14547.5	15170.9	16193.0	16185.2	14579.0	13278.3	12650.5
20°	13865.2	15690.6	15219.0	13349.5	12610.9	13349.5	15219.0	15690.6	13865.2	12419.2	11803.1
22.5°	12970.3	15023.7	13862.4	11517.1	10509.4	11517.1	13862.4	15023.7	12970.3	11420.0	10778.8
25°	11923.7	14206.5	12403.2	9520.5	8489.7	9520.5	12403.2	14206.5	11923.7	10229.5	9649.6
27.5°	10692.6	13170.8	10849.3	7779.8	6828.8	7779.8	10849.3	13170.8	10692.6	9000.3	8408.1
30°	9325.3	11843.0	9232.1	6195.7	5319.8	6195.7	9232.1	11843.0	9325.3	7619.3	7089.1
32.5°	7794.4	10541.6	7679.1	4964.3	4222.5	4964.3	7679.1	10541.6	7794.4	6301.5	5747.3
35°	6381.9	8913.2	6278.9	3900.8	3287.4	3900.8	6278.9	8913.2	6381.9	5057.5	4513.3
37.5°	5008.5	7374.7	5005.2	3141.1	2666.5	3141.1	5005.2	7374.7	5008.5	3932.0	3490.2
40°	3896.6	5766.4	3921.6	2507.4	2139.8	2507.4	3921.6	5766.4	3896.6	2991.7	2709.1
42.5°	2952.4	4409.3	3082.5	2057.9	1817.5	2057.9	3082.5	4409.3	2952.4	2357.1	2145.5
45°	2307.9	3244.7	2407.0	1736.2	1547.2	1736.2	2407.0	3244.7	2307.9	1898.3	1756.2
47.5°	1879.5	2507.7	1950.8	1489.2	1356.8	1489.2	1950.8	2507.7	1879.5	1605.6	1499.2
50°	1578.7	1924.2	1619.8	1300.0	1211.1	1300.0	1619.8	1924.2	1578.7	1374.9	1303.9
52.5°	1356.2	1569.3	1379.4	1158.5	1098.6	1158.5	1379.4	1569.3	1356.2	1202.9	1158.8
55°	1168.7	1319.3	1199.6	1041.8	1000.4	1041.8	1199.6	1319.3	1168.7	1070.5	1037.9
57.5°	1026.4	1119.1	1041.8	942.3	914.8	942.3	1041.8	1119.1	1026.4	952.6	935.1
60°	900.3	969.2	919.3	855.6	847.7	855.6	919.3	969.2	900.3	857.1	845.6
62.5°	803.2	846.7	813.0	777.6	770.6	777.6	813.0	846.7	803.2	770.0	772.1
65°	712.6	753.0	726.5	707.5	709.8	707.5	726.5	753.0	712.6	697.1	700.5
67.5°	642.4	663.5	652.1	641.2	643.9	641.2	652.1	663.5	642.4	627.3	632.4
70°	567.8	590.5	578.7	580.1	584.7	580.1	578.7	590.5	567.8	563.3	567.2
72.5°	496.4	513.9	510.0	513.6	518.5	513.6	510.0	513.9	496.4	495.8	496.1
75°	426.2	439.6	441.3	446.6	454.1	446.6	441.3	439.6	426.2	421.7	427.2
77.5°	349.8	364.9	370.6	377.6	388.8	377.6	370.6	364.9	349.8	352.8	355.5
80°	279.7	286.6	299.3	304.4	320.1	304.4	299.3	286.6	279.7	274.6	278.5
82.5°	204.7	211.0	221.9	231.5	240.7	231.5	221.9	211.0	204.7	202.3	202.6
85°	118.2	127.9	135.2	146.7	149.3	146.7	135.2	127.9	118.2	120.9	118.2
87.5°	41.5	44.4	50.8	55.3	55.6	55.3	50.8	44.4	41.5	42.3	38.4
90°	17.6	29.8	51.4	28.3	19.7	28.3	51.4	29.8	17.6	30.8	48.1
92.5°	22.9	40.4	72.6	37.6	26.3	37.6	72.6	40.4	22.9	40.1	77.3
95°	33.8	49.7	92.5	41.6	31.6	41.6	92.5	49.7	33.8	53.4	107.9
97.5°	52.4	61.7	104.4	44.3	38.3	44.3	104.4	61.7	52.4	65.3	123.8
100°	69.6	69.6	190.8	50.9	43.6	50.9	190.8	69.6	69.6	80.3	192.8
102.5°	105.5	136.3	441.9	101.8	52.9	101.8	441.9	136.3	105.5	150.6	409.2
105°	191.7	311.6	777.9	262.4	97.1	262.4	777.9	311.6	191.7	315.2	729.2
107.5°	363.1	581.0	1002.2	517.3	225.8	517.3	1002.2	581.0	363.1	558.2	961.8
110°	580.7	812.1	1093.8	708.4	456.8	708.4	1093.8	812.1	580.7	766.7	1008.2



TEST NUMBER: P1432878  
 CATALOG NUMBER: EHBR1-18-UNV-TASM-L850-UPL24

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°	202.5°	225°
112.5°	756.0	905.0	1068.6	785.4	632.0	785.4	1068.6	905.0	756.0	846.3	965.8
115°	821.4	891.7	954.4	782.8	701.1	782.8	954.4	891.7	821.4	826.4	862.3
117.5°	793.5	816.1	824.3	735.1	705.1	735.1	824.3	816.1	793.5	743.0	732.1
120°	716.5	707.2	694.5	664.6	665.2	664.6	694.5	707.2	716.5	648.8	611.3
122.5°	619.8	600.0	586.9	593.2	610.8	593.2	586.9	600.0	619.8	552.2	524.0
125°	525.6	505.7	511.6	532.2	550.0	532.2	511.6	505.7	525.6	468.9	461.9
127.5°	446.3	436.9	457.2	480.4	495.6	480.4	457.2	436.9	446.3	410.4	418.1
130°	389.5	391.8	418.7	438.2	447.8	438.2	418.7	391.8	389.5	372.2	390.5
132.5°	354.0	364.2	389.9	406.7	412.3	406.7	389.9	364.2	354.0	349.0	371.2
135°	331.7	346.9	370.2	381.1	383.0	381.1	370.2	346.9	331.7	333.3	354.0
137.5°	318.8	334.1	351.7	360.2	357.9	360.2	351.7	334.1	318.8	323.0	338.6
140°	311.1	326.4	334.4	344.3	342.1	344.3	334.4	326.4	311.1	313.7	325.6
142.5°	303.4	317.4	321.4	328.6	326.2	328.6	321.4	317.4	303.4	306.1	314.0
145°	299.7	310.0	307.1	316.7	313.3	316.7	307.1	310.0	299.7	300.8	305.0
147.5°	293.0	300.8	296.8	305.0	301.7	305.0	296.8	300.8	293.0	293.0	294.7
150°	285.4	290.7	285.1	294.7	293.9	294.7	285.1	290.7	285.4	284.1	285.7
152.5°	275.0	280.3	275.0	285.9	285.0	285.9	275.0	280.3	275.0	273.8	275.3
155°	266.4	269.1	266.4	277.3	277.6	277.3	266.4	269.1	266.4	266.1	266.7
157.5°	260.3	262.0	260.6	270.3	270.6	270.3	260.6	262.0	260.3	260.3	260.6
160°	254.9	257.6	256.6	264.8	265.1	264.8	256.6	257.6	254.9	256.0	256.3
162.5°	252.8	252.8	252.2	260.4	261.0	260.4	252.2	252.8	252.8	252.8	254.2
165°	249.8	251.1	249.0	254.9	257.0	254.9	249.0	251.1	249.8	250.8	250.8
167.5°	249.0	247.7	248.3	253.2	255.2	253.2	248.3	247.7	249.0	250.1	250.1
170°	246.7	247.0	246.4	251.2	253.1	251.2	246.4	247.0	246.7	248.0	249.0
172.5°	247.6	247.6	245.9	249.4	252.6	249.4	245.9	247.6	247.6	248.6	249.9
175°	248.2	247.2	246.5	248.7	252.0	248.7	246.5	247.2	248.2	247.9	247.9
177.5°	247.0	247.5	248.1	250.3	254.9	250.3	248.1	247.5	247.0	247.9	247.9
180°	247.5	247.5	247.5	247.5	247.5	247.5	247.5	247.5	247.5	247.5	247.5



TEST NUMBER: P1432878

CATALOG NUMBER: EHBR1-18-UNV-TASM-L850-UPL24

**CANDELA DISTRIBUTION (continued):**

	247.5°	270°	292.5°	315°	337.5°	360°
0°	16122.3	16122.3	16122.3	16122.3	16122.3	16122.3
2.5°	15654.0	15643.7	15654.0	15763.5	15905.8	16112.9
5°	15290.3	15233.5	15290.3	15411.5	15673.1	16067.3
7.5°	14866.7	14833.8	14866.7	15069.7	15400.0	15958.2
10°	14420.9	14346.2	14420.9	14650.0	15039.7	15791.6
12.5°	13871.3	13772.3	13871.3	14108.0	14599.5	15525.8
15°	13172.3	13085.5	13172.3	13435.0	14005.1	15132.8
17.5°	12422.3	12343.6	12422.3	12650.5	13278.3	14579.0
20°	11480.2	11418.5	11480.2	11803.1	12419.2	13865.2
22.5°	10491.9	10434.2	10491.9	10778.8	11420.0	12970.3
25°	9329.2	9297.8	9329.2	9649.6	10229.5	11923.7
27.5°	8072.7	8019.3	8072.7	8408.1	9000.3	10692.6
30°	6789.2	6700.6	6789.2	7089.1	7619.3	9325.3
32.5°	5533.6	5469.8	5533.6	5747.3	6301.5	7794.4
35°	4320.2	4256.3	4320.2	4513.3	5057.5	6381.9
37.5°	3366.3	3253.6	3366.3	3490.2	3932.0	5008.5
40°	2553.1	2534.9	2553.1	2709.1	2991.7	3896.6
42.5°	2078.4	2029.1	2078.4	2145.5	2357.1	2952.4
45°	1705.4	1686.0	1705.4	1756.2	1898.3	2307.9
47.5°	1466.6	1475.0	1466.6	1499.2	1605.6	1879.5
50°	1288.5	1293.6	1288.5	1303.9	1374.9	1578.7
52.5°	1157.2	1152.7	1157.2	1158.8	1202.9	1356.2
55°	1041.1	1035.4	1041.1	1037.9	1070.5	1168.7
57.5°	939.6	943.8	939.6	935.1	952.6	1026.4
60°	848.9	852.8	848.9	845.6	857.1	900.3
62.5°	772.4	774.8	772.4	772.1	770.0	803.2
65°	704.1	706.9	704.1	700.5	697.1	712.6
67.5°	638.8	638.8	638.8	632.4	627.3	642.4
70°	577.4	577.1	577.4	567.2	563.3	567.8
72.5°	503.6	510.9	503.6	496.1	495.8	496.4
75°	432.0	440.5	432.0	427.2	421.7	426.2
77.5°	359.4	372.5	359.4	355.5	352.8	349.8
80°	285.1	299.3	285.1	278.5	274.6	279.7
82.5°	210.7	221.3	210.7	202.6	202.3	204.7
85°	125.4	142.4	125.4	118.2	120.9	118.2
87.5°	40.2	51.4	40.2	38.4	42.3	41.5
90°	28.2	17.6	28.2	48.1	30.8	17.6
92.5°	42.8	25.5	42.8	77.3	40.1	22.9
95°	49.4	29.5	49.4	107.9	53.4	33.8
97.5°	54.7	37.7	54.7	123.8	65.3	52.4
100°	64.0	49.7	64.0	192.8	80.3	69.6
102.5°	135.8	84.2	135.8	409.2	150.6	105.5
105°	285.8	145.3	285.8	729.2	315.2	191.7
107.5°	511.5	251.5	511.5	961.8	558.2	363.1
110°	678.7	469.2	678.7	1008.2	766.7	580.7



TEST NUMBER: P1432878

CATALOG NUMBER: EHBR1-18-UNV-TASM-L850-UPL24

**CANDELA DISTRIBUTION (continued):**

	247.5°	270°	292.5°	315°	337.5°	360°
112.5°	729.2	633.9	729.2	965.8	846.3	756.0
115°	701.3	667.1	701.3	862.3	826.4	821.4
117.5°	640.3	644.5	640.3	732.1	743.0	793.5
120°	569.8	596.7	569.8	611.3	648.8	716.5
122.5°	505.1	536.9	505.1	524.0	552.2	619.8
125°	449.3	481.5	449.3	461.9	468.9	525.6
127.5°	410.8	432.4	410.8	418.1	410.4	446.3
130°	380.5	399.2	380.5	390.5	372.2	389.5
132.5°	359.6	371.6	359.6	371.2	349.0	354.0
135°	341.3	351.7	341.3	354.0	333.3	331.7
137.5°	325.7	334.7	325.7	338.6	323.0	318.8
140°	311.8	319.4	311.8	325.6	313.7	311.1
142.5°	297.4	302.8	297.4	314.0	306.1	303.4
145°	287.4	291.4	287.4	305.0	300.8	299.7
147.5°	278.8	281.4	278.8	294.7	293.0	293.0
150°	270.0	272.7	270.0	285.7	284.1	285.4
152.5°	261.1	264.0	261.1	275.3	273.8	275.0
155°	255.0	258.0	255.0	266.7	266.1	266.4
157.5°	251.7	253.6	251.7	260.6	260.3	260.3
160°	248.6	250.2	248.6	256.3	256.0	254.9
162.5°	245.2	246.9	245.2	254.2	252.8	252.8
165°	244.5	244.8	244.5	250.8	250.8	249.8
167.5°	243.4	244.8	243.4	250.1	250.1	249.0
170°	243.7	244.0	243.7	249.0	248.0	246.7
172.5°	244.3	244.6	244.3	249.9	248.6	247.6
175°	243.7	244.0	243.7	247.9	247.9	248.2
177.5°	245.3	245.6	245.3	247.9	247.9	247.0
180°	247.5	247.5	247.5	247.5	247.5	247.5



TEST NUMBER: P1432878  
 CATALOG NUMBER: EHBR1-18-UNV-TASM-L850-UPL24

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.27	16.31	15.83	16.85	17.45	14.59	15.63	15.15	16.17	16.77
	3H	16.81	17.74	17.39	18.30	18.94	16.43	17.36	17.01	17.92	18.56
	4H	17.45	18.31	18.05	18.88	19.54	17.21	18.08	17.81	18.65	19.31
	6H	17.93	18.72	18.54	19.31	19.98	17.85	18.65	18.46	19.23	19.90
	8H	18.08	18.83	18.70	19.43	20.11	18.07	18.82	18.70	19.43	20.11
	12H	18.15	18.86	18.77	19.46	20.16	18.20	18.92	18.82	19.51	20.21
4H	2H	15.68	16.54	16.28	17.12	17.78	15.16	16.02	15.76	16.59	17.25
	3H	17.47	18.19	18.08	18.80	19.48	17.21	17.93	17.82	18.54	19.22
	4H	18.25	18.89	18.87	19.51	20.22	18.12	18.76	18.75	19.39	20.10
	6H	18.86	19.41	19.51	20.06	20.79	18.89	19.44	19.54	20.09	20.82
	8H	19.05	19.57	19.71	20.22	20.95	19.16	19.67	19.81	20.32	21.05
	12H	19.16	19.62	19.83	20.29	21.03	19.32	19.78	19.99	20.45	21.19
8H	4H	18.49	19.01	19.15	19.66	20.39	18.39	18.91	19.05	19.56	20.29
	6H	19.23	19.65	19.92	20.35	21.08	19.30	19.72	19.98	20.41	21.15
	8H	19.50	19.88	20.21	20.58	21.33	19.65	20.03	20.35	20.73	21.48
	12H	19.67	20.00	20.37	20.68	21.51	19.90	20.23	20.60	20.91	21.73
12H	4H	18.50	18.96	19.17	19.63	20.37	18.40	18.86	19.08	19.54	20.27
	6H	19.28	19.65	19.98	20.35	21.10	19.34	19.72	20.05	20.42	21.17
	8H	19.59	19.92	20.29	20.60	21.42	19.75	20.07	20.44	20.76	21.58

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-4

Test Date: 07/31/2025

Luminaire Tested: EHBR-60-L850-N

Data in this report applies to families of products including EHBR-60-L850-N

**Test Information**

Test Method: LM-79-2019  
 Report Number: SP1-2506-472-4  
 Test Lab: COOPER LIGHTING SOLUTIONS  
 Photometer: SP1 - 76IN SPHERE  
 Measurement Geometry: 4π  
 Issue Date: 08/05/2025  
 Manufacturer: COOPER LIGHTING SOLUTIONS  
 Product Line: Metalux  
 Catalog Number: **EHBR-60-L850-N**  
 Description: Elevate Round Highbay at, 60000 lumens, 5000K 80CRI LEDs with N lens

**Spectral Parameters**

CCT (K): 4875  
 CIE u': 0.2124  
 CIE v': 0.4871  
 Duv: 0.0005  
 CIE x: 0.3488  
 CIE y: 0.3555  
 CIE z: 0.2957  
 Peak Wavelength (nm): 630  
 Dominant Wavelength (nm): 573  
 Purity: 11.33556  
 Rf: 80  
 Rg: 102.3

CRI (Ra):	82.3		
R1:	85.0	R9:	43.9
R2:	83.1	R10:	57.4
R3:	78.8	R11:	83.1
R4:	84.0	R12:	51.0
R5:	83.0	R13:	83.4
R6:	76.3	R14:	87.4
R7:	86.8	R15:	83.4
R8:	81.7		



**Test Conditions**

Stabilization Time: 39M  
 Operation Time: 1H 39M  
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-4

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-4

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-4

**Photopic Flux vs. Wavelength**



**Photopic Lumens: NR**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	89	NR	620	280	NR	750	6	NR	880	0	NR
365	0	NR	495	121	NR	625	280	NR	755	5	NR	885	0	NR
370	0	NR	500	168	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	224	NR	635	626	NR	765	4	NR	895	0	NR
380	1	NR	510	275	NR	640	163	NR	770	4	NR	900	0	NR
385	2	NR	515	321	NR	645	160	NR	775	3	NR	905	0	NR
390	3	NR	520	354	NR	650	136	NR	780	3	NR	910	0	NR
395	5	NR	525	375	NR	655	111	NR	785	2	NR	915	0	NR
400	7	NR	530	388	NR	660	93	NR	790	2	NR	920	0	NR
405	10	NR	535	395	NR	665	76	NR	795	2	NR	925	0	NR
410	15	NR	540	397	NR	670	72	NR	800	2	NR	930	0	NR
415	28	NR	545	398	NR	675	57	NR	805	1	NR	935	0	NR
420	53	NR	550	396	NR	680	49	NR	810	1	NR	940	0	NR
425	97	NR	555	395	NR	685	42	NR	815	1	NR	945	0	NR
430	163	NR	560	392	NR	690	37	NR	820	1	NR	950	0	NR
435	261	NR	565	388	NR	695	32	NR	825	1	NR	955	0	NR
440	409	NR	570	381	NR	700	27	NR	830	1	NR	960	0	NR
445	637	NR	575	374	NR	705	23	NR	835	1	NR	965	0	NR
450	699	NR	580	365	NR	710	20	NR	840	1	NR	970	0	NR
455	436	NR	585	354	NR	715	17	NR	845	0	NR	975	0	NR
460	274	NR	590	342	NR	720	15	NR	850	0	NR	980	0	NR
465	205	NR	595	325	NR	725	13	NR	855	0	NR	985	0	NR
470	130	NR	600	313	NR	730	11	NR	860	0	NR	990	0	NR
475	90	NR	605	301	NR	735	10	NR	865	0	NR	995	0	NR
480	78	NR	610	323	NR	740	8	NR	870	0	NR	1000	0	NR
485	77	NR	615	340	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-4

**Scotopic Flux vs. Wavelength**



**Scotopic Lumens: NR**

**S/P: 1.82**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	89	NR	620	280	NR	750	6	NR	880	0	NR
365	0	NR	495	121	NR	625	280	NR	755	5	NR	885	0	NR
370	0	NR	500	168	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	224	NR	635	626	NR	765	4	NR	895	0	NR
380	1	NR	510	275	NR	640	163	NR	770	4	NR	900	0	NR
385	2	NR	515	321	NR	645	160	NR	775	3	NR	905	0	NR
390	3	NR	520	354	NR	650	136	NR	780	3	NR	910	0	NR
395	5	NR	525	375	NR	655	111	NR	785	2	NR	915	0	NR
400	7	NR	530	388	NR	660	93	NR	790	2	NR	920	0	NR
405	10	NR	535	395	NR	665	76	NR	795	2	NR	925	0	NR
410	15	NR	540	397	NR	670	72	NR	800	2	NR	930	0	NR
415	28	NR	545	398	NR	675	57	NR	805	1	NR	935	0	NR
420	53	NR	550	396	NR	680	49	NR	810	1	NR	940	0	NR
425	97	NR	555	395	NR	685	42	NR	815	1	NR	945	0	NR
430	163	NR	560	392	NR	690	37	NR	820	1	NR	950	0	NR
435	261	NR	565	388	NR	695	32	NR	825	1	NR	955	0	NR
440	409	NR	570	381	NR	700	27	NR	830	1	NR	960	0	NR
445	637	NR	575	374	NR	705	23	NR	835	1	NR	965	0	NR
450	699	NR	580	365	NR	710	20	NR	840	1	NR	970	0	NR
455	436	NR	585	354	NR	715	17	NR	845	0	NR	975	0	NR
460	274	NR	590	342	NR	720	15	NR	850	0	NR	980	0	NR
465	205	NR	595	325	NR	725	13	NR	855	0	NR	985	0	NR
470	130	NR	600	313	NR	730	11	NR	860	0	NR	990	0	NR
475	90	NR	605	301	NR	735	10	NR	865	0	NR	995	0	NR
480	78	NR	610	323	NR	740	8	NR	870	0	NR	1000	0	NR
485	77	NR	615	340	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-4

**Melanopic Flux vs. Wavelength**



**Melanopic Lumens: NR**

**M/P: 3.71**


λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	89	NR	620	280	NR	750	6	NR	880	0	NR
365	0	NR	495	121	NR	625	280	NR	755	5	NR	885	0	NR
370	0	NR	500	168	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	224	NR	635	626	NR	765	4	NR	895	0	NR
380	1	NR	510	275	NR	640	163	NR	770	4	NR	900	0	NR
385	2	NR	515	321	NR	645	160	NR	775	3	NR	905	0	NR
390	3	NR	520	354	NR	650	136	NR	780	3	NR	910	0	NR
395	5	NR	525	375	NR	655	111	NR	785	2	NR	915	0	NR
400	7	NR	530	388	NR	660	93	NR	790	2	NR	920	0	NR
405	10	NR	535	395	NR	665	76	NR	795	2	NR	925	0	NR
410	15	NR	540	397	NR	670	72	NR	800	2	NR	930	0	NR
415	28	NR	545	398	NR	675	57	NR	805	1	NR	935	0	NR
420	53	NR	550	396	NR	680	49	NR	810	1	NR	940	0	NR
425	97	NR	555	395	NR	685	42	NR	815	1	NR	945	0	NR
430	163	NR	560	392	NR	690	37	NR	820	1	NR	950	0	NR
435	261	NR	565	388	NR	695	32	NR	825	1	NR	955	0	NR
440	409	NR	570	381	NR	700	27	NR	830	1	NR	960	0	NR
445	637	NR	575	374	NR	705	23	NR	835	1	NR	965	0	NR
450	699	NR	580	365	NR	710	20	NR	840	1	NR	970	0	NR
455	436	NR	585	354	NR	715	17	NR	845	0	NR	975	0	NR
460	274	NR	590	342	NR	720	15	NR	850	0	NR	980	0	NR
465	205	NR	595	325	NR	725	13	NR	855	0	NR	985	0	NR
470	130	NR	600	313	NR	730	11	NR	860	0	NR	990	0	NR
475	90	NR	605	301	NR	735	10	NR	865	0	NR	995	0	NR
480	78	NR	610	323	NR	740	8	NR	870	0	NR	1000	0	NR
485	77	NR	615	340	NR	745	7	NR	875	0	NR			

**Summary**

$R_f = 80$   
 $R_g = 102.3$   
 $CIE R_a = 82.3$   
 $R_9 = 43.9$



**Color Vector Graphics**

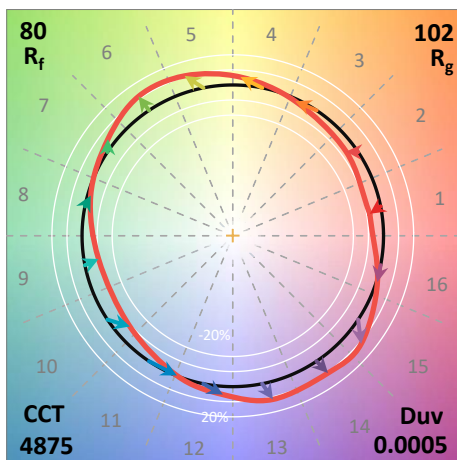


**Individual Sample Fidelity Index ( $R_{f,i}$ )**

CES01 = 85	CES26 = 67	CES51 = 92	CES76 = 54
CES02 = 60	CES27 = 88	CES52 = 91	CES77 = 71
CES03 = 31	CES28 = 81	CES53 = 82	CES78 = 55
CES04 = 69	CES29 = 66	CES54 = 92	CES79 = 81
CES05 = 47	CES30 = 80	CES55 = 90	CES80 = 75
CES06 = 50	CES31 = 69	CES56 = 81	CES81 = 79
CES07 = 40	CES32 = 61	CES57 = 80	CES82 = 90
CES08 = 39	CES33 = 76	CES58 = 81	CES83 = 87
CES09 = 29	CES34 = 68	CES59 = 93	CES84 = 87
CES10 = 73	CES35 = 82	CES60 = 94	CES85 = 82
CES11 = 56	CES36 = 95	CES61 = 91	CES86 = 83
CES12 = 62	CES37 = 75	CES62 = 89	CES87 = 78
CES13 = 42	CES38 = 87	CES63 = 80	CES88 = 85
CES14 = 74	CES39 = 94	CES64 = 79	CES89 = 81
CES15 = 71	CES40 = 87	CES65 = 75	CES90 = 86
CES16 = 46	CES41 = 91	CES66 = 72	CES91 = 80
CES17 = 48	CES42 = 71	CES67 = 69	CES92 = 77
CES18 = 56	CES43 = 72	CES68 = 75	CES93 = 86
CES19 = 70	CES44 = 99	CES69 = 80	CES94 = 71
CES20 = 65	CES45 = 81	CES70 = 66	CES95 = 79
CES21 = 85	CES46 = 83	CES71 = 59	CES96 = 86
CES22 = 77	CES47 = 83	CES72 = 87	CES97 = 85
CES23 = 91	CES48 = 83	CES73 = 56	CES98 = 82
CES24 = 90	CES49 = 82	CES74 = 95	CES99 = 84
CES25 = 71	CES50 = 91	CES75 = 58	



Color Rendition by Hue-Angle Bin

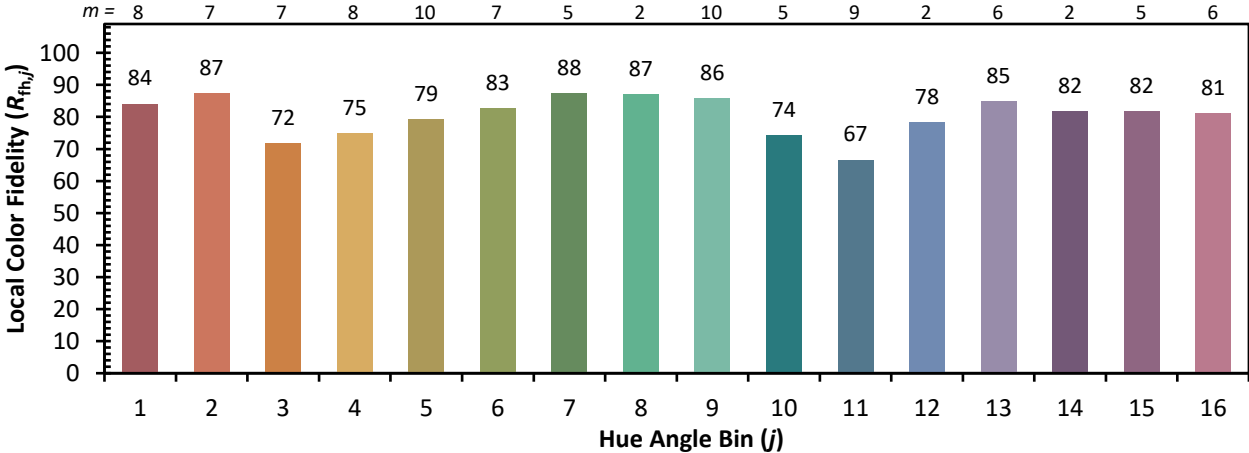

Measure Comparisons



(END OF REPORT)