

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1436399

Luminaire Tested: EHBR1-54-UNV-M-L850-UPL30

Issue Date: 3/25/2026

Test Information

Test Method: LM-79-2019
Report Number: P1436399
REPORT IS A COMBINATION OF REPORTS P1436111 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/25/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-54-UNV-M-L850-UPL30
Description: Elevate Round Highbay at, 54000 lumens, 5000K 80CRI LEDs with M lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 55982.4 lumens
Efficiency: N/A
Efficacy: 176.0 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.15
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 318
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1436399
CATALOG NUMBER: EHBR1-54-UNV-M-L850-UPL30

Luminous Intensity Polar Plot

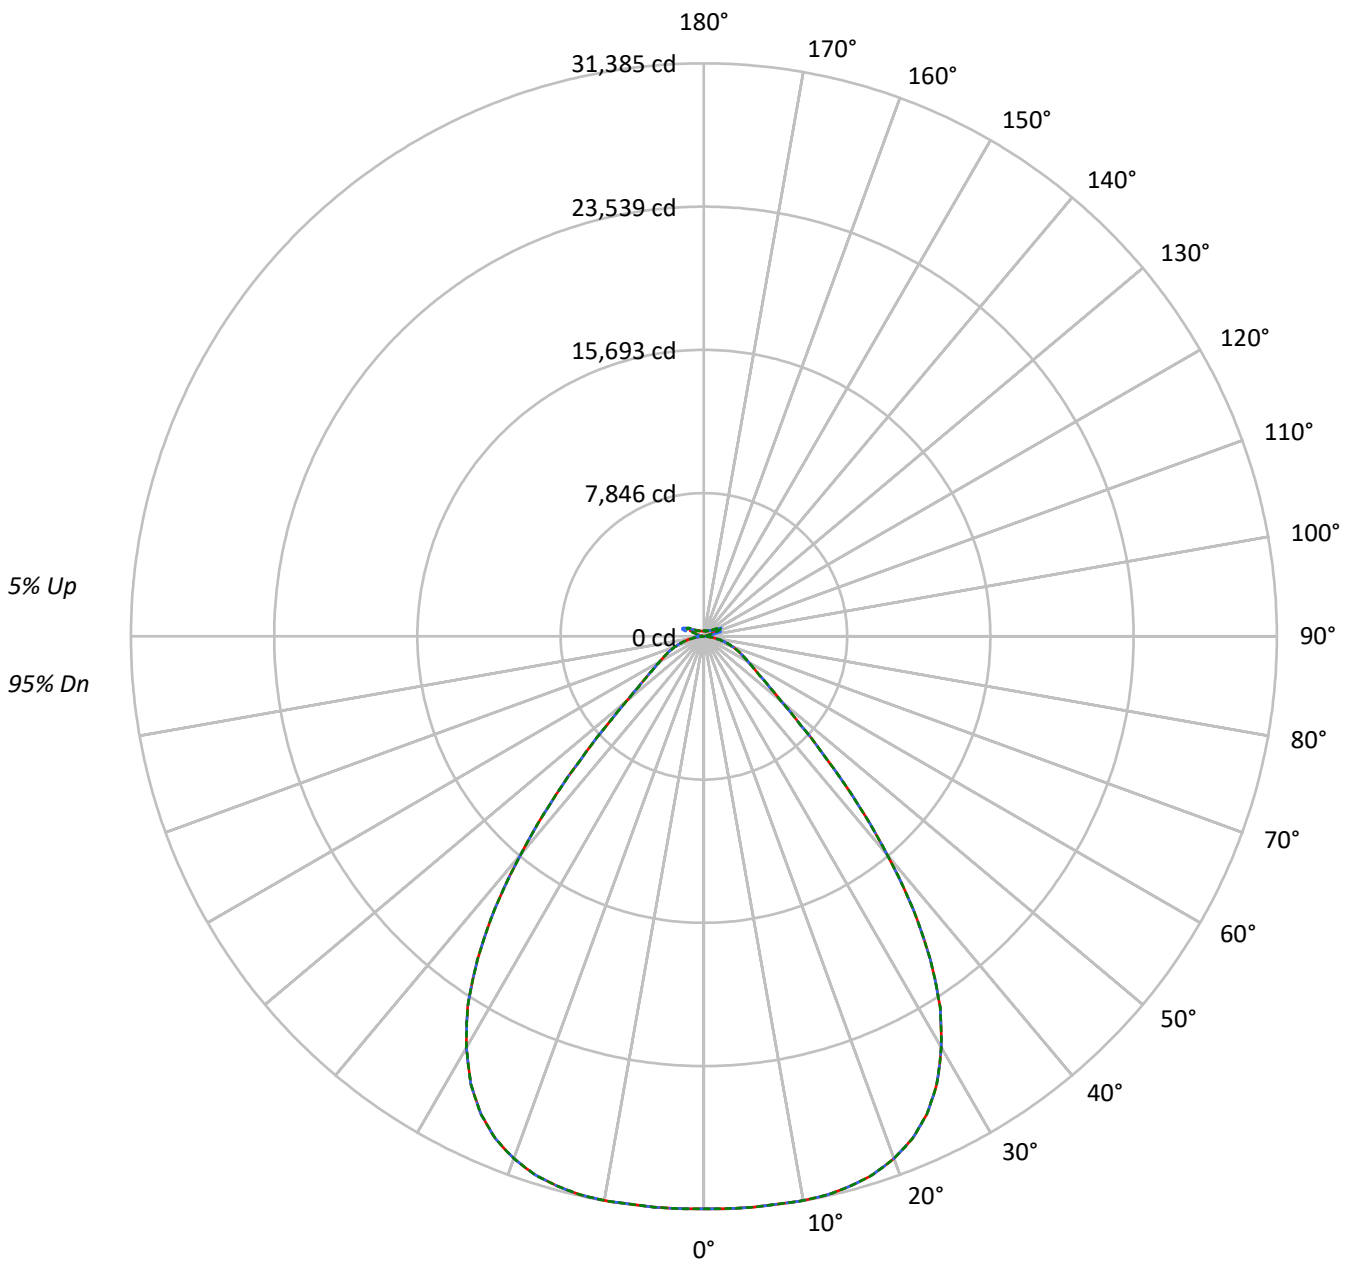

5% Up
95% Dn

— 0°-180° - - 45°-225° - - - 90°-270°



TEST NUMBER: P1436399

CATALOG NUMBER: EHBR1-54-UNV-M-L850-UPL30

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	118	118	118	118	114	114	114	114	108	108	108	103	103	103	97	97	97	97	95	
1	110	107	103	101	107	104	101	98	99	97	94	94	92	91	90	89	87	87	85	
2	103	97	91	87	100	94	90	86	90	86	83	86	83	80	83	80	78	78	76	
3	96	88	81	76	93	86	80	75	82	77	73	79	75	71	76	73	70	70	68	
4	89	80	73	67	87	78	72	67	75	70	65	73	68	64	70	66	63	63	61	
5	83	73	66	60	81	72	65	60	69	63	59	67	62	58	65	60	57	57	55	
6	78	67	60	54	76	66	59	54	64	58	53	62	56	52	60	55	52	52	50	
7	73	62	54	49	71	61	54	49	59	53	48	57	52	48	56	51	47	47	45	
8	69	57	50	45	67	56	50	45	55	49	44	53	48	44	52	47	43	43	41	
9	65	53	46	41	63	52	46	41	51	45	41	50	44	40	48	43	40	40	38	
10	61	49	43	38	60	49	42	38	48	42	37	46	41	37	45	40	37	37	35	

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	147246	147246	147246
5°	146993	146993	146993
10°	147684	147684	147684
15°	148532	148532	148532
20°	148083	148083	148083
25°	144625	144625	144625
30°	135235	135235	135235
35°	117777	117777	117777
40°	90263	90263	90263
45°	58966	58966	58966
50°	37173	37173	37173
55°	27710	27710	27710
60°	23329	23329	23329
65°	21213	21213	21213
70°	19324	19324	19324
75°	16544	16544	16544
80°	12740	12740	12740
85°	6683	6683	6683

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 58966 cd/sqm



TEST NUMBER: P1436399
 CATALOG NUMBER: EHBR1-54-UNV-M-L850-UPL30

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2994.7	5.3
10°-20°	8794.5	15.7
20°-30°	13195.8	23.6
30°-40°	13276.4	23.7
40°-50°	7599.7	13.6
50°-60°	3475.9	6.2
60°-70°	2205.4	3.9
70°-80°	1237.1	2.2
80°-90°	295.5	0.5
90°-100°	82.9	0.1
100°-110°	519.4	0.9
110°-120°	928.9	1.7
120°-130°	545.0	1.0
130°-140°	334.3	0.6
140°-150°	231.9	0.4
150°-160°	150.7	0.3
160°-170°	85.9	0.2
170°-180°	28.4	0.1
0°-30°	24985.0	44.6
0°-40°	38261.4	68.3
0°-60°	49337.0	88.1
0°-90°	53075.0	94.8
90°-120°	1531.2	2.7
90°-150°	2642.5	4.7
90°-180°	2907.0	5.2
0°-180°	55982.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	31355	31355	31355	31355	31355	
5°	31385	31385	31385	31385	31385	2995
15°	31161	31161	31161	31161	31161	8794
25°	28882	28882	28882	28882	28882	13196
35°	21616	21616	21616	21616	21616	13276
45°	9540	9540	9540	9540	9540	7600
55°	3745	3745	3745	3745	3745	3476
65°	2214	2214	2214	2214	2214	2205
75°	1165	1165	1165	1165	1165	1237
85°	230	230	230	230	230	281
90°	22	35	60	38	22	19
95°	37	62	135	67	42	35
105°	181	358	914	394	240	243
115°	835	879	1080	1035	1028	770
125°	602	563	578	586	657	549
135°	439	426	441	414	413	344
145°	361	356	378	373	371	229
155°	316	313	328	328	328	147
165°	296	296	305	305	303	85
175°	293	293	298	298	298	28
180°	296	296	296	296	296	



TEST NUMBER: P1436399

CATALOG NUMBER: EHBR1-54-UNV-M-L850-UPL30

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	31355.0	31355.0	31355.0	31355.0	31355.0
2.5°	31370.2	31370.2	31370.2	31370.2	31370.2
5°	31385.4	31385.4	31385.4	31385.4	31385.4
7.5°	31363.9	31363.9	31363.9	31363.9	31363.9
10°	31377.4	31377.4	31377.4	31377.4	31377.4
12.5°	31323.5	31323.5	31323.5	31323.5	31323.5
15°	31161.2	31161.2	31161.2	31161.2	31161.2
17.5°	30892.9	30892.9	30892.9	30892.9	30892.9
20°	30435.4	30435.4	30435.4	30435.4	30435.4
22.5°	29806.4	29806.4	29806.4	29806.4	29806.4
25°	28881.5	28881.5	28881.5	28881.5	28881.5
27.5°	27637.1	27637.1	27637.1	27637.1	27637.1
30°	26012.3	26012.3	26012.3	26012.3	26012.3
32.5°	24088.8	24088.8	24088.8	24088.8	24088.8
35°	21616.3	21616.3	21616.3	21616.3	21616.3
37.5°	18815.3	18815.3	18815.3	18815.3	18815.3
40°	15644.8	15644.8	15644.8	15644.8	15644.8
42.5°	12502.0	12502.0	12502.0	12502.0	12502.0
45°	9540.4	9540.4	9540.4	9540.4	9540.4
47.5°	7181.7	7181.7	7181.7	7181.7	7181.7
50°	5540.0	5540.0	5540.0	5540.0	5540.0
52.5°	4476.0	4476.0	4476.0	4476.0	4476.0
55°	3744.7	3744.7	3744.7	3744.7	3744.7
57.5°	3206.5	3206.5	3206.5	3206.5	3206.5
60°	2804.5	2804.5	2804.5	2804.5	2804.5
62.5°	2494.1	2494.1	2494.1	2494.1	2494.1
65°	2214.2	2214.2	2214.2	2214.2	2214.2
67.5°	1956.7	1956.7	1956.7	1956.7	1956.7
70°	1695.6	1695.6	1695.6	1695.6	1695.6
72.5°	1432.8	1432.8	1432.8	1432.8	1432.8
75°	1165.4	1165.4	1165.4	1165.4	1165.4
77.5°	911.6	911.6	911.6	911.6	911.6
80°	670.2	670.2	670.2	670.2	670.2
82.5°	436.9	436.9	436.9	436.9	436.9
85°	229.7	229.7	229.7	229.7	229.7
87.5°	65.5	65.5	65.5	65.5	65.5
90°	21.6	35.0	59.9	38.3	21.6
92.5°	31.6	53.2	96.6	49.9	28.3
95°	36.6	61.6	134.8	66.6	41.6
97.5°	46.6	68.3	154.8	81.5	64.9
100°	61.6	79.9	241.3	99.9	86.5
102.5°	104.8	169.7	512.6	188.1	131.5
105°	181.4	357.8	913.7	394.5	239.7
107.5°	314.5	640.7	1205.0	699.0	454.3
110°	587.5	850.5	1263.2	960.3	727.3



TEST NUMBER: P1436399

CATALOG NUMBER: EHBR1-54-UNV-M-L850-UPL30

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	793.9	913.7	1210.0	1060.2	947.0
115°	835.4	878.7	1080.1	1035.2	1028.5
117.5°	807.1	802.2	917.1	930.3	993.6
120°	747.2	714.0	765.6	812.1	897.0
122.5°	672.4	632.4	655.8	690.6	775.6
125°	602.4	562.6	577.5	585.8	657.4
127.5°	540.9	514.2	522.6	512.6	557.5
130°	499.3	476.0	487.6	464.3	485.9
132.5°	464.3	449.4	462.7	434.4	441.0
135°	439.4	426.0	441.0	414.4	412.8
137.5°	417.8	406.1	421.1	401.1	396.1
140°	397.7	387.8	404.4	389.5	386.1
142.5°	376.1	369.4	389.5	379.5	376.1
145°	361.2	356.2	377.8	372.8	371.1
147.5°	347.8	344.5	364.5	362.9	362.9
150°	336.2	332.9	352.8	351.2	352.8
152.5°	324.5	321.2	339.5	337.8	339.5
155°	316.2	312.9	327.9	327.9	327.9
157.5°	309.5	307.8	319.5	319.5	319.5
160°	304.6	302.9	312.9	312.9	311.2
162.5°	299.6	297.9	309.5	307.8	307.8
165°	296.3	296.3	304.6	304.6	302.9
167.5°	296.3	294.6	302.9	302.9	301.3
170°	294.6	294.6	301.3	299.6	297.9
172.5°	294.6	294.6	301.3	299.6	297.9
175°	292.9	292.9	297.9	297.9	297.9
177.5°	294.6	294.6	297.9	297.9	296.3
180°	296.3	296.3	296.3	296.3	296.3



TEST NUMBER: P1436399
 CATALOG NUMBER: EHBR1-54-UNV-M-L850-UPL30

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.81	20.99	20.26	21.42	21.86	19.81	20.99	20.26	21.42	21.86
	3H	21.29	22.35	21.77	22.79	23.28	21.29	22.35	21.77	22.79	23.28
	4H	21.82	22.80	22.31	23.26	23.77	21.82	22.80	22.31	23.26	23.77
	6H	22.14	23.05	22.65	23.52	24.04	22.14	23.05	22.65	23.52	24.04
	8H	22.21	23.07	22.73	23.56	24.09	22.21	23.07	22.73	23.56	24.09
	12H	22.23	23.04	22.75	23.53	24.08	22.23	23.04	22.75	23.53	24.08
4H	2H	20.25	21.23	20.74	21.69	22.20	20.25	21.23	20.74	21.69	22.20
	3H	21.95	22.75	22.45	23.26	23.79	21.95	22.75	22.45	23.26	23.79
	4H	22.58	23.30	23.10	23.82	24.38	22.58	23.30	23.10	23.82	24.38
	6H	23.00	23.62	23.55	24.17	24.75	23.00	23.62	23.55	24.17	24.75
	8H	23.10	23.68	23.65	24.22	24.81	23.10	23.68	23.65	24.22	24.81
	12H	23.13	23.64	23.70	24.21	24.81	23.13	23.64	23.70	24.21	24.81
8H	4H	22.75	23.34	23.31	23.88	24.47	22.75	23.34	23.31	23.88	24.47
	6H	23.26	23.74	23.85	24.33	24.93	23.26	23.74	23.85	24.33	24.93
	8H	23.40	23.83	24.01	24.43	25.04	23.40	23.83	24.01	24.43	25.04
	12H	23.47	23.84	24.07	24.43	25.11	23.47	23.84	24.07	24.43	25.11
12H	4H	22.74	23.26	23.32	23.83	24.43	22.74	23.26	23.32	23.83	24.43
	6H	23.27	23.69	23.87	24.29	24.91	23.27	23.69	23.87	24.29	24.91
	8H	23.44	23.81	24.04	24.40	25.08	23.44	23.81	24.04	24.40	25.08

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-4

Test Date: 07/31/2025

Luminaire Tested: EHBR-60-L850-N

Data in this report applies to families of products including EHBR-60-L850-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-4
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L850-N**
 Description: Elevate Round Highbay at, 60000 lumens, 5000K 80CRI LEDs with N lens

Spectral Parameters

CCT (K): 4875
 CIE u': 0.2124
 CIE v': 0.4871
 Duv: 0.0005
 CIE x: 0.3488
 CIE y: 0.3555
 CIE z: 0.2957
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 573
 Purity: 11.33556
 Rf: 80
 Rg: 102.3

CRI (Ra):	82.3		
R1:	85.0	R9:	43.9
R2:	83.1	R10:	57.4
R3:	78.8	R11:	83.1
R4:	84.0	R12:	51.0
R5:	83.0	R13:	83.4
R6:	76.3	R14:	87.4
R7:	86.8	R15:	83.4
R8:	81.7		



Test Conditions

Stabilization Time: 39M
 Operation Time: 1H 39M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-4

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-4

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-4

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	89	NR	620	280	NR	750	6	NR	880	0	NR
365	0	NR	495	121	NR	625	280	NR	755	5	NR	885	0	NR
370	0	NR	500	168	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	224	NR	635	626	NR	765	4	NR	895	0	NR
380	1	NR	510	275	NR	640	163	NR	770	4	NR	900	0	NR
385	2	NR	515	321	NR	645	160	NR	775	3	NR	905	0	NR
390	3	NR	520	354	NR	650	136	NR	780	3	NR	910	0	NR
395	5	NR	525	375	NR	655	111	NR	785	2	NR	915	0	NR
400	7	NR	530	388	NR	660	93	NR	790	2	NR	920	0	NR
405	10	NR	535	395	NR	665	76	NR	795	2	NR	925	0	NR
410	15	NR	540	397	NR	670	72	NR	800	2	NR	930	0	NR
415	28	NR	545	398	NR	675	57	NR	805	1	NR	935	0	NR
420	53	NR	550	396	NR	680	49	NR	810	1	NR	940	0	NR
425	97	NR	555	395	NR	685	42	NR	815	1	NR	945	0	NR
430	163	NR	560	392	NR	690	37	NR	820	1	NR	950	0	NR
435	261	NR	565	388	NR	695	32	NR	825	1	NR	955	0	NR
440	409	NR	570	381	NR	700	27	NR	830	1	NR	960	0	NR
445	637	NR	575	374	NR	705	23	NR	835	1	NR	965	0	NR
450	699	NR	580	365	NR	710	20	NR	840	1	NR	970	0	NR
455	436	NR	585	354	NR	715	17	NR	845	0	NR	975	0	NR
460	274	NR	590	342	NR	720	15	NR	850	0	NR	980	0	NR
465	205	NR	595	325	NR	725	13	NR	855	0	NR	985	0	NR
470	130	NR	600	313	NR	730	11	NR	860	0	NR	990	0	NR
475	90	NR	605	301	NR	735	10	NR	865	0	NR	995	0	NR
480	78	NR	610	323	NR	740	8	NR	870	0	NR	1000	0	NR
485	77	NR	615	340	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-4

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.82

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	89	NR	620	280	NR	750	6	NR	880	0	NR
365	0	NR	495	121	NR	625	280	NR	755	5	NR	885	0	NR
370	0	NR	500	168	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	224	NR	635	626	NR	765	4	NR	895	0	NR
380	1	NR	510	275	NR	640	163	NR	770	4	NR	900	0	NR
385	2	NR	515	321	NR	645	160	NR	775	3	NR	905	0	NR
390	3	NR	520	354	NR	650	136	NR	780	3	NR	910	0	NR
395	5	NR	525	375	NR	655	111	NR	785	2	NR	915	0	NR
400	7	NR	530	388	NR	660	93	NR	790	2	NR	920	0	NR
405	10	NR	535	395	NR	665	76	NR	795	2	NR	925	0	NR
410	15	NR	540	397	NR	670	72	NR	800	2	NR	930	0	NR
415	28	NR	545	398	NR	675	57	NR	805	1	NR	935	0	NR
420	53	NR	550	396	NR	680	49	NR	810	1	NR	940	0	NR
425	97	NR	555	395	NR	685	42	NR	815	1	NR	945	0	NR
430	163	NR	560	392	NR	690	37	NR	820	1	NR	950	0	NR
435	261	NR	565	388	NR	695	32	NR	825	1	NR	955	0	NR
440	409	NR	570	381	NR	700	27	NR	830	1	NR	960	0	NR
445	637	NR	575	374	NR	705	23	NR	835	1	NR	965	0	NR
450	699	NR	580	365	NR	710	20	NR	840	1	NR	970	0	NR
455	436	NR	585	354	NR	715	17	NR	845	0	NR	975	0	NR
460	274	NR	590	342	NR	720	15	NR	850	0	NR	980	0	NR
465	205	NR	595	325	NR	725	13	NR	855	0	NR	985	0	NR
470	130	NR	600	313	NR	730	11	NR	860	0	NR	990	0	NR
475	90	NR	605	301	NR	735	10	NR	865	0	NR	995	0	NR
480	78	NR	610	323	NR	740	8	NR	870	0	NR	1000	0	NR
485	77	NR	615	340	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-4

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.71


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	89	NR	620	280	NR	750	6	NR	880	0	NR
365	0	NR	495	121	NR	625	280	NR	755	5	NR	885	0	NR
370	0	NR	500	168	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	224	NR	635	626	NR	765	4	NR	895	0	NR
380	1	NR	510	275	NR	640	163	NR	770	4	NR	900	0	NR
385	2	NR	515	321	NR	645	160	NR	775	3	NR	905	0	NR
390	3	NR	520	354	NR	650	136	NR	780	3	NR	910	0	NR
395	5	NR	525	375	NR	655	111	NR	785	2	NR	915	0	NR
400	7	NR	530	388	NR	660	93	NR	790	2	NR	920	0	NR
405	10	NR	535	395	NR	665	76	NR	795	2	NR	925	0	NR
410	15	NR	540	397	NR	670	72	NR	800	2	NR	930	0	NR
415	28	NR	545	398	NR	675	57	NR	805	1	NR	935	0	NR
420	53	NR	550	396	NR	680	49	NR	810	1	NR	940	0	NR
425	97	NR	555	395	NR	685	42	NR	815	1	NR	945	0	NR
430	163	NR	560	392	NR	690	37	NR	820	1	NR	950	0	NR
435	261	NR	565	388	NR	695	32	NR	825	1	NR	955	0	NR
440	409	NR	570	381	NR	700	27	NR	830	1	NR	960	0	NR
445	637	NR	575	374	NR	705	23	NR	835	1	NR	965	0	NR
450	699	NR	580	365	NR	710	20	NR	840	1	NR	970	0	NR
455	436	NR	585	354	NR	715	17	NR	845	0	NR	975	0	NR
460	274	NR	590	342	NR	720	15	NR	850	0	NR	980	0	NR
465	205	NR	595	325	NR	725	13	NR	855	0	NR	985	0	NR
470	130	NR	600	313	NR	730	11	NR	860	0	NR	990	0	NR
475	90	NR	605	301	NR	735	10	NR	865	0	NR	995	0	NR
480	78	NR	610	323	NR	740	8	NR	870	0	NR	1000	0	NR
485	77	NR	615	340	NR	745	7	NR	875	0	NR			

Summary

$R_f = 80$
 $R_g = 102.3$
 $CIE R_a = 82.3$
 $R_9 = 43.9$



Color Vector Graphics

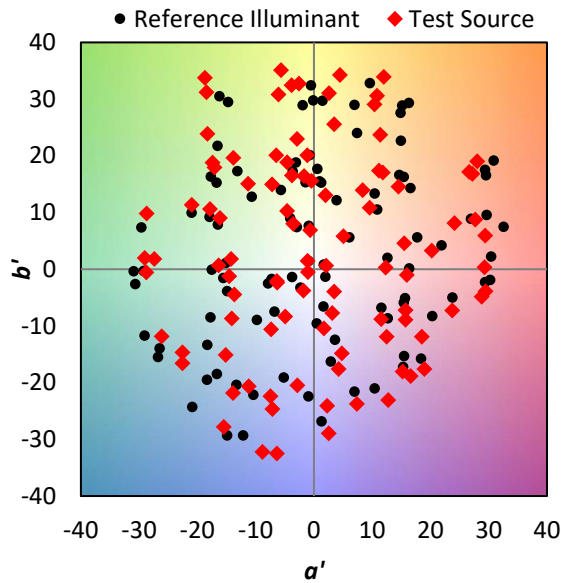

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 67	CES51 = 92	CES76 = 54
CES02 = 60	CES27 = 88	CES52 = 91	CES77 = 71
CES03 = 31	CES28 = 81	CES53 = 82	CES78 = 55
CES04 = 69	CES29 = 66	CES54 = 92	CES79 = 81
CES05 = 47	CES30 = 80	CES55 = 90	CES80 = 75
CES06 = 50	CES31 = 69	CES56 = 81	CES81 = 79
CES07 = 40	CES32 = 61	CES57 = 80	CES82 = 90
CES08 = 39	CES33 = 76	CES58 = 81	CES83 = 87
CES09 = 29	CES34 = 68	CES59 = 93	CES84 = 87
CES10 = 73	CES35 = 82	CES60 = 94	CES85 = 82
CES11 = 56	CES36 = 95	CES61 = 91	CES86 = 83
CES12 = 62	CES37 = 75	CES62 = 89	CES87 = 78
CES13 = 42	CES38 = 87	CES63 = 80	CES88 = 85
CES14 = 74	CES39 = 94	CES64 = 79	CES89 = 81
CES15 = 71	CES40 = 87	CES65 = 75	CES90 = 86
CES16 = 46	CES41 = 91	CES66 = 72	CES91 = 80
CES17 = 48	CES42 = 71	CES67 = 69	CES92 = 77
CES18 = 56	CES43 = 72	CES68 = 75	CES93 = 86
CES19 = 70	CES44 = 99	CES69 = 80	CES94 = 71
CES20 = 65	CES45 = 81	CES70 = 66	CES95 = 79
CES21 = 85	CES46 = 83	CES71 = 59	CES96 = 86
CES22 = 77	CES47 = 83	CES72 = 87	CES97 = 85
CES23 = 91	CES48 = 83	CES73 = 56	CES98 = 82
CES24 = 90	CES49 = 82	CES74 = 95	CES99 = 84
CES25 = 71	CES50 = 91	CES75 = 58	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)