

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1433123

Luminaire Tested: EHBR1-18-UNV-ASM-L930-UPL15

Issue Date: 3/20/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1433123  
REPORT IS A COMBINATION OF REPORTS P1431677 AND P1431635  
Test Lab: INNOVATION CENTER  
Issue Date: 3/20/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: METALUX  
Catalog Number: EHBR1-18-UNV-ASM-L930-UPL15  
Description: Elevate Round Highbay at, 19000 lumens, 3000K 90CRI LEDs with ASM lens  
Light Source: -  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 17680.2 lumens  
Efficiency: N/A  
Efficacy: 170.0 lumens/watt  
Spacing Criteria (0/90/45): 0.84 / 0.99 / 0.92  
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')  
CIE Type: Direct

Input Watts (W): 104  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1433123  
CATALOG NUMBER: EHBR1-18-UNV-ASM-L930-UPL15

### Luminous Intensity Polar Plot

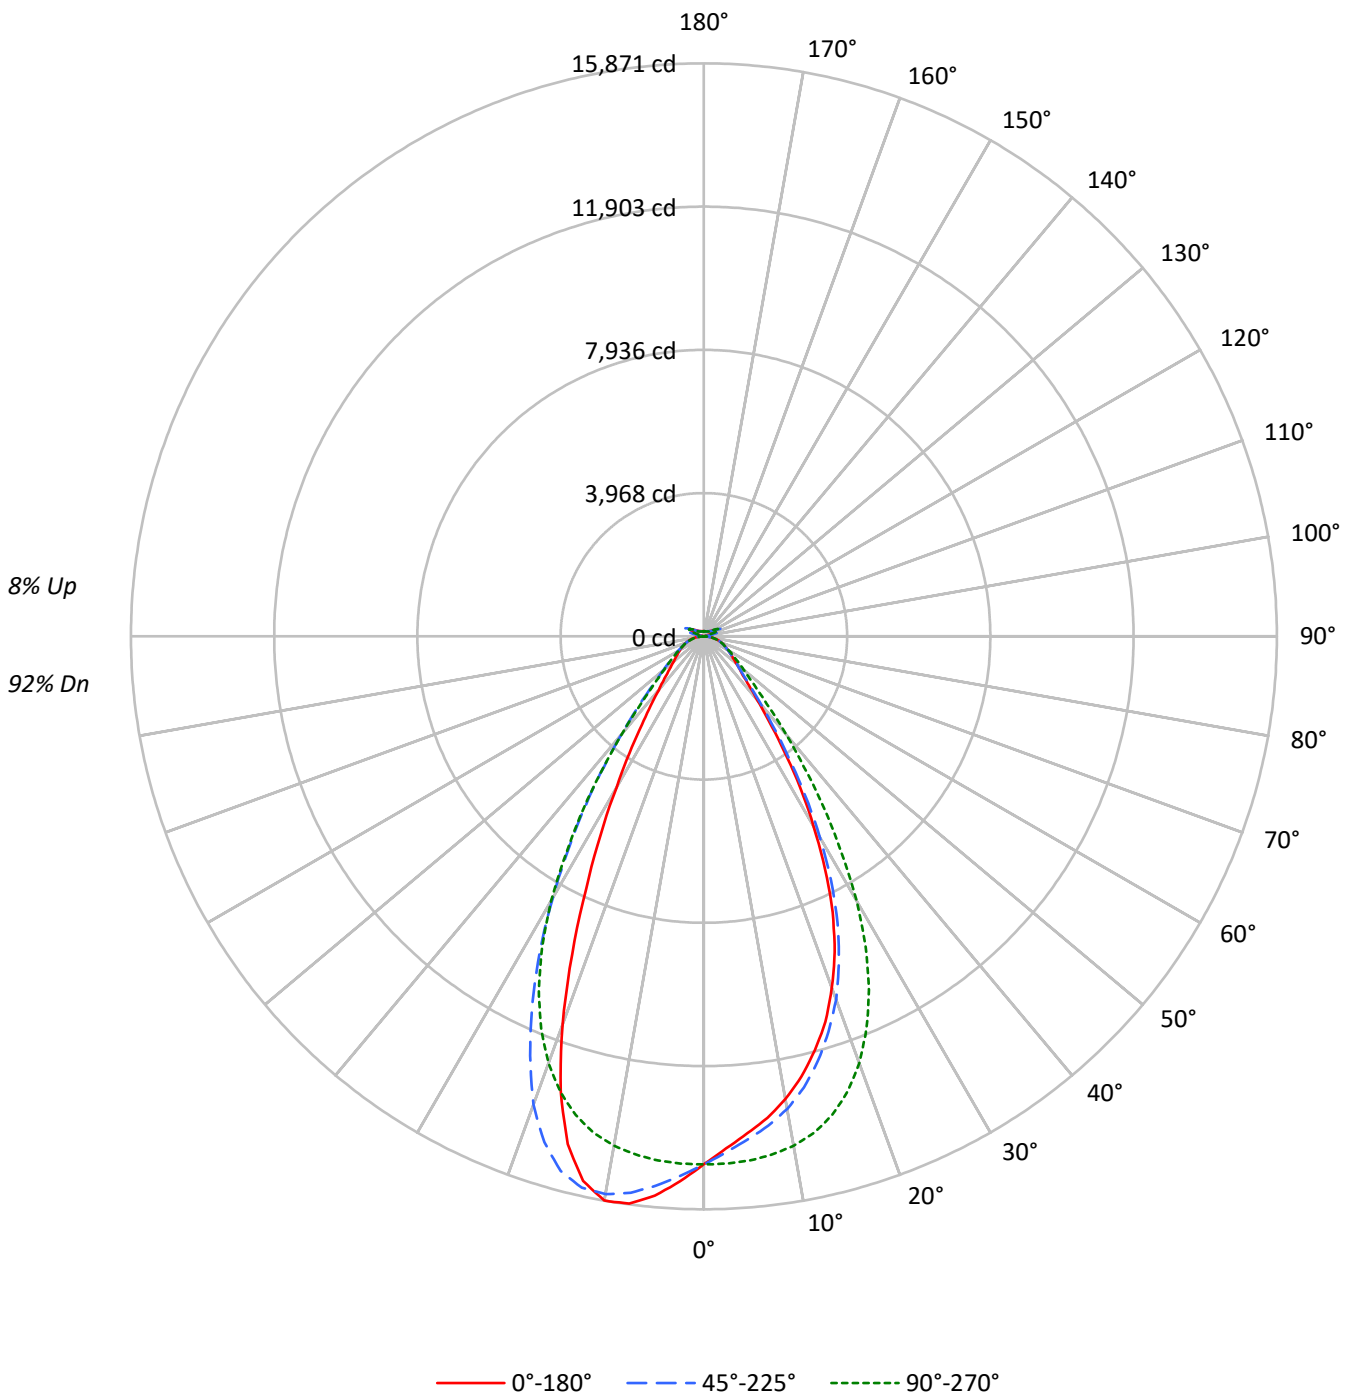



TEST NUMBER: P1433123

CATALOG NUMBER: EHBR1-18-UNV-ASM-L930-UPL15

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	117	117	117	117	114	114	114	114	107	107	107	101	101	101	95	95	95	95	95	95	92
1	110	107	103	101	107	104	101	98	98	96	94	93	91	90	88	87	86	86	87	86	83
2	103	97	92	88	100	95	90	86	90	86	83	86	83	80	82	80	78	82	80	78	75
3	97	89	83	78	94	87	81	77	83	78	75	79	76	73	76	73	70	76	73	70	68
4	91	82	75	70	88	80	74	69	77	72	68	74	69	66	71	67	64	71	67	64	62
5	85	75	69	64	83	74	68	63	71	66	62	69	64	60	66	62	59	66	62	59	57
6	80	70	63	58	78	69	62	58	66	61	57	64	59	56	62	58	55	62	58	55	53
7	76	65	58	54	74	64	58	53	62	56	52	60	55	51	58	54	51	58	54	51	49
8	72	61	54	50	70	60	54	49	58	53	49	57	52	48	55	51	47	55	51	47	46
9	68	57	51	46	66	56	50	46	55	49	45	53	48	45	52	47	44	52	47	44	43
10	64	54	47	43	63	53	47	43	52	46	42	50	45	42	49	45	41	49	45	41	40

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°	135°	180°
0°	68686	68686	68686	68686	68686
5°	64725	65481	68268	71542	72828
10°	61257	62554	67428	73839	74698
15°	56584	58096	65438	73081	69418
20°	50401	52099	61200	67176	55664
25°	42238	43836	54167	56346	38568
30°	31602	33435	43982	43543	25090
35°	21038	22308	31545	31036	16249
40°	13268	14180	20395	20526	11200
45°	9454	9847	12940	13496	8675
50°	7874	7937	9610	9860	7372
55°	6951	6968	7846	8053	6715
60°	6436	6381	6794	6938	6398
65°	6144	6088	6193	6315	6169
70°	5966	5864	5870	5983	6045
75°	5673	5502	5489	5684	5849
80°	5161	4802	4823	5161	5520
85°	3759	3119	3119	3567	3942

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 112.5°  
 Vertical Angle: 45°  
 Luminance: 18193 cd/sqm



TEST NUMBER: P1433123  
 CATALOG NUMBER: EHBR1-18-UNV-ASM-L930-UPL15

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1390.7	7.9
10°-20°	3783.5	21.4
20°-30°	4437.3	25.1
30°-40°	3085.9	17.5
40°-50°	1533.5	8.7
50°-60°	917.2	5.2
60°-70°	645.6	3.7
70°-80°	415.9	2.4
80°-90°	134.4	0.8
90°-100°	35.7	0.2
100°-110°	232.0	1.3
110°-120°	428.5	2.4
120°-130°	254.8	1.4
130°-140°	154.3	0.9
140°-150°	106.9	0.6
150°-160°	70.0	0.4
160°-170°	40.4	0.2
170°-180°	13.5	0.1
0°-30°	9611.6	54.4
0°-40°	12697.4	71.8
0°-60°	15148.2	85.7
0°-90°	16344.1	92.4
90°-120°	696.3	3.9
90°-150°	1212.3	6.9
90°-180°	1336.0	7.6
0°-180°	17680.2	100.0

**CANDELA DISTRIBUTION:**

	0°	45°	90°	135°	180°	Flux
0°	14626	14626	14626	14626	14626	
5°	13820	13981	14576	15275	15550	1296
15°	11871	12188	13728	15332	14564	3311
25°	8435	8754	10817	11252	7702	3806
35°	3861	4094	5790	5696	2982	2460
45°	1530	1593	2094	2184	1404	1236
55°	939	942	1060	1088	908	852
65°	641	636	646	659	644	637
75°	400	388	387	400	412	422
85°	129	107	107	123	136	133
90°	10	27	10	29	12	11
95°	16	60	19	52	18	16
105°	81	405	107	432	55	108
115°	370	479	456	530	390	341
125°	267	257	292	284	306	244
135°	196	197	185	206	214	153
145°	163	170	168	172	175	103
155°	145	150	149	149	156	68
165°	139	142	141	141	146	40
175°	139	141	142	141	144	13
180°	141	141	141	141	141	



TEST NUMBER: P1433123

CATALOG NUMBER: EHBR1-18-UNV-ASM-L930-UPL15

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	14626.1	14626.1	14626.1	14626.1	14626.1	14626.1	14626.1	14626.1	14626.1
2.5°	14191.9	14201.3	14300.6	14429.7	14617.5	14806.6	14959.6	15060.5	15110.4
5°	13819.8	13871.3	13981.3	14218.6	14576.2	14954.7	15275.3	15485.1	15550.0
7.5°	13457.2	13487.0	13671.2	13970.8	14477.2	15066.9	15543.3	15788.1	15847.9
10°	13014.8	13082.6	13290.5	13644.0	14326.1	15137.6	15688.1	15863.5	15870.7
12.5°	12494.2	12584.0	12798.7	13244.7	14085.0	15112.4	15639.5	15581.9	15451.0
15°	11871.1	11949.8	12188.2	12705.4	13728.5	14962.9	15332.1	14863.3	14563.5
17.5°	11198.1	11269.4	11476.5	12046.1	13226.0	14683.1	14690.3	13763.0	13197.4
20°	10358.9	10414.8	10707.8	11266.7	12578.4	14234.4	13806.6	12110.6	11440.5
22.5°	9465.9	9518.3	9778.5	10360.2	11766.6	13629.5	12575.9	10448.3	9534.1
25°	8434.9	8463.4	8754.1	9280.2	10817.2	12888.1	11252.2	8637.0	7701.9
27.5°	7275.1	7323.6	7627.8	8165.1	9700.3	11948.5	9842.5	7057.8	6195.0
30°	6078.7	6159.1	6431.2	6912.2	8459.9	10743.9	8375.4	5620.7	4826.1
32.5°	4962.2	5020.1	5214.0	5716.7	7071.0	9563.3	6966.5	4503.6	3830.7
35°	3861.3	3919.2	4094.4	4588.1	5789.6	8086.0	5696.2	3538.8	2982.3
37.5°	2951.6	3053.9	3166.3	3567.1	4543.7	6690.3	4540.7	2849.6	2419.0
40°	2299.7	2316.2	2457.7	2714.1	3535.0	5231.3	3557.7	2274.7	1941.3
42.5°	1840.8	1885.6	1946.4	2138.4	2678.4	4000.1	2796.4	1866.9	1648.9
45°	1529.6	1547.1	1593.2	1722.1	2093.7	2943.6	2183.6	1575.1	1403.6
47.5°	1338.1	1330.5	1360.1	1456.6	1705.1	2275.0	1769.8	1351.0	1230.8
50°	1173.5	1168.9	1182.9	1247.3	1432.2	1745.7	1469.5	1179.3	1098.7
52.5°	1045.8	1049.9	1051.3	1091.3	1230.3	1423.7	1251.4	1051.0	996.7
55°	939.4	944.5	941.6	971.2	1060.3	1196.9	1088.3	945.1	907.5
57.5°	856.2	852.4	848.3	864.2	931.2	1015.3	945.1	854.9	829.9
60°	773.7	770.1	767.1	777.5	816.7	879.3	834.0	776.2	769.1
62.5°	702.9	700.7	700.4	698.6	728.7	768.2	737.5	705.4	699.1
65°	641.3	638.8	635.5	632.4	646.4	683.1	659.1	641.8	643.9
67.5°	579.5	579.5	573.7	569.1	582.8	602.0	591.5	581.7	584.1
70°	523.5	523.8	514.5	511.0	515.1	535.7	525.0	526.3	530.4
72.5°	463.5	456.9	450.0	449.8	450.3	466.2	462.7	466.0	470.3
75°	399.6	391.9	387.6	382.6	386.7	398.8	400.4	405.1	412.0
77.5°	337.9	326.1	322.5	320.1	317.3	331.1	336.2	342.6	352.7
80°	271.5	258.6	252.6	249.1	253.7	260.0	271.5	276.2	290.4
82.5°	200.8	191.1	183.8	183.5	185.7	191.4	201.3	210.0	218.3
85°	129.2	113.8	107.2	109.7	107.2	116.0	122.6	133.0	135.5
87.5°	46.6	36.4	34.8	38.4	37.6	40.3	46.1	50.2	50.4
90°	9.8	15.8	26.8	17.2	9.8	16.8	28.8	16.3	11.8
92.5°	14.3	23.9	43.0	22.4	12.8	22.6	40.5	21.5	15.5
95°	16.5	27.5	60.0	29.8	19.0	27.8	51.6	23.7	18.4
97.5°	21.1	30.5	68.8	36.4	29.2	34.4	58.3	25.2	22.1
100°	27.8	35.6	107.1	44.7	38.9	38.9	106.1	28.9	25.0
102.5°	47.0	75.4	227.2	83.8	58.7	75.9	245.6	57.2	30.2
105°	80.8	158.6	404.7	175.1	106.6	173.1	432.0	146.3	54.8
107.5°	139.7	283.8	533.9	309.9	201.7	322.7	556.5	287.7	126.3
110°	260.6	376.7	559.6	425.5	322.4	450.9	607.3	393.9	254.4



TEST NUMBER: P1433123

CATALOG NUMBER: EHBR1-18-UNV-ASM-L930-UPL15

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
112.5°	351.9	404.7	536.0	469.7	419.6	502.4	593.3	436.6	351.6
115°	370.4	389.2	478.6	458.7	456.0	495.1	530.0	435.1	390.0
117.5°	357.8	355.3	406.4	412.6	440.6	453.1	457.8	408.6	392.2
120°	331.2	316.3	339.3	360.3	397.8	392.7	385.9	369.6	370.1
122.5°	298.1	280.4	291.0	306.7	344.3	333.3	326.2	330.0	339.9
125°	267.4	249.5	256.6	260.7	292.0	281.0	284.5	296.1	306.3
127.5°	240.2	228.1	232.4	228.2	248.1	242.9	254.2	267.4	276.1
130°	221.8	211.5	217.2	207.1	216.7	217.9	232.9	244.1	249.5
132.5°	206.6	200.0	206.7	194.4	197.1	202.7	217.1	226.7	229.9
135°	195.5	189.9	197.1	185.9	184.9	193.1	206.3	212.4	213.7
137.5°	186.2	181.3	188.8	180.3	177.8	186.2	196.0	201.0	199.7
140°	178.0	173.9	181.8	175.1	173.7	182.0	186.4	192.0	191.1
142.5°	169.0	166.0	175.4	171.0	169.5	177.1	179.3	183.5	182.3
145°	162.9	160.7	170.5	168.1	167.5	173.1	171.5	176.9	175.2
147.5°	157.6	156.0	164.9	163.9	163.9	168.1	165.8	170.5	168.9
150°	152.9	151.4	160.0	159.0	159.7	162.6	159.4	164.9	164.7
152.5°	148.3	146.5	154.3	153.4	154.1	157.0	154.1	160.2	159.8
155°	145.2	143.4	149.7	149.2	149.4	151.0	149.4	155.7	155.9
157.5°	143.0	141.8	146.6	146.3	146.3	147.3	146.6	152.1	152.4
160°	141.4	140.4	144.5	144.3	143.8	145.3	144.8	149.5	149.8
162.5°	139.7	138.8	143.6	142.8	142.8	142.8	142.7	147.4	147.9
165°	138.8	138.5	142.0	142.0	141.4	142.2	141.2	144.7	146.1
167.5°	138.8	138.0	141.7	141.7	141.2	140.5	141.1	144.2	145.4
170°	138.6	138.3	141.2	140.8	140.1	140.4	140.2	143.2	144.5
172.5°	139.1	138.8	142.0	141.3	141.0	141.0	140.3	142.6	144.5
175°	139.0	138.8	141.2	141.2	141.5	141.0	140.8	142.3	144.4
177.5°	140.0	139.7	141.2	141.2	140.7	141.2	141.8	143.4	146.1
180°	141.2	141.2	141.2	141.2	141.2	141.2	141.2	141.2	141.2



TEST NUMBER: P1433123  
 CATALOG NUMBER: EHBR1-18-UNV-ASM-L930-UPL15

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.58	15.68	15.08	16.15	16.65	15.35	16.44	15.85	16.91	17.42
	3H	16.40	17.37	16.91	17.86	18.41	16.91	17.88	17.42	18.37	18.92
	4H	17.13	18.04	17.67	18.54	19.11	17.56	18.46	18.09	18.96	19.53
	6H	17.70	18.54	18.25	19.06	19.63	18.05	18.89	18.60	19.40	19.98
	8H	17.89	18.68	18.45	19.21	19.80	18.21	19.00	18.77	19.53	20.12
	12H	17.99	18.74	18.55	19.27	19.88	18.29	19.04	18.85	19.57	20.18
4H	2H	15.10	16.01	15.63	16.51	17.08	15.73	16.64	16.26	17.14	17.70
	3H	17.14	17.89	17.68	18.44	19.02	17.54	18.29	18.08	18.83	19.42
	4H	18.00	18.68	18.56	19.23	19.85	18.32	19.00	18.88	19.55	20.17
	6H	18.69	19.28	19.28	19.86	20.50	18.96	19.54	19.54	20.12	20.76
	8H	18.92	19.46	19.52	20.05	20.69	19.16	19.70	19.75	20.28	20.93
	12H	19.06	19.53	19.67	20.15	20.79	19.27	19.75	19.89	20.37	21.01
8H	4H	18.26	18.80	18.85	19.38	20.03	18.56	19.11	19.16	19.69	20.33
	6H	19.08	19.52	19.70	20.15	20.80	19.33	19.77	19.95	20.40	21.05
	8H	19.38	19.77	20.02	20.41	21.07	19.61	20.00	20.25	20.64	21.31
	12H	19.58	19.92	20.22	20.54	21.28	19.79	20.14	20.43	20.76	21.50
12H	4H	18.27	18.75	18.88	19.36	20.01	18.57	19.05	19.18	19.66	20.31
	6H	19.11	19.51	19.76	20.15	20.81	19.37	19.76	20.01	20.40	21.07
	8H	19.46	19.80	20.10	20.43	21.16	19.70	20.04	20.34	20.67	21.40

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-5

Test Date: 08/01/2025

Luminaire Tested: EHBR-60-L930-N

Data in this report applies to families of products including EHBR-60-L930-N

**Test Information**

Test Method: LM-79-2019  
 Report Number: SP1-2506-472-5  
 Test Lab: COOPER LIGHTING SOLUTIONS  
 Photometer: SP1 - 76IN SPHERE  
 Measurement Geometry: 4π  
 Issue Date: 08/05/2025  
 Manufacturer: COOPER LIGHTING SOLUTIONS  
 Product Line: Metalux  
 Catalog Number: **EHBR-60-L930-N**  
 Description: Elevate Round Highbay at, 60000 lumens, 3000K 90CRI LEDs with N lens

**Spectral Parameters**

CCT (K): 2996  
 CIE u': 0.2519  
 CIE v': 0.5169  
 Duv: -0.0033  
 CIE x: 0.4325  
 CIE y: 0.3945  
 CIE z: 0.1730  
 Peak Wavelength (nm): 630  
 Dominant Wavelength (nm): 584  
 Purity: 48.21818  
 Rf: 91.3  
 Rg: 102

CRI (Ra):	94.4		
R1:	96.8	R9:	61.4
R2:	98.1	R10:	94.4
R3:	97.8	R11:	95.7
R4:	95.6	R12:	88.5
R5:	96.9	R13:	97.3
R6:	95.7	R14:	97.8
R7:	90.9	R15:	92.3
R8:	83.0		



**Test Conditions**

Stabilization Time: 40M  
 Operation Time: 1H 40M  
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-5

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-5

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3000K 7-step quadrangle

REPORT NUMBER: SP1-2506-472-5

**Photopic Flux vs. Wavelength**



**Photopic Lumens: NR**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

**Scotopic Flux vs. Wavelength**



**Scotopic Lumens: NR**

**S/P: 1.44**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.85

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

**Summary**

$R_f = 91.3$   
 $R_g = 102$   
 CIE  $R_a = 94.4$   
 $R_9 = 61.4$



**Color Vector Graphics**



**Individual Sample Fidelity Index ( $R_{f,i}$ )**

CES01 = 86	CES26 = 91	CES51 = 96	CES76 = 89
CES02 = 63	CES27 = 96	CES52 = 95	CES77 = 85
CES03 = 32	CES28 = 96	CES53 = 93	CES78 = 86
CES04 = 70	CES29 = 90	CES54 = 98	CES79 = 89
CES05 = 51	CES30 = 96	CES55 = 98	CES80 = 91
CES06 = 51	CES31 = 90	CES56 = 95	CES81 = 72
CES07 = 44	CES32 = 84	CES57 = 95	CES82 = 95
CES08 = 42	CES33 = 91	CES58 = 95	CES83 = 93
CES09 = 29	CES34 = 92	CES59 = 99	CES84 = 96
CES10 = 76	CES35 = 96	CES60 = 96	CES85 = 80
CES11 = 59	CES36 = 90	CES61 = 96	CES86 = 77
CES12 = 65	CES37 = 94	CES62 = 95	CES87 = 91
CES13 = 44	CES38 = 99	CES63 = 94	CES88 = 96
CES14 = 74	CES39 = 97	CES64 = 96	CES89 = 82
CES15 = 72	CES40 = 94	CES65 = 92	CES90 = 97
CES16 = 48	CES41 = 94	CES66 = 95	CES91 = 82
CES17 = 50	CES42 = 91	CES67 = 94	CES92 = 78
CES18 = 57	CES43 = 88	CES68 = 93	CES93 = 87
CES19 = 72	CES44 = 99	CES69 = 94	CES94 = 73
CES20 = 67	CES45 = 93	CES70 = 90	CES95 = 85
CES21 = 86	CES46 = 93	CES71 = 90	CES96 = 92
CES22 = 79	CES47 = 86	CES72 = 96	CES97 = 93
CES23 = 92	CES48 = 95	CES73 = 85	CES98 = 94
CES24 = 91	CES49 = 91	CES74 = 90	CES99 = 93
CES25 = 72	CES50 = 96	CES75 = 90	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)