

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1433220

Luminaire Tested: EHBR1-36-UNV-TASM-L930-UPL18

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number: P1433220
REPORT IS A COMBINATION OF REPORTS P1431774 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-36-UNV-TASM-L930-UPL18
Description: Elevate Round Highbay at, 36000 lumens, 3000K 90CRI LEDs with TASM lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 33788.4 lumens
Efficiency: N/A
Efficacy: 166.2 lumens/watt
Spacing Criteria (0/90/45): 0.99 / 0.84 / 0.9
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 203.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1433220
CATALOG NUMBER: EHBR1-36-UNV-TASM-L930-UPL18

Luminous Intensity Polar Plot

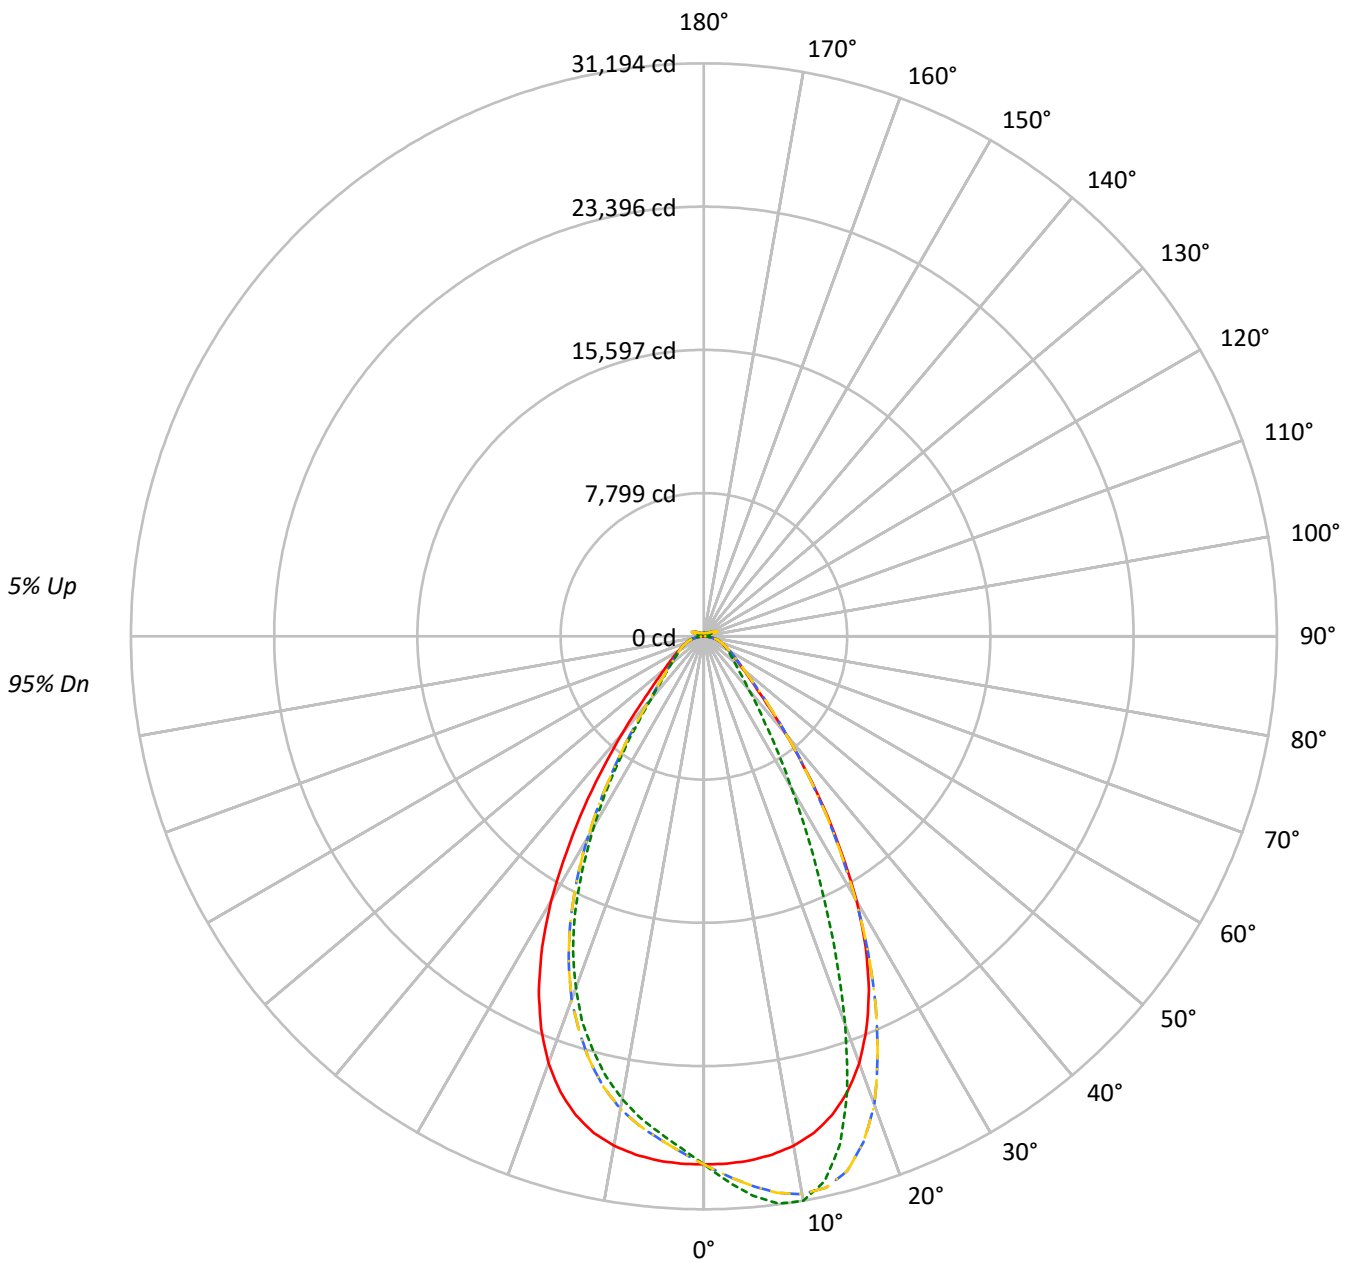

— 0°-180° - - 45°-225° - · - · 90°-270° - · - · 135°-315°



TEST NUMBER: P1433220
 CATALOG NUMBER: EHBR1-36-UNV-TASM-L930-UPL18

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	118	118	118	118	115	115	115	115	108	108	108	103	103	103	98	98	98	98	98	98	95
1	111	107	104	101	108	105	102	99	100	97	95	95	93	92	91	89	88	88	88	88	86
2	104	98	93	89	101	96	91	87	91	88	85	88	85	82	84	82	80	80	80	80	77
3	97	90	84	79	95	88	82	78	84	80	76	81	77	74	78	75	72	72	72	72	70
4	91	82	76	71	89	81	75	70	78	73	69	75	71	67	73	69	66	66	66	66	64
5	86	76	69	64	84	75	69	64	72	67	63	70	65	62	68	64	61	61	61	61	59
6	81	71	64	59	79	70	63	59	68	62	58	66	61	57	64	59	56	56	56	56	54
7	77	66	59	54	75	65	59	54	63	57	53	62	56	53	60	55	52	52	52	52	50
8	72	62	55	50	71	61	54	50	59	54	49	58	53	49	56	52	48	48	48	48	47
9	69	58	51	47	67	57	51	47	56	50	46	54	49	46	53	49	45	45	45	45	44
10	65	54	48	44	64	54	48	44	53	47	43	51	46	43	50	46	42	42	42	42	41

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°	270°
0°	135002	135002	135002	135002
5°	134180	143145	134180	127217
10°	132531	146820	132531	120400
15°	128618	136442	128618	111217
20°	120290	109408	120290	99063
25°	106466	75804	106466	83019
30°	86447	49316	86447	62115
35°	62002	31938	62002	41352
40°	40086	22014	40086	26078
45°	25435	17052	25435	18581
50°	18888	14490	18888	15477
55°	15421	13200	15421	13662
60°	13353	12574	13353	12650
65°	12173	12126	12173	12074
70°	11537	11881	11537	11728
75°	10790	11494	10790	11151
80°	9478	10852	9478	10145
85°	6133	7748	6133	7387

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 35759 cd/sqm



TEST NUMBER: P1433220
 CATALOG NUMBER: EHBR1-36-UNV-TASM-L930-UPL18

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2733.5	8.1
10°-20°	7436.6	22.0
20°-30°	8721.6	25.8
30°-40°	6065.3	18.0
40°-50°	3014.2	8.9
50°-60°	1802.8	5.3
60°-70°	1268.9	3.8
70°-80°	817.4	2.4
80°-90°	262.5	0.8
90°-100°	44.8	0.1
100°-110°	288.4	0.9
110°-120°	532.0	1.6
120°-130°	316.8	0.9
130°-140°	192.5	0.6
140°-150°	134.0	0.4
150°-160°	88.3	0.3
160°-170°	51.6	0.2
170°-180°	17.4	0.1
0°-30°	18891.6	55.9
0°-40°	24956.9	73.9
0°-60°	29773.9	88.1
0°-90°	32122.7	95.1
90°-120°	865.2	2.6
90°-150°	1508.5	4.5
90°-180°	1666.0	4.9
0°-180°	33788.4	100.0

CANDELA DISTRIBUTION:

	0°	90°	180°	270°	360°	Flux
0°	28748	28748	28748	28748	28748	
5°	28650	30564	28650	27163	28650	2719
15°	26983	28625	26983	23333	26983	7541
25°	21261	15138	21261	16579	21261	9626
35°	11380	5862	11380	7590	11380	7104
45°	4115	2759	4115	3006	4115	3367
55°	2084	1784	2084	1846	2084	1906
65°	1271	1266	1271	1260	1271	1276
75°	760	810	760	786	760	798
85°	211	266	211	254	211	234
90°	12	16	12	12	12	16
95°	24	24	24	21	24	25
105°	133	70	133	101	133	179
115°	566	485	566	460	566	516
125°	363	382	363	332	363	334
135°	231	267	231	243	231	183
145°	210	220	210	204	210	132
155°	189	197	189	184	189	88
165°	181	188	181	178	181	51
175°	182	188	182	179	182	17
180°	182	182	182	182	182	



TEST NUMBER: P1433220
 CATALOG NUMBER: EHBR1-36-UNV-TASM-L930-UPL18

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°	202.5°	225°
0°	28747.7	28747.7	28747.7	28747.7	28747.7	28747.7	28747.7	28747.7	28747.7	28747.7	28747.7
2.5°	28731.0	29102.4	29403.2	29601.6	29699.6	29601.6	29403.2	29102.4	28731.0	28361.7	28107.8
5°	28649.6	29393.5	30023.7	30436.1	30563.8	30436.1	30023.7	29393.5	28649.6	27946.7	27480.4
7.5°	28455.0	29614.0	30550.3	31031.7	31149.3	31031.7	30550.3	29614.0	28455.0	27459.9	26870.7
10°	28158.0	29753.0	30835.0	31179.9	31194.0	31179.9	30835.0	29753.0	28158.0	26817.3	26122.4
12.5°	27684.2	29703.5	30739.5	30626.3	30369.2	30626.3	30739.5	29703.5	27684.2	26032.4	25155.9
15°	26983.4	29409.7	30135.2	29214.0	28624.8	29214.0	30135.2	29409.7	26983.4	24972.7	23956.0
17.5°	25995.8	28859.8	28873.8	27051.3	25939.7	27051.3	28873.8	28859.8	25995.8	23676.7	22557.1
20°	24723.1	27978.0	27137.0	23803.4	22486.5	23803.4	27137.0	27978.0	24723.1	22144.7	21046.1
22.5°	23127.4	26788.7	24718.2	20536.1	18739.4	20536.1	24718.2	26788.7	23127.4	20363.1	19219.8
25°	21261.2	25331.6	22116.1	16976.2	15138.0	16976.2	22116.1	25331.6	21261.2	18240.3	17206.4
27.5°	19066.1	23484.8	19345.4	13872.3	12176.4	13872.3	19345.4	23484.8	19066.1	16048.5	14992.5
30°	16628.0	21117.3	16461.9	11047.6	9485.9	11047.6	16461.9	21117.3	16628.0	13586.1	12640.5
32.5°	13898.1	18796.6	13692.7	8852.0	7529.1	8852.0	13692.7	18796.6	13898.1	11236.2	10248.1
35°	11379.6	15893.2	11195.8	6955.5	5861.7	6955.5	11195.8	15893.2	11379.6	9018.0	8047.7
37.5°	8930.6	13149.9	8924.8	5600.9	4754.5	5600.9	8924.8	13149.9	8930.6	7011.0	6223.5
40°	6948.0	10282.1	6992.7	4471.0	3815.5	4471.0	6992.7	10282.1	6948.0	5334.5	4830.5
42.5°	5264.5	7862.3	5496.3	3669.4	3240.8	3669.4	5496.3	7862.3	5264.5	4203.1	3825.8
45°	4115.2	5785.7	4292.0	3095.8	2759.0	3095.8	4292.0	5785.7	4115.2	3384.8	3131.4
47.5°	3351.4	4471.6	3478.6	2655.4	2419.4	2655.4	3478.6	4471.6	3351.4	2863.0	2673.2
50°	2815.0	3431.2	2888.3	2317.9	2159.5	2317.9	2888.3	3431.2	2815.0	2451.6	2325.0
52.5°	2418.2	2798.3	2459.7	2065.7	1959.0	2065.7	2459.7	2798.3	2418.2	2145.0	2066.2
55°	2084.0	2352.4	2139.0	1857.6	1783.8	1857.6	2139.0	2352.4	2084.0	1908.8	1850.6
57.5°	1830.1	1995.6	1857.6	1680.2	1631.2	1680.2	1857.6	1995.6	1830.1	1698.6	1667.3
60°	1605.3	1728.3	1639.3	1525.5	1511.6	1525.5	1639.3	1728.3	1605.3	1528.2	1507.7
62.5°	1432.3	1509.9	1449.5	1386.4	1374.0	1386.4	1449.5	1509.9	1432.3	1373.0	1376.8
65°	1270.6	1342.8	1295.4	1261.4	1265.7	1261.4	1295.4	1342.8	1270.6	1243.1	1249.0
67.5°	1145.5	1183.3	1162.8	1143.3	1148.2	1143.3	1162.8	1183.3	1145.5	1118.6	1127.7
70°	1012.3	1052.8	1031.8	1034.4	1042.5	1034.4	1031.8	1052.8	1012.3	1004.3	1011.3
72.5°	885.2	916.4	909.4	915.8	924.5	915.8	909.4	916.4	885.2	884.1	884.6
75°	760.1	783.8	787.1	796.2	809.7	796.2	787.1	783.8	760.1	752.0	761.7
77.5°	623.7	650.6	660.9	673.3	693.2	673.3	660.9	650.6	623.7	629.1	634.0
80°	498.6	511.1	533.7	542.8	570.9	542.8	533.7	511.1	498.6	489.5	496.5
82.5°	364.9	376.2	395.7	413.0	429.1	413.0	395.7	376.2	364.9	360.6	361.2
85°	210.8	228.0	241.0	261.5	266.3	261.5	241.0	228.0	210.8	215.7	210.8
87.5°	73.9	79.2	90.5	98.6	99.2	98.6	90.5	79.2	73.9	75.5	68.4
90°	12.4	21.1	36.3	21.5	16.1	21.5	36.3	21.1	12.4	21.6	33.4
92.5°	16.0	28.4	50.9	27.9	20.7	27.9	50.9	28.4	16.0	27.9	53.5
95°	23.9	34.8	64.6	30.6	24.3	30.6	64.6	34.8	23.9	37.1	74.5
97.5°	36.7	43.0	72.8	32.4	29.0	32.4	72.8	43.0	36.7	45.3	85.5
100°	48.6	48.6	132.2	37.0	32.6	37.0	132.2	48.6	48.6	55.9	133.0
102.5°	73.3	94.7	305.4	72.3	38.9	72.3	305.4	94.7	73.3	104.3	281.9
105°	132.6	215.3	536.5	182.8	69.7	182.8	536.5	215.3	132.6	217.5	502.0
107.5°	250.4	400.7	690.8	358.1	158.3	358.1	690.8	400.7	250.4	384.7	662.3
110°	400.2	559.6	753.8	489.7	317.2	489.7	753.8	559.6	400.2	528.1	694.3



TEST NUMBER: P1433220
 CATALOG NUMBER: EHBR1-36-UNV-TASM-L930-UPL18

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°	202.5°	225°
112.5°	520.8	623.6	736.4	542.6	437.7	542.6	736.4	623.6	520.8	582.9	665.1
115°	566.1	614.4	657.9	540.8	485.2	540.8	657.9	614.4	566.1	569.2	593.9
117.5°	546.9	562.4	568.5	507.9	488.0	507.9	568.5	562.4	546.9	512.1	504.3
120°	493.9	487.5	479.4	459.5	460.5	459.5	479.4	487.5	493.9	447.4	421.2
122.5°	427.7	414.0	405.5	410.7	423.1	410.7	405.5	414.0	427.7	381.1	361.4
125°	362.9	349.2	354.0	368.7	381.7	368.7	354.0	349.2	362.9	324.2	319.0
127.5°	308.6	302.3	316.4	333.1	344.2	333.1	316.4	302.3	308.6	284.0	288.9
130°	269.9	271.2	290.0	304.4	311.3	304.4	290.0	271.2	269.9	258.1	270.3
132.5°	245.8	252.5	270.5	283.0	287.3	283.0	270.5	252.5	245.8	242.7	257.6
135°	230.8	240.7	257.3	265.1	267.2	265.1	257.3	240.7	230.8	232.2	245.8
137.5°	222.2	232.1	244.5	251.0	249.9	251.0	244.5	232.1	222.2	225.5	235.9
140°	217.3	227.2	232.6	240.1	239.4	240.1	232.6	227.2	217.3	219.0	227.3
142.5°	212.4	221.3	224.0	229.7	228.5	229.7	224.0	221.3	212.4	214.2	219.7
145°	210.2	217.0	214.5	221.5	219.8	221.5	214.5	217.0	210.2	210.6	213.9
147.5°	205.6	210.6	207.8	213.9	212.2	213.9	207.8	210.6	205.6	205.6	207.1
150°	200.7	204.3	200.2	207.1	207.2	207.1	200.2	204.3	200.7	199.8	201.2
152.5°	193.9	197.6	193.9	201.8	201.4	201.8	193.9	197.6	193.9	193.0	194.4
155°	188.6	190.4	188.6	196.4	196.9	196.4	188.6	190.4	188.6	188.0	189.1
157.5°	185.1	186.5	185.6	192.6	193.1	192.6	185.6	186.5	185.1	185.1	185.6
160°	182.7	184.5	184.1	190.1	190.6	190.1	184.1	184.5	182.7	183.0	183.6
162.5°	181.9	181.9	182.1	188.0	189.1	188.0	182.1	181.9	181.9	181.9	182.8
165°	180.7	181.7	180.9	185.7	187.7	185.7	180.9	181.7	180.7	181.2	181.2
167.5°	180.9	180.0	181.2	185.5	187.5	185.5	181.2	180.0	180.9	181.3	181.3
170°	179.7	180.3	180.4	184.7	186.7	184.7	180.4	180.3	179.7	180.5	180.9
172.5°	181.3	181.3	181.1	184.6	187.4	184.6	181.1	181.3	181.3	181.7	182.6
175°	182.4	182.0	182.1	184.6	187.6	184.6	182.1	182.0	182.4	181.9	181.9
177.5°	181.4	182.5	183.6	186.2	189.9	186.2	183.6	182.5	181.4	181.9	181.9
180°	182.5	182.5	182.5	182.5	182.5	182.5	182.5	182.5	182.5	182.5	182.5



TEST NUMBER: P1433220

CATALOG NUMBER: EHBR1-36-UNV-TASM-L930-UPL18

CANDELA DISTRIBUTION (continued):

	247.5°	270°	292.5°	315°	337.5°	360°
0°	28747.7	28747.7	28747.7	28747.7	28747.7	28747.7
2.5°	27912.7	27894.4	27912.7	28107.8	28361.7	28731.0
5°	27264.2	27162.8	27264.2	27480.4	27946.7	28649.6
7.5°	26509.0	26450.2	26509.0	26870.7	27459.9	28455.0
10°	25713.8	25580.7	25713.8	26122.4	26817.3	28158.0
12.5°	24733.9	24557.6	24733.9	25155.9	26032.4	27684.2
15°	23487.5	23332.8	23487.5	23956.0	24972.7	26983.4
17.5°	22150.1	22009.9	22150.1	22557.1	23676.7	25995.8
20°	20470.4	20360.4	20470.4	21046.1	22144.7	24723.1
22.5°	18708.1	18605.2	18708.1	19219.8	20363.1	23127.4
25°	16634.9	16578.9	16634.9	17206.4	18240.3	21261.2
27.5°	14394.6	14299.2	14394.6	14992.5	16048.5	19066.1
30°	12105.8	11947.8	12105.8	12640.5	13586.1	16628.0
32.5°	9867.0	9753.3	9867.0	10248.1	11236.2	13898.1
35°	7703.2	7589.5	7703.2	8047.7	9018.0	11379.6
37.5°	6002.5	5801.4	6002.5	6223.5	7011.0	8930.6
40°	4552.4	4520.0	4552.4	4830.5	5334.5	6948.0
42.5°	3706.1	3618.2	3706.1	3825.8	4203.1	5264.5
45°	3040.8	3006.3	3040.8	3131.4	3384.8	4115.2
47.5°	2615.0	2630.1	2615.0	2673.2	2863.0	3351.4
50°	2297.4	2306.6	2297.4	2325.0	2451.6	2815.0
52.5°	2063.5	2055.4	2063.5	2066.2	2145.0	2418.2
55°	1856.5	1846.3	1856.5	1850.6	1908.8	2084.0
57.5°	1675.4	1682.9	1675.4	1667.3	1698.6	1830.1
60°	1513.7	1520.7	1513.7	1507.7	1528.2	1605.3
62.5°	1377.3	1381.6	1377.3	1376.8	1373.0	1432.3
65°	1255.4	1260.3	1255.4	1249.0	1243.1	1270.6
67.5°	1139.1	1139.1	1139.1	1127.7	1118.6	1145.5
70°	1029.6	1029.1	1029.6	1011.3	1004.3	1012.3
72.5°	898.1	911.0	898.1	884.6	884.1	885.2
75°	770.3	785.5	770.3	761.7	752.0	760.1
77.5°	640.9	664.2	640.9	634.0	629.1	623.7
80°	508.3	533.7	508.3	496.5	489.5	498.6
82.5°	375.7	394.6	375.7	361.2	360.6	364.9
85°	223.7	253.9	223.7	210.8	215.7	210.8
87.5°	71.7	91.6	71.7	68.4	75.5	73.9
90°	19.7	12.4	19.7	33.4	21.6	12.4
92.5°	29.8	17.9	29.8	53.5	27.9	16.0
95°	34.3	20.6	34.3	74.5	37.1	23.9
97.5°	38.0	26.6	38.0	85.5	45.3	36.7
100°	44.4	34.8	44.4	133.0	55.9	48.6
102.5°	93.7	58.6	93.7	281.9	104.3	73.3
105°	196.9	100.6	196.9	502.0	217.5	132.6
107.5°	352.2	173.7	352.2	662.3	384.7	250.4
110°	467.2	323.5	467.2	694.3	528.1	400.2



TEST NUMBER: P1433220

CATALOG NUMBER: EHBR1-36-UNV-TASM-L930-UPL18

CANDELA DISTRIBUTION (continued):

	247.5°	270°	292.5°	315°	337.5°	360°
112.5°	502.0	436.7	502.0	665.1	582.9	520.8
115°	482.8	459.6	482.8	593.9	569.2	566.1
117.5°	440.8	444.1	440.8	504.3	512.1	546.9
120°	392.4	411.2	392.4	421.2	447.4	493.9
122.5°	348.2	370.1	348.2	361.4	381.1	427.7
125°	309.8	332.2	309.8	319.0	324.2	362.9
127.5°	283.3	298.4	283.3	288.9	284.0	308.6
130°	262.8	275.6	262.8	270.3	258.1	269.9
132.5°	248.7	257.0	248.7	257.6	242.7	245.8
135°	236.5	243.3	236.5	245.8	232.2	230.8
137.5°	226.1	232.0	226.1	235.9	225.5	222.2
140°	217.1	222.1	217.1	227.3	219.0	217.3
142.5°	207.5	211.2	207.5	219.7	214.2	212.4
145°	201.4	204.2	201.4	213.9	210.6	210.2
147.5°	196.1	197.9	196.1	207.1	205.6	205.6
150°	190.8	192.6	190.8	201.2	199.8	200.7
152.5°	184.9	187.3	184.9	194.4	193.0	193.9
155°	181.4	183.8	181.4	189.1	188.0	188.6
157.5°	179.7	181.7	179.7	185.6	185.1	185.1
160°	178.6	180.1	178.6	183.6	183.0	182.7
162.5°	177.0	178.4	177.0	182.8	181.9	181.9
165°	177.1	177.6	177.1	181.2	181.2	180.7
167.5°	176.7	177.6	176.7	181.3	181.3	180.9
170°	177.2	177.8	177.2	180.9	180.5	179.7
172.5°	178.4	178.9	178.4	182.6	181.7	181.3
175°	178.6	179.1	178.6	181.9	181.9	182.4
177.5°	180.0	180.5	180.0	181.9	181.9	181.4
180°	182.5	182.5	182.5	182.5	182.5	182.5



TEST NUMBER: P1433220
 CATALOG NUMBER: EHBR1-36-UNV-TASM-L930-UPL18

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.82	18.95	18.28	19.37	19.81	17.14	18.27	17.59	18.69	19.13
	3H	19.37	20.37	19.84	20.81	21.30	18.99	19.99	19.46	20.43	20.92
	4H	20.01	20.94	20.50	21.40	21.90	19.77	20.71	20.26	21.16	21.67
	6H	20.49	21.35	20.99	21.82	22.34	20.41	21.28	20.92	21.75	22.26
	8H	20.64	21.46	21.16	21.94	22.47	20.64	21.45	21.15	21.94	22.47
	12H	20.71	21.49	21.23	21.97	22.52	20.76	21.54	21.28	22.02	22.57
4H	2H	18.24	19.18	18.73	19.63	20.13	17.72	18.65	18.21	19.11	19.61
	3H	20.04	20.81	20.54	21.31	21.84	19.77	20.55	20.28	21.05	21.57
	4H	20.81	21.51	21.33	22.02	22.58	20.68	21.38	21.20	21.89	22.45
	6H	21.43	22.03	21.97	22.56	23.15	21.45	22.05	22.00	22.59	23.18
	8H	21.62	22.18	22.18	22.72	23.31	21.72	22.28	22.28	22.82	23.41
	12H	21.73	22.22	22.30	22.79	23.38	21.89	22.39	22.46	22.96	23.55
8H	4H	21.06	21.62	21.61	22.16	22.74	20.96	21.52	21.52	22.06	22.65
	6H	21.80	22.26	22.39	22.84	23.44	21.87	22.32	22.45	22.91	23.50
	8H	22.07	22.48	22.68	23.08	23.69	22.22	22.63	22.82	23.23	23.83
	12H	22.25	22.60	22.84	23.18	23.86	22.47	22.82	23.07	23.41	24.09
12H	4H	21.07	21.56	21.64	22.14	22.73	20.97	21.47	21.54	22.04	22.63
	6H	21.84	22.25	22.45	22.85	23.46	21.91	22.32	22.52	22.92	23.53
	8H	22.16	22.52	22.76	23.10	23.78	22.32	22.67	22.92	23.25	23.94

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-5

Test Date: 08/01/2025

Luminaire Tested: EHBR-60-L930-N

Data in this report applies to families of products including EHBR-60-L930-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-5
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L930-N**
 Description: Elevate Round Highbay at, 60000 lumens, 3000K 90CRI LEDs with N lens

Spectral Parameters

CCT (K): 2996
 CIE u': 0.2519
 CIE v': 0.5169
 Duv: -0.0033
 CIE x: 0.4325
 CIE y: 0.3945
 CIE z: 0.1730
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 584
 Purity: 48.21818
 Rf: 91.3
 Rg: 102

CRI (Ra):	94.4		
R1:	96.8	R9:	61.4
R2:	98.1	R10:	94.4
R3:	97.8	R11:	95.7
R4:	95.6	R12:	88.5
R5:	96.9	R13:	97.3
R6:	95.7	R14:	97.8
R7:	90.9	R15:	92.3
R8:	83.0		



Test Conditions

Stabilization Time: 40M
 Operation Time: 1H 40M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-5

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

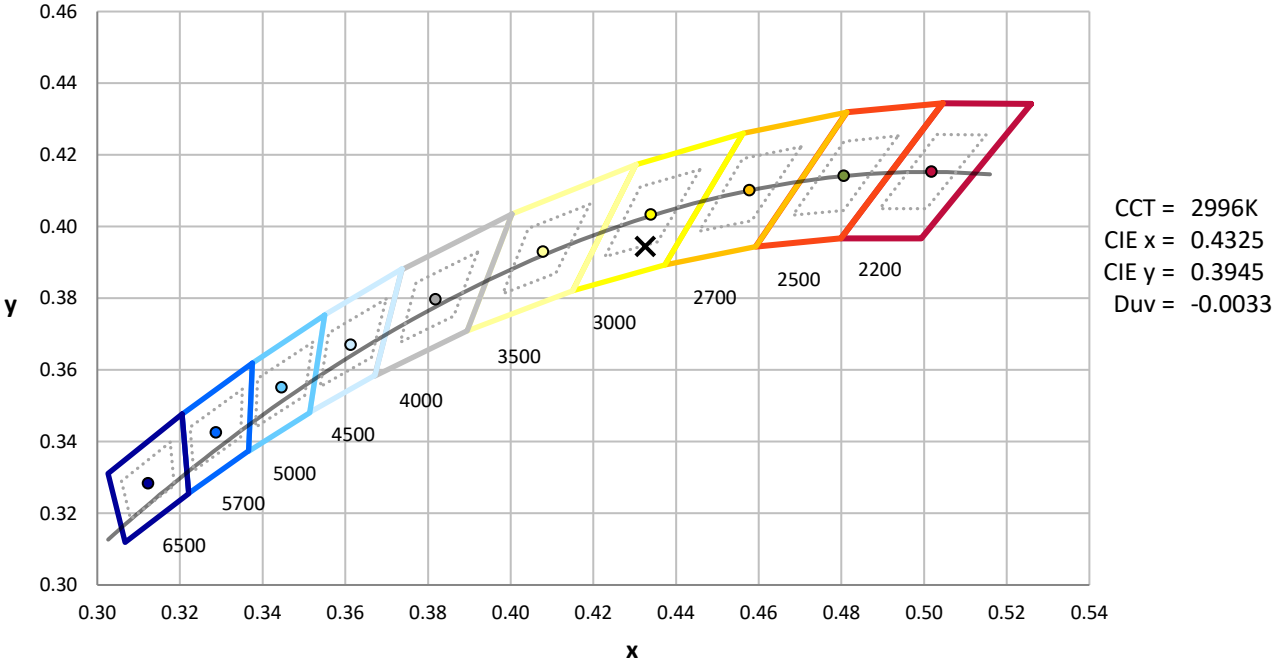

Point lies inside the ANSI 3000K 7-step quadrangle

REPORT NUMBER: SP1-2506-472-5

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.44

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.85


λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

Summary

$R_f = 91.3$
 $R_g = 102$
 CIE $R_a = 94.4$
 $R_9 = 61.4$



Color Vector Graphics

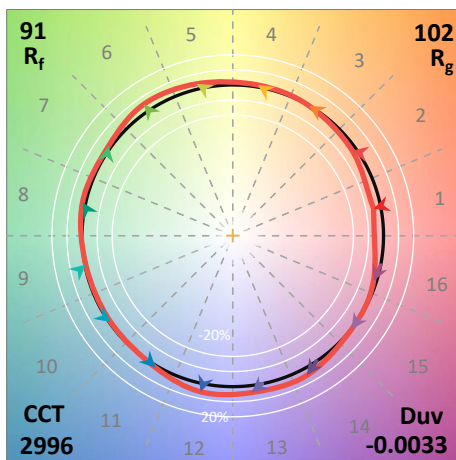

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 91	CES51 = 96	CES76 = 89
CES02 = 63	CES27 = 96	CES52 = 95	CES77 = 85
CES03 = 32	CES28 = 96	CES53 = 93	CES78 = 86
CES04 = 70	CES29 = 90	CES54 = 98	CES79 = 89
CES05 = 51	CES30 = 96	CES55 = 98	CES80 = 91
CES06 = 51	CES31 = 90	CES56 = 95	CES81 = 72
CES07 = 44	CES32 = 84	CES57 = 95	CES82 = 95
CES08 = 42	CES33 = 91	CES58 = 95	CES83 = 93
CES09 = 29	CES34 = 92	CES59 = 99	CES84 = 96
CES10 = 76	CES35 = 96	CES60 = 96	CES85 = 80
CES11 = 59	CES36 = 90	CES61 = 96	CES86 = 77
CES12 = 65	CES37 = 94	CES62 = 95	CES87 = 91
CES13 = 44	CES38 = 99	CES63 = 94	CES88 = 96
CES14 = 74	CES39 = 97	CES64 = 96	CES89 = 82
CES15 = 72	CES40 = 94	CES65 = 92	CES90 = 97
CES16 = 48	CES41 = 94	CES66 = 95	CES91 = 82
CES17 = 50	CES42 = 91	CES67 = 94	CES92 = 78
CES18 = 57	CES43 = 88	CES68 = 93	CES93 = 87
CES19 = 72	CES44 = 99	CES69 = 94	CES94 = 73
CES20 = 67	CES45 = 93	CES70 = 90	CES95 = 85
CES21 = 86	CES46 = 93	CES71 = 90	CES96 = 92
CES22 = 79	CES47 = 86	CES72 = 96	CES97 = 93
CES23 = 92	CES48 = 95	CES73 = 85	CES98 = 94
CES24 = 91	CES49 = 91	CES74 = 90	CES99 = 93
CES25 = 72	CES50 = 96	CES75 = 90	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)