

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1436423

Luminaire Tested: EHBR1-18-UNV-M-L930-UPL30

Issue Date: 3/25/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1436423  
REPORT IS A COMBINATION OF REPORTS P1436063 AND P1431635  
Test Lab: INNOVATION CENTER  
Issue Date: 3/25/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: METALUX  
Catalog Number: EHBR1-18-UNV-M-L930-UPL30  
Description: Elevate Round Highbay at, 18000 lumens, 3000K 90CRI LEDs with M lens  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 19084.0 lumens  
Efficiency: N/A  
Efficacy: 163.5 lumens/watt  
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.15  
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')  
CIE Type: Semi-Direct  
  
Input Watts (W): 116.7  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1436423  
CATALOG NUMBER: EHBR1-18-UNV-M-L930-UPL30

### Luminous Intensity Polar Plot

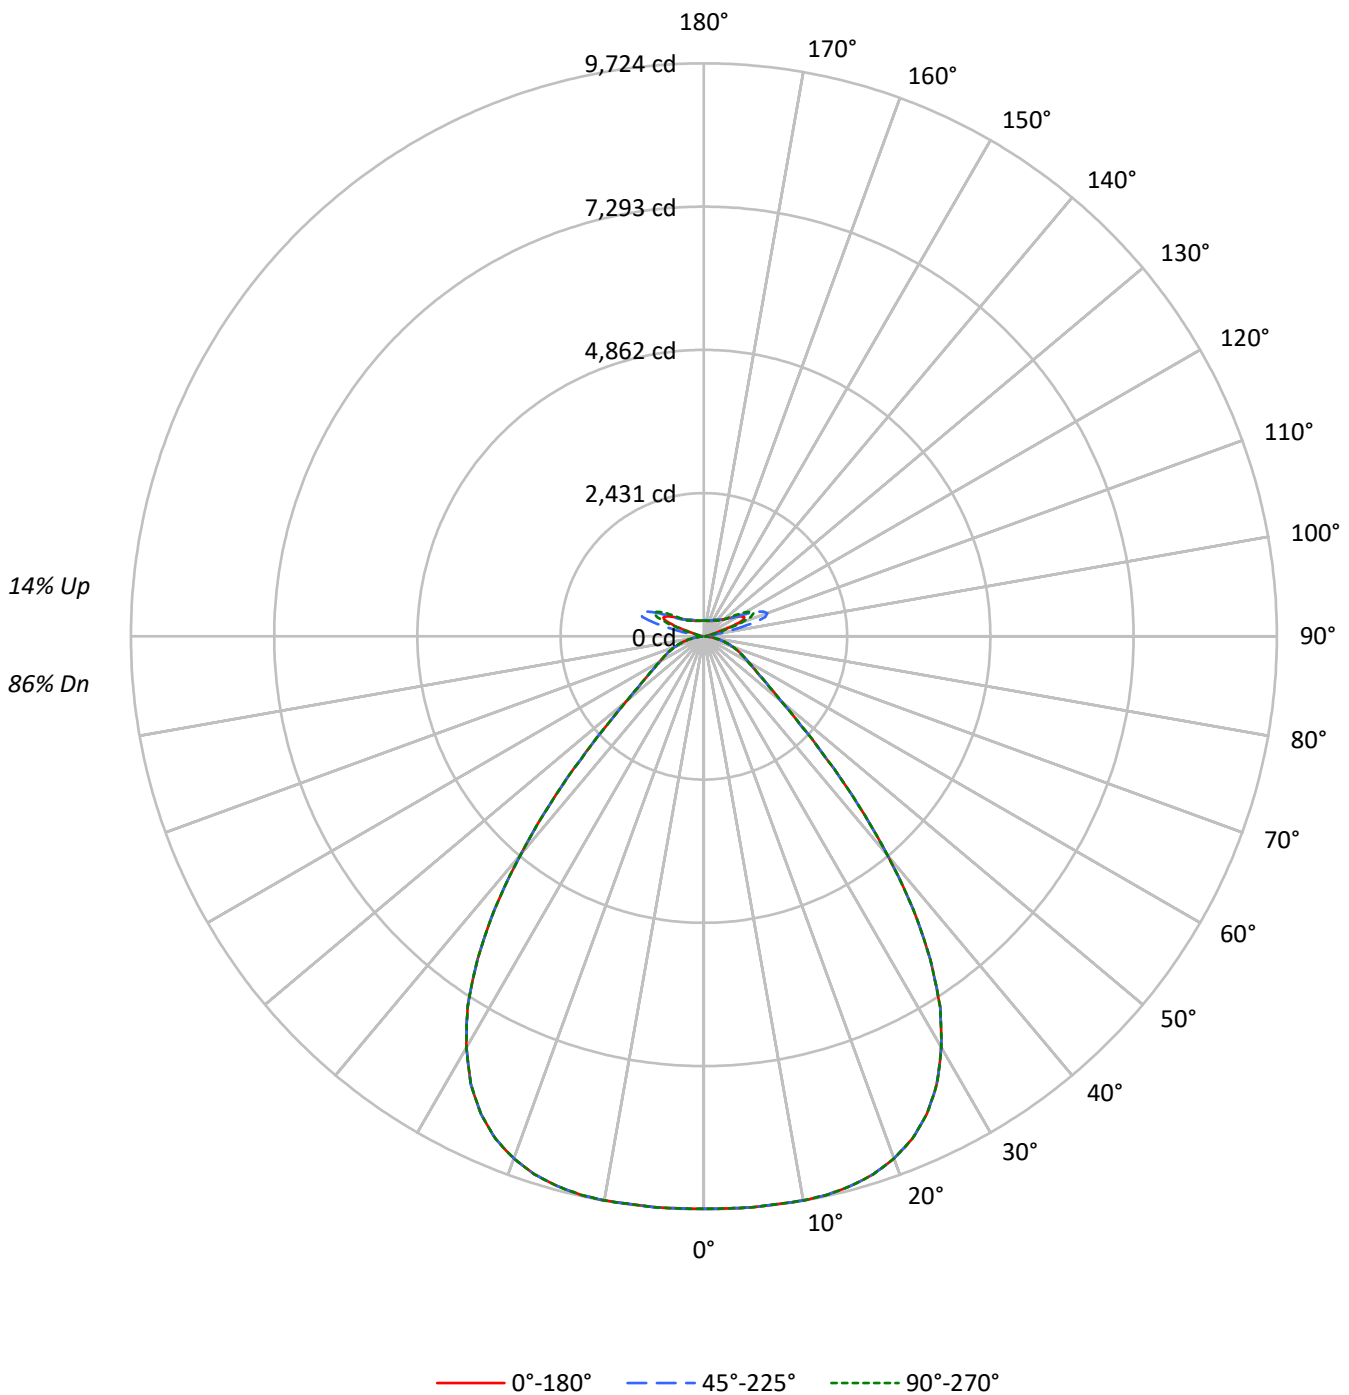



TEST NUMBER: P1436423  
 CATALOG NUMBER: EHBR1-18-UNV-M-L930-UPL30

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	116	116	116	116	111	111	111	111	103	103	103	96	96	96	89	89	89	89	89	89	86
1	108	105	101	98	104	101	98	95	94	92	90	88	86	85	83	81	80	80	80	80	77
2	101	94	89	85	97	91	87	83	86	82	79	81	78	75	76	73	71	71	71	71	69
3	94	85	79	74	90	83	77	72	78	73	69	74	70	67	70	67	64	64	64	64	61
4	87	78	71	65	84	75	69	64	71	66	62	68	63	60	64	60	57	57	57	57	55
5	81	71	64	58	78	69	62	57	66	60	55	62	57	54	59	55	52	52	52	52	50
6	76	65	58	52	73	63	57	52	60	54	50	57	52	49	55	51	47	47	47	47	45
7	71	60	52	47	69	58	52	47	56	50	45	53	48	44	51	46	43	43	43	43	41
8	67	55	48	43	65	54	47	43	52	46	42	49	44	41	47	43	40	40	40	40	38
9	63	51	44	39	61	50	43	39	48	42	38	46	41	37	44	40	36	36	36	36	35
10	59	48	41	36	57	47	40	36	45	39	35	43	38	34	41	37	34	34	34	34	32

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	45618	45618	45618
5°	45540	45540	45540
10°	45754	45754	45754
15°	46017	46017	46017
20°	45877	45877	45877
25°	44806	44806	44806
30°	41897	41897	41897
35°	36488	36488	36488
40°	27964	27964	27964
45°	18268	18268	18268
50°	11516	11516	11516
55°	8585	8585	8585
60°	7228	7228	7228
65°	6572	6572	6572
70°	5987	5987	5987
75°	5126	5126	5126
80°	3946	3946	3946
85°	2069	2069	2069

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 18268 cd/sqm



TEST NUMBER: P1436423  
 CATALOG NUMBER: EHBR1-18-UNV-M-L930-UPL30

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	927.8	4.9
10°-20°	2724.6	14.3
20°-30°	4088.2	21.4
30°-40°	4113.1	21.6
40°-50°	2354.5	12.3
50°-60°	1076.9	5.6
60°-70°	683.3	3.6
70°-80°	383.3	2.0
80°-90°	94.7	0.5
90°-100°	75.2	0.4
100°-110°	471.2	2.5
110°-120°	842.7	4.4
120°-130°	494.5	2.6
130°-140°	303.3	1.6
140°-150°	210.4	1.1
150°-160°	136.7	0.7
160°-170°	77.9	0.4
170°-180°	25.7	0.1
0°-30°	7740.6	40.6
0°-40°	11853.7	62.1
0°-60°	15285.1	80.1
0°-90°	16446.3	86.2
90°-120°	1389.2	7.3
90°-150°	2397.3	12.6
90°-180°	2638.0	13.8
0°-180°	19084.0	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	9714	9714	9714	9714	9714	
5°	9724	9724	9724	9724	9724	928
15°	9654	9654	9654	9654	9654	2725
25°	8948	8948	8948	8948	8948	4088
35°	6697	6697	6697	6697	6697	4113
45°	2956	2956	2956	2956	2956	2354
55°	1160	1160	1160	1160	1160	1077
65°	686	686	686	686	686	683
75°	361	361	361	361	361	383
85°	71	71	71	71	71	87
90°	20	32	54	35	20	12
95°	33	56	122	60	38	32
105°	165	325	829	358	217	220
115°	758	797	980	939	933	698
125°	546	510	524	532	596	498
135°	399	386	400	376	374	312
145°	328	323	343	338	337	208
155°	287	284	298	298	298	134
165°	269	269	276	276	275	77
175°	266	266	270	270	270	25
180°	269	269	269	269	269	



TEST NUMBER: P1436423

CATALOG NUMBER: EHBR1-18-UNV-M-L930-UPL30

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	9714.0	9714.0	9714.0	9714.0	9714.0
2.5°	9718.9	9718.9	9718.9	9718.9	9718.9
5°	9723.6	9723.6	9723.6	9723.6	9723.6
7.5°	9716.9	9716.9	9716.9	9716.9	9716.9
10°	9721.0	9721.0	9721.0	9721.0	9721.0
12.5°	9704.3	9704.3	9704.3	9704.3	9704.3
15°	9654.1	9654.1	9654.1	9654.1	9654.1
17.5°	9570.9	9570.9	9570.9	9570.9	9570.9
20°	9429.1	9429.1	9429.1	9429.1	9429.1
22.5°	9234.3	9234.3	9234.3	9234.3	9234.3
25°	8947.7	8947.7	8947.7	8947.7	8947.7
27.5°	8562.2	8562.2	8562.2	8562.2	8562.2
30°	8058.9	8058.9	8058.9	8058.9	8058.9
32.5°	7462.9	7462.9	7462.9	7462.9	7462.9
35°	6696.9	6696.9	6696.9	6696.9	6696.9
37.5°	5829.2	5829.2	5829.2	5829.2	5829.2
40°	4846.9	4846.9	4846.9	4846.9	4846.9
42.5°	3873.2	3873.2	3873.2	3873.2	3873.2
45°	2955.7	2955.7	2955.7	2955.7	2955.7
47.5°	2225.0	2225.0	2225.0	2225.0	2225.0
50°	1716.3	1716.3	1716.3	1716.3	1716.3
52.5°	1386.7	1386.7	1386.7	1386.7	1386.7
55°	1160.2	1160.2	1160.2	1160.2	1160.2
57.5°	993.4	993.4	993.4	993.4	993.4
60°	868.9	868.9	868.9	868.9	868.9
62.5°	772.7	772.7	772.7	772.7	772.7
65°	686.0	686.0	686.0	686.0	686.0
67.5°	606.2	606.2	606.2	606.2	606.2
70°	525.3	525.3	525.3	525.3	525.3
72.5°	443.9	443.9	443.9	443.9	443.9
75°	361.1	361.1	361.1	361.1	361.1
77.5°	282.4	282.4	282.4	282.4	282.4
80°	207.6	207.6	207.6	207.6	207.6
82.5°	135.4	135.4	135.4	135.4	135.4
85°	71.1	71.1	71.1	71.1	71.1
87.5°	20.3	20.3	20.3	20.3	20.3
90°	19.6	31.7	54.4	34.8	19.6
92.5°	28.7	48.3	87.6	45.3	25.7
95°	33.2	55.9	122.3	60.4	37.8
97.5°	42.2	61.9	140.4	74.0	58.9
100°	55.9	72.4	219.0	90.6	78.5
102.5°	95.1	154.0	465.0	170.7	119.3
105°	164.6	324.6	828.9	357.9	217.4
107.5°	285.3	581.3	1093.2	634.1	412.2
110°	533.0	771.5	1146.0	871.2	659.8



TEST NUMBER: P1436423

CATALOG NUMBER: EHBR1-18-UNV-M-L930-UPL30

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°
112.5°	720.2	828.9	1097.7	961.8	859.1
115°	757.9	797.2	979.9	939.2	933.1
117.5°	732.2	727.8	832.0	844.0	901.4
120°	677.9	647.8	694.6	736.8	813.8
122.5°	610.0	573.7	594.9	626.6	703.6
125°	546.5	510.4	523.9	531.5	596.4
127.5°	490.8	466.5	474.1	465.0	505.8
130°	453.0	431.8	442.4	421.2	440.8
132.5°	421.2	407.7	419.7	394.1	400.1
135°	398.6	386.5	400.1	376.0	374.5
137.5°	379.0	368.4	382.0	363.9	359.3
140°	360.8	351.8	366.9	353.3	350.3
142.5°	341.2	335.2	353.3	344.2	341.2
145°	327.7	323.1	342.7	338.2	336.7
147.5°	315.6	312.5	330.7	329.2	329.2
150°	305.0	302.0	320.1	318.6	320.1
152.5°	294.4	291.4	308.0	306.5	308.0
155°	286.9	283.8	297.5	297.5	297.5
157.5°	280.8	279.3	289.9	289.9	289.9
160°	276.3	274.8	283.8	283.8	282.3
162.5°	271.8	270.3	280.8	279.3	279.3
165°	268.8	268.8	276.3	276.3	274.8
167.5°	268.8	267.3	274.8	274.8	273.3
170°	267.3	267.3	273.3	271.8	270.3
172.5°	267.3	267.3	273.3	271.8	270.3
175°	265.7	265.7	270.3	270.3	270.3
177.5°	267.3	267.3	270.3	270.3	268.8
180°	268.8	268.8	268.8	268.8	268.8



TEST NUMBER: P1436423  
 CATALOG NUMBER: EHBR1-18-UNV-M-L930-UPL30

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.06	16.13	15.65	16.70	17.35	15.06	16.13	15.65	16.70	17.35
	3H	16.54	17.49	17.15	18.08	18.77	16.54	17.49	17.15	18.08	18.77
	4H	17.06	17.95	17.69	18.55	19.25	17.06	17.95	17.69	18.55	19.25
	6H	17.38	18.20	18.02	18.81	19.53	17.38	18.20	18.02	18.81	19.53
	8H	17.45	18.22	18.10	18.85	19.57	17.45	18.22	18.10	18.85	19.57
	12H	17.46	18.19	18.11	18.82	19.56	17.46	18.19	18.11	18.82	19.56
4H	2H	15.49	16.38	16.12	16.98	17.68	15.49	16.38	16.12	16.98	17.68
	3H	17.18	17.91	17.82	18.55	19.27	17.18	17.91	17.82	18.55	19.27
	4H	17.81	18.46	18.46	19.12	19.87	17.81	18.46	18.46	19.12	19.87
	6H	18.23	18.79	18.91	19.47	20.24	18.23	18.79	18.91	19.47	20.24
	8H	18.32	18.85	19.01	19.52	20.30	18.32	18.85	19.01	19.52	20.30
	12H	18.35	18.82	19.05	19.52	20.29	18.35	18.82	19.05	19.52	20.29
8H	4H	17.98	18.51	18.66	19.18	19.96	17.98	18.51	18.66	19.18	19.96
	6H	18.49	18.92	19.20	19.64	20.42	18.49	18.92	19.20	19.64	20.42
	8H	18.63	19.01	19.36	19.74	20.53	18.63	19.01	19.36	19.74	20.53
	12H	18.69	19.03	19.42	19.74	20.60	18.69	19.03	19.42	19.74	20.60
12H	4H	17.97	18.43	18.66	19.13	19.91	17.97	18.43	18.66	19.13	19.91
	6H	18.49	18.88	19.22	19.60	20.39	18.49	18.88	19.22	19.60	20.39
	8H	18.66	19.00	19.38	19.71	20.57	18.66	19.00	19.38	19.71	20.57

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-5

Test Date: 08/01/2025

Luminaire Tested: EHBR-60-L930-N

Data in this report applies to families of products including EHBR-60-L930-N

**Test Information**

Test Method: LM-79-2019  
 Report Number: SP1-2506-472-5  
 Test Lab: COOPER LIGHTING SOLUTIONS  
 Photometer: SP1 - 76IN SPHERE  
 Measurement Geometry: 4π  
 Issue Date: 08/05/2025  
 Manufacturer: COOPER LIGHTING SOLUTIONS  
 Product Line: Metalux  
 Catalog Number: **EHBR-60-L930-N**  
 Description: Elevate Round Highbay at, 60000 lumens, 3000K 90CRI LEDs with N lens

**Spectral Parameters**

CCT (K): 2996  
 CIE u': 0.2519  
 CIE v': 0.5169  
 Duv: -0.0033  
 CIE x: 0.4325  
 CIE y: 0.3945  
 CIE z: 0.1730  
 Peak Wavelength (nm): 630  
 Dominant Wavelength (nm): 584  
 Purity: 48.21818  
 Rf: 91.3  
 Rg: 102

CRI (Ra):	94.4		
R1:	96.8	R9:	61.4
R2:	98.1	R10:	94.4
R3:	97.8	R11:	95.7
R4:	95.6	R12:	88.5
R5:	96.9	R13:	97.3
R6:	95.7	R14:	97.8
R7:	90.9	R15:	92.3
R8:	83.0		



**Test Conditions**

Stabilization Time: 40M  
 Operation Time: 1H 40M  
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-5

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-5

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3000K 7-step quadrangle

REPORT NUMBER: SP1-2506-472-5

**Photopic Flux vs. Wavelength**




**Photopic Lumens: NR**

$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

Scotopic Flux vs. Wavelength

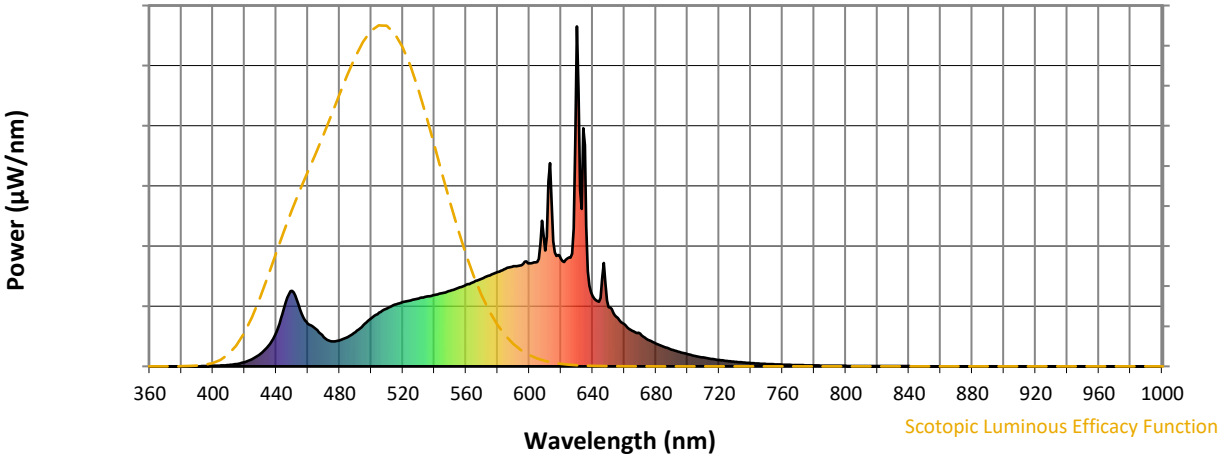

Scotopic Lumens: NR S/P: 1.44

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

**Melanopic Flux vs. Wavelength**



**Melanopic Lumens: NR**

**M/P: 2.85**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

**Summary**

$R_f = 91.3$   
 $R_g = 102$   
 $CIE R_a = 94.4$   
 $R_9 = 61.4$



**Color Vector Graphics**



**Individual Sample Fidelity Index ( $R_{f,i}$ )**

CES01 = 86	CES26 = 91	CES51 = 96	CES76 = 89
CES02 = 63	CES27 = 96	CES52 = 95	CES77 = 85
CES03 = 32	CES28 = 96	CES53 = 93	CES78 = 86
CES04 = 70	CES29 = 90	CES54 = 98	CES79 = 89
CES05 = 51	CES30 = 96	CES55 = 98	CES80 = 91
CES06 = 51	CES31 = 90	CES56 = 95	CES81 = 72
CES07 = 44	CES32 = 84	CES57 = 95	CES82 = 95
CES08 = 42	CES33 = 91	CES58 = 95	CES83 = 93
CES09 = 29	CES34 = 92	CES59 = 99	CES84 = 96
CES10 = 76	CES35 = 96	CES60 = 96	CES85 = 80
CES11 = 59	CES36 = 90	CES61 = 96	CES86 = 77
CES12 = 65	CES37 = 94	CES62 = 95	CES87 = 91
CES13 = 44	CES38 = 99	CES63 = 94	CES88 = 96
CES14 = 74	CES39 = 97	CES64 = 96	CES89 = 82
CES15 = 72	CES40 = 94	CES65 = 92	CES90 = 97
CES16 = 48	CES41 = 94	CES66 = 95	CES91 = 82
CES17 = 50	CES42 = 91	CES67 = 94	CES92 = 78
CES18 = 57	CES43 = 88	CES68 = 93	CES93 = 87
CES19 = 72	CES44 = 99	CES69 = 94	CES94 = 73
CES20 = 67	CES45 = 93	CES70 = 90	CES95 = 85
CES21 = 86	CES46 = 93	CES71 = 90	CES96 = 92
CES22 = 79	CES47 = 86	CES72 = 96	CES97 = 93
CES23 = 92	CES48 = 95	CES73 = 85	CES98 = 94
CES24 = 91	CES49 = 91	CES74 = 90	CES99 = 93
CES25 = 72	CES50 = 96	CES75 = 90	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)