

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1433143

Luminaire Tested: EHBR1-18-UNV-W-L930-UPL36

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number: P1433143
REPORT IS A COMBINATION OF REPORTS P1431697 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-18-UNV-W-L930-UPL36
Description: Elevate Round Highbay at, 19000 lumens, 3000K 90CRI LEDs with W lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 19482.7 lumens
Efficiency: N/A
Efficacy: 158.3 lumens/watt
Spacing Criteria (0/90/45): 1.54 / 1.54 / 1.31
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 123.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1433143
CATALOG NUMBER: EHBR1-18-UNV-W-L930-UPL36

Luminous Intensity Polar Plot

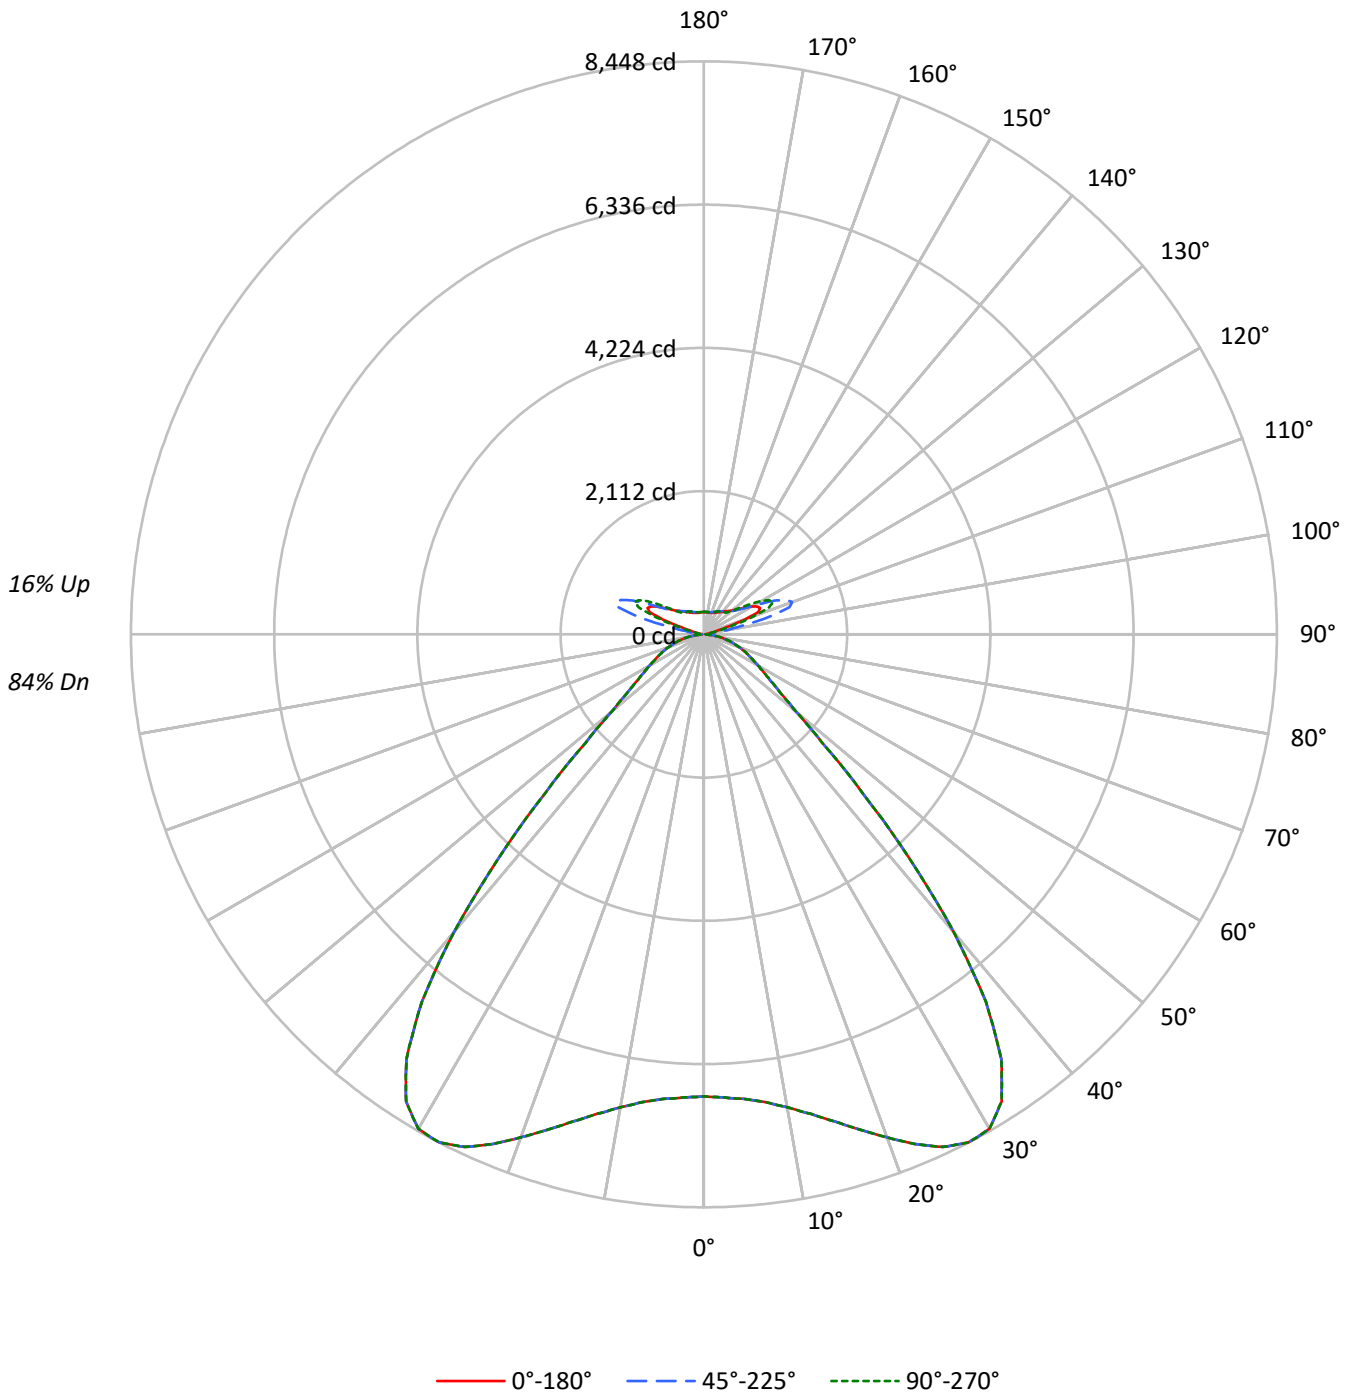



TEST NUMBER: P1433143
 CATALOG NUMBER: EHBR1-18-UNV-W-L930-UPL36

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	115	115	115	115	111	111	111	111	102	102	102	94	94	94	87	87	87	87	87	87	84
1	107	103	100	97	103	100	97	94	93	90	88	86	84	83	80	79	77	77	77	77	74
2	99	93	87	83	95	90	85	81	84	80	76	78	75	72	73	70	68	68	68	68	66
3	92	84	77	72	88	81	75	70	76	71	67	71	67	64	67	63	61	61	61	61	58
4	85	76	68	63	82	73	67	61	69	63	59	65	60	56	61	57	54	54	54	54	52
5	79	69	61	55	76	67	60	54	63	57	52	59	54	50	56	52	48	48	48	48	46
6	74	62	55	49	71	61	54	48	57	51	47	54	49	45	51	47	44	44	44	44	41
7	69	57	50	44	66	56	49	44	53	47	42	50	45	41	47	43	39	39	39	39	37
8	64	52	45	40	62	51	44	39	49	42	38	46	41	37	44	39	36	36	36	36	34
9	60	48	41	36	58	47	40	36	45	39	35	43	37	34	41	36	33	33	33	33	31
10	57	45	38	33	55	44	37	32	42	36	32	40	34	31	38	33	30	30	30	30	28

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	31990	31990	31990
5°	32203	32203	32203
10°	33322	33322	33322
15°	35433	35433	35433
20°	38411	38411	38411
25°	41756	41756	41756
30°	43768	43768	43768
35°	41659	41659	41659
40°	33057	33057	33057
45°	20432	20432	20432
50°	11831	11831	11831
55°	8951	8951	8951
60°	7679	7679	7679
65°	6935	6935	6935
70°	6380	6380	6380
75°	5637	5637	5637
80°	4594	4594	4594
85°	2706	2706	2706

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 20432 cd/sqm



TEST NUMBER: P1433143
 CATALOG NUMBER: EHBR1-18-UNV-W-L930-UPL36

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	662.8	3.4
10°-20°	2124.8	10.9
20°-30°	3835.4	19.7
30°-40°	4634.7	23.8
40°-50°	2647.9	13.6
50°-60°	1121.5	5.8
60°-70°	723.3	3.7
70°-80°	420.6	2.2
80°-90°	117.1	0.6
90°-100°	91.3	0.5
100°-110°	569.5	2.9
110°-120°	1018.1	5.2
120°-130°	597.8	3.1
130°-140°	367.8	1.9
140°-150°	256.2	1.3
150°-160°	166.9	0.9
160°-170°	95.3	0.5
170°-180°	31.5	0.2
0°-30°	6623.0	34.0
0°-40°	11257.7	57.8
0°-60°	15027.1	77.1
0°-90°	16288.2	83.6
90°-120°	1678.9	8.6
90°-150°	2900.8	14.9
90°-180°	3194.0	16.4
0°-180°	19482.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	6812	6812	6812	6812	6812	
5°	6876	6876	6876	6876	6876	663
15°	7434	7434	7434	7434	7434	2125
25°	8339	8339	8339	8339	8339	3835
35°	7646	7646	7646	7646	7646	4635
45°	3306	3306	3306	3306	3306	2648
55°	1210	1210	1210	1210	1210	1121
65°	724	724	724	724	724	723
75°	397	397	397	397	397	421
85°	93	93	93	93	93	107
90°	24	39	66	42	24	15
95°	41	68	148	73	46	39
105°	199	392	1001	433	263	267
115°	916	963	1184	1134	1127	844
125°	661	617	634	643	721	602
135°	483	469	485	456	454	378
145°	399	394	417	412	410	253
155°	350	347	363	363	363	163
165°	329	329	338	338	336	94
175°	326	326	331	331	331	31
180°	330	330	330	330	330	



TEST NUMBER: P1433143

CATALOG NUMBER: EHBR1-18-UNV-W-L930-UPL36

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	6812.1	6812.1	6812.1	6812.1	6812.1
2.5°	6835.0	6835.0	6835.0	6835.0	6835.0
5°	6875.9	6875.9	6875.9	6875.9	6875.9
7.5°	6956.1	6956.1	6956.1	6956.1	6956.1
10°	7079.7	7079.7	7079.7	7079.7	7079.7
12.5°	7240.2	7240.2	7240.2	7240.2	7240.2
15°	7433.7	7433.7	7433.7	7433.7	7433.7
17.5°	7655.2	7655.2	7655.2	7655.2	7655.2
20°	7894.5	7894.5	7894.5	7894.5	7894.5
22.5°	8135.3	8135.3	8135.3	8135.3	8135.3
25°	8338.7	8338.7	8338.7	8338.7	8338.7
27.5°	8448.0	8448.0	8448.0	8448.0	8448.0
30°	8418.7	8418.7	8418.7	8418.7	8418.7
32.5°	8169.1	8169.1	8169.1	8169.1	8169.1
35°	7646.0	7646.0	7646.0	7646.0	7646.0
37.5°	6830.4	6830.4	6830.4	6830.4	6830.4
40°	5729.6	5729.6	5729.6	5729.6	5729.6
42.5°	4484.5	4484.5	4484.5	4484.5	4484.5
45°	3305.8	3305.8	3305.8	3305.8	3305.8
47.5°	2362.8	2362.8	2362.8	2362.8	2362.8
50°	1763.2	1763.2	1763.2	1763.2	1763.2
52.5°	1427.7	1427.7	1427.7	1427.7	1427.7
55°	1209.7	1209.7	1209.7	1209.7	1209.7
57.5°	1050.5	1050.5	1050.5	1050.5	1050.5
60°	923.1	923.1	923.1	923.1	923.1
62.5°	817.0	817.0	817.0	817.0	817.0
65°	723.9	723.9	723.9	723.9	723.9
67.5°	641.7	641.7	641.7	641.7	641.7
70°	559.8	559.8	559.8	559.8	559.8
72.5°	478.2	478.2	478.2	478.2	478.2
75°	397.1	397.1	397.1	397.1	397.1
77.5°	318.9	318.9	318.9	318.9	318.9
80°	241.7	241.7	241.7	241.7	241.7
82.5°	165.8	165.8	165.8	165.8	165.8
85°	93.0	93.0	93.0	93.0	93.0
87.5°	29.4	29.4	29.4	29.4	29.4
90°	24.2	38.9	66.1	42.4	24.2
92.5°	34.9	58.6	106.0	55.0	31.3
95°	40.6	68.0	148.2	73.4	46.1
97.5°	51.6	75.3	170.0	89.8	71.6
100°	68.0	88.0	264.8	109.9	95.4
102.5°	115.4	186.4	562.0	206.5	144.5
105°	199.2	392.5	1001.2	432.6	263.0
107.5°	345.0	702.3	1320.2	766.1	498.1
110°	644.2	932.2	1384.3	1052.5	797.3



TEST NUMBER: P1433143

CATALOG NUMBER: EHBR1-18-UNV-W-L930-UPL36

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	870.3	1001.5	1325.9	1161.9	1037.9
115°	915.8	963.2	1183.8	1134.5	1127.3
117.5°	884.8	879.4	1005.1	1019.7	1089.0
120°	819.2	782.8	839.3	890.3	983.3
122.5°	737.2	693.5	719.0	757.2	850.2
125°	660.9	617.1	633.6	642.7	721.0
127.5°	593.5	564.3	573.4	562.5	611.7
130°	548.1	522.7	535.4	509.9	533.6
132.5°	510.4	494.0	508.6	477.6	484.9
135°	483.4	468.7	485.1	456.0	454.2
137.5°	459.9	447.2	463.6	441.6	436.2
140°	438.7	427.7	445.9	429.5	425.9
142.5°	415.3	408.0	429.8	418.9	415.3
145°	399.1	393.6	417.3	411.9	410.0
147.5°	384.8	381.1	403.0	401.2	401.2
150°	372.1	368.4	390.2	388.4	390.2
152.5°	359.3	355.7	375.7	373.8	375.7
155°	350.4	346.7	363.1	363.1	363.1
157.5°	343.1	341.3	354.0	354.0	354.0
160°	337.9	336.1	347.0	347.0	345.2
162.5°	332.8	330.9	343.6	341.8	341.8
165°	329.1	329.1	338.2	338.2	336.4
167.5°	329.1	327.2	336.4	336.4	334.5
170°	327.2	327.2	334.5	332.8	330.9
172.5°	327.5	327.5	334.8	333.0	331.1
175°	326.0	326.0	331.4	331.4	331.4
177.5°	327.8	327.8	331.4	331.4	329.6
180°	329.9	329.9	329.9	329.9	329.9



TEST NUMBER: P1433143
 CATALOG NUMBER: EHBR1-18-UNV-W-L930-UPL36

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.25	16.31	15.88	16.93	17.63	15.25	16.31	15.88	16.93	17.63
	3H	16.74	17.69	17.38	18.31	19.05	16.74	17.69	17.38	18.31	19.05
	4H	17.30	18.18	17.96	18.82	19.58	17.30	18.18	17.96	18.82	19.58
	6H	17.68	18.49	18.35	19.14	19.91	17.68	18.49	18.35	19.14	19.91
	8H	17.77	18.54	18.46	19.21	19.98	17.77	18.54	18.46	19.21	19.98
	12H	17.81	18.54	18.49	19.20	20.00	17.81	18.54	18.49	19.20	20.00
4H	2H	15.68	16.56	16.34	17.21	17.96	15.68	16.56	16.34	17.21	17.96
	3H	17.39	18.12	18.06	18.80	19.57	17.39	18.12	18.06	18.80	19.57
	4H	18.07	18.72	18.75	19.41	20.21	18.07	18.72	18.75	19.41	20.21
	6H	18.56	19.12	19.27	19.83	20.65	18.56	19.12	19.27	19.83	20.65
	8H	18.69	19.22	19.40	19.92	20.75	18.69	19.22	19.40	19.92	20.75
	12H	18.74	19.21	19.47	19.95	20.77	18.74	19.21	19.47	19.95	20.77
8H	4H	18.26	18.79	18.98	19.50	20.32	18.26	18.79	18.98	19.50	20.32
	6H	18.86	19.29	19.60	20.04	20.87	18.86	19.29	19.60	20.04	20.87
	8H	19.04	19.43	19.80	20.19	21.03	19.04	19.43	19.80	20.19	21.03
	12H	19.15	19.49	19.90	20.23	21.13	19.15	19.49	19.90	20.23	21.13
12H	4H	18.25	18.72	18.98	19.46	20.28	18.25	18.72	18.98	19.46	20.28
	6H	18.87	19.26	19.63	20.01	20.86	18.87	19.26	19.63	20.01	20.86
	8H	19.09	19.43	19.85	20.17	21.08	19.09	19.43	19.85	20.17	21.08

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-5

Test Date: 08/01/2025

Luminaire Tested: EHBR-60-L930-N

Data in this report applies to families of products including EHBR-60-L930-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-5
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L930-N**
 Description: Elevate Round Highbay at, 60000 lumens, 3000K 90CRI LEDs with N lens

Spectral Parameters

CCT (K): 2996
 CIE u': 0.2519
 CIE v': 0.5169
 Duv: -0.0033
 CIE x: 0.4325
 CIE y: 0.3945
 CIE z: 0.1730
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 584
 Purity: 48.21818
 Rf: 91.3
 Rg: 102

CRI (Ra):	94.4		
R1:	96.8	R9:	61.4
R2:	98.1	R10:	94.4
R3:	97.8	R11:	95.7
R4:	95.6	R12:	88.5
R5:	96.9	R13:	97.3
R6:	95.7	R14:	97.8
R7:	90.9	R15:	92.3
R8:	83.0		



Test Conditions

Stabilization Time: 40M
 Operation Time: 1H 40M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-5

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-5

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3000K 7-step quadrangle

REPORT NUMBER: SP1-2506-472-5

Photopic Flux vs. Wavelength




Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

Scotopic Flux vs. Wavelength

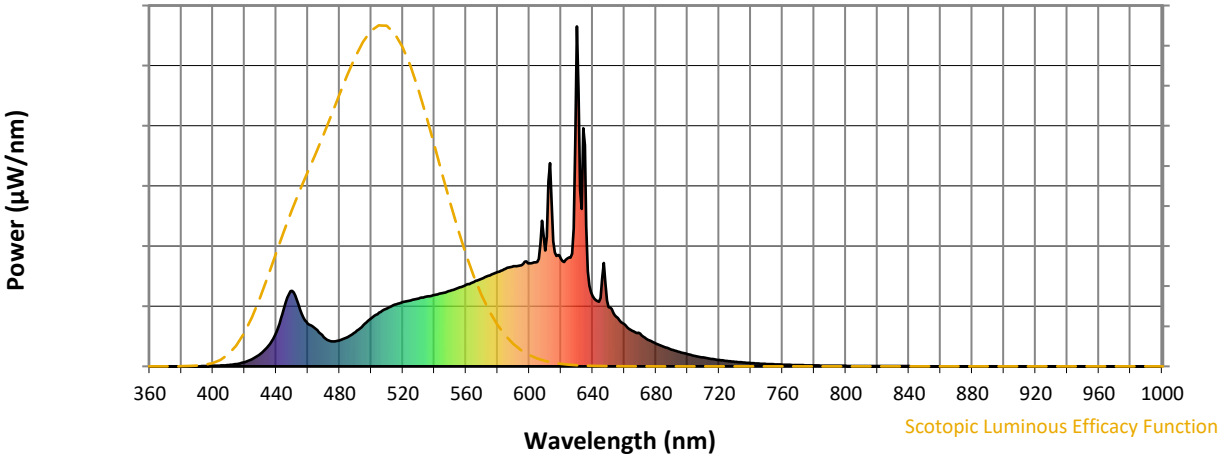

Scotopic Lumens: NR S/P: 1.44

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.85

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

Summary

$R_f = 91.3$
 $R_g = 102$
 $CIE R_a = 94.4$
 $R_9 = 61.4$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 91	CES51 = 96	CES76 = 89
CES02 = 63	CES27 = 96	CES52 = 95	CES77 = 85
CES03 = 32	CES28 = 96	CES53 = 93	CES78 = 86
CES04 = 70	CES29 = 90	CES54 = 98	CES79 = 89
CES05 = 51	CES30 = 96	CES55 = 98	CES80 = 91
CES06 = 51	CES31 = 90	CES56 = 95	CES81 = 72
CES07 = 44	CES32 = 84	CES57 = 95	CES82 = 95
CES08 = 42	CES33 = 91	CES58 = 95	CES83 = 93
CES09 = 29	CES34 = 92	CES59 = 99	CES84 = 96
CES10 = 76	CES35 = 96	CES60 = 96	CES85 = 80
CES11 = 59	CES36 = 90	CES61 = 96	CES86 = 77
CES12 = 65	CES37 = 94	CES62 = 95	CES87 = 91
CES13 = 44	CES38 = 99	CES63 = 94	CES88 = 96
CES14 = 74	CES39 = 97	CES64 = 96	CES89 = 82
CES15 = 72	CES40 = 94	CES65 = 92	CES90 = 97
CES16 = 48	CES41 = 94	CES66 = 95	CES91 = 82
CES17 = 50	CES42 = 91	CES67 = 94	CES92 = 78
CES18 = 57	CES43 = 88	CES68 = 93	CES93 = 87
CES19 = 72	CES44 = 99	CES69 = 94	CES94 = 73
CES20 = 67	CES45 = 93	CES70 = 90	CES95 = 85
CES21 = 86	CES46 = 93	CES71 = 90	CES96 = 92
CES22 = 79	CES47 = 86	CES72 = 96	CES97 = 93
CES23 = 92	CES48 = 95	CES73 = 85	CES98 = 94
CES24 = 91	CES49 = 91	CES74 = 90	CES99 = 93
CES25 = 72	CES50 = 96	CES75 = 90	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)