

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1436457

Luminaire Tested: EHBR1-42-UNV-M-L930-UPL40

Issue Date: 3/25/2026

Test Information

Test Method: LM-79-2019
Report Number: P1436457
REPORT IS A COMBINATION OF REPORTS P1436097 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/25/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-42-UNV-M-L930-UPL40
Description: Elevate Round Highbay at, 42000 lumens, 3000K 90CRI LEDs with M lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 40513.2 lumens
Efficiency: N/A
Efficacy: 158.9 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.15
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 255
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1436457
CATALOG NUMBER: EHBR1-42-UNV-M-L930-UPL40

Luminous Intensity Polar Plot

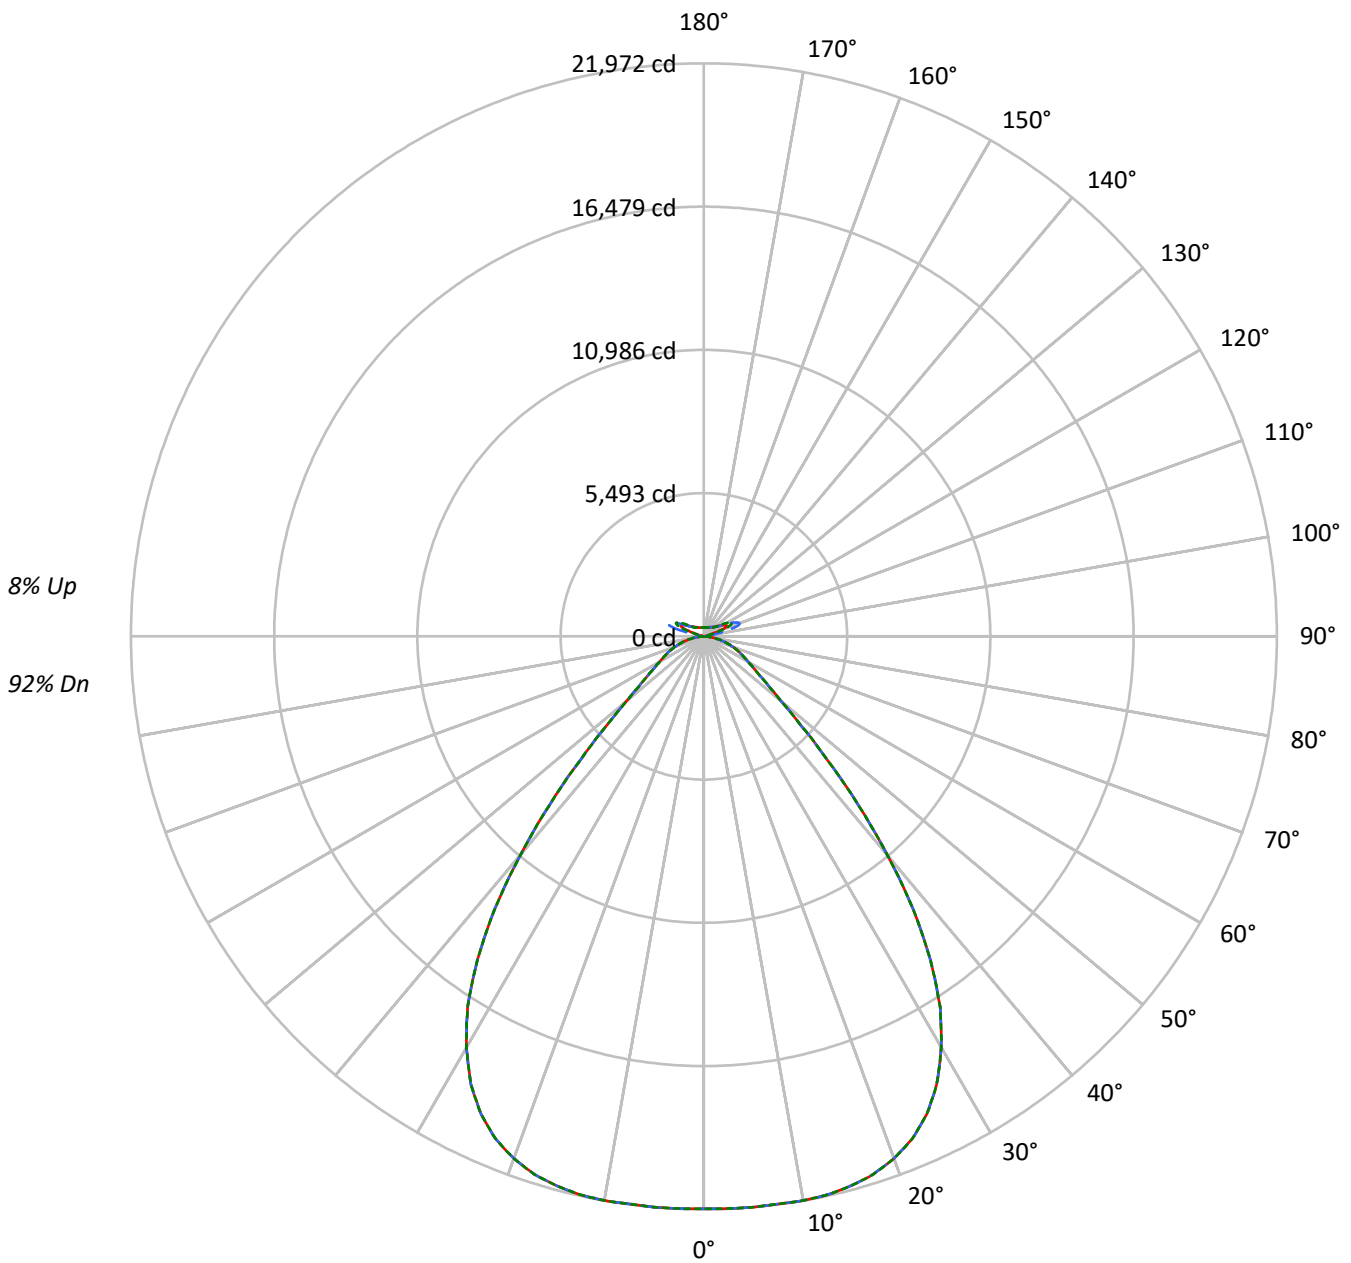

— 0°-180° - - - 45°-225° - · - · - 90°-270°



TEST NUMBER: P1436457
 CATALOG NUMBER: EHBR1-42-UNV-M-L930-UPL40

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	117	117	117	117	113	113	113	113	107	107	107	100	100	100	94	94	94	94	94	94	92
1	110	106	103	100	106	103	100	97	97	95	93	92	90	89	87	86	85	85	85	85	82
2	102	96	90	86	99	93	88	84	89	85	81	84	81	78	80	78	75	75	75	75	73
3	95	87	80	75	92	85	79	74	81	76	72	77	73	70	74	70	68	68	68	68	65
4	89	79	72	67	86	77	71	66	74	68	64	71	66	62	68	64	61	61	61	61	59
5	83	72	65	60	80	71	64	59	68	62	58	65	60	56	63	58	55	55	55	55	53
6	77	66	59	54	75	65	58	53	63	57	52	60	55	51	58	54	50	50	50	50	48
7	72	61	54	49	70	60	53	48	58	52	47	56	50	46	54	49	46	46	46	46	44
8	68	57	49	44	66	56	49	44	54	48	43	52	46	43	50	45	42	42	42	42	40
9	64	52	45	41	62	52	45	40	50	44	40	48	43	39	47	42	39	39	39	39	37
10	60	49	42	37	59	48	42	37	47	41	37	45	40	36	44	39	36	36	36	36	34

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	103082	103082	103082
5°	102906	102906	102906
10°	103389	103389	103389
15°	103983	103983	103983
20°	103669	103669	103669
25°	101248	101248	101248
30°	94674	94674	94674
35°	82452	82452	82452
40°	63190	63190	63190
45°	41280	41280	41280
50°	26023	26023	26023
55°	19399	19399	19399
60°	16332	16332	16332
65°	14851	14851	14851
70°	13529	13529	13529
75°	11581	11581	11581
80°	8919	8919	8919
85°	4679	4679	4679

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 41280 cd/sqm



TEST NUMBER: P1436457
 CATALOG NUMBER: EHBR1-42-UNV-M-L930-UPL40

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2096.5	5.2
10°-20°	6156.8	15.2
20°-30°	9238.0	22.8
30°-40°	9294.4	22.9
40°-50°	5320.3	13.1
50°-60°	2433.4	6.0
60°-70°	1544.0	3.8
70°-80°	866.1	2.1
80°-90°	209.3	0.5
90°-100°	95.6	0.2
100°-110°	599.3	1.5
110°-120°	1071.8	2.6
120°-130°	628.9	1.6
130°-140°	385.8	1.0
140°-150°	267.6	0.7
150°-160°	173.8	0.4
160°-170°	99.1	0.2
170°-180°	32.7	0.1
0°-30°	17491.2	43.2
0°-40°	26785.6	66.1
0°-60°	34539.4	85.3
0°-90°	37158.6	91.7
90°-120°	1766.7	4.4
90°-150°	3048.9	7.5
90°-180°	3355.0	8.3
0°-180°	40513.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	21951	21951	21951	21951	21951	
5°	21972	21972	21972	21972	21972	2097
15°	21815	21815	21815	21815	21815	6157
25°	20219	20219	20219	20219	20219	9238
35°	15133	15133	15133	15133	15133	9294
45°	6679	6679	6679	6679	6679	5320
55°	2622	2622	2622	2622	2622	2433
65°	1550	1550	1550	1550	1550	1544
75°	816	816	816	816	816	866
85°	161	161	161	161	161	197
90°	25	40	69	44	25	18
95°	42	71	156	77	48	41
105°	209	413	1054	455	276	280
115°	964	1014	1246	1194	1187	888
125°	695	649	666	676	758	634
135°	507	492	509	478	476	397
145°	417	411	436	430	428	264
155°	365	361	378	378	378	170
165°	342	342	351	351	350	98
175°	338	338	344	344	344	32
180°	342	342	342	342	342	



TEST NUMBER: P1436457

CATALOG NUMBER: EHBR1-42-UNV-M-L930-UPL40

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	21950.6	21950.6	21950.6	21950.6	21950.6
2.5°	21961.3	21961.3	21961.3	21961.3	21961.3
5°	21972.0	21972.0	21972.0	21972.0	21972.0
7.5°	21957.0	21957.0	21957.0	21957.0	21957.0
10°	21966.4	21966.4	21966.4	21966.4	21966.4
12.5°	21928.7	21928.7	21928.7	21928.7	21928.7
15°	21815.0	21815.0	21815.0	21815.0	21815.0
17.5°	21627.2	21627.2	21627.2	21627.2	21627.2
20°	21306.9	21306.9	21306.9	21306.9	21306.9
22.5°	20866.6	20866.6	20866.6	20866.6	20866.6
25°	20219.1	20219.1	20219.1	20219.1	20219.1
27.5°	19347.9	19347.9	19347.9	19347.9	19347.9
30°	18210.4	18210.4	18210.4	18210.4	18210.4
32.5°	16863.8	16863.8	16863.8	16863.8	16863.8
35°	15132.9	15132.9	15132.9	15132.9	15132.9
37.5°	13172.0	13172.0	13172.0	13172.0	13172.0
40°	10952.4	10952.4	10952.4	10952.4	10952.4
42.5°	8752.2	8752.2	8752.2	8752.2	8752.2
45°	6679.0	6679.0	6679.0	6679.0	6679.0
47.5°	5027.7	5027.7	5027.7	5027.7	5027.7
50°	3878.4	3878.4	3878.4	3878.4	3878.4
52.5°	3133.5	3133.5	3133.5	3133.5	3133.5
55°	2621.6	2621.6	2621.6	2621.6	2621.6
57.5°	2244.8	2244.8	2244.8	2244.8	2244.8
60°	1963.4	1963.4	1963.4	1963.4	1963.4
62.5°	1746.1	1746.1	1746.1	1746.1	1746.1
65°	1550.1	1550.1	1550.1	1550.1	1550.1
67.5°	1369.9	1369.9	1369.9	1369.9	1369.9
70°	1187.1	1187.1	1187.1	1187.1	1187.1
72.5°	1003.1	1003.1	1003.1	1003.1	1003.1
75°	815.8	815.8	815.8	815.8	815.8
77.5°	638.1	638.1	638.1	638.1	638.1
80°	469.2	469.2	469.2	469.2	469.2
82.5°	305.8	305.8	305.8	305.8	305.8
85°	160.8	160.8	160.8	160.8	160.8
87.5°	45.9	45.9	45.9	45.9	45.9
90°	25.0	40.4	69.2	44.2	25.0
92.5°	36.4	61.5	111.4	57.6	32.6
95°	42.2	71.0	155.5	76.8	48.0
97.5°	53.7	78.7	178.6	94.1	74.9
100°	71.0	92.1	278.5	115.2	99.9
102.5°	121.0	195.9	591.4	217.0	151.7
105°	209.3	412.9	1054.2	455.1	276.5
107.5°	363.0	739.3	1390.3	806.5	524.3
110°	677.9	981.2	1457.5	1108.0	839.2



TEST NUMBER: P1436457

CATALOG NUMBER: EHBR1-42-UNV-M-L930-UPL40

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	916.0	1054.2	1396.1	1223.2	1092.6
115°	963.9	1013.9	1246.3	1194.4	1186.7
117.5°	931.3	925.5	1058.0	1073.5	1146.4
120°	862.2	823.8	883.3	937.1	1035.1
122.5°	775.8	729.7	756.6	796.9	894.9
125°	695.1	649.0	666.3	675.9	758.5
127.5°	624.1	593.3	602.9	591.4	643.3
130°	576.1	549.2	562.7	535.8	560.7
132.5°	535.8	518.5	533.8	501.2	508.8
135°	507.0	491.6	508.8	478.2	476.2
137.5°	482.0	468.6	485.8	462.8	457.1
140°	458.9	447.4	466.6	449.3	445.5
142.5°	434.0	426.3	449.3	437.8	434.0
145°	416.7	410.9	435.9	430.2	428.2
147.5°	401.4	397.5	420.5	418.7	418.7
150°	387.9	384.1	407.1	405.2	407.1
152.5°	374.5	370.6	391.7	389.8	391.7
155°	364.8	361.0	378.3	378.3	378.3
157.5°	357.2	355.2	368.7	368.7	368.7
160°	351.4	349.5	361.0	361.0	359.1
162.5°	345.7	343.7	357.2	355.2	355.2
165°	341.8	341.8	351.4	351.4	349.5
167.5°	341.8	339.9	349.5	349.5	347.5
170°	339.9	339.9	347.5	345.7	343.7
172.5°	339.9	339.9	347.5	345.7	343.7
175°	338.0	338.0	343.7	343.7	343.7
177.5°	339.9	339.9	343.7	343.7	341.8
180°	341.8	341.8	341.8	341.8	341.8



TEST NUMBER: P1436457
 CATALOG NUMBER: EHBR1-42-UNV-M-L930-UPL40

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	18.33	19.47	18.83	19.95	20.47	18.33	19.47	18.83	19.95	20.47
	3H	19.81	20.82	20.33	21.32	21.89	19.81	20.82	20.33	21.32	21.89
	4H	20.33	21.28	20.88	21.79	22.37	20.33	21.28	20.88	21.79	22.37
	6H	20.66	21.52	21.21	22.05	22.65	20.66	21.52	21.21	22.05	22.65
	8H	20.73	21.55	21.30	22.10	22.70	20.73	21.55	21.30	22.10	22.70
	12H	20.74	21.52	21.31	22.06	22.69	20.74	21.52	21.31	22.06	22.69
4H	2H	18.76	19.71	19.31	20.22	20.80	18.76	19.71	19.31	20.22	20.80
	3H	20.46	21.23	21.01	21.79	22.39	20.46	21.23	21.01	21.79	22.39
	4H	21.09	21.78	21.66	22.35	22.99	21.09	21.78	21.66	22.35	22.99
	6H	21.51	22.11	22.11	22.71	23.36	21.51	22.11	22.11	22.71	23.36
	8H	21.61	22.17	22.21	22.76	23.42	21.61	22.17	22.21	22.76	23.42
	12H	21.63	22.13	22.25	22.75	23.41	21.63	22.13	22.25	22.75	23.41
8H	4H	21.26	21.82	21.87	22.42	23.07	21.26	21.82	21.87	22.42	23.07
	6H	21.77	22.23	22.41	22.87	23.53	21.77	22.23	22.41	22.87	23.53
	8H	21.91	22.32	22.56	22.97	23.65	21.91	22.32	22.56	22.97	23.65
	12H	21.98	22.34	22.62	22.97	23.72	21.98	22.34	22.62	22.97	23.72
12H	4H	21.25	21.75	21.87	22.37	23.03	21.25	21.75	21.87	22.37	23.03
	6H	21.78	22.18	22.43	22.83	23.51	21.78	22.18	22.43	22.83	23.51
	8H	21.95	22.31	22.59	22.94	23.69	21.95	22.31	22.59	22.94	23.69

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-5

Test Date: 08/01/2025

Luminaire Tested: EHBR-60-L930-N

Data in this report applies to families of products including EHBR-60-L930-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-5
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L930-N**
 Description: Elevate Round Highbay at, 60000 lumens, 3000K 90CRI LEDs with N lens

Spectral Parameters

CCT (K): 2996
 CIE u': 0.2519
 CIE v': 0.5169
 Duv: -0.0033
 CIE x: 0.4325
 CIE y: 0.3945
 CIE z: 0.1730
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 584
 Purity: 48.21818
 Rf: 91.3
 Rg: 102

CRI (Ra):	94.4		
R1:	96.8	R9:	61.4
R2:	98.1	R10:	94.4
R3:	97.8	R11:	95.7
R4:	95.6	R12:	88.5
R5:	96.9	R13:	97.3
R6:	95.7	R14:	97.8
R7:	90.9	R15:	92.3
R8:	83.0		



Test Conditions

Stabilization Time: 40M
 Operation Time: 1H 40M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-5

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-5

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3000K 7-step quadrangle

REPORT NUMBER: SP1-2506-472-5

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.44

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-5

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 2.85

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	101	NR	620	317	NR	750	7	NR	880	0	NR
365	0	NR	495	121	NR	625	320	NR	755	6	NR	885	0	NR
370	0	NR	500	141	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	158	NR	635	651	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	207	NR	770	4	NR	900	0	NR
385	0	NR	515	182	NR	645	201	NR	775	3	NR	905	0	NR
390	0	NR	520	189	NR	650	174	NR	780	3	NR	910	0	NR
395	1	NR	525	194	NR	655	146	NR	785	2	NR	915	0	NR
400	1	NR	530	199	NR	660	124	NR	790	2	NR	920	0	NR
405	3	NR	535	205	NR	665	105	NR	795	2	NR	925	0	NR
410	4	NR	540	210	NR	670	96	NR	800	1	NR	930	0	NR
415	7	NR	545	216	NR	675	79	NR	805	1	NR	935	0	NR
420	13	NR	550	222	NR	680	67	NR	810	1	NR	940	0	NR
425	22	NR	555	230	NR	685	58	NR	815	1	NR	945	0	NR
430	37	NR	560	240	NR	690	49	NR	820	1	NR	950	0	NR
435	60	NR	565	248	NR	695	42	NR	825	1	NR	955	0	NR
440	101	NR	570	258	NR	700	36	NR	830	1	NR	960	0	NR
445	172	NR	575	268	NR	705	30	NR	835	1	NR	965	0	NR
450	223	NR	580	278	NR	710	26	NR	840	1	NR	970	0	NR
455	167	NR	585	287	NR	715	22	NR	845	0	NR	975	0	NR
460	126	NR	590	295	NR	720	19	NR	850	0	NR	980	0	NR
465	111	NR	595	298	NR	725	16	NR	855	0	NR	985	0	NR
470	86	NR	600	303	NR	730	14	NR	860	0	NR	990	0	NR
475	74	NR	605	307	NR	735	12	NR	865	0	NR	995	0	NR
480	77	NR	610	341	NR	740	10	NR	870	0	NR	1000	0	NR
485	86	NR	615	368	NR	745	8	NR	875	0	NR			

Summary

$R_f = 91.3$
 $R_g = 102$
 $CIE R_a = 94.4$
 $R_9 = 61.4$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 91	CES51 = 96	CES76 = 89
CES02 = 63	CES27 = 96	CES52 = 95	CES77 = 85
CES03 = 32	CES28 = 96	CES53 = 93	CES78 = 86
CES04 = 70	CES29 = 90	CES54 = 98	CES79 = 89
CES05 = 51	CES30 = 96	CES55 = 98	CES80 = 91
CES06 = 51	CES31 = 90	CES56 = 95	CES81 = 72
CES07 = 44	CES32 = 84	CES57 = 95	CES82 = 95
CES08 = 42	CES33 = 91	CES58 = 95	CES83 = 93
CES09 = 29	CES34 = 92	CES59 = 99	CES84 = 96
CES10 = 76	CES35 = 96	CES60 = 96	CES85 = 80
CES11 = 59	CES36 = 90	CES61 = 96	CES86 = 77
CES12 = 65	CES37 = 94	CES62 = 95	CES87 = 91
CES13 = 44	CES38 = 99	CES63 = 94	CES88 = 96
CES14 = 74	CES39 = 97	CES64 = 96	CES89 = 82
CES15 = 72	CES40 = 94	CES65 = 92	CES90 = 97
CES16 = 48	CES41 = 94	CES66 = 95	CES91 = 82
CES17 = 50	CES42 = 91	CES67 = 94	CES92 = 78
CES18 = 57	CES43 = 88	CES68 = 93	CES93 = 87
CES19 = 72	CES44 = 99	CES69 = 94	CES94 = 73
CES20 = 67	CES45 = 93	CES70 = 90	CES95 = 85
CES21 = 86	CES46 = 93	CES71 = 90	CES96 = 92
CES22 = 79	CES47 = 86	CES72 = 96	CES97 = 93
CES23 = 92	CES48 = 95	CES73 = 85	CES98 = 94
CES24 = 91	CES49 = 91	CES74 = 90	CES99 = 93
CES25 = 72	CES50 = 96	CES75 = 90	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)