

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1433586

Luminaire Tested: EHBR1-42-UNV-ASM-L935

Issue Date: 3/13/2026

Test Information

Test Method: LM-79-2019
Report Number: P1433586
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2601-654-4)
Test Lab: INNOVATION CENTER
Issue Date: 3/13/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-42-UNV-ASM-L935
Description: Elevate Round Highbay at, 42000 lumens, 3500K 90CRI LEDs with ASM lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 37585.6 lumens
Efficiency: N/A
Efficacy: 167.5 lumens/watt
Spacing Criteria (0/90/45): 0.84 / 0.99 / 0.92
Luminous Opening: Circular (Dia: 1.71' x H: 0')
CIE Type: Direct

Input Watts (W): 224.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1433586
CATALOG NUMBER: EHBR1-42-UNV-ASM-L935

Luminous Intensity Polar Plot

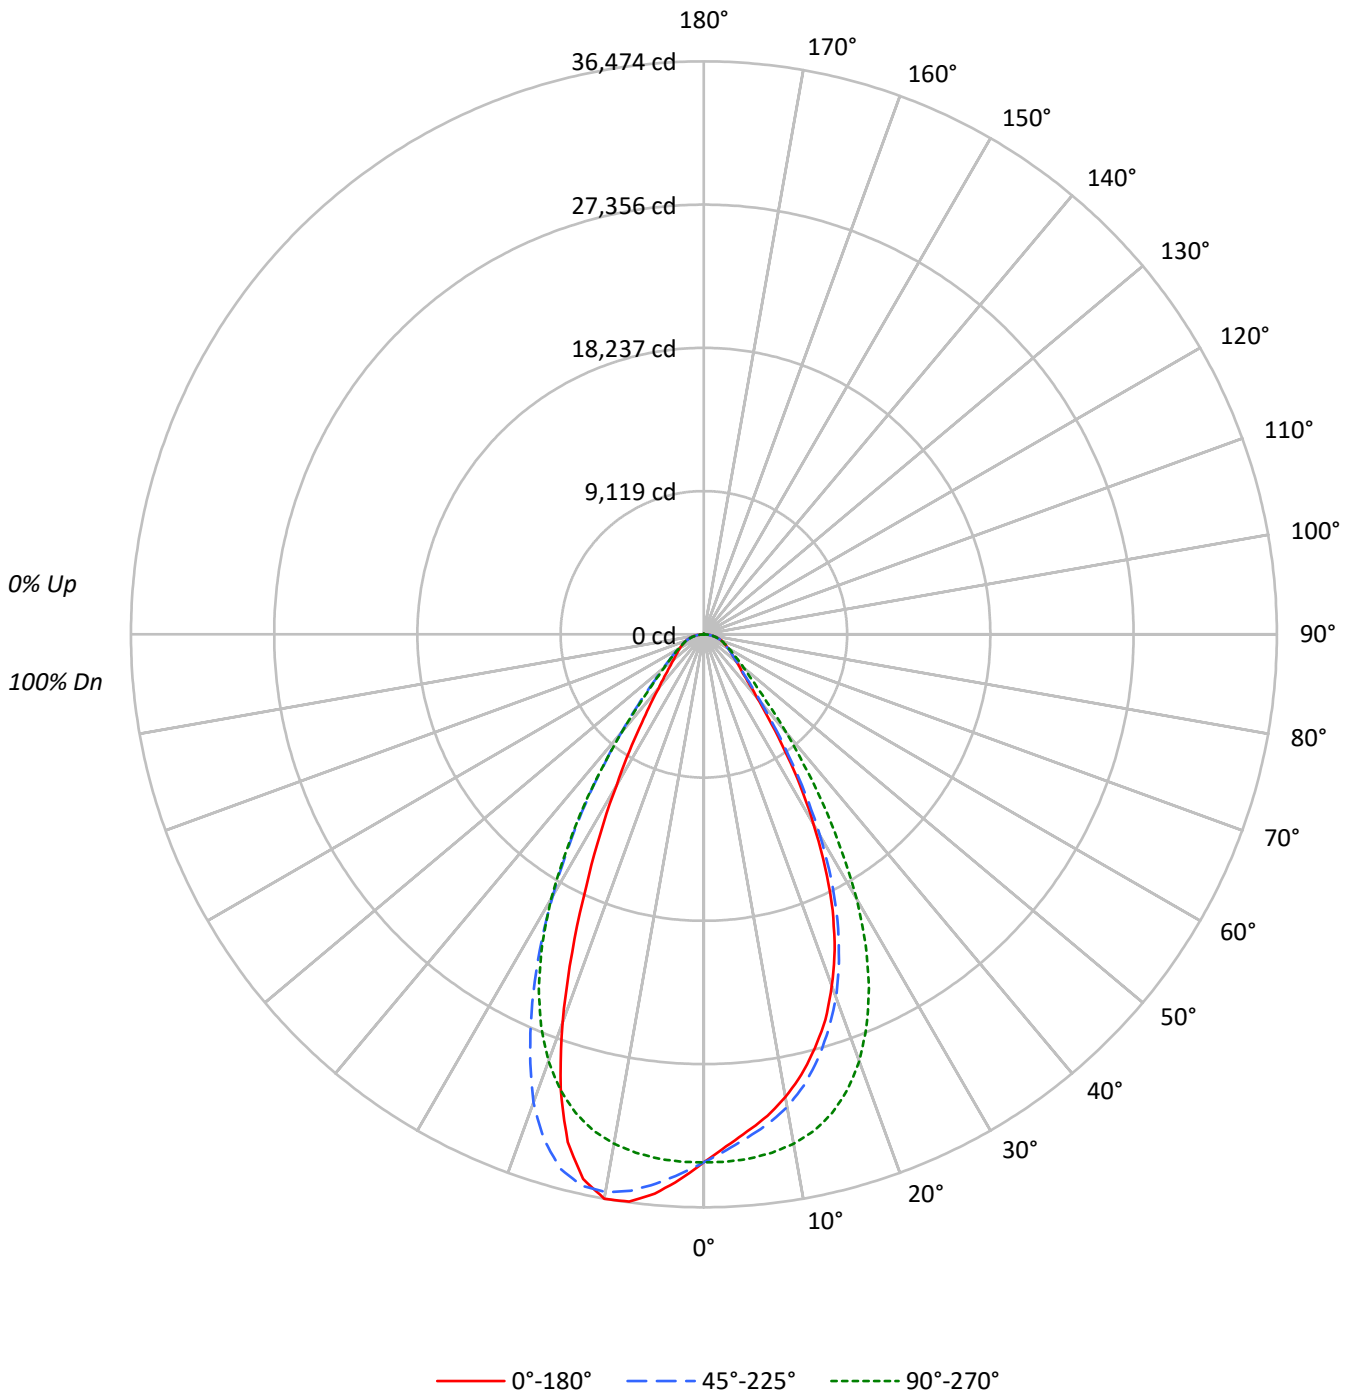



TEST NUMBER: P1433586
 CATALOG NUMBER: EHBR1-42-UNV-ASM-L935

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	103	109	106	104	101	102	100	98	98	97	95	95	93	92	90
2	105	99	94	90	103	97	93	89	94	90	87	91	88	85	88	85	83	81
3	99	91	85	80	96	89	84	79	87	82	78	84	80	77	82	78	76	74
4	93	84	77	72	91	83	77	72	80	75	71	78	74	70	76	72	69	67
5	87	78	71	66	86	77	70	65	75	69	65	73	68	64	71	67	64	62
6	82	72	65	60	81	71	65	60	70	64	60	68	63	59	67	62	59	57
7	78	67	60	56	76	67	60	56	65	59	55	64	59	55	63	58	55	53
8	74	63	56	52	72	62	56	52	61	55	51	60	55	51	59	54	51	49
9	70	59	53	48	69	59	52	48	58	52	48	57	51	48	56	51	47	46
10	66	56	49	45	65	55	49	45	54	49	45	54	48	45	53	48	45	43

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°	135°	180°
0°	157855	157855	157855	157855	157855
5°	149721	151472	157916	165490	168468
10°	142631	145652	157001	171927	173929
15°	132640	136183	153393	171311	162724
20°	118974	122981	144467	158573	131398
25°	100446	104248	128815	133995	91716
30°	75755	80147	105429	104377	60145
35°	50874	53946	76281	75048	39293
40°	32400	34625	49803	50125	27349
45°	23346	24317	31957	33329	21424
50°	19705	19861	24047	24674	18447
55°	17675	17717	19951	20477	17076
60°	16700	16558	17630	18003	16600
65°	16376	16229	16509	16831	16445
70°	16520	16236	16254	16564	16737
75°	16664	16161	16125	16698	17179
80°	16875	15699	15766	16875	18052
85°	15997	13276	13276	15184	16779

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 112.5°
 Vertical Angle: 45°
 Luminance: 44929 cd/sqm



TEST NUMBER: P1433586
 CATALOG NUMBER: EHBR1-42-UNV-ASM-L935

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	3196.2	8.5
10°-20°	8695.4	23.1
20°-30°	10197.9	27.1
30°-40°	7092.0	18.9
40°-50°	3524.4	9.4
50°-60°	2108.0	5.6
60°-70°	1483.7	3.9
70°-80°	955.7	2.5
80°-90°	303.6	0.8
90°-100°	1.8	0.0
100°-110°	2.1	0.0
110°-120°	2.2	0.0
120°-130°	2.7	0.0
130°-140°	3.7	0.0
140°-150°	4.4	0.0
150°-160°	4.9	0.0
160°-170°	4.8	0.0
170°-180°	2.1	0.0
0°-30°	22089.5	58.8
0°-40°	29181.5	77.6
0°-60°	34813.8	92.6
0°-90°	37556.8	99.9
90°-120°	6.0	0.0
90°-150°	16.9	0.0
90°-180°	29.0	0.1
0°-180°	37585.6	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	33614	33614	33614	33614	33614	
5°	31761	32132	33499	35106	35738	2979
15°	27282	28011	31551	35236	33470	7608
25°	19385	20119	24860	25860	17700	8747
35°	8874	9410	13306	13091	6854	5653
45°	3515	3662	4812	5018	3226	2842
55°	2159	2164	2437	2501	2086	1959
65°	1474	1460	1486	1515	1480	1463
75°	918	891	889	920	947	969
85°	297	246	246	282	311	306
90°	1	1	1	2	5	15
95°	1	1	1	2	5	1
105°	1	1	1	2	6	1
115°	1	1	2	2	6	1
125°	2	2	2	4	6	1
135°	2	4	5	5	7	2
145°	7	8	8	6	8	4
155°	12	11	10	10	11	6
165°	18	16	17	18	21	5
175°	21	21	22	24	27	2
180°	23	23	23	23	23	



TEST NUMBER: P1433586
 CATALOG NUMBER: EHBR1-42-UNV-ASM-L935

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	33614.0	33614.0	33614.0	33614.0	33614.0	33614.0	33614.0	33614.0	33614.0
2.5°	32616.2	32637.6	32865.8	33162.6	33594.4	34028.7	34380.4	34612.4	34727.0
5°	31760.8	31879.3	32132.1	32677.3	33499.2	34369.0	35105.9	35588.0	35737.5
7.5°	30927.5	30996.2	31419.2	32108.1	33271.6	34626.9	35721.7	36284.6	36422.0
10°	29910.9	30066.5	30544.3	31356.8	32924.3	34789.5	36054.5	36457.9	36474.3
12.5°	28714.5	28920.6	29414.1	30439.1	32370.3	34731.5	35943.0	35810.5	35509.9
15°	27282.4	27463.3	28011.1	29199.9	31550.9	34388.0	35236.4	34159.1	33470.2
17.5°	25735.7	25899.6	26375.5	27684.6	30396.2	33745.0	33761.4	31630.4	30330.6
20°	23806.9	23935.5	24608.7	25893.2	28908.0	32713.9	31730.5	27832.7	26292.8
22.5°	21754.6	21875.0	22473.2	23810.0	27042.3	31323.4	28902.3	24012.4	21911.5
25°	19385.2	19450.8	20119.0	21327.8	24860.2	29619.7	25859.9	19849.8	17700.4
27.5°	16719.7	16831.3	17530.2	18765.0	22293.5	27460.2	22620.0	16220.5	14237.5
30°	13970.3	14155.0	14780.2	15885.8	19442.6	24691.9	19248.5	12917.6	11091.6
32.5°	11404.3	11537.2	11982.9	13138.3	16250.7	21978.4	16010.6	10350.4	8803.5
35°	8874.1	9007.2	9410.0	10544.5	13305.9	18583.5	13090.9	8133.0	6854.0
37.5°	6783.4	7018.5	7276.9	8197.8	10442.4	15375.9	10435.5	6549.0	5559.3
40°	5285.2	5323.0	5648.2	6237.5	8124.1	12022.6	8176.5	5227.8	4461.3
42.5°	4230.7	4333.4	4473.4	4914.6	6155.6	9193.1	6426.7	4290.6	3789.5
45°	3515.3	3555.6	3661.5	3957.8	4811.8	6765.1	5018.5	3619.9	3225.9
47.5°	3075.3	3057.7	3125.8	3347.6	3918.6	5228.4	4067.4	3104.9	2828.8
50°	2697.1	2686.4	2718.5	2866.6	3291.5	4012.0	3377.3	2710.4	2525.0
52.5°	2403.4	2412.8	2416.0	2508.0	2827.6	3271.9	2876.1	2415.4	2290.6
55°	2158.8	2170.8	2163.9	2231.9	2436.8	2750.7	2501.1	2172.0	2085.7
57.5°	1967.8	1959.0	1949.5	1986.1	2139.9	2333.4	2172.0	1964.7	1907.3
60°	1778.1	1769.9	1763.0	1786.9	1877.1	2020.8	1916.8	1783.7	1767.4
62.5°	1615.5	1610.5	1609.8	1605.4	1674.7	1765.5	1694.9	1621.2	1606.7
65°	1473.7	1468.0	1460.5	1453.5	1485.7	1570.1	1514.7	1475.0	1479.9
67.5°	1331.9	1331.9	1318.6	1307.9	1339.4	1383.5	1359.6	1336.9	1342.5
70°	1203.2	1203.9	1182.5	1174.2	1183.8	1231.0	1206.4	1209.6	1219.0
72.5°	1065.2	1050.1	1034.3	1033.7	1034.9	1071.6	1063.3	1070.9	1081.0
75°	918.4	900.7	890.7	879.3	888.7	916.5	920.3	931.0	946.8
77.5°	776.5	749.4	741.3	735.6	729.2	760.8	772.7	787.2	810.6
80°	624.0	594.4	580.5	572.3	583.0	597.5	624.0	634.7	667.5
82.5°	461.4	439.3	422.3	421.7	426.7	439.9	462.7	482.8	501.7
85°	296.9	261.6	246.4	252.1	246.4	266.6	281.8	305.7	311.4
87.5°	107.1	83.8	80.0	88.3	86.4	92.6	105.9	115.4	116.0
90°	0.6	0.6	0.6	0.6	0.6	1.3	1.9	3.8	5.1
92.5°	0.6	0.6	0.6	0.6	0.6	1.3	1.9	3.8	5.1
95°	0.6	0.6	0.6	0.6	1.3	1.3	1.9	3.8	5.1
97.5°	1.3	0.6	0.6	0.6	1.3	1.3	1.9	3.8	5.1
100°	1.3	0.6	0.6	1.3	1.3	1.3	1.9	3.8	5.1
102.5°	1.3	0.6	0.6	1.3	1.3	1.9	2.5	4.4	5.1
105°	1.3	0.6	0.6	1.3	1.3	1.9	2.5	4.4	5.7
107.5°	1.3	0.6	1.3	1.3	1.3	1.9	2.5	4.4	5.7
110°	1.3	0.6	1.3	1.3	1.3	1.9	2.5	4.4	5.7



TEST NUMBER: P1433586
 CATALOG NUMBER: EHBR1-42-UNV-ASM-L935

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
112.5°	1.3	0.6	1.3	1.3	1.3	1.9	2.5	4.4	5.7
115°	1.3	0.6	1.3	1.3	1.9	1.9	2.5	4.4	5.7
117.5°	1.3	0.6	1.3	1.9	1.9	1.9	2.5	4.4	5.7
120°	1.3	0.6	1.3	1.9	1.9	1.9	3.2	4.4	5.7
122.5°	1.3	1.3	1.9	2.5	2.5	2.5	3.2	5.1	5.7
125°	1.9	1.3	2.5	3.2	2.5	2.5	3.8	5.1	6.3
127.5°	1.9	1.3	2.5	3.2	3.2	3.2	3.8	5.1	6.3
130°	1.9	1.9	3.2	3.8	3.8	3.2	3.8	5.7	6.3
132.5°	2.5	2.5	4.4	5.1	4.4	3.8	4.4	6.3	7.0
135°	2.5	3.2	4.4	5.7	5.1	3.8	5.1	5.7	7.0
137.5°	3.2	3.8	5.7	6.3	5.7	4.4	5.1	6.3	7.0
140°	4.4	5.1	6.3	6.3	6.3	5.1	5.1	6.3	7.5
142.5°	5.7	5.7	7.0	7.0	7.0	5.7	5.7	7.0	7.5
145°	7.0	7.0	7.5	7.0	7.5	7.0	6.3	7.0	8.2
147.5°	8.2	8.2	8.2	7.5	7.5	7.0	7.0	7.5	8.8
150°	9.4	9.4	8.8	8.2	8.2	8.2	7.5	8.2	9.4
152.5°	10.7	10.1	9.4	8.8	8.8	8.8	8.8	9.4	10.1
155°	12.0	11.3	10.7	9.4	10.1	10.1	10.1	10.7	11.3
157.5°	13.9	12.6	12.0	11.3	11.3	12.0	12.0	12.6	13.2
160°	15.1	14.5	13.9	13.2	13.9	13.9	14.5	15.1	15.8
162.5°	16.4	15.8	15.1	15.1	15.1	15.1	16.4	17.0	18.3
165°	17.7	17.0	16.4	16.4	17.0	17.0	18.3	19.6	20.8
167.5°	17.7	17.7	17.7	17.7	18.3	18.3	19.6	21.4	22.7
170°	18.9	18.3	18.3	18.9	18.9	19.6	20.8	22.7	23.9
172.5°	20.2	19.6	20.2	20.2	20.8	20.8	22.7	24.6	25.8
175°	21.4	20.8	21.4	21.4	22.0	22.7	23.9	25.8	27.1
177.5°	22.0	21.4	21.4	21.4	22.0	23.3	24.6	26.5	27.7
180°	23.3	23.3	23.3	23.3	23.3	23.3	23.3	23.3	23.3



TEST NUMBER: P1433586
 CATALOG NUMBER: EHBR1-42-UNV-ASM-L935

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	18.56	19.76	18.92	20.08	20.40	19.32	20.53	19.69	20.84	21.16
	3H	20.47	21.55	20.86	21.88	22.25	20.97	22.05	21.36	22.38	22.75
	4H	21.29	22.29	21.69	22.64	23.03	21.69	22.69	22.10	23.04	23.43
	6H	21.95	22.87	22.37	23.25	23.64	22.28	23.20	22.70	23.57	23.97
	8H	22.19	23.06	22.63	23.46	23.87	22.49	23.36	22.92	23.75	24.16
	12H	22.35	23.19	22.79	23.57	24.00	22.62	23.45	23.06	23.84	24.27
4H	2H	19.13	20.13	19.53	20.48	20.87	19.75	20.75	20.15	21.10	21.49
	3H	21.28	22.11	21.70	22.52	22.92	21.67	22.49	22.08	22.90	23.31
	4H	22.23	22.97	22.67	23.40	23.84	22.54	23.28	22.98	23.70	24.15
	6H	23.04	23.68	23.51	24.13	24.60	23.28	23.92	23.75	24.37	24.84
	8H	23.34	23.93	23.81	24.38	24.86	23.55	24.15	24.03	24.60	25.07
	12H	23.54	24.07	24.03	24.55	25.03	23.74	24.26	24.23	24.75	25.22
8H	4H	22.55	23.15	23.03	23.60	24.07	22.84	23.44	23.31	23.89	24.36
	6H	23.51	23.99	24.01	24.49	24.98	23.74	24.23	24.25	24.73	25.21
	8H	23.89	24.33	24.42	24.85	25.34	24.11	24.54	24.63	25.06	25.55
	12H	24.19	24.57	24.71	25.07	25.64	24.38	24.76	24.90	25.26	25.83
12H	4H	22.58	23.10	23.07	23.59	24.07	22.87	23.39	23.36	23.88	24.36
	6H	23.57	24.00	24.10	24.52	25.02	23.81	24.25	24.34	24.76	25.26
	8H	24.02	24.40	24.54	24.90	25.47	24.24	24.62	24.76	25.12	25.69

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-6

Test Date: 08/01/2025

Luminaire Tested: EHBR-60-L935-N

Data in this report applies to families of products including EHBR-60-L935-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-6
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L935-N**
 Description: Elevate Round Highbay at, 60000 lumens, 3500K 90CRI LEDs with N lens

Spectral Parameters

CCT (K): 3406
 CIE u': 0.2394
 CIE v': 0.5094
 Duv: -0.0028
 CIE x: 0.4076
 CIE y: 0.3856
 CIE z: 0.2068
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 582
 Purity: 38.0517
 Rf: 91.3
 Rg: 100

CRI (Ra):	94.6		
R1:	96.6	R9:	63.8
R2:	98.4	R10:	94.7
R3:	98.1	R11:	96.6
R4:	95.8	R12:	80.9
R5:	96.2	R13:	97.4
R6:	95.4	R14:	98.3
R7:	91.8	R15:	93.1
R8:	84.4		



Test Conditions

Stabilization Time: 35M
 Operation Time: 1H 35M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-6

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-6

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-6

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	140	NR	620	338	NR	750	8	NR	880	0	NR
365	0	NR	495	159	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	182	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	202	NR	635	653	NR	765	5	NR	895	0	NR
380	0	NR	510	216	NR	640	222	NR	770	4	NR	900	0	NR
385	0	NR	515	228	NR	645	214	NR	775	3	NR	905	0	NR
390	0	NR	520	236	NR	650	185	NR	780	3	NR	910	0	NR
395	1	NR	525	242	NR	655	157	NR	785	3	NR	915	0	NR
400	2	NR	530	248	NR	660	133	NR	790	2	NR	920	0	NR
405	3	NR	535	253	NR	665	113	NR	795	2	NR	925	0	NR
410	4	NR	540	258	NR	670	103	NR	800	2	NR	930	0	NR
415	7	NR	545	264	NR	675	85	NR	805	1	NR	935	0	NR
420	13	NR	550	270	NR	680	72	NR	810	1	NR	940	0	NR
425	22	NR	555	278	NR	685	62	NR	815	1	NR	945	0	NR
430	38	NR	560	286	NR	690	53	NR	820	1	NR	950	0	NR
435	65	NR	565	295	NR	695	45	NR	825	1	NR	955	0	NR
440	108	NR	570	303	NR	700	39	NR	830	1	NR	960	0	NR
445	193	NR	575	311	NR	705	33	NR	835	1	NR	965	0	NR
450	312	NR	580	319	NR	710	28	NR	840	1	NR	970	0	NR
455	300	NR	585	326	NR	715	24	NR	845	0	NR	975	0	NR
460	214	NR	590	332	NR	720	20	NR	850	0	NR	980	0	NR
465	184	NR	595	333	NR	725	17	NR	855	0	NR	985	0	NR
470	153	NR	600	336	NR	730	15	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	12	NR	865	0	NR	995	0	NR
480	115	NR	610	367	NR	740	10	NR	870	0	NR	1000	0	NR
485	125	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-6

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.62

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	140	NR	620	338	NR	750	8	NR	880	0	NR
365	0	NR	495	159	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	182	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	202	NR	635	653	NR	765	5	NR	895	0	NR
380	0	NR	510	216	NR	640	222	NR	770	4	NR	900	0	NR
385	0	NR	515	228	NR	645	214	NR	775	3	NR	905	0	NR
390	0	NR	520	236	NR	650	185	NR	780	3	NR	910	0	NR
395	1	NR	525	242	NR	655	157	NR	785	3	NR	915	0	NR
400	2	NR	530	248	NR	660	133	NR	790	2	NR	920	0	NR
405	3	NR	535	253	NR	665	113	NR	795	2	NR	925	0	NR
410	4	NR	540	258	NR	670	103	NR	800	2	NR	930	0	NR
415	7	NR	545	264	NR	675	85	NR	805	1	NR	935	0	NR
420	13	NR	550	270	NR	680	72	NR	810	1	NR	940	0	NR
425	22	NR	555	278	NR	685	62	NR	815	1	NR	945	0	NR
430	38	NR	560	286	NR	690	53	NR	820	1	NR	950	0	NR
435	65	NR	565	295	NR	695	45	NR	825	1	NR	955	0	NR
440	108	NR	570	303	NR	700	39	NR	830	1	NR	960	0	NR
445	193	NR	575	311	NR	705	33	NR	835	1	NR	965	0	NR
450	312	NR	580	319	NR	710	28	NR	840	1	NR	970	0	NR
455	300	NR	585	326	NR	715	24	NR	845	0	NR	975	0	NR
460	214	NR	590	332	NR	720	20	NR	850	0	NR	980	0	NR
465	184	NR	595	333	NR	725	17	NR	855	0	NR	985	0	NR
470	153	NR	600	336	NR	730	15	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	12	NR	865	0	NR	995	0	NR
480	115	NR	610	367	NR	740	10	NR	870	0	NR	1000	0	NR
485	125	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-6

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.3

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	140	NR	620	338	NR	750	8	NR	880	0	NR
365	0	NR	495	159	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	182	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	202	NR	635	653	NR	765	5	NR	895	0	NR
380	0	NR	510	216	NR	640	222	NR	770	4	NR	900	0	NR
385	0	NR	515	228	NR	645	214	NR	775	3	NR	905	0	NR
390	0	NR	520	236	NR	650	185	NR	780	3	NR	910	0	NR
395	1	NR	525	242	NR	655	157	NR	785	3	NR	915	0	NR
400	2	NR	530	248	NR	660	133	NR	790	2	NR	920	0	NR
405	3	NR	535	253	NR	665	113	NR	795	2	NR	925	0	NR
410	4	NR	540	258	NR	670	103	NR	800	2	NR	930	0	NR
415	7	NR	545	264	NR	675	85	NR	805	1	NR	935	0	NR
420	13	NR	550	270	NR	680	72	NR	810	1	NR	940	0	NR
425	22	NR	555	278	NR	685	62	NR	815	1	NR	945	0	NR
430	38	NR	560	286	NR	690	53	NR	820	1	NR	950	0	NR
435	65	NR	565	295	NR	695	45	NR	825	1	NR	955	0	NR
440	108	NR	570	303	NR	700	39	NR	830	1	NR	960	0	NR
445	193	NR	575	311	NR	705	33	NR	835	1	NR	965	0	NR
450	312	NR	580	319	NR	710	28	NR	840	1	NR	970	0	NR
455	300	NR	585	326	NR	715	24	NR	845	0	NR	975	0	NR
460	214	NR	590	332	NR	720	20	NR	850	0	NR	980	0	NR
465	184	NR	595	333	NR	725	17	NR	855	0	NR	985	0	NR
470	153	NR	600	336	NR	730	15	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	12	NR	865	0	NR	995	0	NR
480	115	NR	610	367	NR	740	10	NR	870	0	NR	1000	0	NR
485	125	NR	615	390	NR	745	9	NR	875	0	NR			

Summary

$R_f = 91.3$
 $R_g = 100$
 $CIE R_a = 94.6$
 $R_9 = 63.8$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 94	CES51 = 97	CES76 = 90
CES02 = 63	CES27 = 92	CES52 = 98	CES77 = 86
CES03 = 31	CES28 = 97	CES53 = 98	CES78 = 86
CES04 = 70	CES29 = 97	CES54 = 93	CES79 = 90
CES05 = 50	CES30 = 92	CES55 = 92	CES80 = 91
CES06 = 51	CES31 = 97	CES56 = 96	CES81 = 74
CES07 = 43	CES32 = 89	CES57 = 94	CES82 = 96
CES08 = 41	CES33 = 99	CES58 = 95	CES83 = 94
CES09 = 29	CES34 = 94	CES59 = 98	CES84 = 95
CES10 = 75	CES35 = 97	CES60 = 92	CES85 = 79
CES11 = 58	CES36 = 81	CES61 = 93	CES86 = 79
CES12 = 64	CES37 = 96	CES62 = 86	CES87 = 92
CES13 = 44	CES38 = 87	CES63 = 94	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 91	CES89 = 84
CES15 = 72	CES40 = 97	CES65 = 90	CES90 = 96
CES16 = 48	CES41 = 96	CES66 = 89	CES91 = 75
CES17 = 49	CES42 = 94	CES67 = 88	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 89	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 90	CES94 = 74
CES20 = 67	CES45 = 97	CES70 = 88	CES95 = 83
CES21 = 86	CES46 = 97	CES71 = 83	CES96 = 92
CES22 = 78	CES47 = 91	CES72 = 94	CES97 = 96
CES23 = 91	CES48 = 91	CES73 = 83	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 90	CES99 = 92
CES25 = 71	CES50 = 98	CES75 = 85	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)