

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1433516

Luminaire Tested: EHBR1-30-UNV-ASM-L935-UPL15

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number: P1433516
REPORT IS A COMBINATION OF REPORTS P1431741 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-30-UNV-ASM-L935-UPL15
Description: Elevate Round Highbay at, 30000 lumens, 3500K 90CRI LEDs with ASM lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 28976.2 lumens
Efficiency: N/A
Efficacy: 171.4 lumens/watt
Spacing Criteria (0/90/45): 0.84 / 0.99 / 0.92
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 169.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1433516
CATALOG NUMBER: EHBR1-30-UNV-ASM-L935-UPL15

Luminous Intensity Polar Plot

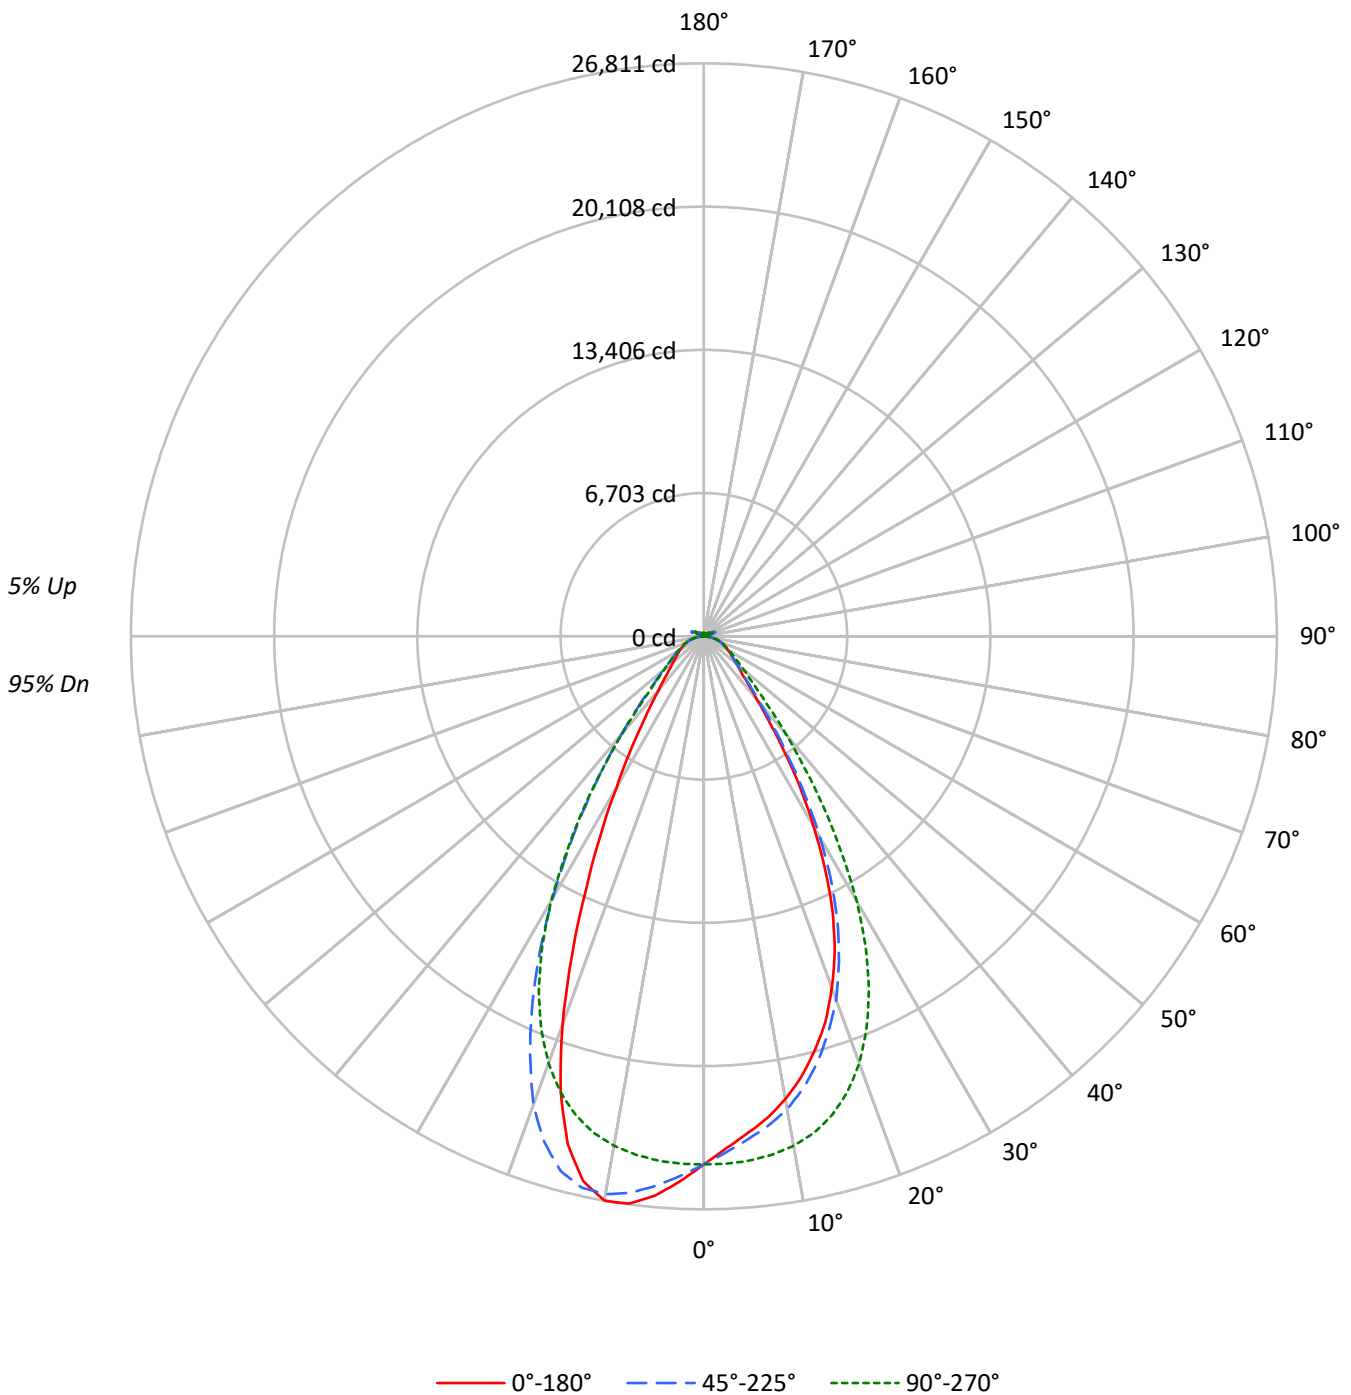



TEST NUMBER: P1433516

CATALOG NUMBER: EHBR1-30-UNV-ASM-L935-UPL15

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	118	118	118	118	115	115	115	115	108	108	108	103	103	103	98	98	98	98	98	98	95
1	111	107	104	101	108	105	102	99	100	97	95	95	93	92	91	90	88	88	88	88	86
2	104	98	93	89	101	96	91	87	92	88	85	88	85	82	84	82	80	84	82	80	78
3	97	90	84	79	95	88	82	78	84	80	76	81	77	74	78	75	72	78	75	72	70
4	91	82	76	71	89	81	75	70	78	73	69	75	71	68	73	69	66	73	69	66	64
5	86	76	69	64	84	75	69	64	73	67	63	70	66	62	68	64	61	68	64	61	59
6	81	71	64	59	79	70	63	59	68	62	58	66	61	57	64	60	56	64	60	56	55
7	77	66	59	54	75	65	59	54	63	58	53	62	57	53	60	56	52	60	56	52	51
8	72	62	55	50	71	61	55	50	59	54	50	58	53	49	57	52	49	57	52	49	47
9	69	58	51	47	67	57	51	47	56	50	46	55	49	46	53	49	45	53	49	45	44
10	65	54	48	44	64	54	48	44	53	47	43	52	46	43	50	46	43	50	46	43	41

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°	135°	180°
0°	116033	116033	116033	116033	116033
5°	109342	110620	115326	120858	123032
10°	103483	105674	113909	124738	126190
15°	95590	98143	110546	123458	117270
20°	85144	88011	103388	113482	94035
25°	71354	74055	91507	95186	65153
30°	53387	56483	74300	73558	42386
35°	35541	37686	53290	52430	27450
40°	22414	23954	34454	34675	18920
45°	15970	16635	21861	22800	14656
50°	13302	13408	16234	16657	12454
55°	11743	11770	13254	13604	11345
60°	10872	10780	11478	11721	10806
65°	10378	10285	10462	10666	10423
70°	10080	9906	9916	10107	10213
75°	9582	9293	9274	9603	9879
80°	8719	8111	8147	8719	9328
85°	6349	5272	5272	6026	6657

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 112.5°
 Vertical Angle: 45°
 Luminance: 30735 cd/sqm



TEST NUMBER: P1433516
 CATALOG NUMBER: EHBR1-30-UNV-ASM-L935-UPL15

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2349.4	8.1
10°-20°	6391.6	22.1
20°-30°	7496.1	25.9
30°-40°	5213.1	18.0
40°-50°	2590.6	8.9
50°-60°	1549.5	5.3
60°-70°	1090.6	3.8
70°-80°	702.5	2.4
80°-90°	225.5	0.8
90°-100°	36.8	0.1
100°-110°	236.6	0.8
110°-120°	436.5	1.5
120°-130°	260.0	0.9
130°-140°	158.0	0.5
140°-150°	110.0	0.4
150°-160°	72.6	0.3
160°-170°	42.5	0.1
170°-180°	14.3	0.0
0°-30°	16237.1	56.0
0°-40°	21450.2	74.0
0°-60°	25590.3	88.3
0°-90°	27608.9	95.3
90°-120°	709.9	2.4
90°-150°	1237.9	4.3
90°-180°	1367.0	4.7
0°-180°	28976.2	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	24708	24708	24708	24708	24708	
5°	23346	23619	24624	25805	26269	2190
15°	20054	20590	23192	25901	24603	5593
25°	14249	14789	18274	19008	13011	6429
35°	6523	6917	9781	9623	5038	4155
45°	2584	2691	3537	3689	2371	2089
55°	1587	1591	1791	1838	1533	1440
65°	1083	1074	1092	1113	1088	1076
75°	675	655	653	676	696	713
85°	218	181	181	207	229	225
90°	10	28	10	30	13	16
95°	17	61	20	53	20	16
105°	83	412	109	440	57	110
115°	377	487	464	540	398	347
125°	272	262	298	290	313	248
135°	200	202	190	211	219	156
145°	168	176	173	176	180	106
155°	151	155	155	155	162	70
165°	146	149	149	149	155	42
175°	148	150	150	150	155	14
180°	150	150	150	150	150	



TEST NUMBER: P1433516
 CATALOG NUMBER: EHBR1-30-UNV-ASM-L935-UPL15

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	24708.3	24708.3	24708.3	24708.3	24708.3	24708.3	24708.3	24708.3	24708.3
2.5°	23974.9	23990.6	24158.3	24376.6	24694.0	25013.2	25271.7	25442.2	25526.5
5°	23346.2	23433.3	23619.1	24019.8	24624.0	25263.4	25805.0	26159.4	26269.2
7.5°	22733.7	22784.1	23095.0	23601.5	24456.8	25452.8	26257.6	26671.4	26772.4
10°	21986.3	22100.8	22452.0	23049.2	24201.5	25572.4	26502.3	26798.8	26810.9
12.5°	21107.0	21258.4	21621.2	22374.6	23794.2	25529.8	26420.2	26323.0	26101.9
15°	20054.3	20187.2	20589.9	21463.7	23191.9	25277.3	25900.9	25109.1	24602.7
17.5°	18917.3	19037.7	19387.6	20349.9	22343.0	24804.7	24816.8	23250.3	22294.9
20°	17499.5	17594.0	18088.9	19033.1	21249.2	24046.7	23323.9	20458.8	19326.9
22.5°	15991.0	16079.5	16519.1	17501.9	19877.7	23024.6	21245.0	17650.6	16106.3
25°	14249.3	14297.5	14788.7	15677.3	18273.8	21772.2	19008.5	14590.8	13010.9
27.5°	12290.0	12372.0	12885.8	13793.4	16387.1	20185.0	16627.1	11923.0	10465.5
30°	10269.0	10404.8	10864.4	11677.0	14291.6	18150.1	14148.8	9495.3	8153.0
32.5°	8382.8	8480.6	8808.2	9657.4	11945.2	16155.4	11768.8	7608.2	6471.2
35°	6523.0	6620.8	6916.8	7750.8	9780.7	13660.0	9622.7	5978.2	5038.1
37.5°	4986.3	5159.0	5349.0	6025.9	7675.8	11302.2	7670.7	4813.9	4086.5
40°	3884.9	3912.7	4151.8	4585.0	5971.7	8837.4	6010.1	3842.7	3279.4
42.5°	3109.8	3185.3	3288.2	3612.5	4524.8	6757.5	4724.0	3153.8	2785.5
45°	2583.9	2613.6	2691.4	2909.1	3537.0	4972.8	3688.9	2660.8	2371.2
47.5°	2260.6	2247.5	2297.6	2460.7	2880.4	3843.2	2989.8	2282.3	2079.4
50°	1982.5	1974.6	1998.3	2107.2	2419.4	2949.0	2482.4	1992.3	1856.1
52.5°	1766.6	1773.6	1775.9	1843.6	2078.5	2405.1	2114.1	1775.4	1683.7
55°	1586.9	1595.7	1590.6	1640.6	1791.2	2021.9	1838.5	1596.6	1533.1
57.5°	1446.5	1440.0	1433.1	1459.9	1572.9	1715.2	1596.6	1444.1	1402.0
60°	1307.0	1301.0	1295.9	1313.5	1379.8	1485.4	1409.0	1311.2	1299.1
62.5°	1187.5	1183.8	1183.3	1180.0	1231.1	1297.8	1245.8	1191.6	1181.0
65°	1083.2	1079.1	1073.5	1068.4	1092.0	1154.1	1113.3	1084.2	1087.9
67.5°	979.0	979.0	969.2	961.3	984.5	1017.0	999.4	982.7	986.9
70°	884.5	884.9	869.2	863.2	870.1	904.9	886.8	889.1	896.1
72.5°	783.0	771.9	760.3	759.9	760.8	787.6	781.6	787.1	794.6
75°	675.0	662.1	654.6	646.3	653.3	673.7	676.5	684.3	695.9
77.5°	570.8	550.9	544.9	540.7	536.1	559.2	568.0	578.7	595.8
80°	458.7	436.9	426.7	420.7	428.6	439.2	458.7	466.6	490.7
82.5°	339.1	322.9	310.4	310.0	313.7	323.4	340.1	354.9	368.8
85°	218.2	192.2	181.2	185.3	181.2	195.9	207.1	224.7	228.8
87.5°	78.8	61.6	58.8	64.9	63.4	68.1	77.9	84.8	85.3
90°	10.2	16.2	27.5	17.7	10.2	17.4	29.8	17.8	13.4
92.5°	14.7	24.5	43.9	22.9	13.2	23.4	41.8	23.0	17.2
95°	16.9	28.2	61.2	30.5	19.7	28.6	53.0	25.3	20.2
97.5°	21.8	31.2	70.1	37.2	30.1	35.3	59.8	26.8	23.9
100°	28.6	36.4	109.1	45.9	39.9	39.9	108.5	30.5	26.9
102.5°	48.1	76.9	231.2	85.6	60.1	77.8	250.5	59.5	32.2
105°	82.6	161.5	411.7	178.5	108.8	176.6	440.1	150.1	57.4
107.5°	142.5	288.8	543.3	315.6	205.5	328.7	566.7	293.9	130.1
110°	265.4	383.3	569.5	433.1	328.3	459.1	618.4	401.9	260.4



TEST NUMBER: P1433516
 CATALOG NUMBER: EHBR1-30-UNV-ASM-L935-UPL15

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
112.5°	358.3	411.7	545.5	478.1	427.2	511.5	604.2	445.3	359.3
115°	377.0	396.0	487.2	466.9	464.3	504.1	539.7	443.7	398.2
117.5°	364.3	361.5	413.7	420.2	448.6	461.3	466.3	416.8	400.5
120°	337.2	321.8	345.5	367.0	405.1	400.0	393.4	377.1	378.0
122.5°	303.5	285.6	296.6	312.7	350.9	339.7	332.7	337.1	347.3
125°	272.5	254.1	261.7	266.1	297.7	286.5	290.5	302.6	313.3
127.5°	244.8	232.4	237.1	233.1	253.3	248.1	259.8	273.4	282.6
130°	226.1	215.6	221.9	211.8	221.6	222.6	238.1	249.9	255.6
132.5°	210.8	204.1	211.5	199.2	201.7	207.4	222.1	232.4	235.8
135°	199.6	194.1	201.7	190.7	189.5	197.6	211.3	217.7	219.3
137.5°	190.4	185.6	193.7	185.2	182.4	190.6	200.8	206.2	205.1
140°	182.4	178.3	186.7	179.9	178.5	186.5	191.1	197.1	196.6
142.5°	173.5	170.5	180.4	175.9	174.4	181.7	184.0	188.6	187.6
145°	167.7	165.4	175.6	172.9	172.6	178.1	176.2	181.9	180.5
147.5°	162.6	161.1	170.0	168.8	168.8	172.9	170.7	175.6	174.4
150°	158.3	156.8	165.3	164.0	164.8	167.8	164.3	170.0	170.3
152.5°	154.0	152.0	159.8	158.6	159.3	162.3	159.3	165.8	165.5
155°	151.2	149.2	155.4	154.5	155.0	156.5	155.0	161.5	162.0
157.5°	149.5	147.8	152.6	152.2	152.2	153.4	152.6	158.3	158.8
160°	148.3	147.0	151.0	150.5	150.3	151.7	151.5	156.5	157.0
162.5°	146.9	145.7	150.5	149.7	149.7	149.7	149.9	154.9	155.8
165°	146.3	145.8	149.2	149.2	148.8	149.6	149.0	152.9	154.6
167.5°	146.3	145.6	149.3	149.3	149.0	148.3	149.2	152.9	154.5
170°	146.5	146.0	149.0	148.7	148.0	148.5	148.6	152.3	153.9
172.5°	147.5	146.9	150.5	149.7	149.5	149.5	149.3	152.2	154.6
175°	147.6	147.2	149.9	149.9	150.4	150.0	150.2	152.4	154.8
177.5°	148.8	148.4	149.9	149.9	149.5	150.5	151.4	153.6	156.7
180°	150.5	150.5	150.5	150.5	150.5	150.5	150.5	150.5	150.5



TEST NUMBER: P1433516
 CATALOG NUMBER: EHBR1-30-UNV-ASM-L935-UPL15

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.63	17.77	17.08	18.18	18.62	17.40	18.53	17.85	18.94	19.38
	3H	18.45	19.46	18.91	19.89	20.37	18.96	19.97	19.42	20.40	20.88
	4H	19.19	20.13	19.67	20.58	21.08	19.61	20.55	20.09	21.00	21.50
	6H	19.76	20.62	20.26	21.09	21.60	20.10	20.97	20.60	21.43	21.94
	8H	19.94	20.76	20.45	21.24	21.76	20.26	21.08	20.77	21.56	22.08
	12H	20.04	20.82	20.56	21.30	21.84	20.34	21.12	20.86	21.60	22.14
4H	2H	17.15	18.09	17.64	18.54	19.04	17.78	18.72	18.27	19.17	19.67
	3H	19.19	19.97	19.69	20.46	20.98	19.59	20.36	20.09	20.86	21.38
	4H	20.05	20.75	20.57	21.26	21.82	20.37	21.07	20.89	21.58	22.14
	6H	20.75	21.35	21.29	21.89	22.46	21.01	21.61	21.55	22.15	22.72
	8H	20.98	21.54	21.53	22.07	22.65	21.21	21.78	21.76	22.31	22.89
	12H	21.11	21.61	21.68	22.17	22.76	21.33	21.83	21.90	22.39	22.98
8H	4H	20.31	20.88	20.87	21.41	21.99	20.62	21.18	21.17	21.71	22.30
	6H	21.13	21.59	21.71	22.17	22.76	21.38	21.84	21.97	22.42	23.01
	8H	21.43	21.84	22.03	22.44	23.04	21.66	22.07	22.27	22.67	23.27
	12H	21.64	21.99	22.23	22.57	23.25	21.85	22.21	22.44	22.78	23.46
12H	4H	20.32	20.82	20.89	21.38	21.97	20.63	21.12	21.20	21.69	22.28
	6H	21.17	21.58	21.77	22.17	22.78	21.43	21.83	22.03	22.43	23.03
	8H	21.52	21.87	22.11	22.45	23.13	21.76	22.11	22.35	22.69	23.37

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-6

Test Date: 08/01/2025

Luminaire Tested: EHBR-60-L935-N

Data in this report applies to families of products including EHBR-60-L935-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-6
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L935-N**
 Description: Elevate Round Highbay at, 60000 lumens, 3500K 90CRI LEDs with N lens

Spectral Parameters

CCT (K): 3406
 CIE u': 0.2394
 CIE v': 0.5094
 Duv: -0.0028
 CIE x: 0.4076
 CIE y: 0.3856
 CIE z: 0.2068
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 582
 Purity: 38.0517
 Rf: 91.3
 Rg: 100

CRI (Ra): 94.6
 R1: 96.6
 R2: 98.4
 R3: 98.1
 R4: 95.8
 R5: 96.2
 R6: 95.4
 R7: 91.8
 R8: 84.4
 R9: 63.8
 R10: 94.7
 R11: 96.6
 R12: 80.9
 R13: 97.4
 R14: 98.3
 R15: 93.1



Test Conditions

Stabilization Time: 35M
 Operation Time: 1H 35M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-6

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-6

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



CCT = 3406K
 CIE x = 0.4076
 CIE y = 0.3856
 Duv = -0.0028

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-6

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	140	NR	620	338	NR	750	8	NR	880	0	NR
365	0	NR	495	159	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	182	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	202	NR	635	653	NR	765	5	NR	895	0	NR
380	0	NR	510	216	NR	640	222	NR	770	4	NR	900	0	NR
385	0	NR	515	228	NR	645	214	NR	775	3	NR	905	0	NR
390	0	NR	520	236	NR	650	185	NR	780	3	NR	910	0	NR
395	1	NR	525	242	NR	655	157	NR	785	3	NR	915	0	NR
400	2	NR	530	248	NR	660	133	NR	790	2	NR	920	0	NR
405	3	NR	535	253	NR	665	113	NR	795	2	NR	925	0	NR
410	4	NR	540	258	NR	670	103	NR	800	2	NR	930	0	NR
415	7	NR	545	264	NR	675	85	NR	805	1	NR	935	0	NR
420	13	NR	550	270	NR	680	72	NR	810	1	NR	940	0	NR
425	22	NR	555	278	NR	685	62	NR	815	1	NR	945	0	NR
430	38	NR	560	286	NR	690	53	NR	820	1	NR	950	0	NR
435	65	NR	565	295	NR	695	45	NR	825	1	NR	955	0	NR
440	108	NR	570	303	NR	700	39	NR	830	1	NR	960	0	NR
445	193	NR	575	311	NR	705	33	NR	835	1	NR	965	0	NR
450	312	NR	580	319	NR	710	28	NR	840	1	NR	970	0	NR
455	300	NR	585	326	NR	715	24	NR	845	0	NR	975	0	NR
460	214	NR	590	332	NR	720	20	NR	850	0	NR	980	0	NR
465	184	NR	595	333	NR	725	17	NR	855	0	NR	985	0	NR
470	153	NR	600	336	NR	730	15	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	12	NR	865	0	NR	995	0	NR
480	115	NR	610	367	NR	740	10	NR	870	0	NR	1000	0	NR
485	125	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-6

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.62

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	140	NR	620	338	NR	750	8	NR	880	0	NR
365	0	NR	495	159	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	182	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	202	NR	635	653	NR	765	5	NR	895	0	NR
380	0	NR	510	216	NR	640	222	NR	770	4	NR	900	0	NR
385	0	NR	515	228	NR	645	214	NR	775	3	NR	905	0	NR
390	0	NR	520	236	NR	650	185	NR	780	3	NR	910	0	NR
395	1	NR	525	242	NR	655	157	NR	785	3	NR	915	0	NR
400	2	NR	530	248	NR	660	133	NR	790	2	NR	920	0	NR
405	3	NR	535	253	NR	665	113	NR	795	2	NR	925	0	NR
410	4	NR	540	258	NR	670	103	NR	800	2	NR	930	0	NR
415	7	NR	545	264	NR	675	85	NR	805	1	NR	935	0	NR
420	13	NR	550	270	NR	680	72	NR	810	1	NR	940	0	NR
425	22	NR	555	278	NR	685	62	NR	815	1	NR	945	0	NR
430	38	NR	560	286	NR	690	53	NR	820	1	NR	950	0	NR
435	65	NR	565	295	NR	695	45	NR	825	1	NR	955	0	NR
440	108	NR	570	303	NR	700	39	NR	830	1	NR	960	0	NR
445	193	NR	575	311	NR	705	33	NR	835	1	NR	965	0	NR
450	312	NR	580	319	NR	710	28	NR	840	1	NR	970	0	NR
455	300	NR	585	326	NR	715	24	NR	845	0	NR	975	0	NR
460	214	NR	590	332	NR	720	20	NR	850	0	NR	980	0	NR
465	184	NR	595	333	NR	725	17	NR	855	0	NR	985	0	NR
470	153	NR	600	336	NR	730	15	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	12	NR	865	0	NR	995	0	NR
480	115	NR	610	367	NR	740	10	NR	870	0	NR	1000	0	NR
485	125	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-6

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.3

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	140	NR	620	338	NR	750	8	NR	880	0	NR
365	0	NR	495	159	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	182	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	202	NR	635	653	NR	765	5	NR	895	0	NR
380	0	NR	510	216	NR	640	222	NR	770	4	NR	900	0	NR
385	0	NR	515	228	NR	645	214	NR	775	3	NR	905	0	NR
390	0	NR	520	236	NR	650	185	NR	780	3	NR	910	0	NR
395	1	NR	525	242	NR	655	157	NR	785	3	NR	915	0	NR
400	2	NR	530	248	NR	660	133	NR	790	2	NR	920	0	NR
405	3	NR	535	253	NR	665	113	NR	795	2	NR	925	0	NR
410	4	NR	540	258	NR	670	103	NR	800	2	NR	930	0	NR
415	7	NR	545	264	NR	675	85	NR	805	1	NR	935	0	NR
420	13	NR	550	270	NR	680	72	NR	810	1	NR	940	0	NR
425	22	NR	555	278	NR	685	62	NR	815	1	NR	945	0	NR
430	38	NR	560	286	NR	690	53	NR	820	1	NR	950	0	NR
435	65	NR	565	295	NR	695	45	NR	825	1	NR	955	0	NR
440	108	NR	570	303	NR	700	39	NR	830	1	NR	960	0	NR
445	193	NR	575	311	NR	705	33	NR	835	1	NR	965	0	NR
450	312	NR	580	319	NR	710	28	NR	840	1	NR	970	0	NR
455	300	NR	585	326	NR	715	24	NR	845	0	NR	975	0	NR
460	214	NR	590	332	NR	720	20	NR	850	0	NR	980	0	NR
465	184	NR	595	333	NR	725	17	NR	855	0	NR	985	0	NR
470	153	NR	600	336	NR	730	15	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	12	NR	865	0	NR	995	0	NR
480	115	NR	610	367	NR	740	10	NR	870	0	NR	1000	0	NR
485	125	NR	615	390	NR	745	9	NR	875	0	NR			

Summary

$R_f = 91.3$
 $R_g = 100$
 $CIE R_a = 94.6$
 $R_9 = 63.8$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 94	CES51 = 97	CES76 = 90
CES02 = 63	CES27 = 92	CES52 = 98	CES77 = 86
CES03 = 31	CES28 = 97	CES53 = 98	CES78 = 86
CES04 = 70	CES29 = 97	CES54 = 93	CES79 = 90
CES05 = 50	CES30 = 92	CES55 = 92	CES80 = 91
CES06 = 51	CES31 = 97	CES56 = 96	CES81 = 74
CES07 = 43	CES32 = 89	CES57 = 94	CES82 = 96
CES08 = 41	CES33 = 99	CES58 = 95	CES83 = 94
CES09 = 29	CES34 = 94	CES59 = 98	CES84 = 95
CES10 = 75	CES35 = 97	CES60 = 92	CES85 = 79
CES11 = 58	CES36 = 81	CES61 = 93	CES86 = 79
CES12 = 64	CES37 = 96	CES62 = 86	CES87 = 92
CES13 = 44	CES38 = 87	CES63 = 94	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 91	CES89 = 84
CES15 = 72	CES40 = 97	CES65 = 90	CES90 = 96
CES16 = 48	CES41 = 96	CES66 = 89	CES91 = 75
CES17 = 49	CES42 = 94	CES67 = 88	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 89	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 90	CES94 = 74
CES20 = 67	CES45 = 97	CES70 = 88	CES95 = 83
CES21 = 86	CES46 = 97	CES71 = 83	CES96 = 92
CES22 = 78	CES47 = 91	CES72 = 94	CES97 = 96
CES23 = 91	CES48 = 91	CES73 = 83	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 90	CES99 = 92
CES25 = 71	CES50 = 98	CES75 = 85	



Color Rendition by Hue-Angle Bin



Measure Comparisons

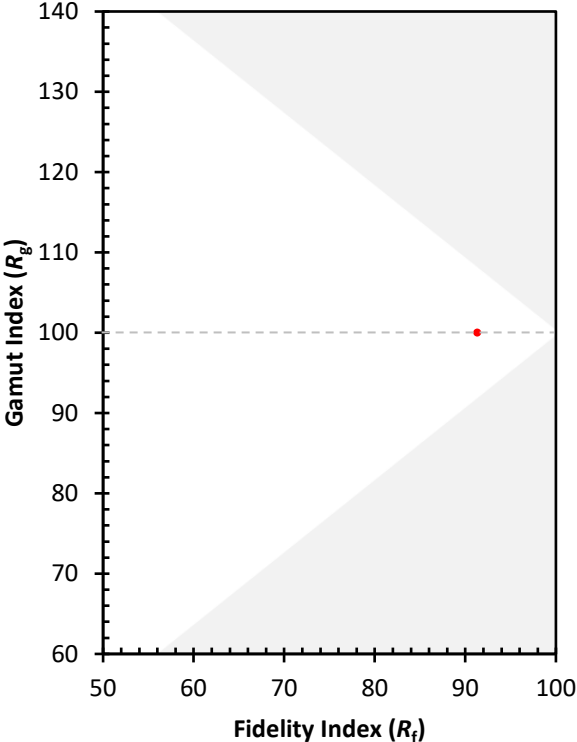

(END OF REPORT)