

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1433437

Luminaire Tested: EHBR1-12-UNV-W-L935-UPL18

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number: P1433437
REPORT IS A COMBINATION OF REPORTS P1431662 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-12-UNV-W-L935-UPL18
Description: Elevate Round Highbay at, 12000 lumens, 3500K 90CRI LEDs with W lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 12727.3 lumens
Efficiency: N/A
Efficacy: 166.2 lumens/watt
Spacing Criteria (0/90/45): 1.54 / 1.54 / 1.31
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 76.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1433437
CATALOG NUMBER: EHBR1-12-UNV-W-L935-UPL18

Luminous Intensity Polar Plot

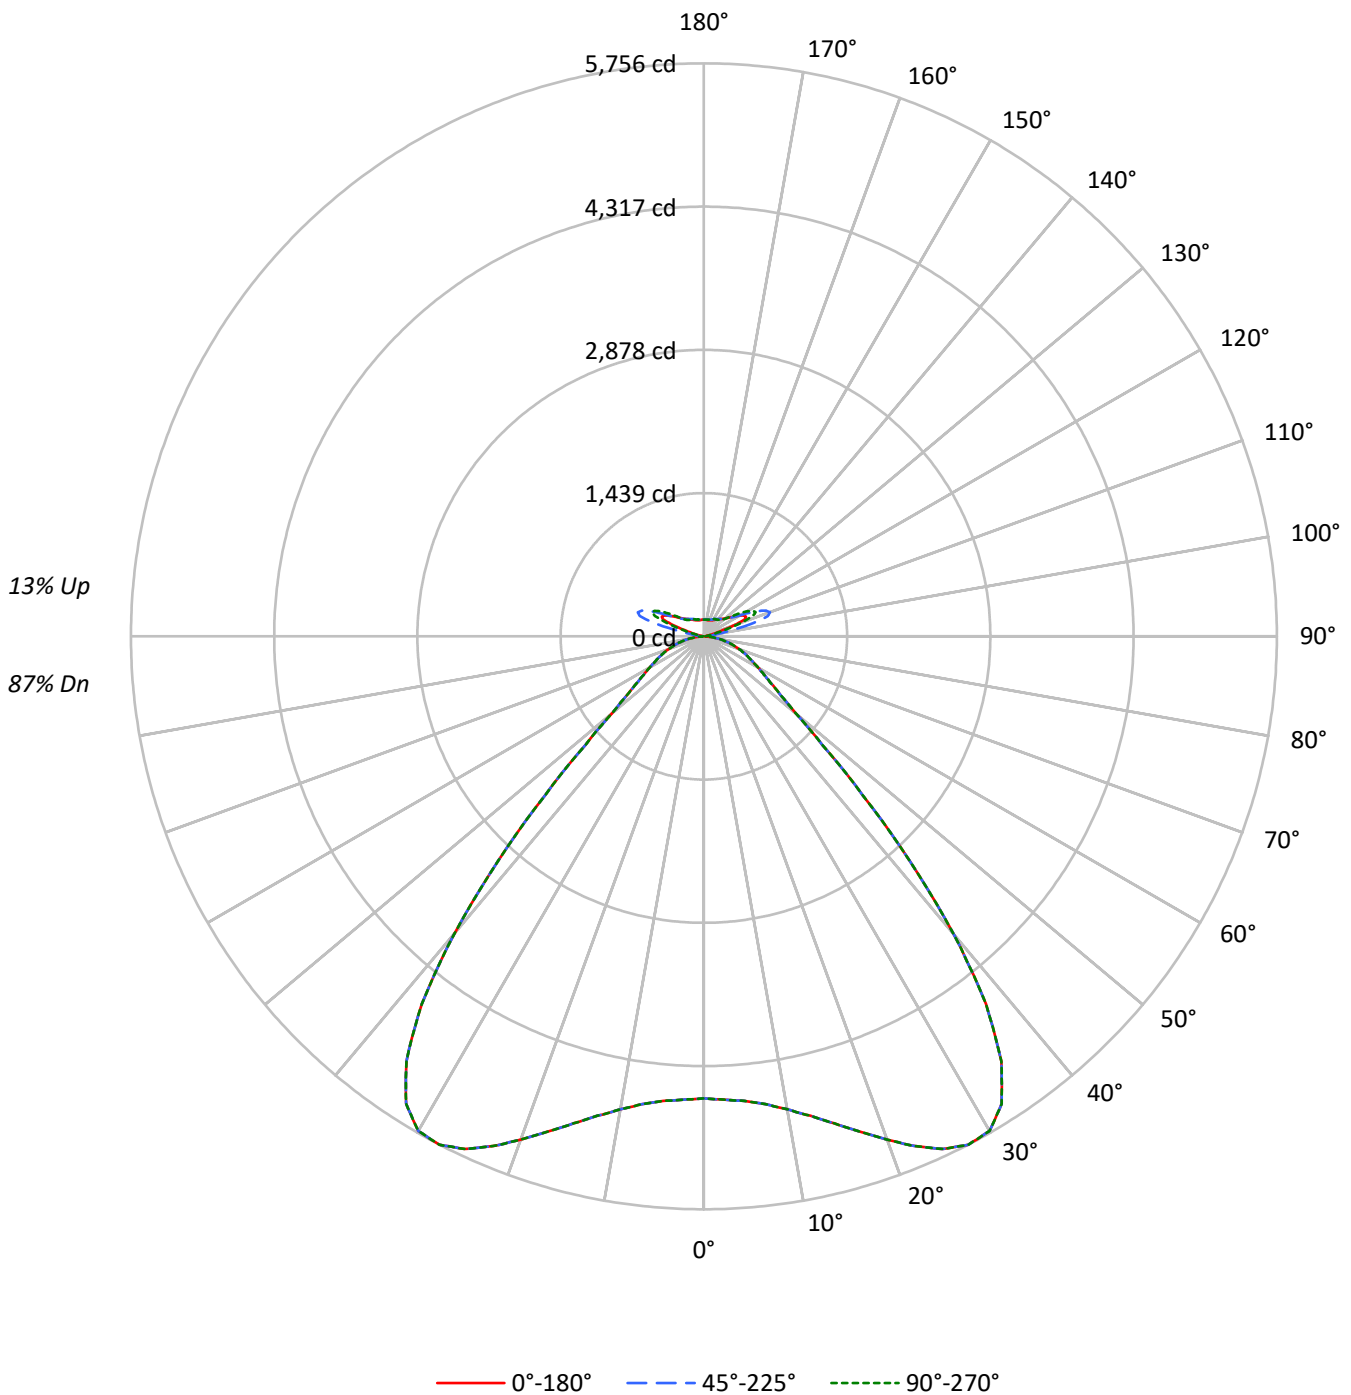



TEST NUMBER: P1433437

CATALOG NUMBER: EHBR1-12-UNV-W-L935-UPL18

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	116	116	116	116	112	112	112	112	104	104	104	97	97	97	90	90	90	90	90	90	87
1	108	104	101	98	104	101	98	95	94	92	90	88	87	85	83	82	80	80	80	80	77
2	100	94	88	84	97	91	86	82	85	81	78	80	77	74	76	73	71	71	71	71	68
3	93	84	78	73	90	82	76	71	77	72	68	73	69	66	69	66	63	63	63	63	61
4	86	76	69	64	83	74	68	62	70	65	60	67	62	58	63	59	56	56	56	56	54
5	80	69	62	56	77	68	61	55	64	58	54	61	56	52	58	54	50	50	50	50	48
6	75	63	56	50	72	62	55	49	59	53	48	56	51	47	53	49	45	45	45	45	43
7	70	58	50	45	67	57	49	44	54	48	43	52	46	42	49	45	41	41	41	41	39
8	65	53	46	41	63	52	45	40	50	44	39	48	42	38	46	41	37	37	37	37	35
9	61	49	42	37	59	48	41	36	46	40	36	44	39	35	42	37	34	34	34	34	32
10	57	45	38	34	55	44	38	33	43	37	32	41	36	32	39	35	31	31	31	31	29

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	21798	21798	21798
5°	21943	21943	21943
10°	22705	22705	22705
15°	24144	24144	24144
20°	26172	26172	26172
25°	28452	28452	28452
30°	29822	29822	29822
35°	28386	28386	28386
40°	22524	22524	22524
45°	13922	13922	13922
50°	8061	8061	8061
55°	6100	6100	6100
60°	5232	5232	5232
65°	4725	4725	4725
70°	4348	4348	4348
75°	3840	3840	3840
80°	3131	3131	3131
85°	1845	1845	1845

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13922 cd/sqm



TEST NUMBER: P1433437
 CATALOG NUMBER: EHBR1-12-UNV-W-L935-UPL18

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	451.6	3.5
10°-20°	1447.8	11.4
20°-30°	2613.4	20.5
30°-40°	3158.0	24.8
40°-50°	1804.3	14.2
50°-60°	764.2	6.0
60°-70°	492.9	3.9
70°-80°	286.6	2.3
80°-90°	78.8	0.6
90°-100°	46.6	0.4
100°-110°	290.3	2.3
110°-120°	519.0	4.1
120°-130°	304.8	2.4
130°-140°	187.7	1.5
140°-150°	131.0	1.0
150°-160°	85.4	0.7
160°-170°	48.8	0.4
170°-180°	16.2	0.1
0°-30°	4512.8	35.5
0°-40°	7670.8	60.3
0°-60°	10239.3	80.5
0°-90°	11097.5	87.2
90°-120°	855.9	6.7
90°-150°	1479.4	11.6
90°-180°	1630.0	12.8
0°-180°	12727.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4642	4642	4642	4642	4642	
5°	4685	4685	4685	4685	4685	452
15°	5065	5065	5065	5065	5065	1448
25°	5682	5682	5682	5682	5682	2613
35°	5210	5210	5210	5210	5210	3158
45°	2252	2252	2252	2252	2252	1804
55°	824	824	824	824	824	764
65°	493	493	493	493	493	493
75°	270	270	270	270	270	287
85°	63	63	63	63	63	73
90°	12	20	34	22	12	9
95°	21	35	76	38	24	20
105°	102	200	510	220	134	136
115°	467	491	603	578	575	430
125°	337	315	323	328	368	307
135°	247	239	248	233	232	193
145°	204	201	213	210	210	129
155°	179	178	186	186	186	84
165°	168	168	173	173	172	48
175°	167	167	170	170	170	16
180°	169	169	169	169	169	



TEST NUMBER: P1433437

CATALOG NUMBER: EHBR1-12-UNV-W-L935-UPL18

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4641.7	4641.7	4641.7	4641.7	4641.7
2.5°	4657.3	4657.3	4657.3	4657.3	4657.3
5°	4685.1	4685.1	4685.1	4685.1	4685.1
7.5°	4739.8	4739.8	4739.8	4739.8	4739.8
10°	4824.0	4824.0	4824.0	4824.0	4824.0
12.5°	4933.4	4933.4	4933.4	4933.4	4933.4
15°	5065.3	5065.3	5065.3	5065.3	5065.3
17.5°	5216.2	5216.2	5216.2	5216.2	5216.2
20°	5379.2	5379.2	5379.2	5379.2	5379.2
22.5°	5543.3	5543.3	5543.3	5543.3	5543.3
25°	5681.9	5681.9	5681.9	5681.9	5681.9
27.5°	5756.4	5756.4	5756.4	5756.4	5756.4
30°	5736.3	5736.3	5736.3	5736.3	5736.3
32.5°	5566.3	5566.3	5566.3	5566.3	5566.3
35°	5209.9	5209.9	5209.9	5209.9	5209.9
37.5°	4654.1	4654.1	4654.1	4654.1	4654.1
40°	3904.0	3904.0	3904.0	3904.0	3904.0
42.5°	3055.7	3055.7	3055.7	3055.7	3055.7
45°	2252.5	2252.5	2252.5	2252.5	2252.5
47.5°	1610.0	1610.0	1610.0	1610.0	1610.0
50°	1201.4	1201.4	1201.4	1201.4	1201.4
52.5°	972.9	972.9	972.9	972.9	972.9
55°	824.3	824.3	824.3	824.3	824.3
57.5°	715.8	715.8	715.8	715.8	715.8
60°	629.0	629.0	629.0	629.0	629.0
62.5°	556.7	556.7	556.7	556.7	556.7
65°	493.2	493.2	493.2	493.2	493.2
67.5°	437.3	437.3	437.3	437.3	437.3
70°	381.5	381.5	381.5	381.5	381.5
72.5°	325.8	325.8	325.8	325.8	325.8
75°	270.5	270.5	270.5	270.5	270.5
77.5°	217.3	217.3	217.3	217.3	217.3
80°	164.7	164.7	164.7	164.7	164.7
82.5°	112.9	112.9	112.9	112.9	112.9
85°	63.4	63.4	63.4	63.4	63.4
87.5°	20.0	20.0	20.0	20.0	20.0
90°	12.4	19.8	33.8	21.8	12.4
92.5°	17.9	29.9	54.0	28.0	16.0
95°	20.8	34.7	75.6	37.5	23.6
97.5°	26.4	38.4	86.7	45.9	36.6
100°	34.7	45.0	135.0	56.1	48.7
102.5°	58.9	95.1	286.5	105.3	73.8
105°	101.6	200.1	510.4	220.5	134.1
107.5°	175.9	358.0	672.9	390.5	254.0
110°	328.5	475.2	705.6	536.5	406.5



TEST NUMBER: P1433437

CATALOG NUMBER: EHBR1-12-UNV-W-L935-UPL18

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	443.6	510.5	675.9	592.3	529.1
115°	466.9	491.0	603.4	578.3	574.6
117.5°	451.1	448.3	512.3	519.8	555.1
120°	417.6	399.1	427.9	453.9	501.2
122.5°	375.9	353.6	366.5	386.0	433.4
125°	337.0	314.7	323.0	327.7	367.6
127.5°	302.6	287.8	292.4	286.9	311.9
130°	279.6	266.6	273.1	260.1	272.2
132.5°	260.5	252.1	259.5	243.7	247.4
135°	246.7	239.3	247.6	232.7	231.8
137.5°	234.8	228.3	236.6	225.5	222.7
140°	224.1	218.5	227.9	219.4	217.6
142.5°	212.2	208.5	219.6	214.1	212.2
145°	204.0	201.2	213.4	210.5	209.6
147.5°	196.8	195.0	206.1	205.1	205.1
150°	190.2	188.4	199.6	198.7	199.6
152.5°	183.8	181.9	192.1	191.2	192.1
155°	179.3	177.5	185.8	185.8	185.8
157.5°	175.6	174.6	181.2	181.2	181.2
160°	173.0	172.0	177.6	177.6	176.7
162.5°	170.4	169.5	175.9	175.0	175.0
165°	168.5	168.5	173.2	173.2	172.2
167.5°	168.5	167.6	172.2	172.2	171.3
170°	167.6	167.6	171.3	170.4	169.5
172.5°	167.8	167.8	171.5	170.6	169.7
175°	167.0	167.0	169.8	169.8	169.8
177.5°	167.9	167.9	169.8	169.8	168.8
180°	169.0	169.0	169.0	169.0	169.0



TEST NUMBER: P1433437
 CATALOG NUMBER: EHBR1-12-UNV-W-L935-UPL18

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.20	15.30	14.77	15.86	16.49	14.20	15.30	14.77	15.86	16.49
	3H	15.69	16.67	16.28	17.25	17.91	15.69	16.67	16.28	17.25	17.91
	4H	16.25	17.17	16.86	17.75	18.43	16.25	17.17	16.86	17.75	18.43
	6H	16.63	17.47	17.25	18.08	18.77	16.63	17.47	17.25	18.08	18.77
	8H	16.73	17.53	17.36	18.15	18.84	16.73	17.53	17.36	18.15	18.84
	12H	16.76	17.52	17.40	18.14	18.86	16.76	17.52	17.40	18.14	18.86
4H	2H	14.63	15.55	15.24	16.14	16.82	14.63	15.55	15.24	16.14	16.82
	3H	16.35	17.10	16.97	17.73	18.43	16.35	17.10	16.97	17.73	18.43
	4H	17.02	17.70	17.66	18.34	19.07	17.02	17.70	17.66	18.34	19.07
	6H	17.51	18.10	18.18	18.76	19.51	17.51	18.10	18.18	18.76	19.51
	8H	17.64	18.19	18.31	18.85	19.60	17.64	18.19	18.31	18.85	19.60
	12H	17.70	18.19	18.38	18.87	19.63	17.70	18.19	18.38	18.87	19.63
8H	4H	17.22	17.77	17.88	18.43	19.18	17.22	17.77	17.88	18.43	19.18
	6H	17.81	18.26	18.51	18.97	19.72	17.81	18.26	18.51	18.97	19.72
	8H	18.00	18.40	18.71	19.11	19.88	18.00	18.40	18.71	19.11	19.88
	12H	18.10	18.46	18.81	19.15	19.99	18.10	18.46	18.81	19.15	19.99
12H	4H	17.21	17.70	17.89	18.39	19.14	17.21	17.70	17.89	18.39	19.14
	6H	17.83	18.23	18.54	18.94	19.71	17.83	18.23	18.54	18.94	19.71
	8H	18.05	18.40	18.76	19.10	19.94	18.05	18.40	18.76	19.10	19.94

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-6

Test Date: 08/01/2025

Luminaire Tested: EHBR-60-L935-N

Data in this report applies to families of products including EHBR-60-L935-N

REPORT NUMBER: SP1-2506-472-6

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-6

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-6

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	140	NR	620	338	NR	750	8	NR	880	0	NR
365	0	NR	495	159	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	182	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	202	NR	635	653	NR	765	5	NR	895	0	NR
380	0	NR	510	216	NR	640	222	NR	770	4	NR	900	0	NR
385	0	NR	515	228	NR	645	214	NR	775	3	NR	905	0	NR
390	0	NR	520	236	NR	650	185	NR	780	3	NR	910	0	NR
395	1	NR	525	242	NR	655	157	NR	785	3	NR	915	0	NR
400	2	NR	530	248	NR	660	133	NR	790	2	NR	920	0	NR
405	3	NR	535	253	NR	665	113	NR	795	2	NR	925	0	NR
410	4	NR	540	258	NR	670	103	NR	800	2	NR	930	0	NR
415	7	NR	545	264	NR	675	85	NR	805	1	NR	935	0	NR
420	13	NR	550	270	NR	680	72	NR	810	1	NR	940	0	NR
425	22	NR	555	278	NR	685	62	NR	815	1	NR	945	0	NR
430	38	NR	560	286	NR	690	53	NR	820	1	NR	950	0	NR
435	65	NR	565	295	NR	695	45	NR	825	1	NR	955	0	NR
440	108	NR	570	303	NR	700	39	NR	830	1	NR	960	0	NR
445	193	NR	575	311	NR	705	33	NR	835	1	NR	965	0	NR
450	312	NR	580	319	NR	710	28	NR	840	1	NR	970	0	NR
455	300	NR	585	326	NR	715	24	NR	845	0	NR	975	0	NR
460	214	NR	590	332	NR	720	20	NR	850	0	NR	980	0	NR
465	184	NR	595	333	NR	725	17	NR	855	0	NR	985	0	NR
470	153	NR	600	336	NR	730	15	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	12	NR	865	0	NR	995	0	NR
480	115	NR	610	367	NR	740	10	NR	870	0	NR	1000	0	NR
485	125	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-6

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.62

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	140	NR	620	338	NR	750	8	NR	880	0	NR
365	0	NR	495	159	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	182	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	202	NR	635	653	NR	765	5	NR	895	0	NR
380	0	NR	510	216	NR	640	222	NR	770	4	NR	900	0	NR
385	0	NR	515	228	NR	645	214	NR	775	3	NR	905	0	NR
390	0	NR	520	236	NR	650	185	NR	780	3	NR	910	0	NR
395	1	NR	525	242	NR	655	157	NR	785	3	NR	915	0	NR
400	2	NR	530	248	NR	660	133	NR	790	2	NR	920	0	NR
405	3	NR	535	253	NR	665	113	NR	795	2	NR	925	0	NR
410	4	NR	540	258	NR	670	103	NR	800	2	NR	930	0	NR
415	7	NR	545	264	NR	675	85	NR	805	1	NR	935	0	NR
420	13	NR	550	270	NR	680	72	NR	810	1	NR	940	0	NR
425	22	NR	555	278	NR	685	62	NR	815	1	NR	945	0	NR
430	38	NR	560	286	NR	690	53	NR	820	1	NR	950	0	NR
435	65	NR	565	295	NR	695	45	NR	825	1	NR	955	0	NR
440	108	NR	570	303	NR	700	39	NR	830	1	NR	960	0	NR
445	193	NR	575	311	NR	705	33	NR	835	1	NR	965	0	NR
450	312	NR	580	319	NR	710	28	NR	840	1	NR	970	0	NR
455	300	NR	585	326	NR	715	24	NR	845	0	NR	975	0	NR
460	214	NR	590	332	NR	720	20	NR	850	0	NR	980	0	NR
465	184	NR	595	333	NR	725	17	NR	855	0	NR	985	0	NR
470	153	NR	600	336	NR	730	15	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	12	NR	865	0	NR	995	0	NR
480	115	NR	610	367	NR	740	10	NR	870	0	NR	1000	0	NR
485	125	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-6

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.3

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	140	NR	620	338	NR	750	8	NR	880	0	NR
365	0	NR	495	159	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	182	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	202	NR	635	653	NR	765	5	NR	895	0	NR
380	0	NR	510	216	NR	640	222	NR	770	4	NR	900	0	NR
385	0	NR	515	228	NR	645	214	NR	775	3	NR	905	0	NR
390	0	NR	520	236	NR	650	185	NR	780	3	NR	910	0	NR
395	1	NR	525	242	NR	655	157	NR	785	3	NR	915	0	NR
400	2	NR	530	248	NR	660	133	NR	790	2	NR	920	0	NR
405	3	NR	535	253	NR	665	113	NR	795	2	NR	925	0	NR
410	4	NR	540	258	NR	670	103	NR	800	2	NR	930	0	NR
415	7	NR	545	264	NR	675	85	NR	805	1	NR	935	0	NR
420	13	NR	550	270	NR	680	72	NR	810	1	NR	940	0	NR
425	22	NR	555	278	NR	685	62	NR	815	1	NR	945	0	NR
430	38	NR	560	286	NR	690	53	NR	820	1	NR	950	0	NR
435	65	NR	565	295	NR	695	45	NR	825	1	NR	955	0	NR
440	108	NR	570	303	NR	700	39	NR	830	1	NR	960	0	NR
445	193	NR	575	311	NR	705	33	NR	835	1	NR	965	0	NR
450	312	NR	580	319	NR	710	28	NR	840	1	NR	970	0	NR
455	300	NR	585	326	NR	715	24	NR	845	0	NR	975	0	NR
460	214	NR	590	332	NR	720	20	NR	850	0	NR	980	0	NR
465	184	NR	595	333	NR	725	17	NR	855	0	NR	985	0	NR
470	153	NR	600	336	NR	730	15	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	12	NR	865	0	NR	995	0	NR
480	115	NR	610	367	NR	740	10	NR	870	0	NR	1000	0	NR
485	125	NR	615	390	NR	745	9	NR	875	0	NR			

Summary

$R_f = 91.3$
 $R_g = 100$
 $CIE R_a = 94.6$
 $R_9 = 63.8$




Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 94	CES51 = 97	CES76 = 90
CES02 = 63	CES27 = 92	CES52 = 98	CES77 = 86
CES03 = 31	CES28 = 97	CES53 = 98	CES78 = 86
CES04 = 70	CES29 = 97	CES54 = 93	CES79 = 90
CES05 = 50	CES30 = 92	CES55 = 92	CES80 = 91
CES06 = 51	CES31 = 97	CES56 = 96	CES81 = 74
CES07 = 43	CES32 = 89	CES57 = 94	CES82 = 96
CES08 = 41	CES33 = 99	CES58 = 95	CES83 = 94
CES09 = 29	CES34 = 94	CES59 = 98	CES84 = 95
CES10 = 75	CES35 = 97	CES60 = 92	CES85 = 79
CES11 = 58	CES36 = 81	CES61 = 93	CES86 = 79
CES12 = 64	CES37 = 96	CES62 = 86	CES87 = 92
CES13 = 44	CES38 = 87	CES63 = 94	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 91	CES89 = 84
CES15 = 72	CES40 = 97	CES65 = 90	CES90 = 96
CES16 = 48	CES41 = 96	CES66 = 89	CES91 = 75
CES17 = 49	CES42 = 94	CES67 = 88	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 89	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 90	CES94 = 74
CES20 = 67	CES45 = 97	CES70 = 88	CES95 = 83
CES21 = 86	CES46 = 97	CES71 = 83	CES96 = 92
CES22 = 78	CES47 = 91	CES72 = 94	CES97 = 96
CES23 = 91	CES48 = 91	CES73 = 83	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 90	CES99 = 92
CES25 = 71	CES50 = 98	CES75 = 85	

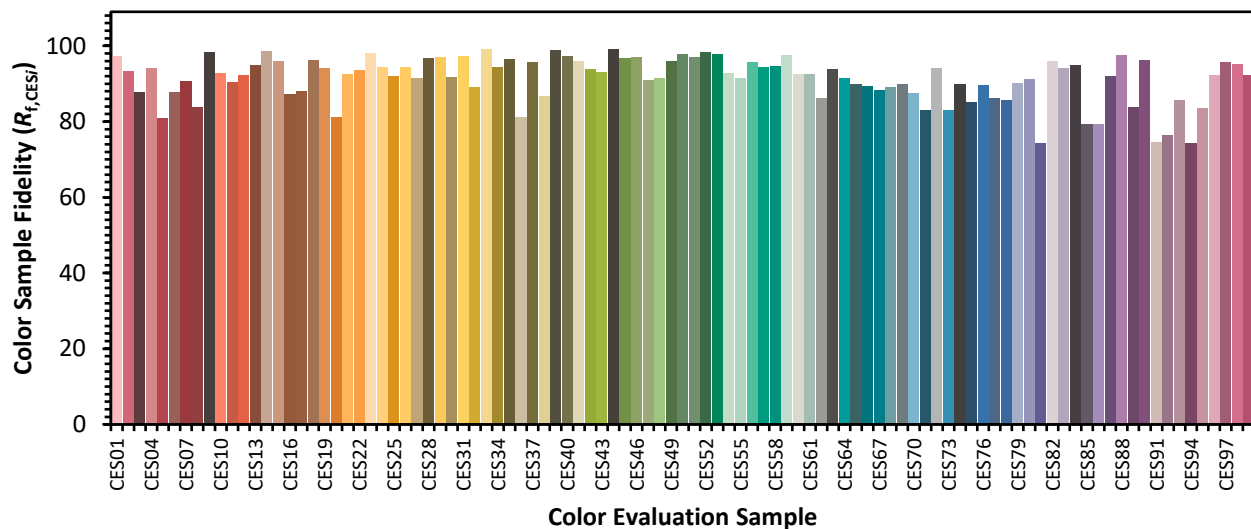

Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)