

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P1436635

Luminaire Tested: EHBR1-18-UNV-M-L950-UPL12

Issue Date: 3/25/2026

Test Information

Test Method: LM-79-2019
Report Number: P1436635
REPORT IS A COMBINATION OF REPORTS P1436059 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/25/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-18-UNV-M-L950-UPL12
Description: Elevate Round Highbay at, 18000 lumens, 5000K 90CRI LEDs with M lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 18383.3 lumens
Efficiency: N/A
Efficacy: 180.1 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.21 / 1.15
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 102.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1436635
CATALOG NUMBER: EHBR1-18-UNV-M-L950-UPL12

Luminous Intensity Polar Plot

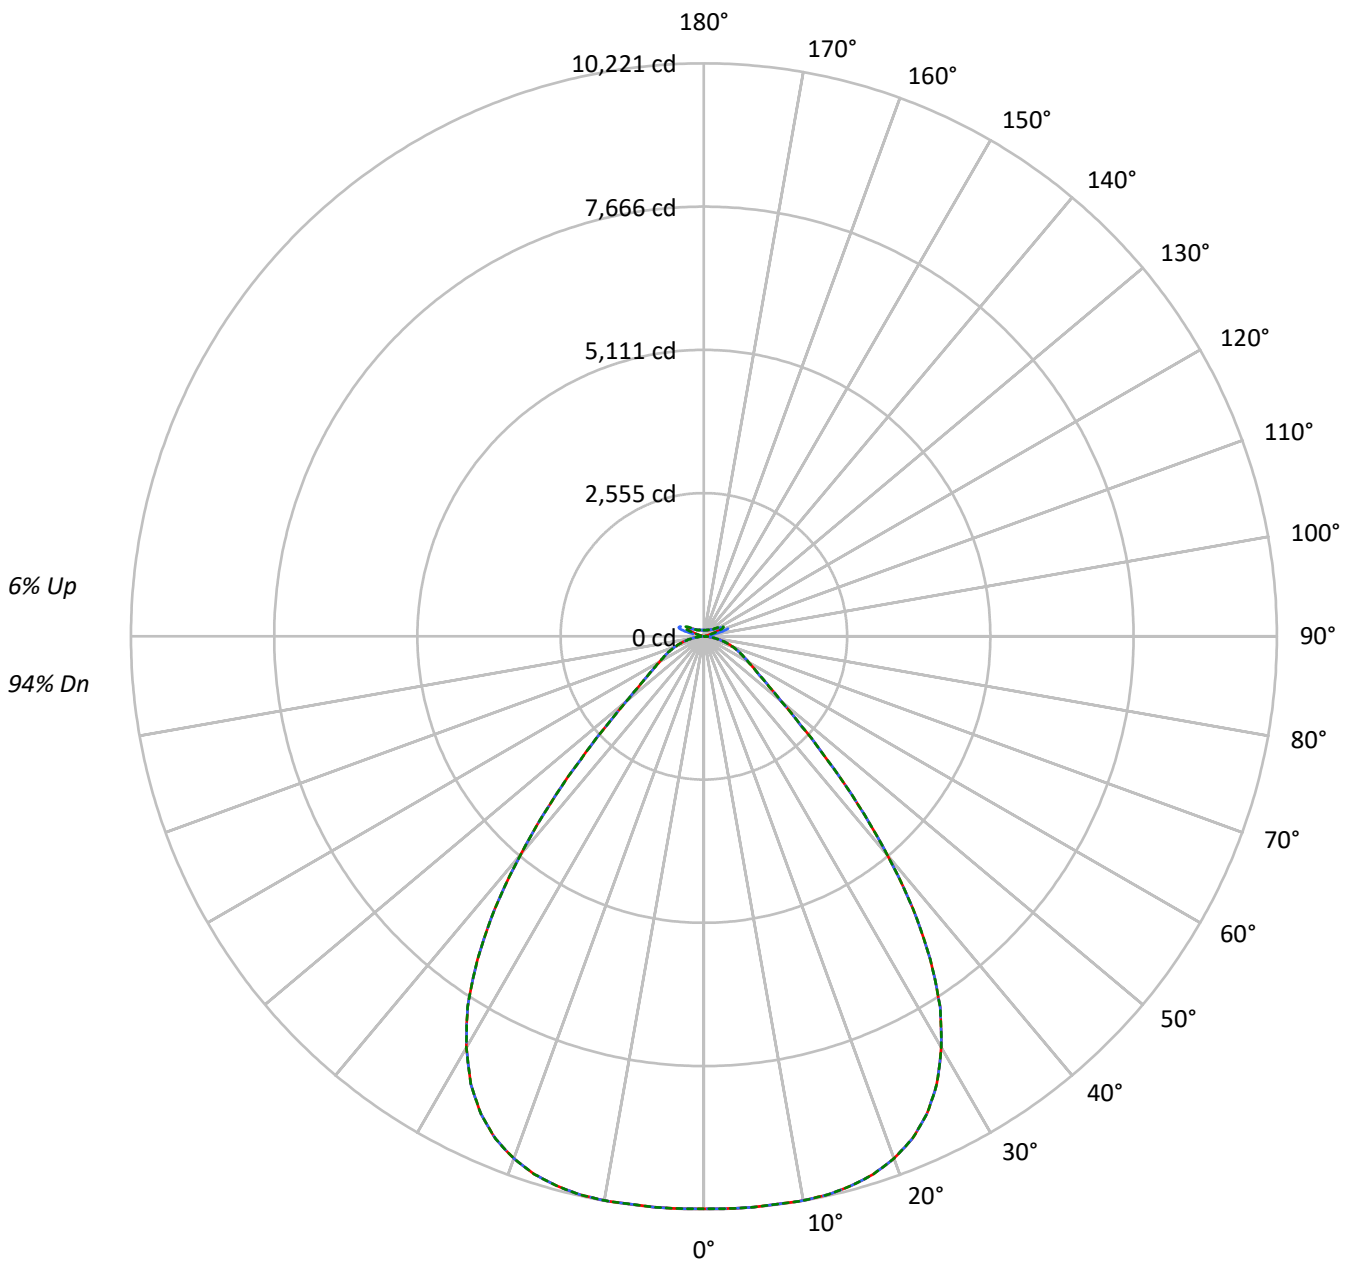

— 0°-180° - - - 45°-225° - - - 90°-270°



TEST NUMBER: P1436635
 CATALOG NUMBER: EHBR1-18-UNV-M-L950-UPL12

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	118	118	118	118	114	114	114	114	108	108	108	102	102	102	97	97	97	97	97	97	94
1	110	107	103	100	107	104	101	98	99	96	94	94	92	90	89	88	87	87	87	87	84
2	103	96	91	87	100	94	89	85	90	86	82	86	83	80	82	79	77	77	77	77	75
3	96	87	81	76	93	85	80	75	82	77	73	78	74	71	75	72	69	69	69	69	67
4	89	80	73	67	87	78	72	67	75	69	65	72	67	64	69	65	62	62	62	62	60
5	83	73	66	60	81	71	65	60	69	63	58	66	61	57	64	60	56	56	56	56	54
6	78	67	59	54	76	66	59	54	63	57	53	61	56	52	59	55	51	51	51	51	49
7	73	62	54	49	71	61	54	49	59	53	48	57	51	47	55	50	47	47	47	47	45
8	69	57	50	45	67	56	49	45	54	48	44	53	47	43	51	46	43	43	43	43	41
9	65	53	46	41	63	52	45	41	51	45	40	49	44	40	48	43	39	39	39	39	38
10	61	49	42	38	59	49	42	38	47	41	37	46	41	37	45	40	36	36	36	36	35

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	47951	47951	47951
5°	47869	47869	47869
10°	48093	48093	48093
15°	48370	48370	48370
20°	48223	48223	48223
25°	47097	47097	47097
30°	44040	44040	44040
35°	38354	38354	38354
40°	29394	29394	29394
45°	19203	19203	19203
50°	12105	12105	12105
55°	9024	9024	9024
60°	7597	7597	7597
65°	6909	6909	6909
70°	6293	6293	6293
75°	5389	5389	5389
80°	4150	4150	4150
85°	2173	2173	2173

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 19203 cd/sqm



TEST NUMBER: P1436635
 CATALOG NUMBER: EHBR1-18-UNV-M-L950-UPL12

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	975.2	5.3
10°-20°	2863.9	15.6
20°-30°	4297.2	23.4
30°-40°	4323.5	23.5
40°-50°	2474.9	13.5
50°-60°	1131.9	6.2
60°-70°	718.2	3.9
70°-80°	402.9	2.2
80°-90°	96.5	0.5
90°-100°	31.3	0.2
100°-110°	196.4	1.1
110°-120°	351.1	1.9
120°-130°	206.0	1.1
130°-140°	126.4	0.7
140°-150°	87.7	0.5
150°-160°	56.9	0.3
160°-170°	32.4	0.2
170°-180°	10.7	0.1
0°-30°	8136.4	44.3
0°-40°	12459.9	67.8
0°-60°	16066.7	87.4
0°-90°	17284.3	94.0
90°-120°	578.8	3.1
90°-150°	998.9	5.4
90°-180°	1099.0	6.0
0°-180°	18383.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	10211	10211	10211	10211	10211	
5°	10221	10221	10221	10221	10221	975
15°	10148	10148	10148	10148	10148	2864
25°	9405	9405	9405	9405	9405	4297
35°	7039	7039	7039	7039	7039	4324
45°	3107	3107	3107	3107	3107	2475
55°	1220	1220	1220	1220	1220	1132
65°	721	721	721	721	721	718
75°	380	380	380	380	380	403
85°	75	75	75	75	75	92
90°	8	13	23	14	8	7
95°	14	23	51	25	16	13
105°	69	135	345	149	91	92
115°	316	332	408	391	389	291
125°	228	213	218	221	248	208
135°	166	161	167	157	156	130
145°	136	135	143	141	140	86
155°	120	118	124	124	124	56
165°	112	112	115	115	114	32
175°	111	111	113	113	113	11
180°	112	112	112	112	112	



TEST NUMBER: P1436635

CATALOG NUMBER: EHBR1-18-UNV-M-L950-UPL12

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	10210.8	10210.8	10210.8	10210.8	10210.8
2.5°	10215.8	10215.8	10215.8	10215.8	10215.8
5°	10220.8	10220.8	10220.8	10220.8	10220.8
7.5°	10213.8	10213.8	10213.8	10213.8	10213.8
10°	10218.1	10218.1	10218.1	10218.1	10218.1
12.5°	10200.6	10200.6	10200.6	10200.6	10200.6
15°	10147.7	10147.7	10147.7	10147.7	10147.7
17.5°	10060.3	10060.3	10060.3	10060.3	10060.3
20°	9911.3	9911.3	9911.3	9911.3	9911.3
22.5°	9706.6	9706.6	9706.6	9706.6	9706.6
25°	9405.3	9405.3	9405.3	9405.3	9405.3
27.5°	9000.1	9000.1	9000.1	9000.1	9000.1
30°	8471.0	8471.0	8471.0	8471.0	8471.0
32.5°	7844.6	7844.6	7844.6	7844.6	7844.6
35°	7039.4	7039.4	7039.4	7039.4	7039.4
37.5°	6127.3	6127.3	6127.3	6127.3	6127.3
40°	5094.8	5094.8	5094.8	5094.8	5094.8
42.5°	4071.3	4071.3	4071.3	4071.3	4071.3
45°	3106.9	3106.9	3106.9	3106.9	3106.9
47.5°	2338.8	2338.8	2338.8	2338.8	2338.8
50°	1804.1	1804.1	1804.1	1804.1	1804.1
52.5°	1457.6	1457.6	1457.6	1457.6	1457.6
55°	1219.5	1219.5	1219.5	1219.5	1219.5
57.5°	1044.1	1044.1	1044.1	1044.1	1044.1
60°	913.3	913.3	913.3	913.3	913.3
62.5°	812.2	812.2	812.2	812.2	812.2
65°	721.1	721.1	721.1	721.1	721.1
67.5°	637.2	637.2	637.2	637.2	637.2
70°	552.2	552.2	552.2	552.2	552.2
72.5°	466.6	466.6	466.6	466.6	466.6
75°	379.6	379.6	379.6	379.6	379.6
77.5°	296.8	296.8	296.8	296.8	296.8
80°	218.3	218.3	218.3	218.3	218.3
82.5°	142.3	142.3	142.3	142.3	142.3
85°	74.7	74.7	74.7	74.7	74.7
87.5°	21.4	21.4	21.4	21.4	21.4
90°	8.1	13.2	22.7	14.4	8.1
92.5°	12.0	20.1	36.5	18.8	10.7
95°	13.9	23.2	51.0	25.2	15.7
97.5°	17.6	25.8	58.5	30.8	24.5
100°	23.2	30.2	91.2	37.7	32.7
102.5°	39.6	64.2	193.8	71.1	49.7
105°	68.6	135.3	345.4	149.1	90.6
107.5°	118.9	242.2	455.4	264.2	171.8
110°	222.1	321.5	477.5	363.0	274.9



TEST NUMBER: P1436635

CATALOG NUMBER: EHBR1-18-UNV-M-L950-UPL12

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	300.1	345.4	457.4	400.7	357.9
115°	315.9	332.2	408.3	391.3	388.8
117.5°	305.1	303.2	346.7	351.6	375.6
120°	282.5	269.9	289.3	307.0	339.1
122.5°	254.1	239.0	247.9	261.1	293.2
125°	227.7	212.6	218.3	221.4	248.5
127.5°	204.5	194.4	197.6	193.8	210.8
130°	188.7	179.9	184.3	175.5	183.7
132.5°	175.5	169.8	174.9	164.2	166.7
135°	166.1	161.0	166.7	156.6	156.1
137.5°	157.9	153.5	159.1	151.7	149.7
140°	150.3	146.6	152.9	147.3	145.9
142.5°	142.2	139.7	147.3	143.4	142.2
145°	136.5	134.6	142.8	140.9	140.3
147.5°	131.5	130.2	137.8	137.1	137.1
150°	127.1	125.8	133.4	132.7	133.4
152.5°	122.7	121.4	128.3	127.7	128.3
155°	119.5	118.3	123.9	123.9	123.9
157.5°	117.0	116.3	120.8	120.8	120.8
160°	115.1	114.5	118.3	118.3	117.7
162.5°	113.2	112.6	117.0	116.3	116.3
165°	111.9	111.9	115.1	115.1	114.5
167.5°	111.9	111.4	114.5	114.5	113.9
170°	111.4	111.4	113.9	113.2	112.6
172.5°	111.4	111.4	113.9	113.2	112.6
175°	110.7	110.7	112.6	112.6	112.6
177.5°	111.4	111.4	112.6	112.6	111.9
180°	111.9	111.9	111.9	111.9	111.9



TEST NUMBER: P1436635
 CATALOG NUMBER: EHBR1-18-UNV-M-L950-UPL12

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.85	17.02	16.32	17.46	17.93	15.85	17.02	16.32	17.46	17.93
	3H	17.33	18.38	17.82	18.83	19.34	17.33	18.38	17.82	18.83	19.34
	4H	17.86	18.83	18.36	19.30	19.83	17.86	18.83	18.36	19.30	19.83
	6H	18.18	19.08	18.70	19.56	20.10	18.18	19.08	18.70	19.56	20.10
	8H	18.25	19.10	18.78	19.60	20.15	18.25	19.10	18.78	19.60	20.15
	12H	18.26	19.07	18.80	19.57	20.14	18.26	19.07	18.80	19.57	20.14
4H	2H	16.29	17.26	16.79	17.73	18.26	16.29	17.26	16.79	17.73	18.26
	3H	17.98	18.78	18.50	19.30	19.85	17.98	18.78	18.50	19.30	19.85
	4H	18.61	19.33	19.15	19.86	20.45	18.61	19.33	19.15	19.86	20.45
	6H	19.04	19.66	19.60	20.21	20.82	19.04	19.66	19.60	20.21	20.82
	8H	19.13	19.71	19.70	20.26	20.87	19.13	19.71	19.70	20.26	20.87
	12H	19.16	19.67	19.75	20.26	20.87	19.16	19.67	19.75	20.26	20.87
8H	4H	18.79	19.37	19.36	19.92	20.53	18.79	19.37	19.36	19.92	20.53
	6H	19.30	19.77	19.90	20.37	20.99	19.30	19.77	19.90	20.37	20.99
	8H	19.44	19.86	20.06	20.48	21.10	19.44	19.86	20.06	20.48	21.10
	12H	19.51	19.88	20.12	20.47	21.18	19.51	19.88	20.12	20.47	21.18
12H	4H	18.78	19.29	19.37	19.88	20.49	18.78	19.29	19.37	19.88	20.49
	6H	19.30	19.72	19.92	20.34	20.97	19.30	19.72	19.92	20.34	20.97
	8H	19.48	19.85	20.09	20.44	21.15	19.48	19.85	20.09	20.44	21.15

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-8

Test Date: 08/04/2025

Luminaire Tested: EHBR-60-L950-N

Data in this report applies to families of products including EHBR-60-L950-N


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-8
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L950-N**
 Description: Elevate Round Highbay at, 60000 lumens, 5000K 90CRI LEDs with N lens

Spectral Parameters

CCT (K): 4901
 CIE u': 0.2131
 CIE v': 0.4853
 Duv: -0.0008
 CIE x: 0.3477
 CIE y: 0.3520
 CIE z: 0.3003
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 574
 Purity: 9.953987
 Rf: 90.7
 Rg: 100.5

CRI (Ra):	94.3		
R1:	95.8	R9:	72.3
R2:	96.5	R10:	89.1
R3:	94.4	R11:	94.9
R4:	95.3	R12:	68.4
R5:	94.1	R13:	96.4
R6:	92.5	R14:	96.4
R7:	95.5	R15:	93.9
R8:	90.1		

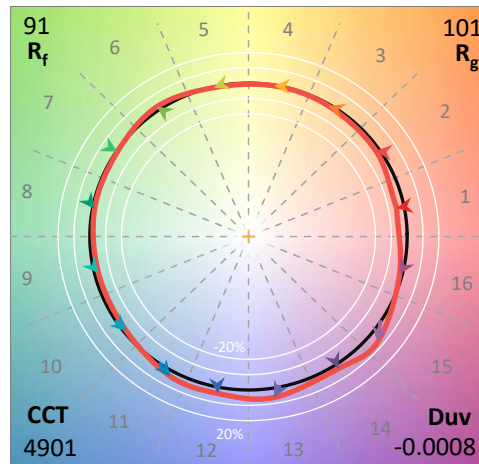

Test Conditions

Stabilization Time: 35M
 Operation Time: 1H 35M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-8

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-8

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-8

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-8

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 2.04

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-8

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 4.41

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

Summary

$R_f = 90.7$
 $R_g = 100.5$
 CIE $R_a = 94.3$
 $R_9 = 72.3$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 91	CES51 = 98	CES76 = 83
CES02 = 61	CES27 = 92	CES52 = 98	CES77 = 87
CES03 = 31	CES28 = 94	CES53 = 97	CES78 = 80
CES04 = 69	CES29 = 94	CES54 = 93	CES79 = 94
CES05 = 48	CES30 = 93	CES55 = 92	CES80 = 91
CES06 = 50	CES31 = 95	CES56 = 95	CES81 = 84
CES07 = 41	CES32 = 86	CES57 = 94	CES82 = 96
CES08 = 40	CES33 = 99	CES58 = 94	CES83 = 96
CES09 = 29	CES34 = 90	CES59 = 97	CES84 = 93
CES10 = 73	CES35 = 94	CES60 = 92	CES85 = 83
CES11 = 56	CES36 = 81	CES61 = 92	CES86 = 86
CES12 = 62	CES37 = 92	CES62 = 86	CES87 = 91
CES13 = 43	CES38 = 88	CES63 = 92	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 89	CES89 = 87
CES15 = 71	CES40 = 97	CES65 = 88	CES90 = 98
CES16 = 47	CES41 = 97	CES66 = 85	CES91 = 73
CES17 = 48	CES42 = 90	CES67 = 84	CES92 = 79
CES18 = 56	CES43 = 91	CES68 = 86	CES93 = 87
CES19 = 70	CES44 = 99	CES69 = 87	CES94 = 78
CES20 = 65	CES45 = 95	CES70 = 83	CES95 = 83
CES21 = 85	CES46 = 97	CES71 = 77	CES96 = 92
CES22 = 77	CES47 = 95	CES72 = 92	CES97 = 95
CES23 = 91	CES48 = 93	CES73 = 77	CES98 = 95
CES24 = 90	CES49 = 95	CES74 = 92	CES99 = 94
CES25 = 70	CES50 = 98	CES75 = 79	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)