

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number:

Luminaire Tested: EHBR1-60-UNV-W-L950-UPL18

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number: REPORT IS A COMBINATION OF REPORTS P1431918 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-60-UNV-W-L950-UPL18
Description: Elevate Round Highbay at, 60000 lumens, 5000K 90CRI LEDs with W lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 56642.3 lumens
Efficiency: N/A
Efficacy: 165.5 lumens/watt
Spacing Criteria (0/90/45): 1.54 / 1.54 / 1.31
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 342.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER:
CATALOG NUMBER: EHBR1-60-UNV-W-L950-UPL18

Luminous Intensity Polar Plot

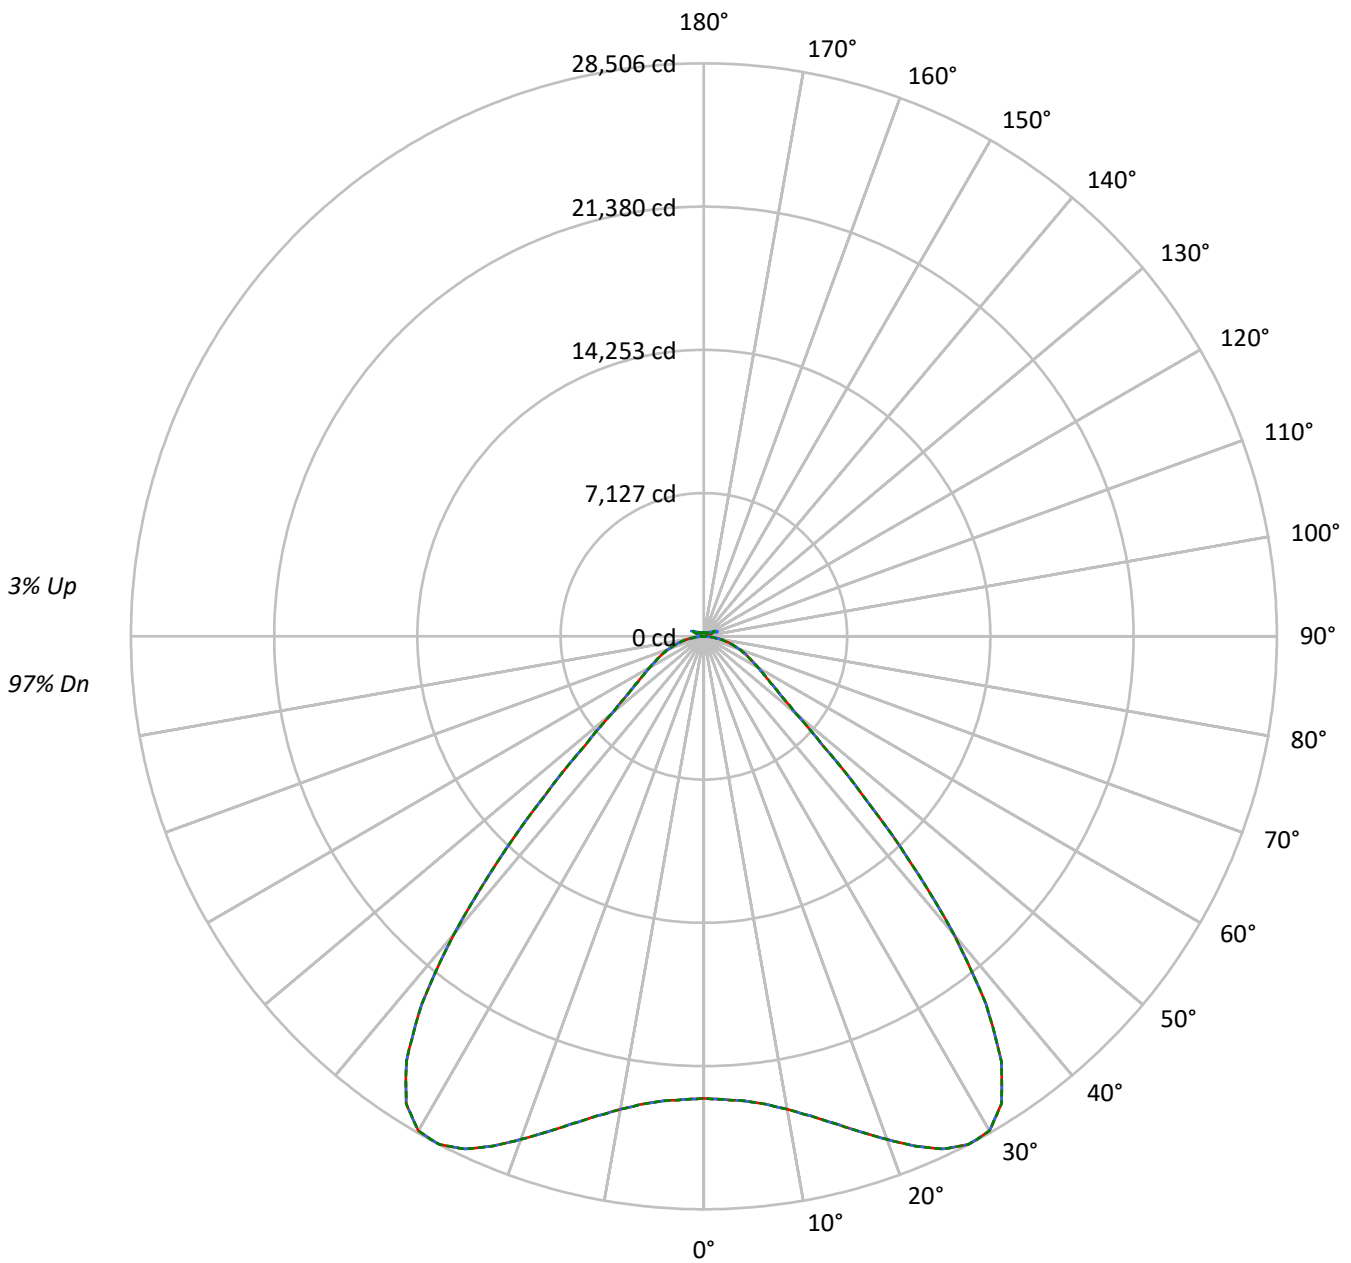

— 0°-180° - - 45°-225° - · - · 90°-270°



TEST NUMBER:

CATALOG NUMBER: EHBR1-60-UNV-W-L950-UPL18

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	99	99	99	97
1	111	107	103	100	108	104	101	99	100	97	95	95	93	92	91	90	88	88	88	88	86
2	103	96	91	86	100	94	89	85	90	86	83	87	83	80	83	81	78	78	78	78	76
3	95	87	80	75	93	85	79	74	82	77	72	79	75	71	76	72	69	69	69	69	67
4	89	79	71	66	86	77	71	65	75	69	64	72	67	63	70	65	62	62	62	62	60
5	82	72	64	58	80	70	63	58	68	62	57	66	61	56	64	59	56	56	56	56	54
6	77	65	58	52	75	64	57	52	62	56	51	61	55	51	59	54	50	50	50	50	48
7	72	60	52	47	70	59	52	47	57	51	46	56	50	46	54	49	45	45	45	45	43
8	67	55	48	43	66	54	47	42	53	46	42	52	46	42	50	45	41	41	41	41	39
9	63	51	44	39	62	50	43	38	49	43	38	48	42	38	47	41	38	38	38	38	36
10	59	47	40	35	58	47	40	35	45	39	35	44	39	35	43	38	34	34	34	34	33

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	107944	107944	107944
5°	108661	108661	108661
10°	112436	112436	112436
15°	119561	119561	119561
20°	129607	129607	129607
25°	140895	140895	140895
30°	147682	147682	147682
35°	140569	140569	140569
40°	111541	111541	111541
45°	68942	68942	68942
50°	39922	39922	39922
55°	30205	30205	30205
60°	25911	25911	25911
65°	23402	23402	23402
70°	21528	21528	21528
75°	19019	19019	19019
80°	15502	15502	15502
85°	9136	9136	9136

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 68942 cd/sqm



TEST NUMBER:

CATALOG NUMBER: EHBR1-60-UNV-W-L950-UPL18

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2236.4	3.9
10°-20°	7169.7	12.7
20°-30°	12941.6	22.8
30°-40°	15638.6	27.6
40°-50°	8934.8	15.8
50°-60°	3784.2	6.7
60°-70°	2440.8	4.3
70°-80°	1419.2	2.5
80°-90°	378.6	0.7
90°-100°	49.2	0.1
100°-110°	299.3	0.5
110°-120°	534.3	0.9
120°-130°	315.0	0.6
130°-140°	196.9	0.3
140°-150°	140.1	0.2
150°-160°	92.4	0.2
160°-170°	53.5	0.1
170°-180°	17.8	0.0
0°-30°	22347.7	39.5
0°-40°	37986.2	67.1
0°-60°	50705.2	89.5
0°-90°	54943.8	97.0
90°-120°	882.8	1.6
90°-150°	1534.7	2.7
90°-180°	1698.0	3.0
0°-180°	56642.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	22986	22986	22986	22986	22986	
5°	23201	23201	23201	23201	23201	2236
15°	25083	25083	25083	25083	25083	7170
25°	28137	28137	28137	28137	28137	12942
35°	25800	25800	25800	25800	25800	15639
45°	11155	11155	11155	11155	11155	8935
55°	4082	4082	4082	4082	4082	3784
65°	2443	2443	2443	2443	2443	2441
75°	1340	1340	1340	1340	1340	1419
85°	314	314	314	314	314	362
90°	14	22	36	24	14	20
95°	23	37	79	40	26	22
105°	106	207	525	228	139	141
115°	481	506	621	595	591	443
125°	348	326	334	339	380	317
135°	259	251	260	244	244	202
145°	218	216	228	225	224	138
155°	195	193	201	201	201	91
165°	185	185	190	190	189	53
175°	185	185	188	188	188	18
180°	188	188	188	188	188	



TEST NUMBER:

CATALOG NUMBER: EHBR1-60-UNV-W-L950-UPL18

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	22985.9	22985.9	22985.9	22985.9	22985.9
2.5°	23063.0	23063.0	23063.0	23063.0	23063.0
5°	23200.8	23200.8	23200.8	23200.8	23200.8
7.5°	23471.6	23471.6	23471.6	23471.6	23471.6
10°	23888.6	23888.6	23888.6	23888.6	23888.6
12.5°	24430.4	24430.4	24430.4	24430.4	24430.4
15°	25083.3	25083.3	25083.3	25083.3	25083.3
17.5°	25830.8	25830.8	25830.8	25830.8	25830.8
20°	26638.0	26638.0	26638.0	26638.0	26638.0
22.5°	27450.7	27450.7	27450.7	27450.7	27450.7
25°	28136.6	28136.6	28136.6	28136.6	28136.6
27.5°	28505.8	28505.8	28505.8	28505.8	28505.8
30°	28406.6	28406.6	28406.6	28406.6	28406.6
32.5°	27564.6	27564.6	27564.6	27564.6	27564.6
35°	25799.5	25799.5	25799.5	25799.5	25799.5
37.5°	23047.4	23047.4	23047.4	23047.4	23047.4
40°	19332.9	19332.9	19332.9	19332.9	19332.9
42.5°	15131.7	15131.7	15131.7	15131.7	15131.7
45°	11154.6	11154.6	11154.6	11154.6	11154.6
47.5°	7972.6	7972.6	7972.6	7972.6	7972.6
50°	5949.7	5949.7	5949.7	5949.7	5949.7
52.5°	4817.4	4817.4	4817.4	4817.4	4817.4
55°	4081.9	4081.9	4081.9	4081.9	4081.9
57.5°	3544.7	3544.7	3544.7	3544.7	3544.7
60°	3114.9	3114.9	3114.9	3114.9	3114.9
62.5°	2756.8	2756.8	2756.8	2756.8	2756.8
65°	2442.6	2442.6	2442.6	2442.6	2442.6
67.5°	2165.3	2165.3	2165.3	2165.3	2165.3
70°	1889.0	1889.0	1889.0	1889.0	1889.0
72.5°	1613.4	1613.4	1613.4	1613.4	1613.4
75°	1339.8	1339.8	1339.8	1339.8	1339.8
77.5°	1076.3	1076.3	1076.3	1076.3	1076.3
80°	815.5	815.5	815.5	815.5	815.5
82.5°	559.2	559.2	559.2	559.2	559.2
85°	314.0	314.0	314.0	314.0	314.0
87.5°	99.1	99.1	99.1	99.1	99.1
90°	14.2	21.8	36.1	23.8	14.2
92.5°	19.0	31.4	56.1	29.5	17.1
95°	22.8	37.1	79.0	40.0	25.6
97.5°	28.5	40.9	90.4	48.5	39.0
100°	37.1	47.6	139.9	59.0	51.4
102.5°	61.9	99.0	295.2	109.4	77.1
105°	105.6	206.6	524.7	227.5	139.0
107.5°	181.8	368.5	691.3	401.8	261.8
110°	338.9	489.4	725.5	552.3	418.9



TEST NUMBER:

CATALOG NUMBER: EHBR1-60-UNV-W-L950-UPL18

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	457.0	525.6	695.1	609.4	544.6
115°	480.8	505.6	620.8	595.1	591.3
117.5°	464.6	461.8	527.5	535.1	571.3
120°	430.4	411.3	440.9	467.5	516.0
122.5°	387.5	364.7	378.0	397.9	446.5
125°	348.4	325.6	334.1	338.9	379.8
127.5°	313.2	298.0	302.7	297.0	322.7
130°	290.3	276.9	283.6	270.3	282.6
132.5°	272.1	263.5	271.1	254.9	258.8
135°	258.8	251.1	259.7	244.4	243.5
137.5°	247.3	240.6	249.2	237.8	234.9
140°	237.8	232.0	241.6	232.9	231.1
142.5°	226.2	222.4	233.9	228.2	226.2
145°	218.5	215.6	228.1	225.2	224.3
147.5°	211.8	210.0	221.4	220.4	220.4
150°	205.1	203.3	214.7	213.8	214.7
152.5°	198.6	196.6	207.1	206.2	207.1
155°	194.6	192.8	201.3	201.3	201.3
157.5°	190.8	189.9	196.6	196.6	196.6
160°	189.0	188.0	193.7	193.7	192.8
162.5°	187.0	186.1	192.7	191.8	191.8
165°	185.1	185.1	189.9	189.9	188.9
167.5°	185.1	184.2	188.9	188.9	188.0
170°	184.2	184.2	188.0	187.0	186.1
172.5°	185.1	185.1	188.9	188.0	187.0
175°	185.1	185.1	188.0	188.0	188.0
177.5°	186.0	186.0	188.0	188.0	186.9
180°	187.9	187.9	187.9	187.9	187.9



TEST NUMBER: CATALOG
 CATALOG NUMBER: EHBR1-60-UNV-W-L950-UPL18

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	20.51	21.77	20.93	22.15	22.54	20.51	21.77	20.93	22.15	22.54
	3H	22.02	23.13	22.45	23.53	23.97	22.02	23.13	22.45	23.53	23.97
	4H	22.58	23.62	23.03	24.03	24.49	22.58	23.62	23.03	24.03	24.49
	6H	22.96	23.92	23.43	24.35	24.82	22.96	23.92	23.43	24.35	24.82
	8H	23.07	23.97	23.55	24.42	24.90	23.07	23.97	23.55	24.42	24.90
	12H	23.10	23.97	23.59	24.41	24.92	23.10	23.97	23.59	24.41	24.92
4H	2H	20.96	22.00	21.42	22.42	22.88	20.96	22.00	21.42	22.42	22.88
	3H	22.69	23.54	23.15	24.01	24.48	22.69	23.54	23.15	24.01	24.48
	4H	23.36	24.13	23.85	24.61	25.12	23.36	24.13	23.85	24.61	25.12
	6H	23.86	24.53	24.38	25.03	25.57	23.86	24.53	24.38	25.03	25.57
	8H	24.00	24.61	24.52	25.12	25.66	24.00	24.61	24.52	25.12	25.66
	12H	24.06	24.61	24.60	25.14	25.69	24.06	24.61	24.60	25.14	25.69
8H	4H	23.57	24.19	24.09	24.69	25.23	23.57	24.19	24.09	24.69	25.23
	6H	24.17	24.67	24.72	25.22	25.77	24.17	24.67	24.72	25.22	25.77
	8H	24.35	24.81	24.92	25.37	25.94	24.35	24.81	24.92	25.37	25.94
	12H	24.46	24.86	25.03	25.41	26.05	24.46	24.86	25.03	25.41	26.05
12H	4H	23.57	24.12	24.11	24.65	25.20	23.57	24.12	24.11	24.65	25.20
	6H	24.18	24.64	24.75	25.20	25.77	24.18	24.64	24.75	25.20	25.77
	8H	24.41	24.81	24.97	25.36	26.00	24.41	24.81	24.97	25.36	26.00

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-8

Test Date: 08/04/2025

Luminaire Tested: EHBR-60-L950-N

Data in this report applies to families of products including EHBR-60-L950-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-8
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L950-N**
 Description: Elevate Round Highbay at, 60000 lumens, 5000K 90CRI LEDs with N lens

Spectral Parameters

CCT (K): 4901
 CIE u': 0.2131
 CIE v': 0.4853
 Duv: -0.0008
 CIE x: 0.3477
 CIE y: 0.3520
 CIE z: 0.3003
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 574
 Purity: 9.953987
 Rf: 90.7
 Rg: 100.5

CRI (Ra):	94.3		
R1:	95.8	R9:	72.3
R2:	96.5	R10:	89.1
R3:	94.4	R11:	94.9
R4:	95.3	R12:	68.4
R5:	94.1	R13:	96.4
R6:	92.5	R14:	96.4
R7:	95.5	R15:	93.9
R8:	90.1		



Test Conditions

Stabilization Time: 35M
 Operation Time: 1H 35M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-8

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-8

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-8

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-8

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 2.04

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-8

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 4.41

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

Summary

$R_f = 90.7$
 $R_g = 100.5$
 CIE $R_a = 94.3$
 $R_9 = 72.3$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 91	CES51 = 98	CES76 = 83
CES02 = 61	CES27 = 92	CES52 = 98	CES77 = 87
CES03 = 31	CES28 = 94	CES53 = 97	CES78 = 80
CES04 = 69	CES29 = 94	CES54 = 93	CES79 = 94
CES05 = 48	CES30 = 93	CES55 = 92	CES80 = 91
CES06 = 50	CES31 = 95	CES56 = 95	CES81 = 84
CES07 = 41	CES32 = 86	CES57 = 94	CES82 = 96
CES08 = 40	CES33 = 99	CES58 = 94	CES83 = 96
CES09 = 29	CES34 = 90	CES59 = 97	CES84 = 93
CES10 = 73	CES35 = 94	CES60 = 92	CES85 = 83
CES11 = 56	CES36 = 81	CES61 = 92	CES86 = 86
CES12 = 62	CES37 = 92	CES62 = 86	CES87 = 91
CES13 = 43	CES38 = 88	CES63 = 92	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 89	CES89 = 87
CES15 = 71	CES40 = 97	CES65 = 88	CES90 = 98
CES16 = 47	CES41 = 97	CES66 = 85	CES91 = 73
CES17 = 48	CES42 = 90	CES67 = 84	CES92 = 79
CES18 = 56	CES43 = 91	CES68 = 86	CES93 = 87
CES19 = 70	CES44 = 99	CES69 = 87	CES94 = 78
CES20 = 65	CES45 = 95	CES70 = 83	CES95 = 83
CES21 = 85	CES46 = 97	CES71 = 77	CES96 = 92
CES22 = 77	CES47 = 95	CES72 = 92	CES97 = 95
CES23 = 91	CES48 = 93	CES73 = 77	CES98 = 95
CES24 = 90	CES49 = 95	CES74 = 92	CES99 = 94
CES25 = 70	CES50 = 98	CES75 = 79	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)