

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number:

Luminaire Tested: EHBR1-36-UNV-ASM-L950-UPL36

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number:
REPORT IS A COMBINATION OF REPORTS P1431777 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-36-UNV-ASM-L950-UPL36
Description: Elevate Round Highbay at, 36000 lumens, 5000K 90CRI LEDs with ASM lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 36935.0 lumens
Efficiency: N/A
Efficacy: 168.0 lumens/watt
Spacing Criteria (0/90/45): 0.84 / 0.99 / 0.92
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 219.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER:
CATALOG NUMBER: EHBR1-36-UNV-ASM-L950-UPL36

Luminous Intensity Polar Plot

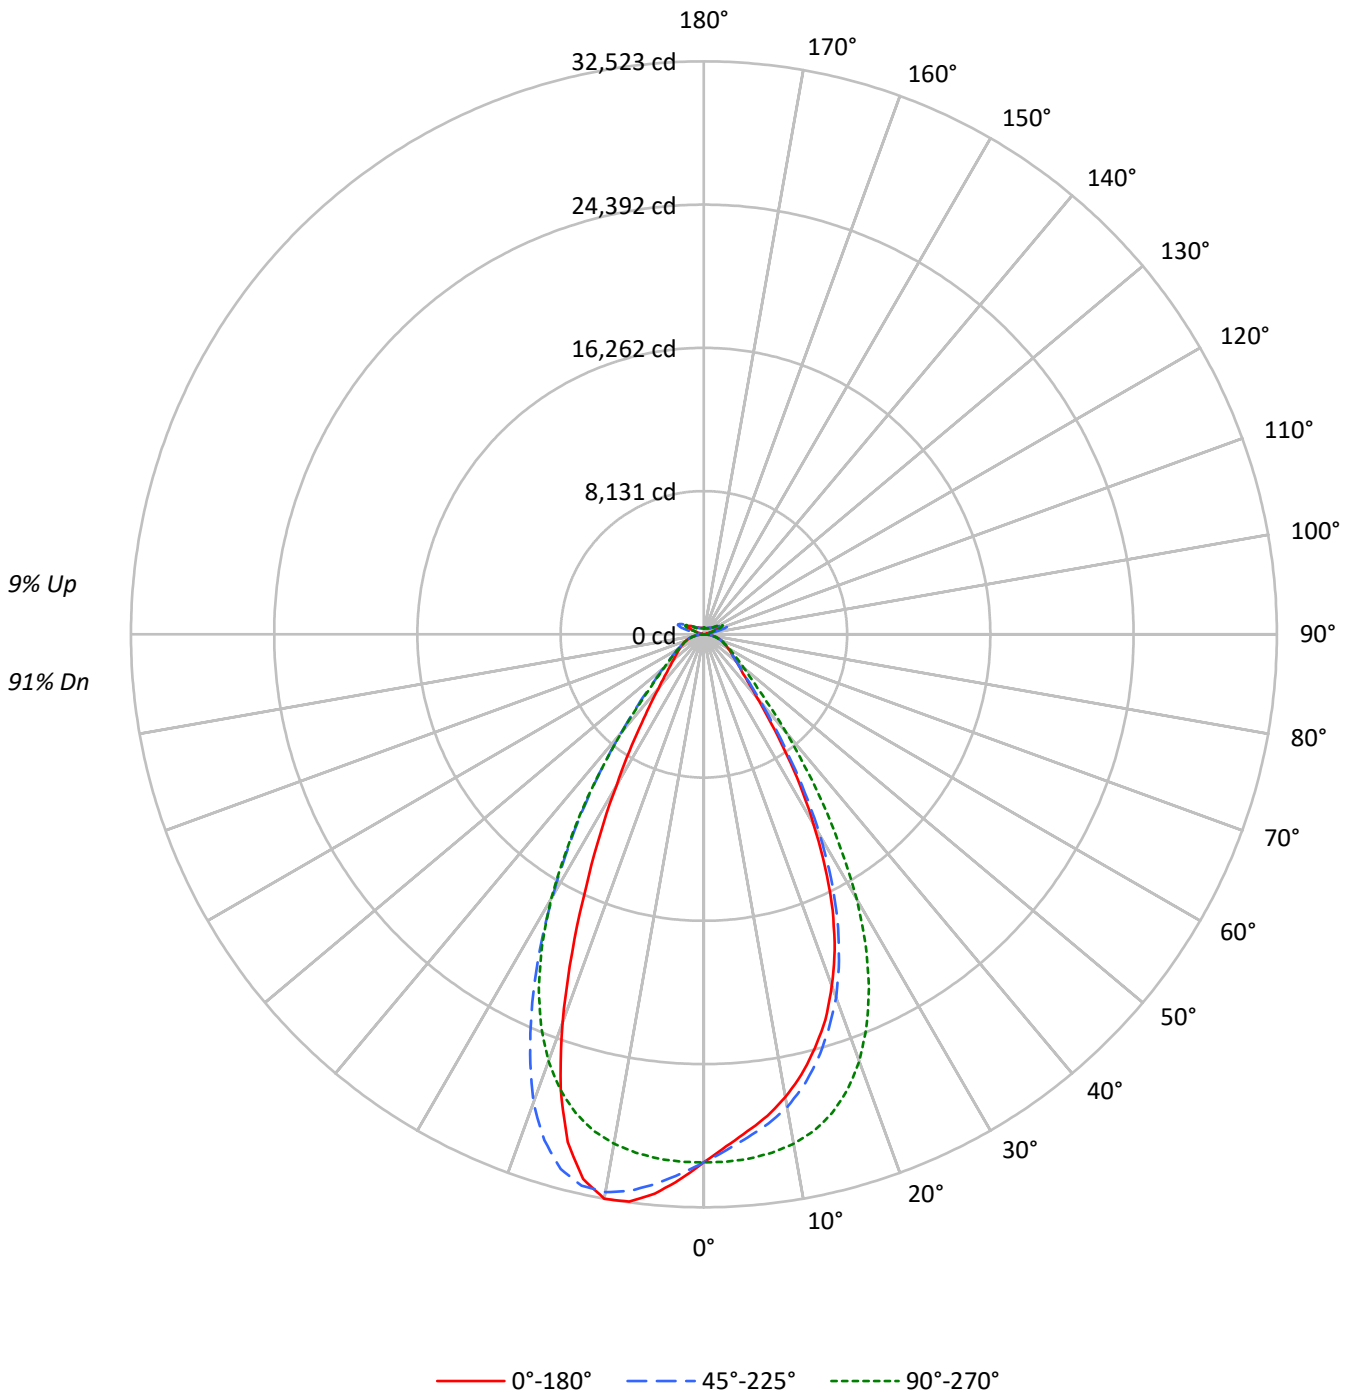



TEST NUMBER:

CATALOG NUMBER: EHBR1-36-UNV-ASM-L950-UPL36

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	117	117	117	117	113	113	113	113	106	106	106	99	99	99	93	93	93	93	91	
1	110	106	103	100	106	103	100	98	97	95	93	92	90	89	87	86	84	84	82	
2	103	97	92	87	99	94	89	86	89	86	82	85	82	79	81	78	76	76	74	
3	96	88	82	77	93	86	81	76	82	78	74	78	75	71	75	72	69	69	67	
4	90	81	75	70	88	79	73	69	76	71	67	73	68	65	70	66	63	63	61	
5	85	75	68	63	82	73	67	62	70	65	61	68	63	60	65	61	58	58	56	
6	80	70	63	58	78	68	62	57	66	60	56	63	58	55	61	57	54	54	52	
7	75	65	58	53	73	64	57	53	61	56	52	59	54	51	57	53	50	50	48	
8	71	60	54	49	69	59	53	49	58	52	48	56	51	47	54	50	46	46	45	
9	67	57	50	46	66	56	50	45	54	48	45	52	47	44	51	47	43	43	42	
10	64	53	47	43	62	52	46	42	51	45	42	50	45	41	48	44	41	41	39	

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°	135°	180°
0°	140755	140755	140755	140755	140755
5°	132638	134189	139898	146608	149245
10°	125531	128189	138178	151315	153077
15°	115957	119054	134099	149763	142256
20°	103285	106764	125416	137661	114070
25°	86557	89833	111003	115467	79034
30°	64762	68516	90130	89230	51417
35°	43114	45716	64644	63600	33299
40°	27190	29057	41794	42064	22952
45°	19373	20179	26519	27658	17779
50°	16136	16265	19693	20206	15107
55°	14244	14278	16078	16503	13762
60°	13189	13076	13922	14217	13110
65°	12589	12476	12691	12940	12643
70°	12228	12017	12029	12259	12388
75°	11625	11273	11249	11649	11984
80°	10577	9839	9881	10577	11314
85°	7702	6392	6392	7309	8077

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 112.5°
 Vertical Angle: 45°
 Luminance: 37283 cd/sqm



TEST NUMBER:

CATALOG NUMBER: EHBR1-36-UNV-ASM-L950-UPL36

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2849.9	7.7
10°-20°	7753.5	21.0
20°-30°	9093.2	24.6
30°-40°	6323.8	17.1
40°-50°	3142.6	8.5
50°-60°	1879.6	5.1
60°-70°	1323.0	3.6
70°-80°	852.2	2.3
80°-90°	276.7	0.7
90°-100°	91.6	0.2
100°-110°	598.2	1.6
110°-120°	1105.1	3.0
120°-130°	656.8	1.8
130°-140°	397.2	1.1
140°-150°	274.8	0.7
150°-160°	179.4	0.5
160°-170°	103.0	0.3
170°-180°	34.3	0.1
0°-30°	19696.6	53.3
0°-40°	26020.4	70.4
0°-60°	31042.6	84.0
0°-90°	33494.5	90.7
90°-120°	1794.9	4.9
90°-150°	3123.8	8.5
90°-180°	3440.0	9.3
0°-180°	36935.0	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	29973	29973	29973	29973	29973	
5°	28320	28651	29870	31303	31866	2656
15°	24327	24977	28133	31419	29844	6784
25°	17285	17940	22167	23059	15783	7799
35°	7913	8391	11864	11673	6112	5041
45°	3134	3265	4291	4475	2876	2534
55°	1925	1930	2173	2230	1860	1747
65°	1314	1302	1325	1351	1320	1305
75°	819	794	792	821	844	864
85°	265	220	220	251	278	272
90°	25	69	25	74	29	25
95°	42	154	49	133	46	41
105°	208	1044	275	1114	140	278
115°	955	1234	1176	1367	1005	880
125°	690	662	753	733	788	628
135°	504	508	476	531	550	394
145°	419	438	431	441	450	265
155°	372	384	383	383	400	173
165°	354	362	361	360	372	101
175°	354	359	360	358	366	34
180°	359	359	359	359	359	



TEST NUMBER:

CATALOG NUMBER: EHBR1-36-UNV-ASM-L950-UPL36

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	29972.8	29972.8	29972.8	29972.8	29972.8	29972.8	29972.8	29972.8	29972.8
2.5°	29083.0	29102.2	29305.6	29570.3	29955.3	30342.5	30656.1	30863.0	30965.2
5°	28320.3	28426.0	28651.4	29137.6	29870.5	30646.1	31303.1	31733.1	31866.2
7.5°	27577.3	27638.6	28015.8	28630.0	29667.5	30875.9	31852.2	32354.1	32476.6
10°	26670.8	26809.6	27235.6	27960.1	29357.9	31020.9	32148.9	32508.6	32523.3
12.5°	25604.1	25787.8	26227.9	27141.7	28863.9	30969.2	32049.4	31931.4	31663.3
15°	24327.1	24488.4	24976.8	26036.8	28133.2	30662.9	31419.4	30458.9	29844.5
17.5°	22947.8	23094.0	23518.3	24685.6	27103.6	30089.6	30104.2	28204.0	27045.1
20°	21228.0	21342.7	21943.0	23088.4	25776.6	29170.2	28293.4	24817.7	23444.7
22.5°	19398.0	19505.4	20038.8	21230.8	24112.9	27930.3	25771.5	21411.2	19538.0
25°	17285.3	17343.8	17939.6	19017.6	22167.2	26411.1	23058.6	17699.6	15783.0
27.5°	14908.6	15008.0	15631.3	16732.3	19878.6	24485.6	20169.8	14463.4	12695.2
30°	12456.9	12621.6	13179.1	14165.0	17336.5	22017.1	17163.4	11518.3	9890.1
32.5°	10168.9	10287.4	10684.8	11715.0	14490.4	19597.6	14276.2	9229.2	7849.9
35°	7912.9	8031.4	8390.6	9402.3	11864.5	16570.5	11672.9	7251.9	6111.5
37.5°	6048.6	6258.2	6488.7	7309.8	9311.2	13710.3	9305.1	5839.6	4957.1
40°	4712.7	4746.4	5036.4	5561.9	7244.0	10720.2	7290.7	4661.6	3978.1
42.5°	3772.4	3864.0	3988.8	4382.2	5488.8	8197.3	5730.5	3825.8	3378.9
45°	3134.5	3170.4	3264.8	3529.1	4290.6	6032.3	4474.9	3227.7	2876.5
47.5°	2742.2	2726.4	2787.2	2985.0	3494.2	4662.1	3626.8	2768.6	2522.5
50°	2404.9	2395.3	2424.1	2556.1	2935.0	3577.4	3011.4	2416.7	2251.5
52.5°	2143.0	2151.5	2154.2	2236.4	2521.2	2917.5	2564.5	2153.7	2042.5
55°	1924.9	1935.6	1929.5	1990.2	2172.8	2452.7	2230.2	1936.7	1859.8
57.5°	1754.6	1746.8	1738.4	1771.0	1908.1	2080.7	1936.7	1751.8	1700.7
60°	1585.5	1578.2	1572.0	1593.3	1673.7	1801.9	1709.1	1590.6	1576.0
62.5°	1440.5	1436.0	1435.5	1431.5	1493.4	1574.3	1511.3	1445.5	1432.6
65°	1314.0	1308.9	1302.2	1296.0	1324.7	1400.0	1350.6	1315.2	1319.6
67.5°	1187.6	1187.6	1175.8	1166.2	1194.3	1233.7	1212.3	1192.1	1197.2
70°	1072.9	1073.5	1054.4	1047.1	1055.5	1097.7	1075.7	1078.5	1087.0
72.5°	949.8	936.4	922.3	921.8	922.9	955.5	948.2	954.9	963.9
75°	818.9	803.1	794.1	784.1	792.4	817.2	820.6	830.2	844.2
77.5°	692.5	668.2	661.0	655.9	650.3	678.3	689.0	701.9	722.8
80°	556.4	530.0	517.6	510.4	519.8	532.8	556.4	565.9	595.2
82.5°	411.4	391.7	376.6	376.0	380.5	392.3	412.5	430.6	447.4
85°	264.7	233.2	219.7	224.8	219.7	237.8	251.2	272.6	277.6
87.5°	95.5	74.8	71.4	78.7	77.0	82.6	94.4	102.9	103.4
90°	25.3	40.5	68.9	44.2	25.3	42.9	73.9	41.3	29.2
92.5°	36.7	61.4	110.8	57.6	32.9	58.2	104.3	54.6	38.7
95°	42.4	70.9	154.5	76.6	48.6	71.4	132.8	60.4	46.3
97.5°	54.4	78.5	177.3	93.7	75.3	88.5	149.9	64.2	55.7
100°	71.4	91.8	276.1	115.1	100.0	100.0	273.4	73.7	63.4
102.5°	120.9	194.4	585.9	215.8	151.3	195.5	633.2	146.4	76.7
105°	208.2	409.2	1043.9	451.5	274.7	446.3	1114.0	376.4	139.9
107.5°	360.3	732.2	1377.0	799.3	519.9	832.1	1435.1	741.2	324.3
110°	671.9	971.7	1443.6	1097.7	831.6	1162.8	1566.3	1015.0	654.9



TEST NUMBER:

CATALOG NUMBER: EHBR1-36-UNV-ASM-L950-UPL36

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
112.5°	907.7	1043.9	1382.7	1211.7	1082.4	1295.8	1530.2	1125.2	905.8
115°	955.1	1004.0	1234.5	1183.1	1176.2	1276.9	1366.7	1121.3	1004.7
117.5°	922.8	916.6	1048.2	1064.0	1136.2	1168.5	1180.4	1053.0	1010.3
120°	854.4	815.9	875.3	929.1	1026.0	1012.7	994.8	952.2	953.4
122.5°	768.8	723.3	750.4	790.9	887.9	859.3	840.8	850.1	875.4
125°	689.6	643.4	661.7	671.7	752.9	724.4	733.1	762.7	788.5
127.5°	619.3	588.3	599.0	588.1	639.4	626.1	655.2	688.6	710.6
130°	571.8	545.2	559.6	533.6	558.3	561.5	600.1	628.4	642.2
132.5°	532.5	515.4	532.2	500.4	507.5	522.2	558.9	583.3	591.6
135°	504.0	489.3	507.5	478.2	475.8	497.4	530.9	546.6	549.8
137.5°	479.8	467.1	485.8	463.5	457.3	479.0	504.2	516.8	513.6
140°	458.1	447.3	467.3	450.2	446.4	468.2	479.5	494.0	491.4
142.5°	434.5	426.9	450.9	439.6	435.8	455.5	461.1	471.8	468.6
145°	418.7	412.9	438.2	431.9	430.6	445.2	440.8	454.7	450.2
147.5°	404.5	400.7	423.5	421.1	421.1	431.9	426.2	438.2	433.6
150°	392.4	388.6	410.8	408.3	410.2	417.8	409.6	423.5	422.7
152.5°	380.2	375.8	396.2	393.7	395.6	403.1	395.6	411.3	410.0
155°	371.7	367.4	383.9	382.8	383.4	387.2	383.4	399.1	399.7
157.5°	365.8	362.8	375.5	375.0	375.0	377.5	375.5	389.4	389.9
160°	361.2	358.8	369.6	369.0	367.7	371.6	370.2	382.1	382.7
162.5°	356.7	354.2	366.9	365.0	365.0	365.0	364.3	376.2	377.3
165°	354.0	353.4	362.4	362.4	361.1	362.9	360.2	369.0	372.0
167.5°	354.0	352.0	361.6	361.6	360.2	358.4	359.6	366.9	370.0
170°	353.2	352.6	360.2	358.9	357.0	357.6	356.9	364.2	367.3
172.5°	354.4	353.8	362.0	360.1	358.7	358.7	356.6	362.1	367.0
175°	353.6	353.1	359.3	359.3	359.8	358.5	357.7	361.3	366.3
177.5°	356.0	355.5	359.3	359.3	358.0	359.1	360.2	363.7	370.6
180°	359.1	359.1	359.1	359.1	359.1	359.1	359.1	359.1	359.1



TEST NUMBER: CATALOG
 CATALOG NUMBER: EHBR1-36-UNV-ASM-L950-UPL36

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.94	18.01	17.46	18.51	19.06	17.70	18.77	18.23	19.27	19.82
	3H	18.75	19.70	19.29	20.22	20.81	19.26	20.21	19.80	20.73	21.32
	4H	19.49	20.38	20.05	20.91	21.51	19.91	20.80	20.47	21.33	21.93
	6H	20.05	20.87	20.63	21.42	22.04	20.40	21.22	20.97	21.77	22.38
	8H	20.24	21.01	20.82	21.58	22.20	20.56	21.33	21.14	21.90	22.52
	12H	20.33	21.07	20.92	21.63	22.28	20.64	21.37	21.22	21.93	22.58
4H	2H	17.45	18.34	18.01	18.87	19.48	18.08	18.97	18.64	19.50	20.11
	3H	19.49	20.22	20.06	20.80	21.42	19.89	20.62	20.46	21.20	21.82
	4H	20.35	21.01	20.94	21.60	22.26	20.67	21.33	21.26	21.92	22.58
	6H	21.04	21.61	21.66	22.22	22.90	21.30	21.87	21.92	22.48	23.16
	8H	21.27	21.80	21.89	22.41	23.09	21.51	22.04	22.13	22.65	23.33
	12H	21.40	21.87	22.04	22.51	23.20	21.62	22.09	22.26	22.73	23.42
8H	4H	20.61	21.14	21.23	21.75	22.43	20.91	21.44	21.53	22.05	22.74
	6H	21.43	21.86	22.08	22.51	23.20	21.68	22.11	22.33	22.76	23.45
	8H	21.73	22.11	22.40	22.78	23.48	21.96	22.34	22.63	23.01	23.71
	12H	21.93	22.26	22.59	22.91	23.69	22.14	22.48	22.80	23.13	23.90
12H	4H	20.61	21.08	21.25	21.72	22.41	20.92	21.39	21.56	22.03	22.72
	6H	21.46	21.85	22.13	22.51	23.22	21.72	22.11	22.39	22.77	23.47
	8H	21.81	22.15	22.47	22.79	23.57	22.05	22.38	22.71	23.03	23.81

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-8

Test Date: 08/04/2025

Luminaire Tested: EHBR-60-L950-N

Data in this report applies to families of products including EHBR-60-L950-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-8
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L950-N**
 Description: Elevate Round Highbay at, 60000 lumens, 5000K 90CRI LEDs with N lens

Spectral Parameters

CCT (K): 4901
 CIE u': 0.2131
 CIE v': 0.4853
 Duv: -0.0008
 CIE x: 0.3477
 CIE y: 0.3520
 CIE z: 0.3003
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 574
 Purity: 9.953987
 Rf: 90.7
 Rg: 100.5

CRI (Ra):	94.3		
R1:	95.8	R9:	72.3
R2:	96.5	R10:	89.1
R3:	94.4	R11:	94.9
R4:	95.3	R12:	68.4
R5:	94.1	R13:	96.4
R6:	92.5	R14:	96.4
R7:	95.5	R15:	93.9
R8:	90.1		



Test Conditions

Stabilization Time: 35M
 Operation Time: 1H 35M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-8

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-8

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-8

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-8

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 2.04

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-8

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 4.41


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

Summary

$R_f = 90.7$
 $R_g = 100.5$
 CIE $R_a = 94.3$
 $R_9 = 72.3$



Color Vector Graphics

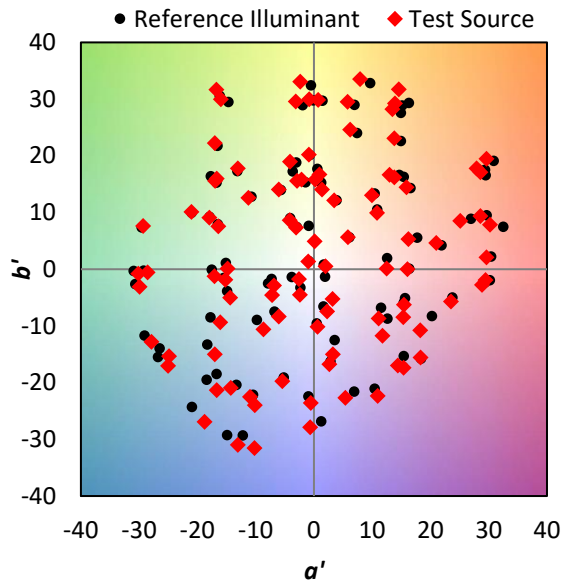

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 91	CES51 = 98	CES76 = 83
CES02 = 61	CES27 = 92	CES52 = 98	CES77 = 87
CES03 = 31	CES28 = 94	CES53 = 97	CES78 = 80
CES04 = 69	CES29 = 94	CES54 = 93	CES79 = 94
CES05 = 48	CES30 = 93	CES55 = 92	CES80 = 91
CES06 = 50	CES31 = 95	CES56 = 95	CES81 = 84
CES07 = 41	CES32 = 86	CES57 = 94	CES82 = 96
CES08 = 40	CES33 = 99	CES58 = 94	CES83 = 96
CES09 = 29	CES34 = 90	CES59 = 97	CES84 = 93
CES10 = 73	CES35 = 94	CES60 = 92	CES85 = 83
CES11 = 56	CES36 = 81	CES61 = 92	CES86 = 86
CES12 = 62	CES37 = 92	CES62 = 86	CES87 = 91
CES13 = 43	CES38 = 88	CES63 = 92	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 89	CES89 = 87
CES15 = 71	CES40 = 97	CES65 = 88	CES90 = 98
CES16 = 47	CES41 = 97	CES66 = 85	CES91 = 73
CES17 = 48	CES42 = 90	CES67 = 84	CES92 = 79
CES18 = 56	CES43 = 91	CES68 = 86	CES93 = 87
CES19 = 70	CES44 = 99	CES69 = 87	CES94 = 78
CES20 = 65	CES45 = 95	CES70 = 83	CES95 = 83
CES21 = 85	CES46 = 97	CES71 = 77	CES96 = 92
CES22 = 77	CES47 = 95	CES72 = 92	CES97 = 95
CES23 = 91	CES48 = 93	CES73 = 77	CES98 = 95
CES24 = 90	CES49 = 95	CES74 = 92	CES99 = 94
CES25 = 70	CES50 = 98	CES75 = 79	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)