

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number:

Luminaire Tested: EHBR1-48-UNV-W-L950-UPL36

Issue Date: 3/20/2026

Test Information

Test Method: LM-79-2019
Report Number: REPORT IS A COMBINATION OF REPORTS P1431857 AND P1431635
Test Lab: INNOVATION CENTER
Issue Date: 3/20/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: EHBR1-48-UNV-W-L950-UPL36
Description: Elevate Round Highbay at, 49000 lumens, 5000K 90CRI LEDs with W lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 47267.6 lumens
Efficiency: N/A
Efficacy: 164.7 lumens/watt
Spacing Criteria (0/90/45): 1.54 / 1.54 / 1.31
Luminous Opening: Vertical Cylinder (Dia: 1.71' x H: 0.1')
CIE Type: Direct

Input Watts (W): 287
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER:
CATALOG NUMBER: EHBR1-48-UNV-W-L950-UPL36

Luminous Intensity Polar Plot

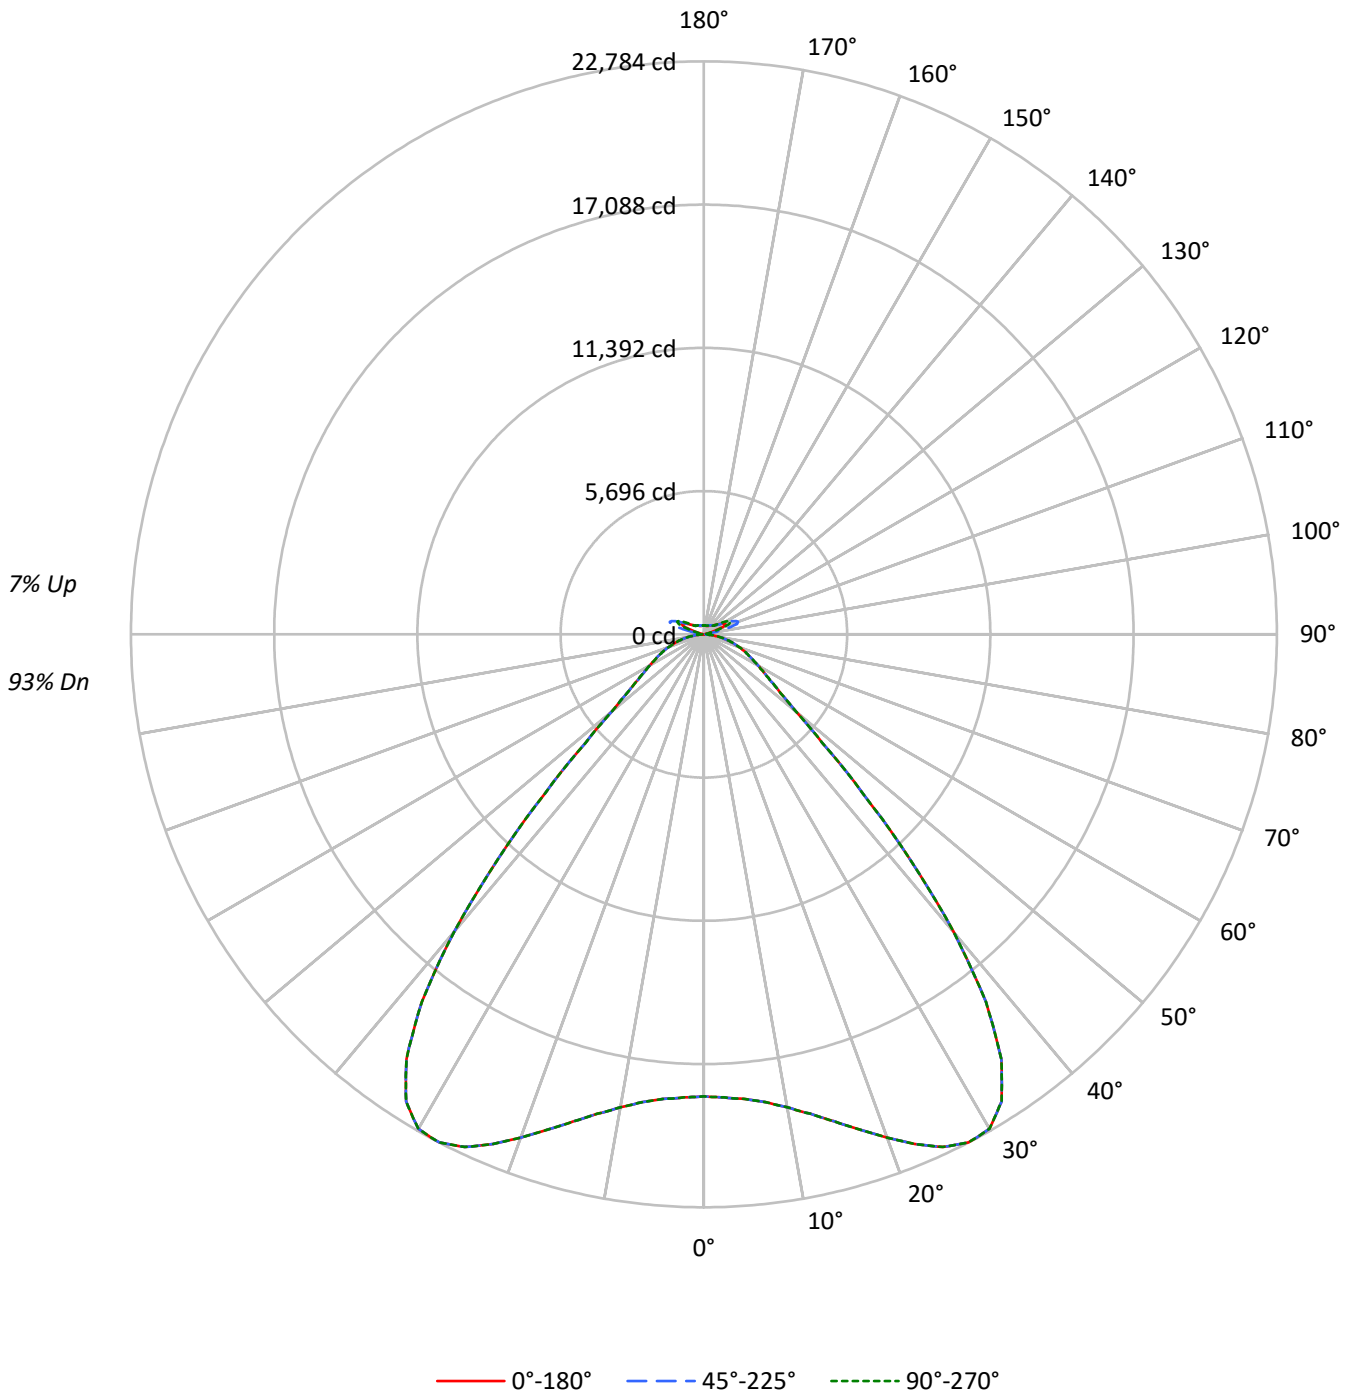



TEST NUMBER:

CATALOG NUMBER: EHBR1-48-UNV-W-L950-UPL36

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	117	117	117	117	114	114	114	114	107	107	107	101	101	101	96	96	96	96	96	96	93
1	110	106	102	99	106	103	100	97	97	95	93	92	91	89	88	86	85	85	85	85	83
2	102	95	90	85	99	93	88	84	88	84	81	84	81	78	80	78	75	75	75	75	73
3	94	86	79	74	92	84	78	73	80	75	71	76	72	69	73	70	67	67	67	67	65
4	88	78	70	65	85	76	69	64	73	67	63	70	65	61	67	63	60	60	60	60	57
5	82	71	63	58	79	69	62	57	66	60	56	64	59	55	61	57	53	53	53	53	51
6	76	65	57	51	74	63	56	51	61	55	50	59	53	49	57	52	48	48	48	48	46
7	71	59	51	46	69	58	51	46	56	50	45	54	48	44	52	47	43	43	43	43	42
8	66	54	47	42	64	53	46	41	52	45	41	50	44	40	48	43	40	40	40	40	38
9	62	50	43	38	60	49	42	38	48	41	37	46	41	37	45	40	36	36	36	36	34
10	58	46	39	35	57	46	39	34	44	38	34	43	37	33	42	37	33	33	33	33	31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	86279	86279	86279
5°	86852	86852	86852
10°	89869	89869	89869
15°	95564	95564	95564
20°	103594	103594	103594
25°	112616	112616	112616
30°	118041	118041	118041
35°	112356	112356	112356
40°	89154	89154	89154
45°	55105	55105	55105
50°	31909	31909	31909
55°	24142	24142	24142
60°	20710	20710	20710
65°	18705	18705	18705
70°	17207	17207	17207
75°	15202	15202	15202
80°	12390	12390	12390
85°	7303	7303	7303

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 55105 cd/sqm



TEST NUMBER:

CATALOG NUMBER: EHBR1-48-UNV-W-L950-UPL36

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1787.5	3.8
10°-20°	5730.7	12.1
20°-30°	10344.1	21.9
30°-40°	12499.8	26.4
40°-50°	7141.5	15.1
50°-60°	3024.6	6.4
60°-70°	1950.9	4.1
70°-80°	1134.4	2.4
80°-90°	306.3	0.6
90°-100°	96.1	0.2
100°-110°	594.8	1.3
110°-120°	1062.9	2.2
120°-130°	624.8	1.3
130°-140°	386.3	0.8
140°-150°	270.7	0.6
150°-160°	177.0	0.4
160°-170°	101.5	0.2
170°-180°	33.7	0.1
0°-30°	17862.3	37.8
0°-40°	30362.1	64.2
0°-60°	40528.2	85.7
0°-90°	43919.7	92.9
90°-120°	1753.8	3.7
90°-150°	3035.6	6.4
90°-180°	3348.0	7.1
0°-180°	47267.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	18372	18372	18372	18372	18372	
5°	18544	18544	18544	18544	18544	1788
15°	20049	20049	20049	20049	20049	5731
25°	22489	22489	22489	22489	22489	10344
35°	20621	20621	20621	20621	20621	12500
45°	8916	8916	8916	8916	8916	7142
55°	3263	3263	3263	3263	3263	3025
65°	1952	1952	1952	1952	1952	1951
75°	1071	1071	1071	1071	1071	1134
85°	251	251	251	251	251	289
90°	26	41	70	45	26	23
95°	43	72	155	78	49	41
105°	209	410	1045	452	275	279
115°	956	1006	1236	1184	1177	881
125°	691	645	662	672	754	630
135°	508	492	509	479	477	397
145°	422	416	441	435	433	267
155°	372	368	385	385	385	173
165°	351	351	360	360	358	100
175°	348	348	354	354	354	33
180°	353	353	353	353	353	



TEST NUMBER:

CATALOG NUMBER: EHBR1-48-UNV-W-L950-UPL36

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	18372.4	18372.4	18372.4	18372.4	18372.4
2.5°	18434.1	18434.1	18434.1	18434.1	18434.1
5°	18544.2	18544.2	18544.2	18544.2	18544.2
7.5°	18760.7	18760.7	18760.7	18760.7	18760.7
10°	19093.9	19093.9	19093.9	19093.9	19093.9
12.5°	19527.0	19527.0	19527.0	19527.0	19527.0
15°	20048.9	20048.9	20048.9	20048.9	20048.9
17.5°	20646.3	20646.3	20646.3	20646.3	20646.3
20°	21291.5	21291.5	21291.5	21291.5	21291.5
22.5°	21941.0	21941.0	21941.0	21941.0	21941.0
25°	22489.4	22489.4	22489.4	22489.4	22489.4
27.5°	22784.4	22784.4	22784.4	22784.4	22784.4
30°	22705.1	22705.1	22705.1	22705.1	22705.1
32.5°	22032.1	22032.1	22032.1	22032.1	22032.1
35°	20621.3	20621.3	20621.3	20621.3	20621.3
37.5°	18421.6	18421.6	18421.6	18421.6	18421.6
40°	15452.7	15452.7	15452.7	15452.7	15452.7
42.5°	12094.6	12094.6	12094.6	12094.6	12094.6
45°	8915.8	8915.8	8915.8	8915.8	8915.8
47.5°	6372.5	6372.5	6372.5	6372.5	6372.5
50°	4755.5	4755.5	4755.5	4755.5	4755.5
52.5°	3850.5	3850.5	3850.5	3850.5	3850.5
55°	3262.6	3262.6	3262.6	3262.6	3262.6
57.5°	2833.1	2833.1	2833.1	2833.1	2833.1
60°	2489.7	2489.7	2489.7	2489.7	2489.7
62.5°	2203.4	2203.4	2203.4	2203.4	2203.4
65°	1952.4	1952.4	1952.4	1952.4	1952.4
67.5°	1730.8	1730.8	1730.8	1730.8	1730.8
70°	1509.8	1509.8	1509.8	1509.8	1509.8
72.5°	1289.6	1289.6	1289.6	1289.6	1289.6
75°	1070.9	1070.9	1070.9	1070.9	1070.9
77.5°	860.3	860.3	860.3	860.3	860.3
80°	651.8	651.8	651.8	651.8	651.8
82.5°	447.0	447.0	447.0	447.0	447.0
85°	251.0	251.0	251.0	251.0	251.0
87.5°	79.3	79.3	79.3	79.3	79.3
90°	26.2	41.4	69.9	45.2	26.2
92.5°	36.9	61.6	110.9	57.8	33.1
95°	43.3	71.8	155.4	77.5	49.0
97.5°	54.7	79.4	178.2	94.6	75.6
100°	71.8	92.7	277.1	115.5	100.3
102.5°	121.2	195.3	586.8	216.2	151.6
105°	208.6	410.1	1044.8	451.9	275.1
107.5°	360.7	733.2	1377.4	799.7	520.3
110°	673.1	973.3	1444.7	1098.8	832.7



TEST NUMBER:

CATALOG NUMBER: EHBR1-48-UNV-W-L950-UPL36

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	908.8	1045.5	1383.8	1212.8	1083.5
115°	956.2	1005.7	1235.6	1184.2	1176.7
117.5°	923.9	918.2	1049.3	1064.6	1136.8
120°	855.5	817.5	876.4	929.7	1026.6
122.5°	770.0	724.4	751.0	790.9	887.9
125°	690.9	645.3	662.5	671.9	753.6
127.5°	620.6	590.2	599.7	588.3	639.6
130°	573.7	547.2	560.4	533.9	558.6
132.5°	535.4	518.3	533.4	501.1	508.7
135°	507.6	492.3	509.4	479.1	477.2
137.5°	483.6	470.3	487.4	464.6	458.9
140°	462.3	450.9	469.9	452.8	448.9
142.5°	438.4	430.7	453.5	442.2	438.4
145°	422.0	416.2	441.0	435.3	433.3
147.5°	407.5	403.7	426.5	424.6	424.6
150°	394.2	390.4	413.2	411.3	413.2
152.5°	380.9	377.1	398.0	396.1	398.0
155°	372.0	368.2	385.3	385.3	385.3
157.5°	364.4	362.5	375.8	375.8	375.8
160°	359.5	357.6	369.0	369.0	367.1
162.5°	354.5	352.6	365.9	364.0	364.0
165°	350.7	350.7	360.2	360.2	358.4
167.5°	350.7	348.8	358.4	358.4	356.4
170°	348.8	348.8	356.4	354.5	352.6
172.5°	349.5	349.5	357.2	355.3	353.3
175°	348.4	348.4	354.1	354.1	354.1
177.5°	350.3	350.3	354.1	354.1	352.2
180°	353.0	353.0	353.0	353.0	353.0



TEST NUMBER: CATALOG
 CATALOG NUMBER: EHBR1-48-UNV-W-L950-UPL36

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.42	20.61	19.90	21.07	21.56	19.42	20.61	19.90	21.07	21.56
	3H	20.92	21.97	21.42	22.45	22.99	20.92	21.97	21.42	22.45	22.99
	4H	21.48	22.46	22.00	22.96	23.51	21.48	22.46	22.00	22.96	23.51
	6H	21.86	22.77	22.40	23.28	23.84	21.86	22.77	22.40	23.28	23.84
	8H	21.96	22.82	22.51	23.35	23.92	21.96	22.82	22.51	23.35	23.92
	12H	22.00	22.82	22.55	23.34	23.94	22.00	22.82	22.55	23.34	23.94
4H	2H	19.86	20.85	20.38	21.34	21.89	19.86	20.85	20.38	21.34	21.89
	3H	21.58	22.39	22.11	22.93	23.50	21.58	22.39	22.11	22.93	23.50
	4H	22.26	22.99	22.81	23.53	24.14	22.26	22.99	22.81	23.53	24.14
	6H	22.75	23.38	23.33	23.96	24.58	22.75	23.38	23.33	23.96	24.58
	8H	22.89	23.47	23.47	24.05	24.68	22.89	23.47	23.47	24.05	24.68
	12H	22.95	23.47	23.55	24.07	24.71	22.95	23.47	23.55	24.07	24.71
8H	4H	22.46	23.05	23.04	23.62	24.25	22.46	23.05	23.04	23.62	24.25
	6H	23.06	23.54	23.67	24.16	24.80	23.06	23.54	23.67	24.16	24.80
	8H	23.24	23.67	23.88	24.30	24.96	23.24	23.67	23.88	24.30	24.96
	12H	23.35	23.73	23.98	24.34	25.07	23.35	23.73	23.98	24.34	25.07
12H	4H	22.46	22.98	23.06	23.58	24.22	22.46	22.98	23.06	23.58	24.22
	6H	23.07	23.50	23.70	24.13	24.79	23.07	23.50	23.70	24.13	24.79
	8H	23.30	23.67	23.92	24.29	25.01	23.30	23.67	23.92	24.29	25.01

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-472-8

Test Date: 08/04/2025

Luminaire Tested: EHBR-60-L950-N

Data in this report applies to families of products including EHBR-60-L950-N

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-472-8
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **EHBR-60-L950-N**
 Description: Elevate Round Highbay at, 60000 lumens, 5000K 90CRI LEDs with N lens

Spectral Parameters

CCT (K): 4901
 CIE u': 0.2131
 CIE v': 0.4853
 Duv: -0.0008
 CIE x: 0.3477
 CIE y: 0.3520
 CIE z: 0.3003
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 574
 Purity: 9.953987
 Rf: 90.7
 Rg: 100.5

CRI (Ra):	94.3		
R1:	95.8	R9:	72.3
R2:	96.5	R10:	89.1
R3:	94.4	R11:	94.9
R4:	95.3	R12:	68.4
R5:	94.1	R13:	96.4
R6:	92.5	R14:	96.4
R7:	95.5	R15:	93.9
R8:	90.1		



Test Conditions

Stabilization Time: 35M
 Operation Time: 1H 35M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-472-8

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-472-8

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-472-8

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-8

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 2.04

λ (nm)	Power W^{\wedge}/nm	Lumens (ϕ/nm)	λ (nm)	Power W^{\wedge}/nm	Lumens (ϕ/nm)	λ (nm)	Power W^{\wedge}/nm	Lumens (ϕ/nm)	λ (nm)	Power W^{\wedge}/nm	Lumens (ϕ/nm)	λ (nm)	Power W^{\wedge}/nm	Lumens (ϕ/nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-472-8

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 4.41

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	221	NR	620	326	NR	750	7	NR	880	0	NR
365	0	NR	495	250	NR	625	325	NR	755	6	NR	885	0	NR
370	0	NR	500	284	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	643	NR	765	4	NR	895	0	NR
380	0	NR	510	329	NR	640	206	NR	770	4	NR	900	0	NR
385	1	NR	515	344	NR	645	199	NR	775	3	NR	905	0	NR
390	2	NR	520	353	NR	650	172	NR	780	3	NR	910	0	NR
395	3	NR	525	357	NR	655	143	NR	785	2	NR	915	0	NR
400	5	NR	530	362	NR	660	122	NR	790	2	NR	920	0	NR
405	6	NR	535	365	NR	665	102	NR	795	2	NR	925	0	NR
410	9	NR	540	367	NR	670	94	NR	800	2	NR	930	0	NR
415	15	NR	545	369	NR	675	76	NR	805	1	NR	935	0	NR
420	26	NR	550	370	NR	680	65	NR	810	1	NR	940	0	NR
425	47	NR	555	372	NR	685	56	NR	815	1	NR	945	0	NR
430	81	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	143	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	243	NR	570	370	NR	700	35	NR	830	1	NR	960	0	NR
445	434	NR	575	367	NR	705	30	NR	835	1	NR	965	0	NR
450	675	NR	580	365	NR	710	25	NR	840	1	NR	970	0	NR
455	615	NR	585	361	NR	715	22	NR	845	0	NR	975	0	NR
460	418	NR	590	356	NR	720	19	NR	850	0	NR	980	0	NR
465	344	NR	595	348	NR	725	16	NR	855	0	NR	985	0	NR
470	272	NR	600	343	NR	730	13	NR	860	0	NR	990	0	NR
475	206	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	190	NR	610	362	NR	740	10	NR	870	0	NR	1000	0	NR
485	202	NR	615	381	NR	745	8	NR	875	0	NR			

Summary

$R_f = 90.7$
 $R_g = 100.5$
 CIE $R_a = 94.3$
 $R_9 = 72.3$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 91	CES51 = 98	CES76 = 83
CES02 = 61	CES27 = 92	CES52 = 98	CES77 = 87
CES03 = 31	CES28 = 94	CES53 = 97	CES78 = 80
CES04 = 69	CES29 = 94	CES54 = 93	CES79 = 94
CES05 = 48	CES30 = 93	CES55 = 92	CES80 = 91
CES06 = 50	CES31 = 95	CES56 = 95	CES81 = 84
CES07 = 41	CES32 = 86	CES57 = 94	CES82 = 96
CES08 = 40	CES33 = 99	CES58 = 94	CES83 = 96
CES09 = 29	CES34 = 90	CES59 = 97	CES84 = 93
CES10 = 73	CES35 = 94	CES60 = 92	CES85 = 83
CES11 = 56	CES36 = 81	CES61 = 92	CES86 = 86
CES12 = 62	CES37 = 92	CES62 = 86	CES87 = 91
CES13 = 43	CES38 = 88	CES63 = 92	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 89	CES89 = 87
CES15 = 71	CES40 = 97	CES65 = 88	CES90 = 98
CES16 = 47	CES41 = 97	CES66 = 85	CES91 = 73
CES17 = 48	CES42 = 90	CES67 = 84	CES92 = 79
CES18 = 56	CES43 = 91	CES68 = 86	CES93 = 87
CES19 = 70	CES44 = 99	CES69 = 87	CES94 = 78
CES20 = 65	CES45 = 95	CES70 = 83	CES95 = 83
CES21 = 85	CES46 = 97	CES71 = 77	CES96 = 92
CES22 = 77	CES47 = 95	CES72 = 92	CES97 = 95
CES23 = 91	CES48 = 93	CES73 = 77	CES98 = 95
CES24 = 90	CES49 = 95	CES74 = 92	CES99 = 94
CES25 = 70	CES50 = 98	CES75 = 79	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)