

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: METALUX

Report Number: P830130

Luminaire Tested: **OHBL-24SE-N-UNV-L750-CD**

Issue Date: 5/3/2024



Test Information

Test Method: LM-79-08
Report Number: P830130
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-285-5)
Test Lab: INNOVATION CENTER
Issue Date: 5/3/2024
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: METALUX
Catalog Number: OHBL-24SE-N-UNV-L750-CD
Description: 24000 LUMEN OHBL SE LED LUMINAIRE WITH 70CRI, 5000K LEDS AND NARROW LENS
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 24732.0 lumens
Efficiency: N/A
Efficacy: 179.2 lumens/watt
Spacing Criteria (0/90/45): 1.47 / 0.53 / 0.78
Luminous Opening: Rectangular w/ Sides (W: 1.67' x L: 3.78' x H: 0.17')
CIE Type: Direct

Input Watts (W): 138
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P830130

CATALOG NUMBER: OHBL-24SE-N-UNV-L750-CD

Luminous Intensity Polar Plot

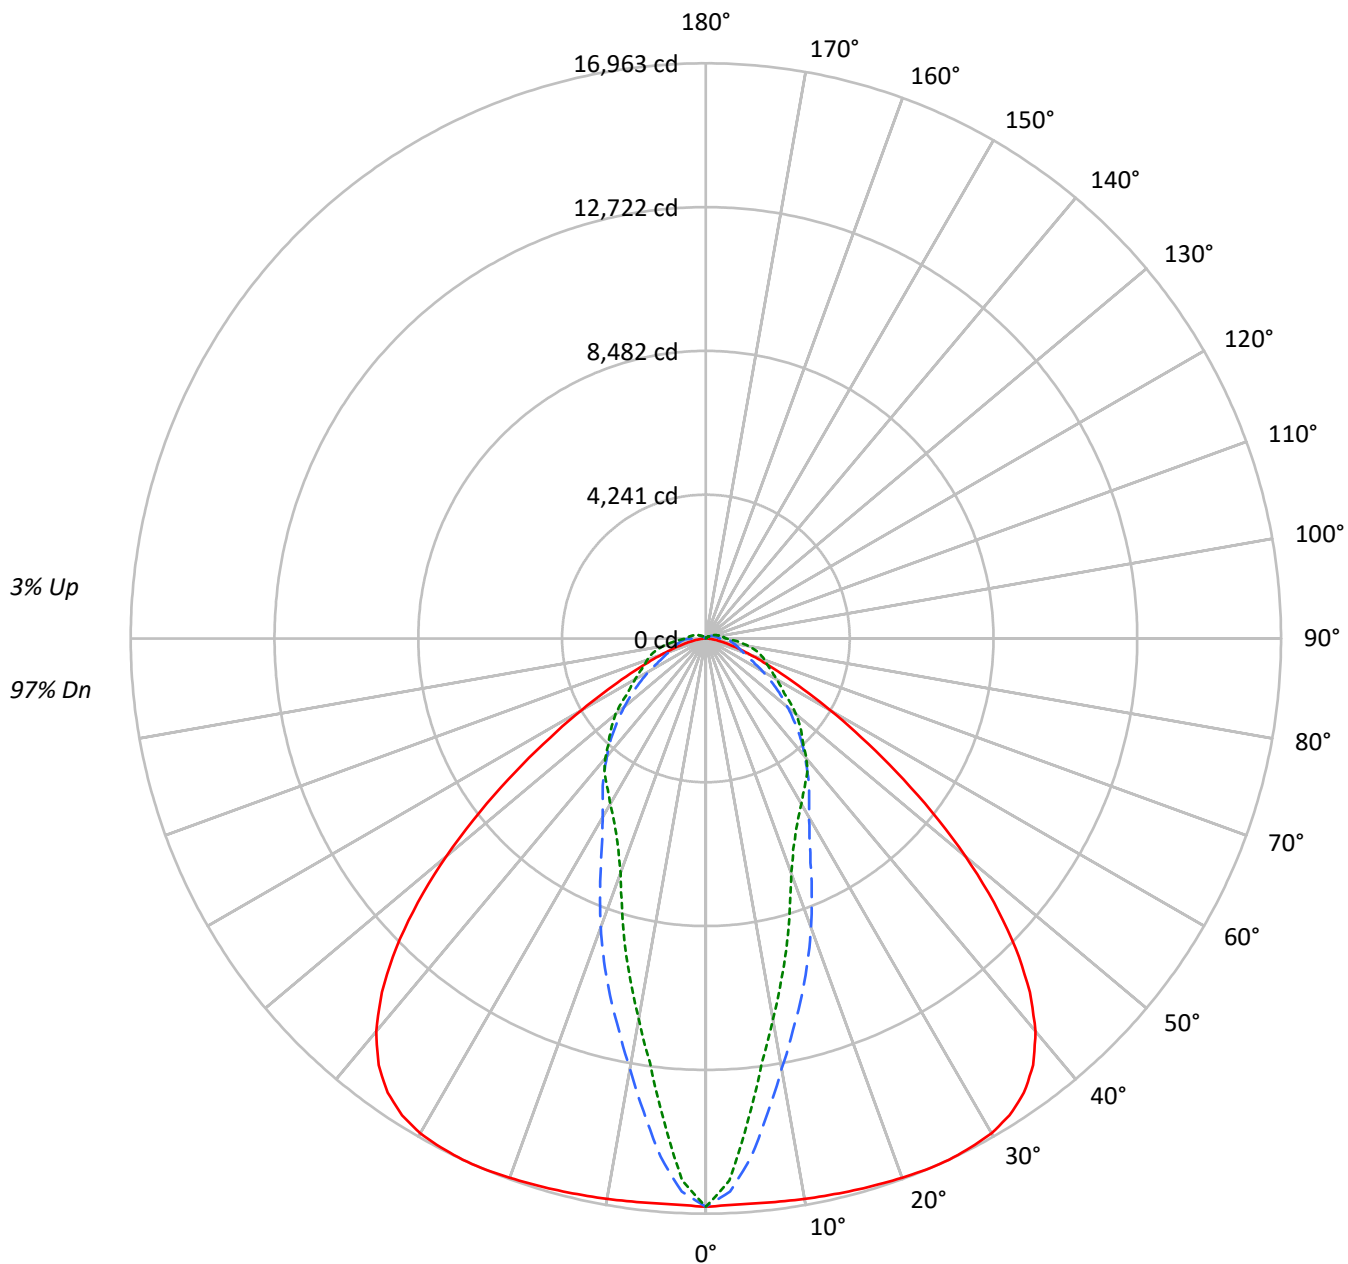



TEST NUMBER: P830130

CATALOG NUMBER: OHBL-24SE-N-UNV-L750-CD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	118	118	118	118	115	115	115	115	109	109	109	104	104	104	99	99	99	99	99	97
1	109	104	100	97	106	102	98	95	97	94	91	92	90	88	88	86	85	85	85	82
2	100	93	86	81	97	90	85	80	86	82	78	83	79	75	79	76	73	73	73	71
3	92	83	75	69	90	81	74	69	78	72	67	74	70	65	72	67	64	64	64	62
4	85	74	66	60	83	73	66	60	70	64	59	67	62	57	65	60	56	56	56	54
5	79	67	59	53	77	66	59	53	64	57	52	62	56	51	59	54	50	50	50	48
6	74	62	53	47	72	60	53	47	58	52	46	56	50	46	55	49	45	45	45	43
7	69	56	48	43	67	55	48	42	54	47	42	52	46	41	50	45	41	41	41	39
8	65	52	44	39	63	51	44	39	50	43	38	48	42	38	47	41	37	37	37	35
9	61	48	41	35	59	47	40	35	46	40	35	45	39	35	44	38	34	34	34	32
10	57	45	37	33	56	44	37	32	43	37	32	42	36	32	41	35	32	32	32	30

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	28621	28621	28621
5°	28563	26065	24234
10°	28885	21955	19432
15°	29449	18777	15949
20°	30277	15876	12900
25°	31324	13141	11303
30°	32407	11321	10500
35°	33081	10317	10004
40°	32515	9320	9491
45°	29912	8422	8787
50°	25237	7441	8247
55°	19176	6517	7339
60°	13438	5589	7026
65°	9039	4814	6878
70°	6173	4518	7216
75°	4284	4659	7710
80°	2949	5160	7937
85°	1725	6454	8327



TEST NUMBER: P830130

CATALOG NUMBER: OHBL-24SE-N-UNV-L750-CD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1410.6	5.7
10°-20°	3318.4	13.4
20°-30°	4159.5	16.8
30°-40°	4413.8	17.8
40°-50°	3990.7	16.1
50°-60°	2893.5	11.7
60°-70°	1815.8	7.3
70°-80°	1201.7	4.9
80°-90°	692.3	2.8
90°-100°	335.4	1.4
100°-110°	231.5	0.9
110°-120°	142.9	0.6
120°-130°	69.2	0.3
130°-140°	31.8	0.1
140°-150°	17.4	0.1
150°-160°	7.6	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	8888.5	35.9
0°-40°	13302.3	53.8
0°-60°	20186.5	81.6
0°-90°	23896.3	96.6
90°-120°	709.7	2.9
90°-150°	828.1	3.3
90°-180°	836.0	3.4
0°-180°	24732.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	16757	16757	16757	16757	16757	
5°	16724	16295	15338	14626	14258	###
15°	16851	13735	10909	9702	9261	4779
25°	16963	10620	7304	6483	6277	7837
35°	16355	7060	5301	5136	5134	10167
45°	12930	4472	3842	3934	4002	9850
55°	6845	2772	2507	2719	2816	6185
65°	2448	1608	1451	1860	2067	2548
75°	756	866	974	1514	1604	843
85°	132	359	713	992	911	159
90°	0	150	413	582	587	9
95°	6	105	364	494	517	6
105°	13	70	265	351	360	13
115°	18	49	179	223	228	17
125°	19	26	91	115	113	17
135°	16	19	40	62	62	12
145°	19	21	24	37	35	11
155°	19	24	26	27	24	6
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	



TEST NUMBER: P830130

CATALOG NUMBER: OHBL-24SE-N-UNV-L750-CD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	16757.2	16757.2	16757.2	16757.2	16757.2
2.5°	16722.2	16626.5	16328.2	16146.4	15993.3
5°	16723.8	16294.7	15337.8	14626.5	14258.1
7.5°	16747.7	15794.0	14069.9	13031.6	12626.5
10°	16784.4	15173.5	12886.5	11779.7	11401.7
12.5°	16811.5	14475.0	11845.1	10707.9	10293.3
15°	16851.3	13735.0	10908.9	9701.6	9261.4
17.5°	16888.0	13038.0	9983.9	8722.3	8232.7
20°	16924.7	12286.8	9058.8	7759.0	7355.5
22.5°	16959.8	11494.2	8156.1	7011.0	6735.1
25°	16963.0	10620.2	7304.5	6483.1	6277.4
27.5°	16921.5	9714.3	6613.9	6041.3	5913.8
30°	16849.8	8835.6	6078.0	5722.4	5631.5
32.5°	16671.1	7939.2	5663.4	5414.6	5361.9
35°	16355.3	7060.5	5301.3	5135.5	5133.9
37.5°	15857.7	6280.6	4909.0	4880.3	4915.4
40°	15122.5	5598.0	4537.4	4613.9	4613.9
42.5°	14141.7	5004.7	4200.9	4279.0	4258.3
45°	12929.6	4472.0	3842.0	3934.5	4001.5
47.5°	11524.5	4003.1	3475.2	3653.8	3746.3
50°	9996.6	3556.5	3140.3	3368.4	3473.6
52.5°	8395.4	3143.5	2813.3	3074.9	3159.4
55°	6845.2	2771.9	2507.1	2719.2	2816.5
57.5°	5441.7	2417.8	2207.3	2408.2	2609.2
60°	4234.4	2113.2	1925.0	2212.1	2413.0
62.5°	3234.4	1842.1	1660.3	2028.7	2229.6
65°	2448.1	1607.6	1451.3	1859.6	2066.9
67.5°	1845.3	1405.1	1288.7	1736.8	1939.4
70°	1385.9	1208.9	1157.9	1660.3	1842.1
72.5°	1023.9	1028.7	1054.2	1593.3	1732.0
75°	756.0	866.0	974.5	1513.5	1604.4
77.5°	540.7	717.7	902.7	1417.8	1449.7
80°	374.8	585.3	827.7	1291.8	1264.7
82.5°	234.4	468.9	760.8	1153.1	1078.1
85°	132.4	358.8	712.9	992.0	910.7
87.5°	59.0	267.9	623.6	773.5	722.5
90°	0.0	149.9	413.1	582.1	586.9
92.5°	3.2	124.4	381.2	532.7	548.6
95°	6.4	105.3	363.6	494.4	516.7
97.5°	8.0	92.5	341.3	459.3	478.5
100°	9.6	82.9	314.2	422.6	438.6
102.5°	11.2	76.6	288.7	384.4	397.1
105°	12.8	70.2	264.7	350.9	360.4



TEST NUMBER: P830130

CATALOG NUMBER: OHBL-24SE-N-UNV-L750-CD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	15.9	54.2	199.4	252.0	260.0
115°	17.5	49.4	178.6	223.3	228.1
117.5°	19.1	43.1	156.3	196.2	197.8
120°	19.1	38.3	134.0	167.5	167.5
122.5°	19.1	31.9	111.6	138.8	137.2
125°	19.1	25.5	90.9	114.8	113.2
127.5°	17.5	20.7	73.4	95.7	94.1
130°	17.5	20.7	59.0	81.3	81.3
132.5°	15.9	19.1	47.8	70.2	70.2
135°	15.9	19.1	39.9	62.2	62.2
137.5°	15.9	20.7	33.5	54.2	54.2
140°	15.9	19.1	28.7	47.8	47.8
142.5°	17.5	19.1	25.5	41.5	41.5
145°	19.1	20.7	23.9	36.7	35.1
147.5°	19.1	22.3	23.9	31.9	30.3
150°	19.1	23.9	23.9	28.7	27.1
152.5°	19.1	23.9	23.9	27.1	25.5
155°	19.1	23.9	25.5	27.1	23.9
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0



Report Generated By 670246072 / DESKTOP-50001EG





— 0°-180° - - 45°-225° - - - 90°-270°







107.5°	12.8	65.4	242.4	314.2	325.4
110°	14.4	59.0	221.7	280.7	291.9



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

METALUX

Report Number: SP1-2304-001-3

Test Date: 05/31/2023

Luminaire Tested: OHB-15SE-N-UNV-L750


Data in this report applies to families of products including OHB-15SE-N-UNV-L750.

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2304-001-3
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 05/31/2023
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: METALUX
 Catalog Number: **OHB-15SE-N-UNV-L750**
 Description: 15SE OHB WITH APT LEDS, NARROW LENS, 70CRI 5000K

Spectral Parameters

CCT (K):	5065	CRI (Ra):	72.1		
CIE u':	0.2097	R1:	70.0	R9:	-29.1
CIE v':	0.4852	R2:	76.6	R10:	44.1
Duv:	0.0015	R3:	81.0	R11:	70.8
CIE x:	0.3435	R4:	73.2	R12:	44.5
CIE y:	0.3531	R5:	70.9	R13:	70.5
CIE z:	0.3034	R6:	67.9	R14:	89.2
Peak Wavelength (nm):	448	R7:	79.9		
Dominant Wavelength (nm):	570	R8:	56.9		
Purity:	9.1				
Rf:	72.7				
Rg:	95.7				

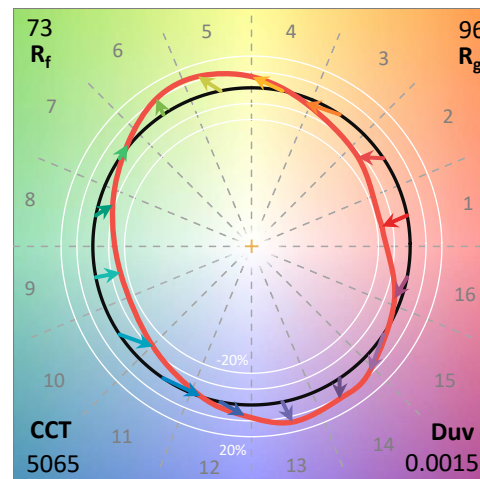

Test Conditions


Stabilization Time: 23M
 Operation Time: 12H
 Room Temperature (°C) / RH%: 25.7/44%
 Sphere Temperature (°C): 25.3

REPORT NUMBER: SP1-2304-001-3


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	2/9/2023	8/9/2023
Power Meter	XITRON 2801 IN0071	11/29/2022	11/29/2023
AC Power Source	CHROMA 61603 IN0063	11/28/2022	11/28/2023
DC Power Source	AGILENT E3634A IN0208	11/28/2022	11/28/2023
Sphere Thermometer	ONSET IN0085	11/28/2022	11/28/2023
Room Thermometer	ONSET IN0046	11/28/2022	11/28/2023

REPORT NUMBER: SP1-2304-001-3

CIE 1931 Chromaticity Diagram

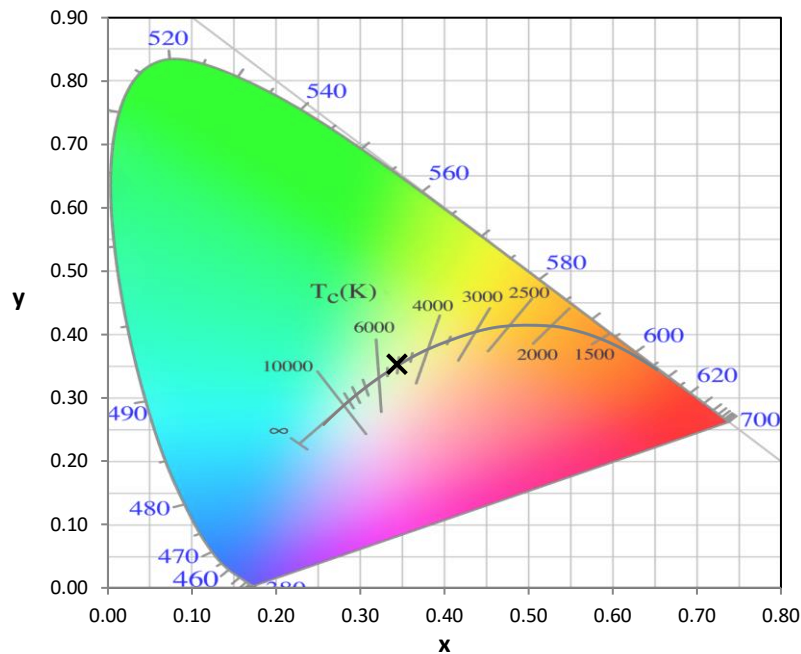


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

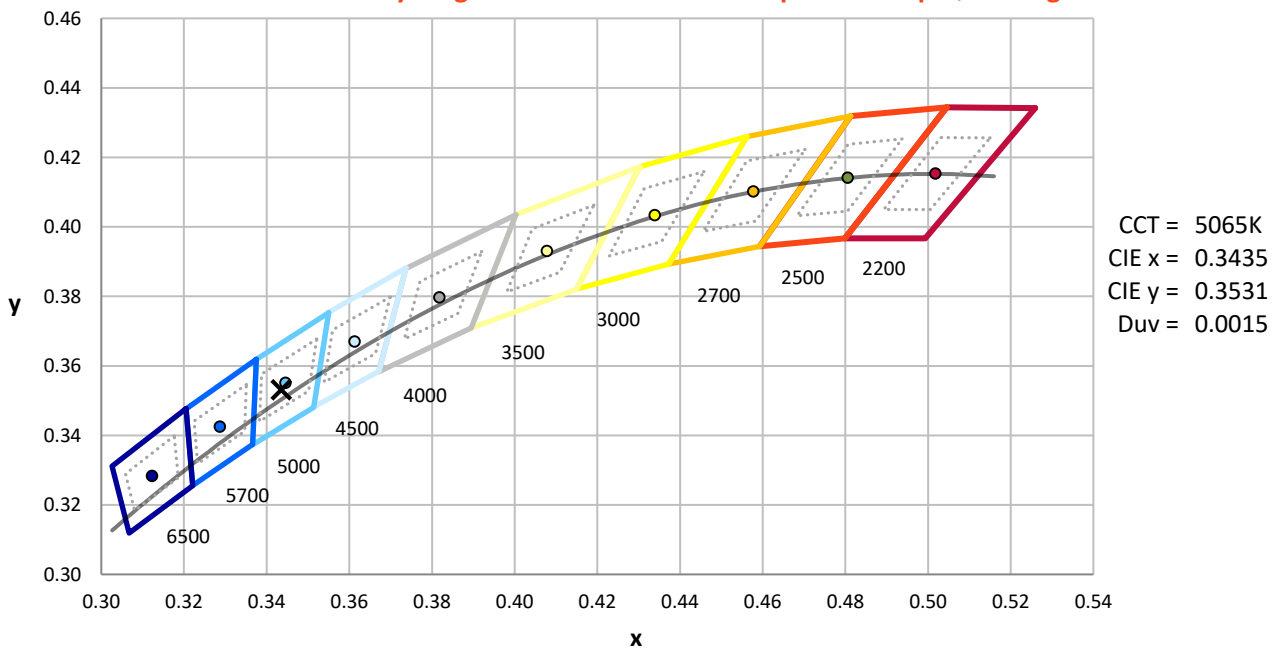

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2304-001-3

Photopic Flux vs. Wavelength

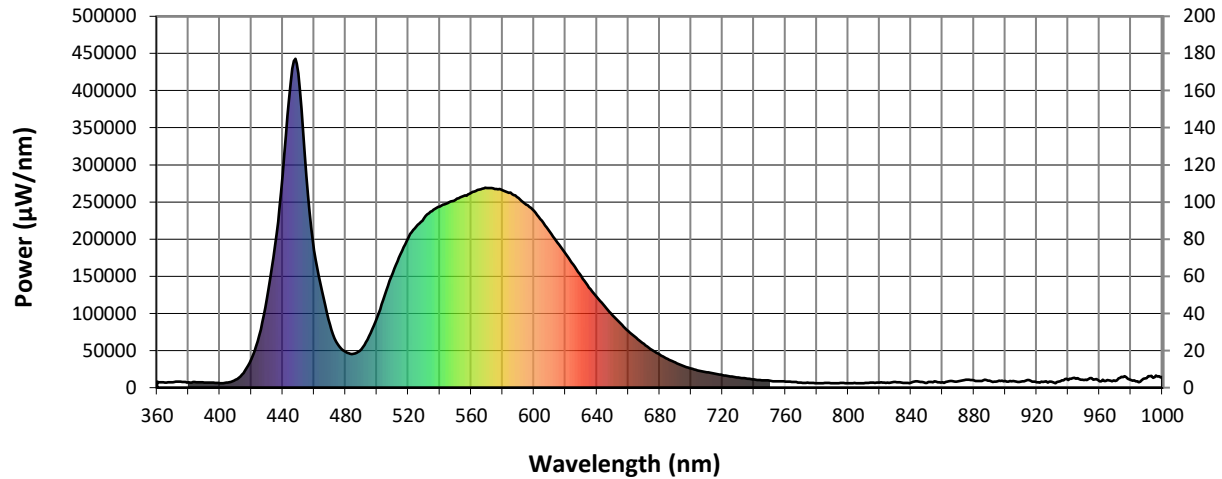


#####

λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)
360	7901	NR	490	51801	NR	620	180332	NR	750	9189	NR	880	9627	NR
365	7002	NR	495	69123	NR	625	165678	NR	755	8359	NR	885	9124	NR
370	7284	NR	500	94270	NR	630	150434	NR	760	8168	NR	890	9197	NR
375	7942	NR	505	124521	NR	635	134965	NR	765	7713	NR	895	8690	NR
380	7035	NR	510	154116	NR	640	121856	NR	770	6636	NR	900	8804	NR
385	7297	NR	515	179594	NR	645	109311	NR	775	6555	NR	905	8894	NR
390	6671	NR	520	201941	NR	650	97492	NR	780	5754	NR	910	8101	NR
395	6834	NR	525	216547	NR	655	86413	NR	785	6320	NR	915	10080	NR
400	5920	NR	530	228346	NR	660	76250	NR	790	5938	NR	920	7255	NR
405	7007	NR	535	237949	NR	665	67186	NR	795	6403	NR	925	8009	NR
410	10588	NR	540	243629	NR	670	58769	NR	800	6035	NR	930	7697	NR
415	19827	NR	545	248627	NR	675	50698	NR	805	5970	NR	935	8410	NR
420	38440	NR	550	252906	NR	680	44590	NR	810	6014	NR	940	10423	NR
425	70453	NR	555	258102	NR	685	38628	NR	815	6644	NR	945	11776	NR
430	120416	NR	560	262415	NR	690	33765	NR	820	6798	NR	950	10166	NR
435	190652	NR	565	266550	NR	695	29058	NR	825	6635	NR	955	12930	NR
440	286544	NR	570	268921	NR	700	25892	NR	830	7694	NR	960	8476	NR
445	410304	NR	575	267672	NR	705	22943	NR	835	6370	NR	965	10058	NR
450	422855	NR	580	265623	NR	710	20733	NR	840	6700	NR	970	8998	NR
455	285343	NR	585	262668	NR	715	18943	NR	845	8162	NR	975	14305	NR
460	184907	NR	590	255270	NR	720	16835	NR	850	6467	NR	980	10085	NR
465	130219	NR	595	246513	NR	725	15199	NR	855	8359	NR	985	7311	NR
470	84822	NR	600	237819	NR	730	13533	NR	860	7106	NR	990	12758	NR
475	58457	NR	605	224633	NR	735	12345	NR	865	9174	NR	995	14051	NR
480	47999	NR	610	209648	NR	740	10946	NR	870	8374	NR	1000	14421	NR
485	45483	NR	615	195117	NR	745	9933	NR	875	10878	NR			

REPORT NUMBER: SP1-2304-001-3

Scotopic Flux vs. Wavelength

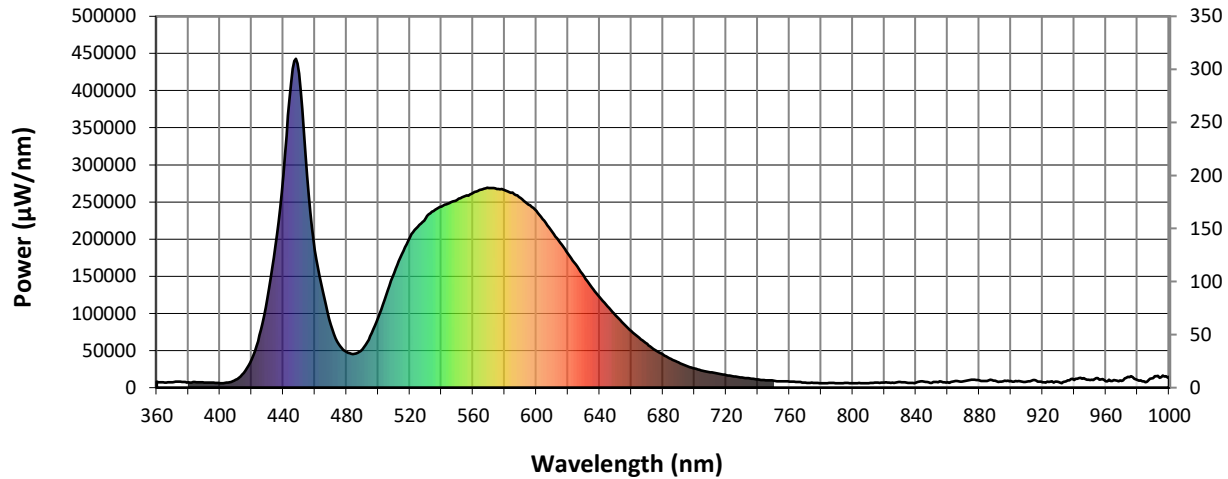


Scotopic Lumens: 28328.9

S/P: 1.78

λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)
360	7901	NR	490	51801	NR	620	180332	NR	750	9189	NR	880	9627	NR
365	7002	NR	495	69123	NR	625	165678	NR	755	8359	NR	885	9124	NR
370	7284	NR	500	94270	NR	630	150434	NR	760	8168	NR	890	9197	NR
375	7942	NR	505	124521	NR	635	134965	NR	765	7713	NR	895	8690	NR
380	7035	NR	510	154116	NR	640	121856	NR	770	6636	NR	900	8804	NR
385	7297	NR	515	179594	NR	645	109311	NR	775	6555	NR	905	8894	NR
390	6671	NR	520	201941	NR	650	97492	NR	780	5754	NR	910	8101	NR
395	6834	NR	525	216547	NR	655	86413	NR	785	6320	NR	915	10080	NR
400	5920	NR	530	228346	NR	660	76250	NR	790	5938	NR	920	7255	NR
405	7007	NR	535	237949	NR	665	67186	NR	795	6403	NR	925	8009	NR
410	10588	NR	540	243629	NR	670	58769	NR	800	6035	NR	930	7697	NR
415	19827	NR	545	248627	NR	675	50698	NR	805	5970	NR	935	8410	NR
420	38440	NR	550	252906	NR	680	44590	NR	810	6014	NR	940	10423	NR
425	70453	NR	555	258102	NR	685	38628	NR	815	6644	NR	945	11776	NR
430	120416	NR	560	262415	NR	690	33765	NR	820	6798	NR	950	10166	NR
435	190652	NR	565	266550	NR	695	29058	NR	825	6635	NR	955	12930	NR
440	286544	NR	570	268921	NR	700	25892	NR	830	7694	NR	960	8476	NR
445	410304	NR	575	267672	NR	705	22943	NR	835	6370	NR	965	10058	NR
450	422855	NR	580	265623	NR	710	20733	NR	840	6700	NR	970	8998	NR
455	285343	NR	585	262668	NR	715	18943	NR	845	8162	NR	975	14305	NR
460	184907	NR	590	255270	NR	720	16835	NR	850	6467	NR	980	10085	NR
465	130219	NR	595	246513	NR	725	15199	NR	855	8359	NR	985	7311	NR
470	84822	NR	600	237819	NR	730	13533	NR	860	7106	NR	990	12758	NR
475	58457	NR	605	224633	NR	735	12345	NR	865	9174	NR	995	14051	NR
480	47999	NR	610	209648	NR	740	10946	NR	870	8374	NR	1000	14421	NR
485	45483	NR	615	195117	NR	745	9933	NR	875	10878	NR			

REPORT NUMBER: SP1-2304-001-3

Melanopic Flux vs. Wavelength

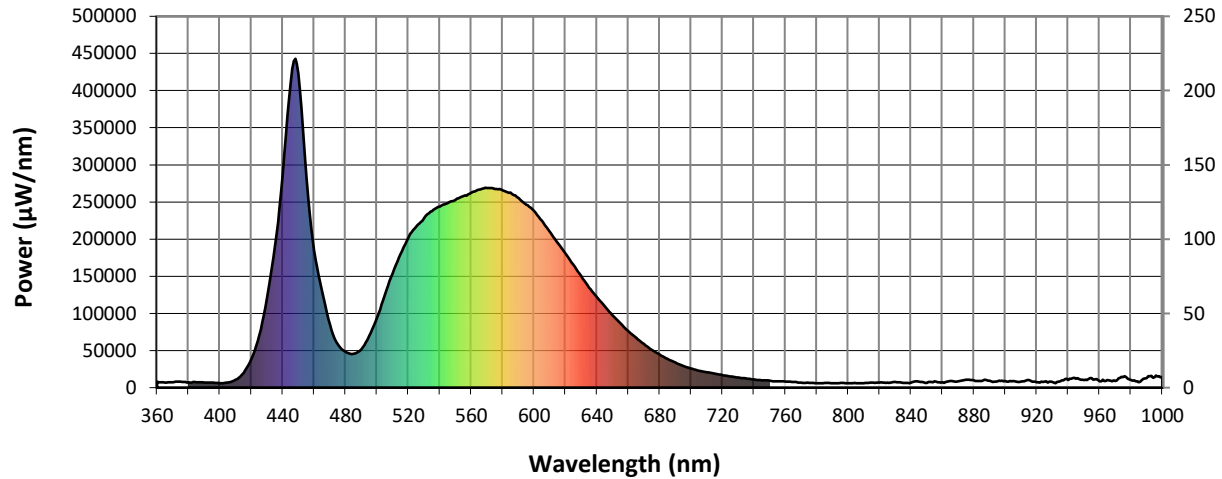

Melanopic Lumens: 11377.8 M/P: 0.71


λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)	λ (nm)	Power (μW/nm)	Lumens (φ/nm)
360	7901	NR	490	51801	NR	620	180332	NR	750	9189	NR	880	9627	NR
365	7002	NR	495	69123	NR	625	165678	NR	755	8359	NR	885	9124	NR
370	7284	NR	500	94270	NR	630	150434	NR	760	8168	NR	890	9197	NR
375	7942	NR	505	124521	NR	635	134965	NR	765	7713	NR	895	8690	NR
380	7035	NR	510	154116	NR	640	121856	NR	770	6636	NR	900	8804	NR
385	7297	NR	515	179594	NR	645	109311	NR	775	6555	NR	905	8894	NR
390	6671	NR	520	201941	NR	650	97492	NR	780	5754	NR	910	8101	NR
395	6834	NR	525	216547	NR	655	86413	NR	785	6320	NR	915	10080	NR
400	5920	NR	530	228346	NR	660	76250	NR	790	5938	NR	920	7255	NR
405	7007	NR	535	237949	NR	665	67186	NR	795	6403	NR	925	8009	NR
410	10588	NR	540	243629	NR	670	58769	NR	800	6035	NR	930	7697	NR
415	19827	NR	545	248627	NR	675	50698	NR	805	5970	NR	935	8410	NR
420	38440	NR	550	252906	NR	680	44590	NR	810	6014	NR	940	10423	NR
425	70453	NR	555	258102	NR	685	38628	NR	815	6644	NR	945	11776	NR
430	120416	NR	560	262415	NR	690	33765	NR	820	6798	NR	950	10166	NR
435	190652	NR	565	266550	NR	695	29058	NR	825	6635	NR	955	12930	NR
440	286544	NR	570	268921	NR	700	25892	NR	830	7694	NR	960	8476	NR
445	410304	NR	575	267672	NR	705	22943	NR	835	6370	NR	965	10058	NR
450	422855	NR	580	265623	NR	710	20733	NR	840	6700	NR	970	8998	NR
455	285343	NR	585	262668	NR	715	18943	NR	845	8162	NR	975	14305	NR
460	184907	NR	590	255270	NR	720	16835	NR	850	6467	NR	980	10085	NR
465	130219	NR	595	246513	NR	725	15199	NR	855	8359	NR	985	7311	NR
470	84822	NR	600	237819	NR	730	13533	NR	860	7106	NR	990	12758	NR
475	58457	NR	605	224633	NR	735	12345	NR	865	9174	NR	995	14051	NR
480	47999	NR	610	209648	NR	740	10946	NR	870	8374	NR	1000	14421	NR
485	45483	NR	615	195117	NR	745	9933	NR	875	10878	NR			

REPORT NUMBER: SP1-2304-001-3





TM-30-18

Summary

$R_f = 72.7$
 $R_g = 95.7$
 CIE $R_a = 72.1$
 $R_g = -29.1$

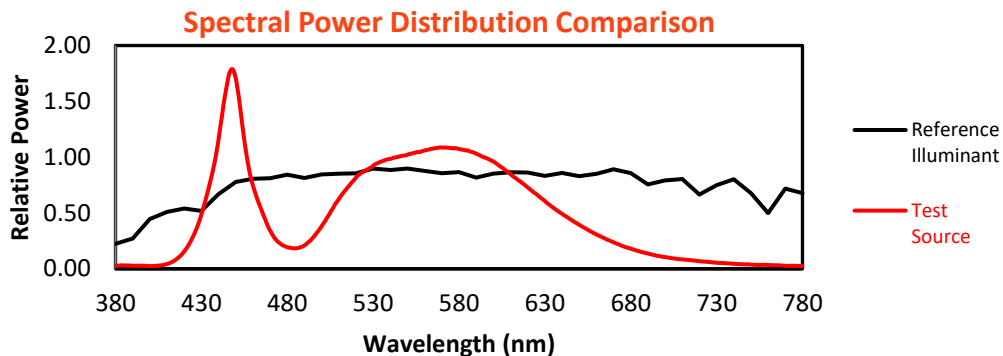

Color Vector Graphics

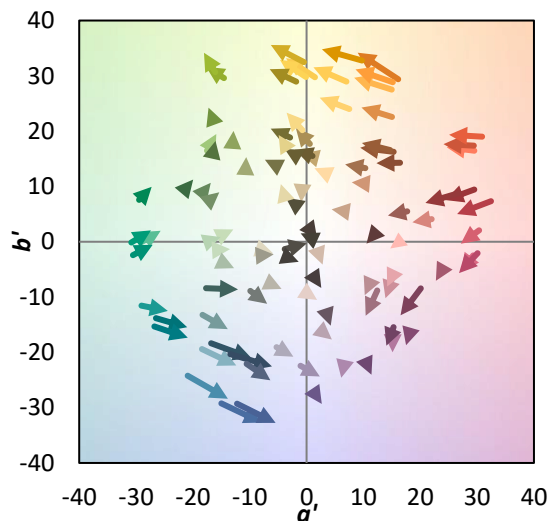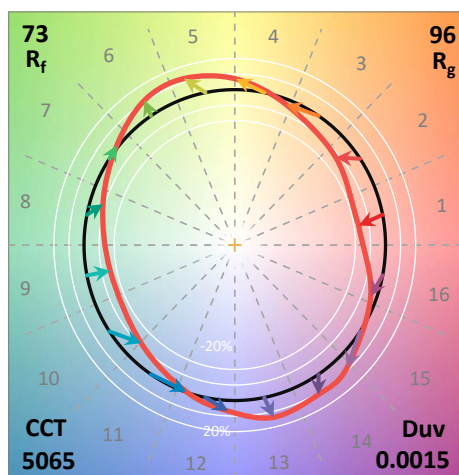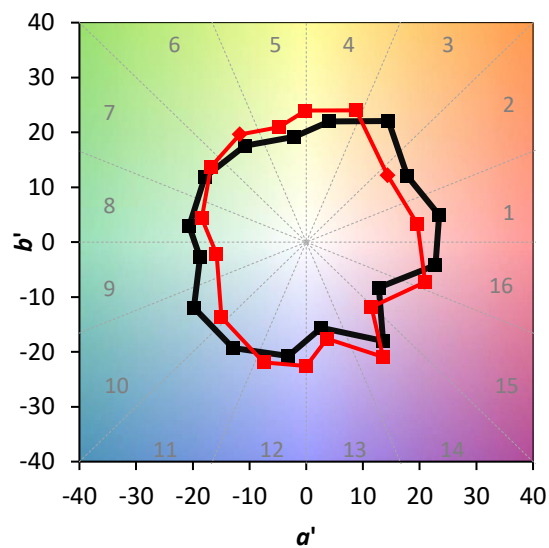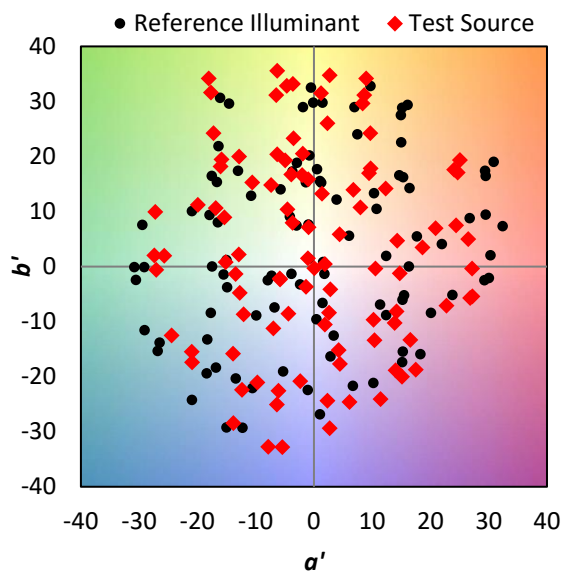


REPORT NUMBER: SP1-2304-001-3

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)




CES01 = 85	CES26 = 57	CES51 = 89	CES76 = 44
CES02 = 59	CES27 = 84	CES52 = 90	CES77 = 64
CES03 = 30	CES28 = 77	CES53 = 78	CES78 = 47
CES04 = 69	CES29 = 59	CES54 = 84	CES79 = 76
CES05 = 46	CES30 = 75	CES55 = 83	CES80 = 72
CES06 = 50	CES31 = 63	CES56 = 73	CES81 = 75
CES07 = 39	CES32 = 55	CES57 = 72	CES82 = 89
CES08 = 38	CES33 = 72	CES58 = 73	CES83 = 86
CES09 = 29	CES34 = 64	CES59 = 87	CES84 = 85
CES10 = 73	CES35 = 80	CES60 = 90	CES85 = 80
CES11 = 56	CES36 = 97	CES61 = 84	CES86 = 76
CES12 = 61	CES37 = 73	CES62 = 85	CES87 = 76
CES13 = 41	CES38 = 84	CES63 = 73	CES88 = 80
CES14 = 74	CES39 = 94	CES64 = 67	CES89 = 75
CES15 = 70	CES40 = 88	CES65 = 62	CES90 = 79
CES16 = 46	CES41 = 90	CES66 = 59	CES91 = 80
CES17 = 49	CES42 = 73	CES67 = 56	CES92 = 64
CES18 = 55	CES43 = 72	CES68 = 65	CES93 = 79
CES19 = 71	CES44 = 99	CES69 = 74	CES94 = 57
CES20 = 64	CES45 = 82	CES70 = 54	CES95 = 69
CES21 = 85	CES46 = 82	CES71 = 48	CES96 = 78
CES22 = 77	CES47 = 83	CES72 = 82	CES97 = 85
CES23 = 91	CES48 = 77	CES73 = 44	CES98 = 75
CES24 = 90	CES49 = 80	CES74 = 93	CES99 = 63
CES25 = 71	CES50 = 89	CES75 = 48	

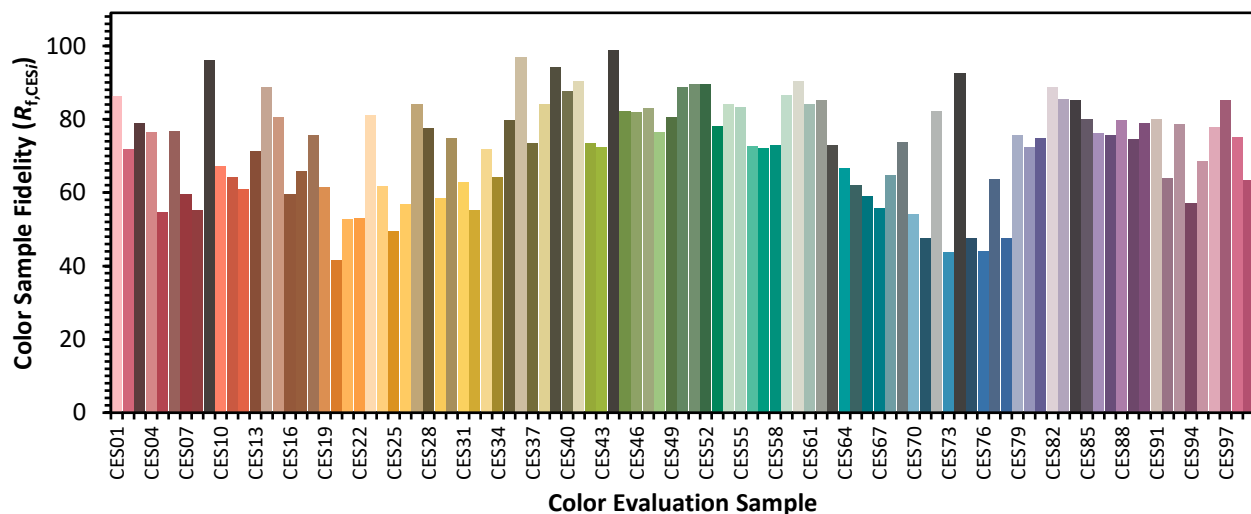

REPORT NUMBER: SP1-2304-001-3

TM-30-18



Color Rendition by Hue-Angle Bin

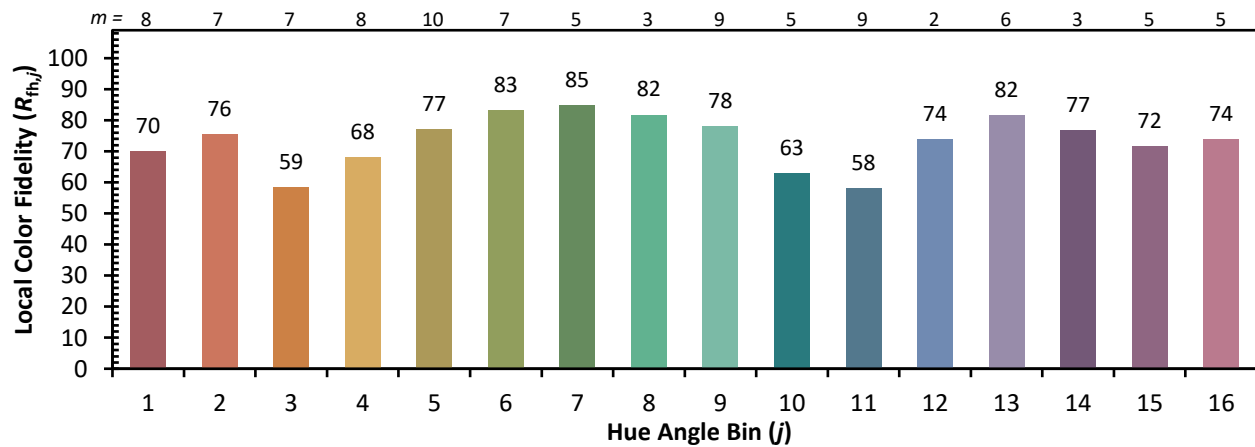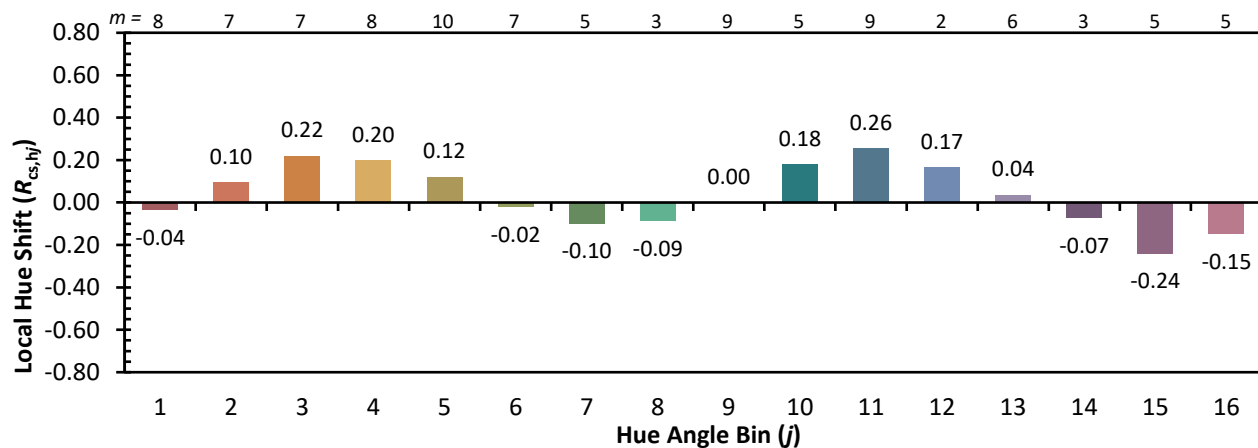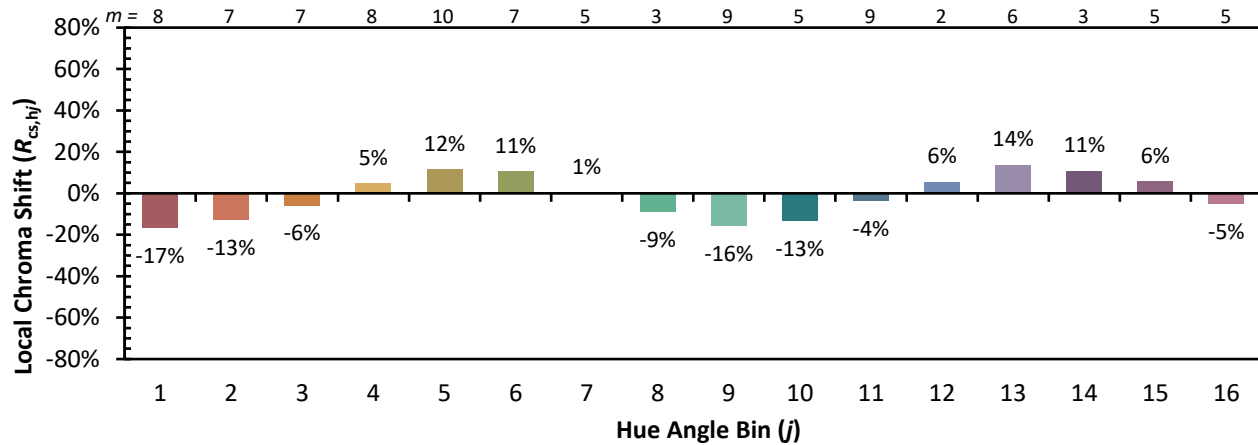

REPORT NUMBER: SP1-2304-001-3

TM-30-18

Measure Comparisons

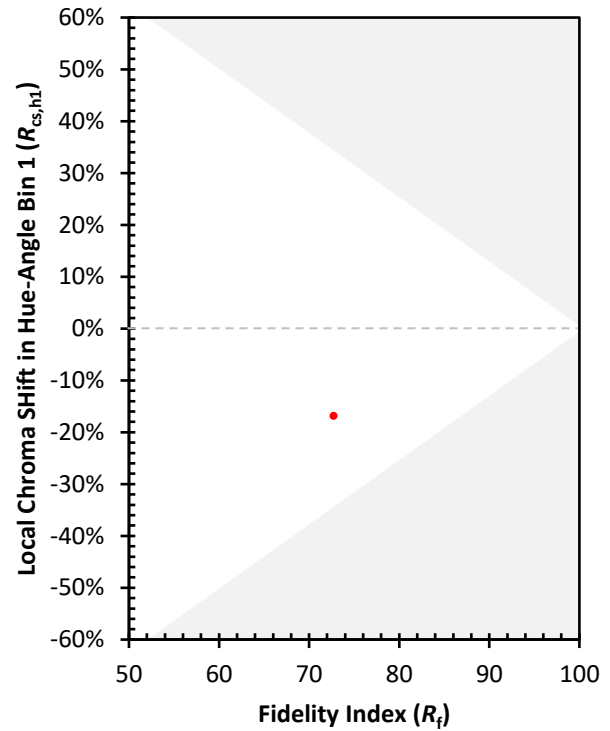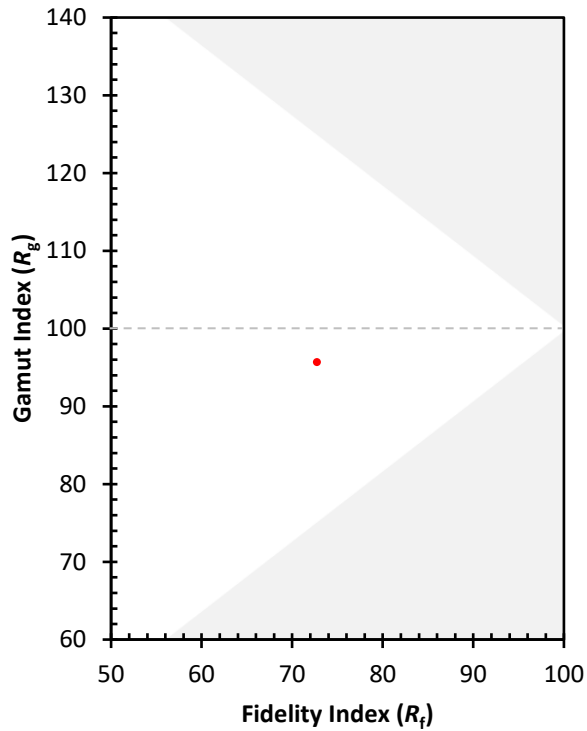

(END OF REPORT)