

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P982614

Luminaire Tested: 14CZ-LD5-39-UNV-L935-RDP-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P982614
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 14CZ-LD5-39-UNV-L935-RDP-CD1-U
Description: METALUX CRUZE 1x4 3900LM PACKAGE 90CRI 3500K TROFFER LENS WITH RDP FILM INSERT
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2531.5 lumens
Efficiency: N/A
Efficacy: 92.7 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.28 / 1.4
Luminous Opening: Rectangular (W 1' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 27.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P982614

CATALOG NUMBER: 14CZ-LD5-39-UNV-L935-RDP-CD1-U

Luminous Intensity Polar Plot

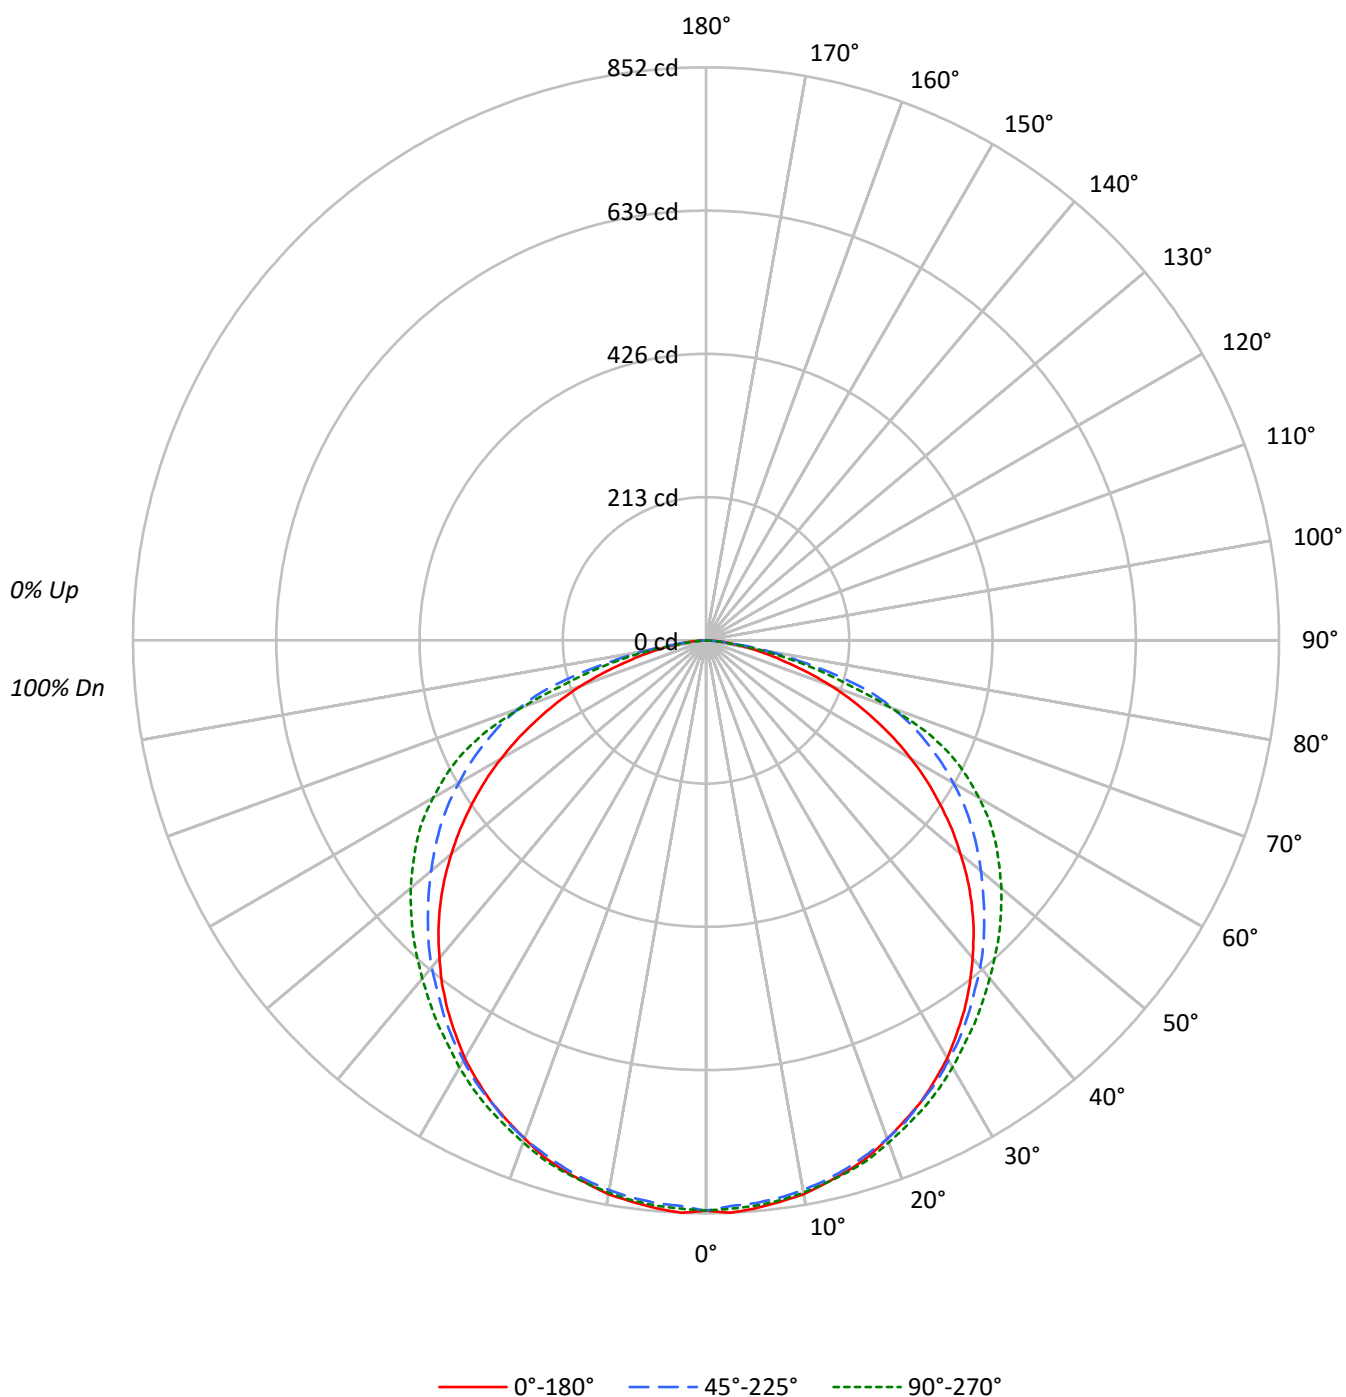

TEST NUMBER: P982614

CATALOG NUMBER: 14CZ-LD5-39-UNV-L935-RDP-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91	93	91	88	90	88	86	86	86	84
2	99	90	83	77	96	88	82	76	85	79	75	81	77	73	78	75	71	71	71	69
3	90	79	71	64	87	77	70	63	74	68	62	71	66	61	69	64	60	60	60	58
4	82	70	61	54	80	68	60	53	66	58	53	63	57	52	61	56	51	51	51	49
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	44	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	50	44	39	39	39	37
7	64	50	42	35	62	50	41	35	48	40	35	47	40	35	45	39	34	34	34	32
8	60	46	37	31	58	45	37	31	44	36	31	43	36	31	41	35	31	31	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	28	28	26
10	52	39	31	25	51	38	31	25	37	30	25	36	30	25	35	29	25	25	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2282	2282	2282
5°	2290	2269	2280
10°	2285	2269	2279
15°	2274	2263	2279
20°	2258	2258	2275
25°	2247	2247	2277
30°	2229	2241	2279
35°	2201	2233	2286
40°	2166	2229	2305
45°	2128	2226	2347
50°	2069	2234	2400
55°	1993	2262	2467
60°	1893	2287	2521
65°	1749	2315	2555
70°	1555	2332	2286
75°	1253	2096	1829
80°	979	1469	1195
85°	670	429	306

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 65°

Luminance: 2555 cd/sqm

TEST NUMBER: P982614

CATALOG NUMBER: 14CZ-LD5-39-UNV-L935-RDP-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	80.3	3.2
10°-20°	230.2	9.1
20°-30°	350.6	13.8
30°-40°	427.0	16.9
40°-50°	453.0	17.9
50°-60°	427.6	16.9
60°-70°	345.2	13.6
70°-80°	187.3	7.4
80°-90°	30.3	1.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	661.1	26.1
0°-40°	1088.1	43.0
0°-60°	1968.7	77.8
0°-90°	2531.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2531.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	848	848	848	848	848	
5°	848	846	840	846	844	81
15°	816	814	812	818	818	230
25°	757	755	757	765	767	348
35°	670	674	680	694	696	419
45°	559	567	585	607	617	431
55°	425	443	482	514	526	380
65°	275	308	364	393	401	272
75°	120	176	202	182	176	132
85°	22	24	14	12	10	28
90°	0	0	0	0	0	

TEST NUMBER: P982614

CATALOG NUMBER: 14CZ-LD5-39-UNV-L935-RDP-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	847.9	847.9	847.9	847.9	847.9
2.5°	851.9	847.9	842.0	847.9	846.0
5°	847.9	846.0	839.9	846.0	843.9
7.5°	842.0	842.0	836.1	839.9	839.9
10°	836.1	834.0	830.2	836.1	834.0
12.5°	826.2	824.1	822.2	828.1	826.2
15°	816.3	814.2	812.3	818.2	818.2
17.5°	804.5	802.4	800.5	808.3	808.3
20°	788.5	788.5	788.5	796.5	794.6
22.5°	772.7	772.7	774.8	782.6	780.7
25°	756.9	755.0	756.9	764.9	766.8
27.5°	737.3	739.2	741.1	749.1	751.0
30°	717.5	719.4	721.3	731.2	733.3
32.5°	693.7	697.7	701.7	713.5	713.5
35°	670.1	673.9	679.8	693.7	695.8
37.5°	644.4	648.2	656.2	672.0	676.0
40°	616.6	622.5	634.5	650.3	656.2
42.5°	589.0	596.8	610.7	628.6	636.4
45°	559.3	567.3	585.0	606.7	616.6
47.5°	527.7	537.6	559.3	586.9	594.9
50°	494.2	507.9	533.6	563.3	573.2
52.5°	460.5	476.3	507.9	539.5	549.4
55°	424.9	442.8	482.2	513.8	525.8
57.5°	389.3	409.1	454.6	488.1	500.1
60°	351.8	375.6	424.9	458.6	468.5
62.5°	314.3	341.9	395.2	428.9	436.7
65°	274.7	308.4	363.6	393.3	401.3
67.5°	237.2	276.8	332.0	353.7	353.7
70°	197.6	241.2	296.4	302.3	290.5
72.5°	158.2	207.5	257.0	235.1	225.4
75°	120.5	175.9	201.6	181.8	175.9
77.5°	91.0	142.4	142.4	130.4	126.4
80°	63.2	108.7	94.8	83.0	77.1
82.5°	41.5	61.3	49.5	39.6	33.5
85°	21.7	23.8	13.9	11.8	9.9
87.5°	8.0	4.0	1.9	4.0	1.9
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-6

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L935-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L935-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-6
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L935-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 935 SMOOTH LENS

Spectral Parameters

CCT (K): 3412
 CIE u' : 0.2386
 CIE v' : 0.5111
 Duv: -0.0015
 CIE x: 0.4087
 CIE y: 0.3890
 CIE z: 0.2023
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 581
 Purity: 39.41044
 R_f: 92.6
 R_g: 102

CRI (Ra): 96.3
 R1: 99.2
 R2: 97.9
 R3: 94.7
 R4: 96.6
 R5: 98.4
 R6: 96.1
 R7: 95.6
 R8: 92.0
 R9: 78.4
 R10: 93.0
 R11: 94.5
 R12: 81.5
 R13: 99.0
 R14: 95.8
 R15: 96.7



Test Conditions

Stabilization Time: 20M
 Operation Time: 1H 20M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-6

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-6

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	112	NR	620	281	NR	750	6	NR	880	0	NR
365	0	NR	495	134	NR	625	286	NR	755	5	NR	885	0	NR
370	0	NR	500	157	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	178	NR	635	695	NR	765	4	NR	895	0	NR
380	0	NR	510	193	NR	640	181	NR	770	3	NR	900	0	NR
385	0	NR	515	206	NR	645	175	NR	775	3	NR	905	0	NR
390	0	NR	520	213	NR	650	156	NR	780	2	NR	910	0	NR
395	1	NR	525	219	NR	655	127	NR	785	2	NR	915	0	NR
400	2	NR	530	223	NR	660	108	NR	790	2	NR	920	0	NR
405	2	NR	535	226	NR	665	89	NR	795	2	NR	925	0	NR
410	4	NR	540	230	NR	670	84	NR	800	1	NR	930	0	NR
415	6	NR	545	235	NR	675	67	NR	805	1	NR	935	0	NR
420	11	NR	550	239	NR	680	57	NR	810	1	NR	940	0	NR
425	19	NR	555	243	NR	685	50	NR	815	1	NR	945	0	NR
430	34	NR	560	248	NR	690	42	NR	820	1	NR	950	0	NR
435	60	NR	565	253	NR	695	36	NR	825	1	NR	955	0	NR
440	106	NR	570	256	NR	700	31	NR	830	0	NR	960	0	NR
445	193	NR	575	260	NR	705	26	NR	835	0	NR	965	0	NR
450	283	NR	580	263	NR	710	22	NR	840	0	NR	970	0	NR
455	234	NR	585	266	NR	715	19	NR	845	0	NR	975	0	NR
460	157	NR	590	267	NR	720	16	NR	850	0	NR	980	0	NR
465	134	NR	595	266	NR	725	14	NR	855	0	NR	985	0	NR
470	107	NR	600	268	NR	730	12	NR	860	0	NR	990	0	NR
475	85	NR	605	269	NR	735	10	NR	865	0	NR	995	0	NR
480	85	NR	610	309	NR	740	8	NR	870	0	NR	1000	0	NR
485	96	NR	615	345	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-6

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.61

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	112	NR	620	281	NR	750	6	NR	880	0	NR
365	0	NR	495	134	NR	625	286	NR	755	5	NR	885	0	NR
370	0	NR	500	157	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	178	NR	635	695	NR	765	4	NR	895	0	NR
380	0	NR	510	193	NR	640	181	NR	770	3	NR	900	0	NR
385	0	NR	515	206	NR	645	175	NR	775	3	NR	905	0	NR
390	0	NR	520	213	NR	650	156	NR	780	2	NR	910	0	NR
395	1	NR	525	219	NR	655	127	NR	785	2	NR	915	0	NR
400	2	NR	530	223	NR	660	108	NR	790	2	NR	920	0	NR
405	2	NR	535	226	NR	665	89	NR	795	2	NR	925	0	NR
410	4	NR	540	230	NR	670	84	NR	800	1	NR	930	0	NR
415	6	NR	545	235	NR	675	67	NR	805	1	NR	935	0	NR
420	11	NR	550	239	NR	680	57	NR	810	1	NR	940	0	NR
425	19	NR	555	243	NR	685	50	NR	815	1	NR	945	0	NR
430	34	NR	560	248	NR	690	42	NR	820	1	NR	950	0	NR
435	60	NR	565	253	NR	695	36	NR	825	1	NR	955	0	NR
440	106	NR	570	256	NR	700	31	NR	830	0	NR	960	0	NR
445	193	NR	575	260	NR	705	26	NR	835	0	NR	965	0	NR
450	283	NR	580	263	NR	710	22	NR	840	0	NR	970	0	NR
455	234	NR	585	266	NR	715	19	NR	845	0	NR	975	0	NR
460	157	NR	590	267	NR	720	16	NR	850	0	NR	980	0	NR
465	134	NR	595	266	NR	725	14	NR	855	0	NR	985	0	NR
470	107	NR	600	268	NR	730	12	NR	860	0	NR	990	0	NR
475	85	NR	605	269	NR	735	10	NR	865	0	NR	995	0	NR
480	85	NR	610	309	NR	740	8	NR	870	0	NR	1000	0	NR
485	96	NR	615	345	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-6

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.24

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	112	NR	620	281	NR	750	6	NR	880	0	NR
365	0	NR	495	134	NR	625	286	NR	755	5	NR	885	0	NR
370	0	NR	500	157	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	178	NR	635	695	NR	765	4	NR	895	0	NR
380	0	NR	510	193	NR	640	181	NR	770	3	NR	900	0	NR
385	0	NR	515	206	NR	645	175	NR	775	3	NR	905	0	NR
390	0	NR	520	213	NR	650	156	NR	780	2	NR	910	0	NR
395	1	NR	525	219	NR	655	127	NR	785	2	NR	915	0	NR
400	2	NR	530	223	NR	660	108	NR	790	2	NR	920	0	NR
405	2	NR	535	226	NR	665	89	NR	795	2	NR	925	0	NR
410	4	NR	540	230	NR	670	84	NR	800	1	NR	930	0	NR
415	6	NR	545	235	NR	675	67	NR	805	1	NR	935	0	NR
420	11	NR	550	239	NR	680	57	NR	810	1	NR	940	0	NR
425	19	NR	555	243	NR	685	50	NR	815	1	NR	945	0	NR
430	34	NR	560	248	NR	690	42	NR	820	1	NR	950	0	NR
435	60	NR	565	253	NR	695	36	NR	825	1	NR	955	0	NR
440	106	NR	570	256	NR	700	31	NR	830	0	NR	960	0	NR
445	193	NR	575	260	NR	705	26	NR	835	0	NR	965	0	NR
450	283	NR	580	263	NR	710	22	NR	840	0	NR	970	0	NR
455	234	NR	585	266	NR	715	19	NR	845	0	NR	975	0	NR
460	157	NR	590	267	NR	720	16	NR	850	0	NR	980	0	NR
465	134	NR	595	266	NR	725	14	NR	855	0	NR	985	0	NR
470	107	NR	600	268	NR	730	12	NR	860	0	NR	990	0	NR
475	85	NR	605	269	NR	735	10	NR	865	0	NR	995	0	NR
480	85	NR	610	309	NR	740	8	NR	870	0	NR	1000	0	NR
485	96	NR	615	345	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-6


TM-30-18

Summary

$R_f = 92.6$
 $R_g = 102$
 $\text{CIE } R_a = 96.3$
 $R_9 = 78.4$



Color Vector Graphics

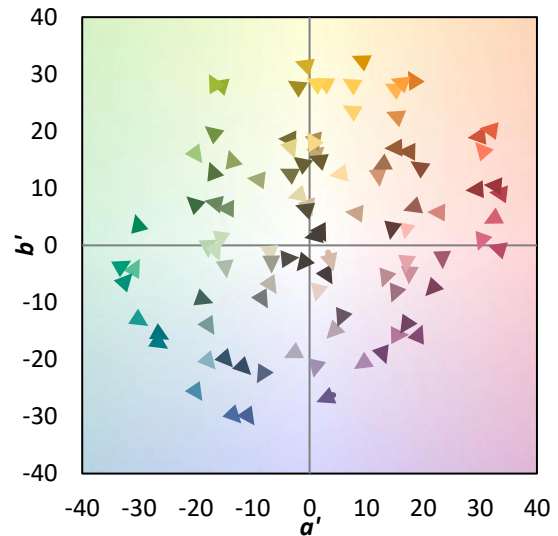

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 94	CES51 = 97	CES76 = 88
CES02 = 63	CES27 = 93	CES52 = 96	CES77 = 88
CES03 = 32	CES28 = 96	CES53 = 95	CES78 = 84
CES04 = 70	CES29 = 95	CES54 = 95	CES79 = 92
CES05 = 50	CES30 = 96	CES55 = 95	CES80 = 92
CES06 = 51	CES31 = 95	CES56 = 98	CES81 = 77
CES07 = 43	CES32 = 87	CES57 = 98	CES82 = 96
CES08 = 42	CES33 = 97	CES58 = 98	CES83 = 95
CES09 = 29	CES34 = 93	CES59 = 100	CES84 = 95
CES10 = 75	CES35 = 96	CES60 = 94	CES85 = 82
CES11 = 58	CES36 = 84	CES61 = 95	CES86 = 84
CES12 = 64	CES37 = 93	CES62 = 90	CES87 = 92
CES13 = 44	CES38 = 91	CES63 = 95	CES88 = 99
CES14 = 74	CES39 = 98	CES64 = 95	CES89 = 86
CES15 = 72	CES40 = 96	CES65 = 92	CES90 = 98
CES16 = 48	CES41 = 97	CES66 = 93	CES91 = 77
CES17 = 49	CES42 = 90	CES67 = 92	CES92 = 81
CES18 = 56	CES43 = 91	CES68 = 91	CES93 = 88
CES19 = 71	CES44 = 99	CES69 = 92	CES94 = 78
CES20 = 67	CES45 = 94	CES70 = 89	CES95 = 86
CES21 = 86	CES46 = 95	CES71 = 85	CES96 = 93
CES22 = 78	CES47 = 90	CES72 = 95	CES97 = 93
CES23 = 91	CES48 = 96	CES73 = 84	CES98 = 96
CES24 = 90	CES49 = 93	CES74 = 91	CES99 = 97
CES25 = 71	CES50 = 97	CES75 = 86	



Color Rendition by Hue-Angle Bin



Measure Comparisons


(END OF REPORT)