

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P982548

Luminaire Tested: 14CZ-LD5-39-UNV-L940-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P982548
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 14CZ-LD5-39-UNV-L940-CD1-U
Description: METALUX CRUZE 1x4 3900LM PACKAGE 90CRI 4000K TROFFER STANDARD LENS
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3893.1 lumens
Efficiency: N/A
Efficacy: 142.6 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.28 / 1.37
Luminous Opening: Rectangular (W 1' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 27.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P982548

CATALOG NUMBER: 14CZ-LD5-39-UNV-L940-CD1-U

Luminous Intensity Polar Plot

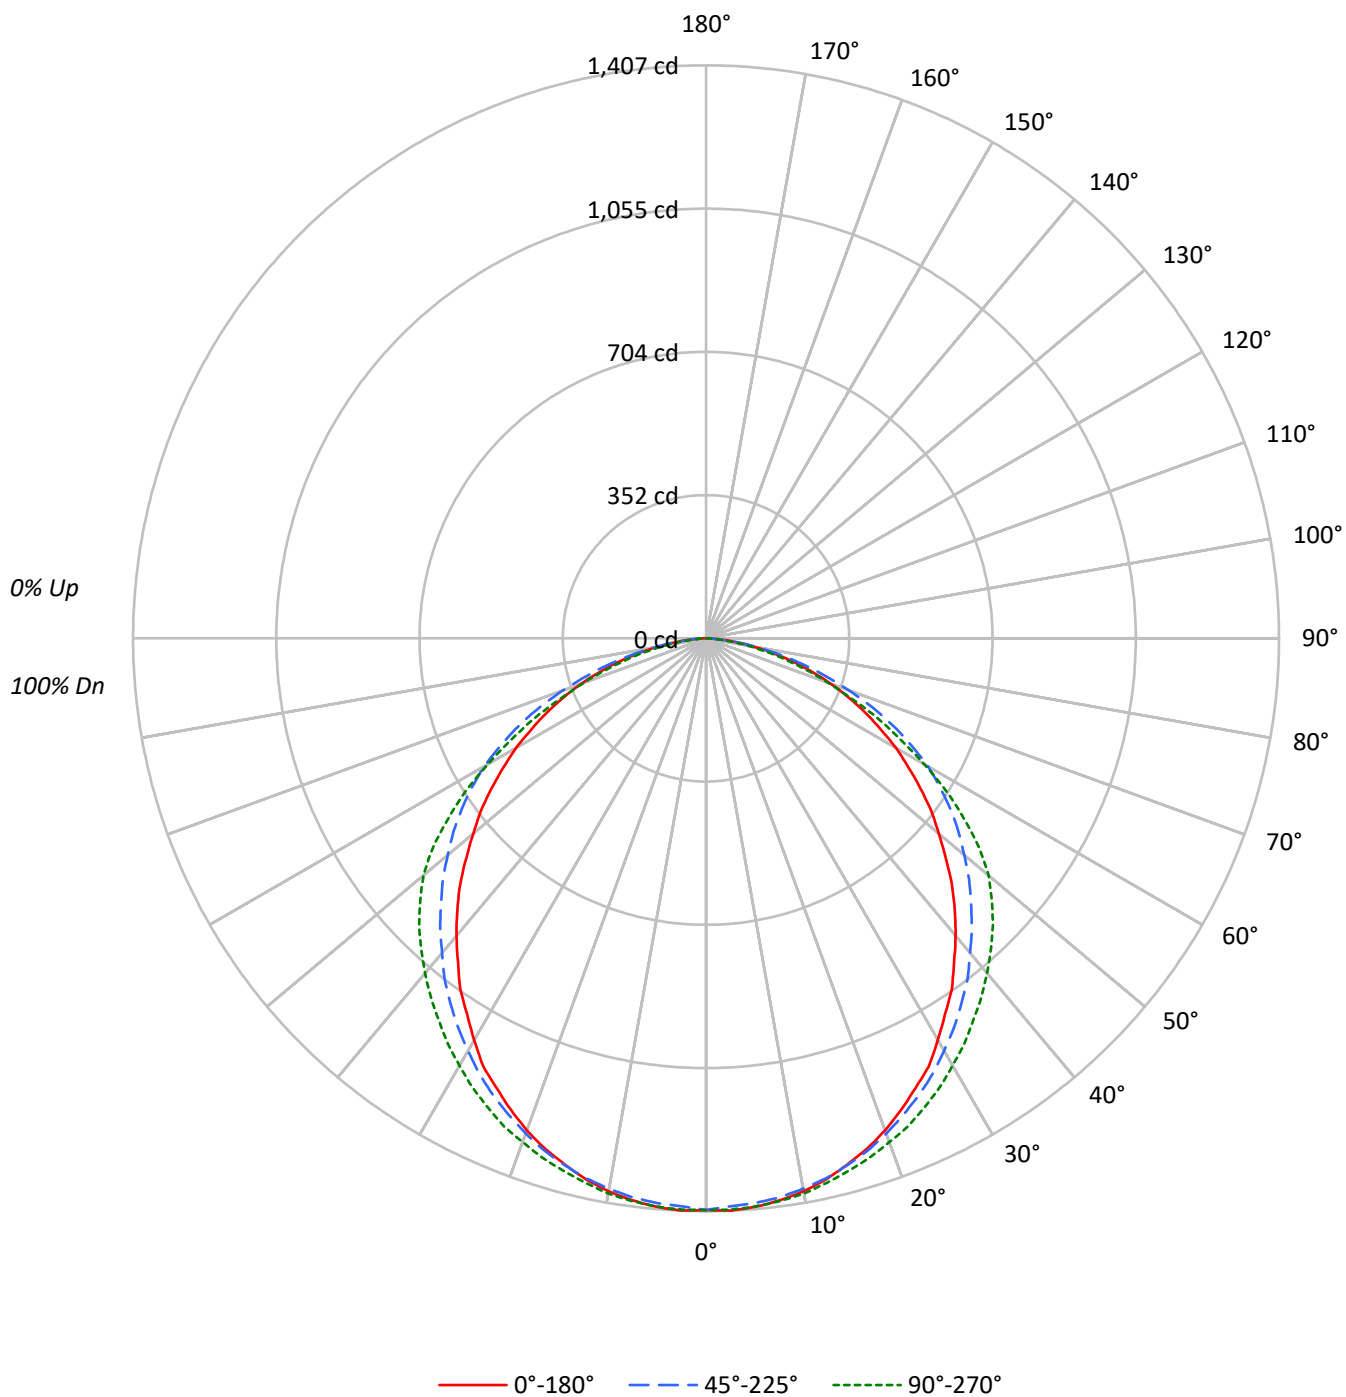

TEST NUMBER: P982548

CATALOG NUMBER: 14CZ-LD5-39-UNV-L940-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	109	104	100	96	106	102	98	95	98	95	92		94	91	89		90
2	99	91	84	79	97	89	83	78	86	80	76		82	78	74		79
3	90	80	72	66	88	78	71	65	75	69	64		73	67	63		70
4	83	71	62	56	81	70	61	55	67	60	54		65	59	54		63
5	76	63	54	48	74	62	54	48	60	53	47		58	52	46		56
6	70	57	48	42	68	56	48	42	54	47	41		53	46	41		51
7	65	52	43	37	63	51	43	37	49	42	36		48	41	36		47
8	61	47	39	33	59	46	38	33	45	38	33		44	37	32		43
9	57	43	35	30	55	43	35	29	42	34	29		40	34	29		39
10	53	40	32	27	52	39	32	27	38	31	27		37	31	26		37

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3778	3778	3778
5°	3784	3760	3783
10°	3768	3750	3783
15°	3727	3732	3771
20°	3682	3706	3769
25°	3616	3674	3770
30°	3538	3633	3763
35°	3456	3594	3758
40°	3349	3542	3770
45°	3249	3500	3791
50°	3122	3464	3792
55°	3018	3438	3634
60°	2901	3387	3331
65°	2744	3225	2963
70°	2563	2931	2505
75°	2313	2556	2099
80°	1861	2007	1601
85°	1325	1152	831

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 50°

Luminance: 3792 cd/sqm

TEST NUMBER: P982548

CATALOG NUMBER: 14CZ-LD5-39-UNV-L940-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	132.8	3.4
10°-20°	379.4	9.7
20°-30°	572.5	14.7
30°-40°	686.4	17.6
40°-50°	712.3	18.3
50°-60°	643.1	16.5
60°-70°	468.4	12.0
70°-80°	245.6	6.3
80°-90°	52.5	1.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1084.8	27.9
0°-40°	1771.2	45.5
0°-60°	3126.6	80.3
0°-90°	3893.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3893.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1404	1404	1404	1404	1404	
5°	1401	1398	1392	1401	1400	133
15°	1338	1338	1340	1354	1354	377
25°	1218	1224	1237	1264	1270	561
35°	1052	1062	1094	1135	1144	656
45°	854	872	920	978	996	657
55°	643	666	733	776	774	575
65°	431	457	506	483	465	427
75°	222	254	246	212	202	234
85°	43	51	37	29	27	55
90°	0	0	0	0	0	

TEST NUMBER: P982548

CATALOG NUMBER: 14CZ-LD5-39-UNV-L940-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1403.8	1403.8	1403.8	1403.8	1403.8
2.5°	1406.7	1402.9	1395.6	1404.8	1403.8
5°	1401.0	1398.4	1391.8	1401.0	1400.3
7.5°	1391.8	1389.9	1384.3	1394.6	1393.7
10°	1378.8	1376.0	1372.2	1383.5	1384.3
12.5°	1361.1	1360.2	1358.3	1370.3	1369.4
15°	1337.8	1337.8	1339.7	1354.5	1353.6
17.5°	1314.4	1314.4	1319.1	1335.9	1336.8
20°	1285.6	1287.5	1294.1	1314.4	1316.3
22.5°	1253.1	1255.0	1266.1	1292.2	1296.7
25°	1217.7	1224.3	1237.3	1264.2	1269.8
27.5°	1185.1	1186.1	1205.7	1235.4	1242.9
30°	1138.7	1151.6	1169.3	1203.8	1211.1
32.5°	1092.9	1105.9	1133.0	1170.3	1180.4
35°	1052.1	1062.2	1093.9	1134.9	1144.1
37.5°	1000.7	1017.6	1054.7	1097.6	1110.6
40°	953.3	968.1	1008.2	1056.6	1073.3
42.5°	904.0	920.7	966.3	1018.4	1035.3
45°	853.7	872.3	919.8	977.5	996.2
47.5°	798.7	822.1	876.1	934.6	951.4
50°	745.7	770.0	827.5	889.1	905.8
52.5°	697.3	718.8	782.0	838.8	846.2
55°	643.3	665.7	732.7	776.4	774.5
57.5°	589.3	614.5	681.5	708.4	701.1
60°	539.0	562.4	629.4	635.0	619.0
62.5°	483.1	510.2	566.9	558.6	539.0
65°	431.0	457.2	506.5	483.1	465.4
67.5°	377.9	406.0	441.3	406.9	386.4
70°	325.8	359.3	372.5	335.2	318.4
72.5°	272.7	308.1	307.2	271.8	257.8
75°	222.5	254.1	245.8	212.3	201.9
77.5°	169.4	201.0	185.2	160.2	150.8
80°	120.1	149.8	129.5	109.9	103.3
82.5°	81.9	99.6	80.9	64.2	61.4
85°	42.9	51.2	37.3	28.8	26.9
87.5°	15.8	14.9	13.0	12.0	12.0
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-7

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L940-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L940-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-7
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L940-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 940 SMOOTH LENS

Spectral Parameters

CCT (K): 3955
 CIE u' : 0.2264
 CIE v' : 0.5014
 Duv: -0.0009
 CIE x: 0.3818
 CIE y: 0.3758
 CIE z: 0.2424
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 579
 Purity: 27.35334
 R_f: 90.3
 R_g: 99.3

CRI (Ra): 93.6
 R1: 95.0
 R2: 96.2
 R3: 95.3
 R4: 94.7
 R5: 93.8
 R6: 93.5
 R7: 94.0
 R8: 86.7
 R9: 65.5
 R10: 88.9
 R11: 94.8
 R12: 71.7
 R13: 95.4
 R14: 96.7
 R15: 92.2



Test Conditions

Stabilization Time: 22M
 Operation Time: 1H 22M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-7

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-7

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.77

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.69

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

TM-30-18

Summary

$R_f = 90.3$
 $R_g = 99.3$
 $CIE\ R_a = 93.6$
 $R_9 = 65.5$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 93	CES51 = 97	CES76 = 85
CES02 = 62	CES27 = 90	CES52 = 99	CES77 = 87
CES03 = 31	CES28 = 95	CES53 = 97	CES78 = 82
CES04 = 69	CES29 = 96	CES54 = 92	CES79 = 93
CES05 = 49	CES30 = 89	CES55 = 90	CES80 = 92
CES06 = 50	CES31 = 97	CES56 = 94	CES81 = 80
CES07 = 42	CES32 = 89	CES57 = 92	CES82 = 96
CES08 = 41	CES33 = 98	CES58 = 92	CES83 = 96
CES09 = 29	CES34 = 93	CES59 = 97	CES84 = 93
CES10 = 74	CES35 = 95	CES60 = 91	CES85 = 80
CES11 = 57	CES36 = 77	CES61 = 91	CES86 = 84
CES12 = 63	CES37 = 94	CES62 = 83	CES87 = 91
CES13 = 43	CES38 = 83	CES63 = 91	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 88	CES89 = 85
CES15 = 71	CES40 = 98	CES65 = 87	CES90 = 96
CES16 = 47	CES41 = 96	CES66 = 84	CES91 = 70
CES17 = 49	CES42 = 92	CES67 = 83	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 86	CES93 = 85
CES19 = 71	CES44 = 99	CES69 = 87	CES94 = 76
CES20 = 66	CES45 = 97	CES70 = 84	CES95 = 81
CES21 = 85	CES46 = 97	CES71 = 76	CES96 = 92
CES22 = 78	CES47 = 94	CES72 = 93	CES97 = 95
CES23 = 91	CES48 = 89	CES73 = 78	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 90	CES99 = 93
CES25 = 71	CES50 = 98	CES75 = 79	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)