

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P982795

Luminaire Tested: 22CZ-LD5-24-UNV-L850-RDP-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P982795
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 22CZ-LD5-24-UNV-L850-RDP-CD1-U
Description: METALUX CRUZE 2x2 2400LM PACKAGE 80CRI 5000K TROFFER LENS WITH RDP FILM INSERT
Light Source: 5000K CCT, 80 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1547.1 lumens
Efficiency: N/A
Efficacy: 85.5 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.31 / 1.41
Luminous Opening: Rectangular (W 2' x L: 2' x H: 0')
CIE Type: Direct

Input Watts (W): 18.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P982795

CATALOG NUMBER: 22CZ-LD5-24-UNV-L850-RDP-CD1-U

Luminous Intensity Polar Plot

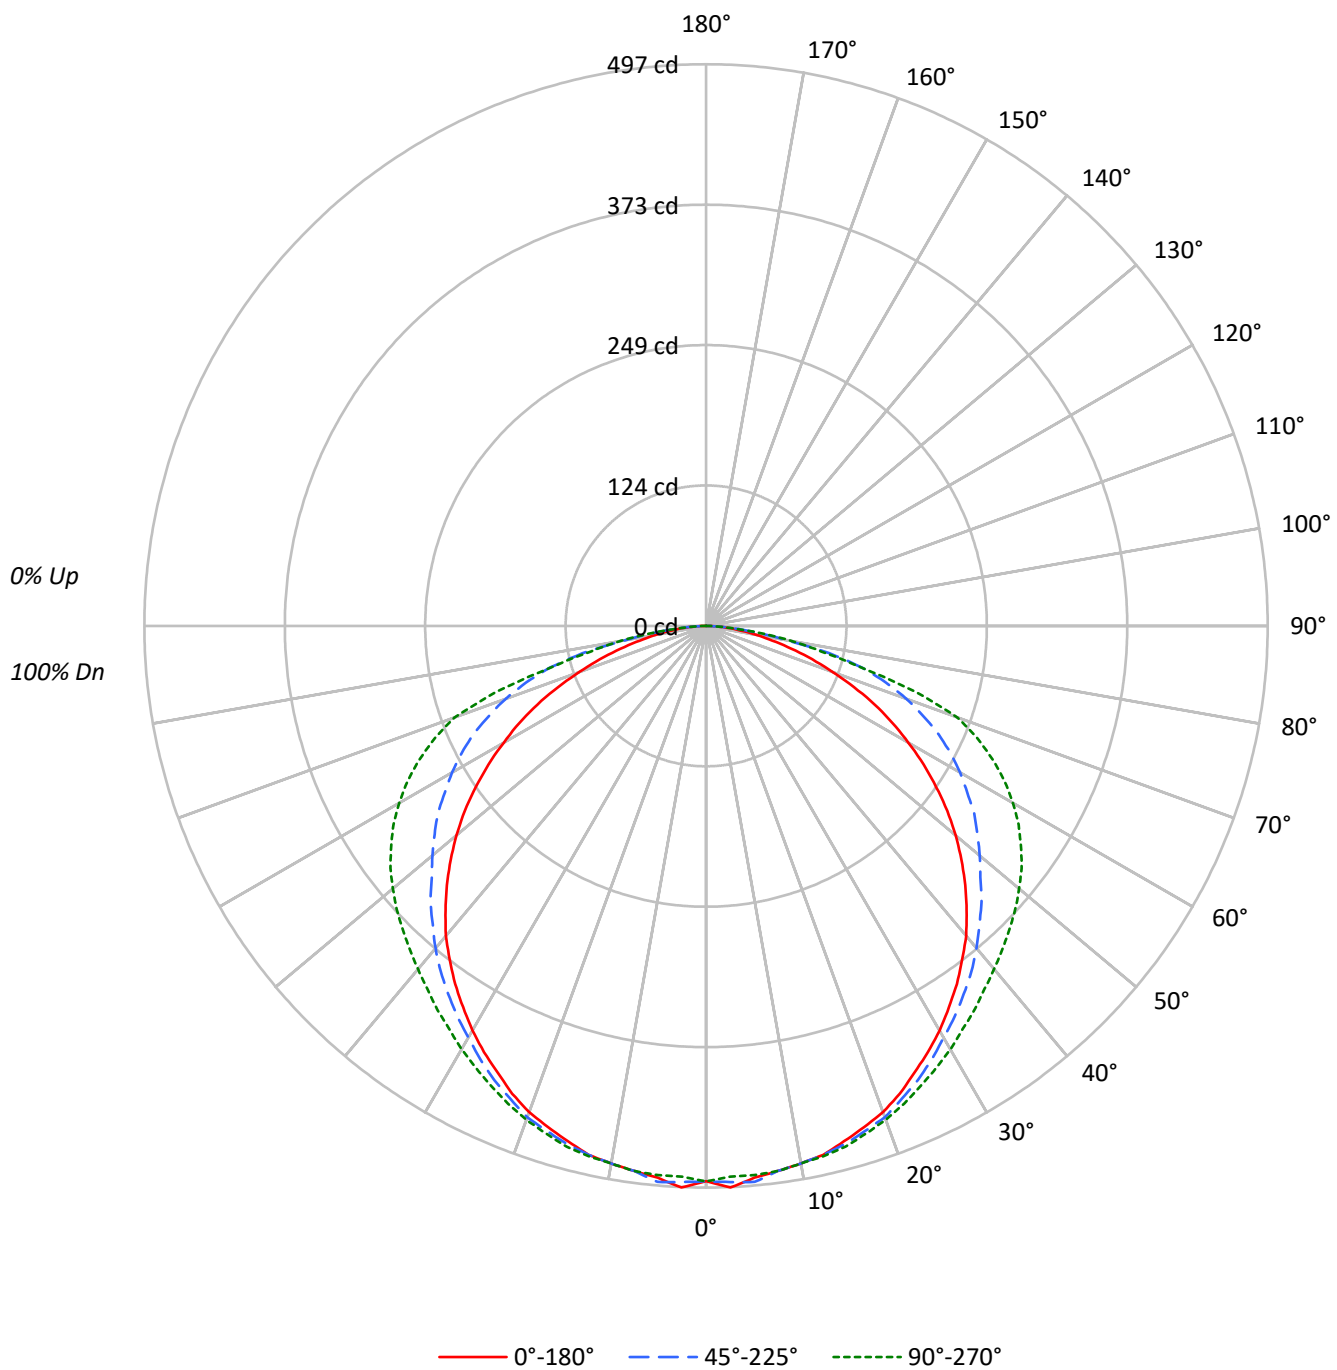

TEST NUMBER: P982795

CATALOG NUMBER: 22CZ-LD5-24-UNV-L850-RDP-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	108	103	99	95	105	101	97	93	97	93	90		93	90	87		89
2	98	89	82	76	95	87	81	75	84	78	73		80	76	71		77
3	89	78	69	62	86	76	68	62	73	66	61		70	64	59		68
4	81	68	59	52	79	67	58	52	64	57	51		62	56	50		60
5	74	61	52	45	72	60	51	44	58	50	44		56	49	43		54
6	68	55	45	39	66	54	45	39	52	44	38		50	43	38		48
7	63	49	40	34	62	49	40	34	47	39	34		45	39	33		44
8	59	45	36	30	57	44	36	30	43	35	30		42	35	30		40
9	55	41	33	27	54	41	33	27	39	32	27		38	32	27		37
10	51	38	30	24	50	37	30	24	36	29	24		35	29	24		35

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1322	1322	1322
5°	1324	1334	1318
10°	1320	1320	1320
15°	1315	1322	1329
20°	1311	1325	1332
25°	1295	1317	1334
30°	1284	1307	1344
35°	1271	1306	1362
40°	1258	1308	1393
45°	1235	1312	1445
50°	1207	1323	1514
55°	1167	1359	1596
60°	1112	1397	1688
65°	1049	1446	1782
70°	935	1485	1862
75°	812	1486	1473
80°	688	1099	1192
85°	593	741	667

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
Vertical Angle: 70°
Luminance: 1862 cd/sqm

TEST NUMBER: P982795

CATALOG NUMBER: 22CZ-LD5-24-UNV-L850-RDP-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	46.7	3.0
10°-20°	134.0	8.7
20°-30°	204.2	13.2
30°-40°	249.8	16.1
40°-50°	268.8	17.4
50°-60°	260.4	16.8
60°-70°	220.6	14.3
70°-80°	133.3	8.6
80°-90°	29.3	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	384.8	24.9
0°-40°	634.7	41.0
0°-60°	1163.9	75.2
0°-90°	1547.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1547.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	491	491	491	491	491	
5°	490	490	494	491	488	47
15°	472	473	475	476	477	133
25°	436	439	443	447	449	201
35°	387	389	398	408	414	242
45°	324	330	345	366	380	250
55°	249	260	290	323	340	222
65°	165	183	227	263	280	162
75°	78	106	143	145	142	84
85°	19	23	24	23	22	22
90°	0	0	0	0	0	

TEST NUMBER: P982795

CATALOG NUMBER: 22CZ-LD5-24-UNV-L850-RDP-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	491.4	491.4	491.4	491.4	491.4
2.5°	497.4	496.3	492.6	490.2	487.8
5°	490.2	490.2	493.9	491.4	487.8
7.5°	486.6	486.6	486.6	492.6	486.6
10°	483.0	484.2	483.0	487.8	483.0
12.5°	479.4	479.4	479.4	480.6	480.6
15°	472.1	473.3	474.6	475.8	477.0
17.5°	465.0	466.2	468.6	469.8	471.0
20°	457.8	459.0	462.6	462.6	465.0
22.5°	448.1	448.1	452.9	454.1	457.8
25°	436.2	438.6	443.4	446.9	449.3
27.5°	425.3	427.7	432.5	437.4	441.0
30°	413.3	415.7	420.5	427.7	432.5
32.5°	400.1	402.5	409.7	418.2	422.9
35°	386.9	389.3	397.7	408.5	414.5
37.5°	372.4	376.0	385.7	397.7	404.9
40°	358.1	361.7	372.4	385.7	396.5
42.5°	341.3	346.0	358.1	376.0	388.1
45°	324.4	330.4	344.8	366.5	379.7
47.5°	306.4	312.4	329.2	356.8	371.2
50°	288.4	295.5	316.0	346.0	361.7
52.5°	269.1	276.3	302.8	335.2	352.0
55°	248.7	259.5	289.6	323.2	340.1
57.5°	228.3	240.3	273.9	310.0	328.0
60°	206.7	221.0	259.5	295.5	313.6
62.5°	186.3	201.8	243.9	279.9	297.9
65°	164.7	182.6	227.1	263.2	279.9
67.5°	141.7	164.7	207.9	242.7	259.5
70°	118.9	145.4	188.7	221.0	236.7
72.5°	98.5	126.2	167.0	194.6	194.6
75°	78.1	105.7	142.9	145.4	141.7
77.5°	60.1	86.5	111.8	102.1	104.5
80°	44.4	66.0	70.9	74.5	76.9
82.5°	30.1	44.4	45.6	48.0	48.0
85°	19.2	22.8	24.0	22.8	21.6
87.5°	8.4	9.6	7.2	4.8	3.6
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-8

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L950-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L950-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-8
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L950-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 950 SMOOTH LENS

Spectral Parameters

CCT (K): 5019
 CIE u' : 0.2113
 CIE v' : 0.4842
 Duv: -0.0002
 CIE x: 0.3445
 CIE y: 0.3508
 CIE z: 0.3046
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 572
 Purity: 8.636369
 R_f: 89.8
 R_g: 98.5

CRI (Ra): 94.6
 R1: 96.4
 R2: 98.4
 R3: 96.9
 R4: 94.5
 R5: 94.5
 R6: 93.5
 R7: 93.6
 R8: 89.4
 R9: 74.6
 R10: 94.2
 R11: 95.5
 R12: 70.8
 R13: 98.0
 R14: 98.0
 R15: 95.0



Test Conditions

Stabilization Time: M
 Operation Time: 1H 0M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-8

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-8

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP3-2508-516-8

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	249	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	269	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	296	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	325	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	347	NR	640	221	NR	770	4	NR	900	0	NR
385	0	NR	515	363	NR	645	210	NR	775	4	NR	905	0	NR
390	1	NR	520	371	NR	650	186	NR	780	3	NR	910	0	NR
395	3	NR	525	378	NR	655	155	NR	785	3	NR	915	0	NR
400	4	NR	530	381	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	383	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	385	NR	670	102	NR	800	2	NR	930	0	NR
415	10	NR	545	389	NR	675	84	NR	805	1	NR	935	0	NR
420	17	NR	550	391	NR	680	72	NR	810	1	NR	940	0	NR
425	29	NR	555	392	NR	685	62	NR	815	1	NR	945	0	NR
430	53	NR	560	393	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	394	NR	695	45	NR	825	1	NR	955	0	NR
440	173	NR	570	391	NR	700	39	NR	830	1	NR	960	0	NR
445	321	NR	575	389	NR	705	33	NR	835	1	NR	965	0	NR
450	597	NR	580	385	NR	710	28	NR	840	1	NR	970	0	NR
455	795	NR	585	382	NR	715	24	NR	845	1	NR	975	0	NR
460	615	NR	590	375	NR	720	21	NR	850	0	NR	980	0	NR
465	438	NR	595	367	NR	725	17	NR	855	0	NR	985	0	NR
470	372	NR	600	361	NR	730	15	NR	860	0	NR	990	0	NR
475	290	NR	605	355	NR	735	13	NR	865	0	NR	995	0	NR
480	236	NR	610	383	NR	740	11	NR	870	0	NR	1000	0	NR
485	232	NR	615	408	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-8

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 2.11

λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)
360	0	NR	490	249	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	269	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	296	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	325	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	347	NR	640	221	NR	770	4	NR	900	0	NR
385	0	NR	515	363	NR	645	210	NR	775	4	NR	905	0	NR
390	1	NR	520	371	NR	650	186	NR	780	3	NR	910	0	NR
395	3	NR	525	378	NR	655	155	NR	785	3	NR	915	0	NR
400	4	NR	530	381	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	383	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	385	NR	670	102	NR	800	2	NR	930	0	NR
415	10	NR	545	389	NR	675	84	NR	805	1	NR	935	0	NR
420	17	NR	550	391	NR	680	72	NR	810	1	NR	940	0	NR
425	29	NR	555	392	NR	685	62	NR	815	1	NR	945	0	NR
430	53	NR	560	393	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	394	NR	695	45	NR	825	1	NR	955	0	NR
440	173	NR	570	391	NR	700	39	NR	830	1	NR	960	0	NR
445	321	NR	575	389	NR	705	33	NR	835	1	NR	965	0	NR
450	597	NR	580	385	NR	710	28	NR	840	1	NR	970	0	NR
455	795	NR	585	382	NR	715	24	NR	845	1	NR	975	0	NR
460	615	NR	590	375	NR	720	21	NR	850	0	NR	980	0	NR
465	438	NR	595	367	NR	725	17	NR	855	0	NR	985	0	NR
470	372	NR	600	361	NR	730	15	NR	860	0	NR	990	0	NR
475	290	NR	605	355	NR	735	13	NR	865	0	NR	995	0	NR
480	236	NR	610	383	NR	740	11	NR	870	0	NR	1000	0	NR
485	232	NR	615	408	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-8

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 4.62

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	249	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	269	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	296	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	325	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	347	NR	640	221	NR	770	4	NR	900	0	NR
385	0	NR	515	363	NR	645	210	NR	775	4	NR	905	0	NR
390	1	NR	520	371	NR	650	186	NR	780	3	NR	910	0	NR
395	3	NR	525	378	NR	655	155	NR	785	3	NR	915	0	NR
400	4	NR	530	381	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	383	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	385	NR	670	102	NR	800	2	NR	930	0	NR
415	10	NR	545	389	NR	675	84	NR	805	1	NR	935	0	NR
420	17	NR	550	391	NR	680	72	NR	810	1	NR	940	0	NR
425	29	NR	555	392	NR	685	62	NR	815	1	NR	945	0	NR
430	53	NR	560	393	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	394	NR	695	45	NR	825	1	NR	955	0	NR
440	173	NR	570	391	NR	700	39	NR	830	1	NR	960	0	NR
445	321	NR	575	389	NR	705	33	NR	835	1	NR	965	0	NR
450	597	NR	580	385	NR	710	28	NR	840	1	NR	970	0	NR
455	795	NR	585	382	NR	715	24	NR	845	1	NR	975	0	NR
460	615	NR	590	375	NR	720	21	NR	850	0	NR	980	0	NR
465	438	NR	595	367	NR	725	17	NR	855	0	NR	985	0	NR
470	372	NR	600	361	NR	730	15	NR	860	0	NR	990	0	NR
475	290	NR	605	355	NR	735	13	NR	865	0	NR	995	0	NR
480	236	NR	610	383	NR	740	11	NR	870	0	NR	1000	0	NR
485	232	NR	615	408	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-8

TM-30-18

Summary

$R_f = 89.8$
 $R_g = 98.5$
 $\text{CIE } R_a = 94.6$
 $R_9 = 74.6$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 96	CES51 = 93	CES76 = 88
CES02 = 61	CES27 = 88	CES52 = 97	CES77 = 87
CES03 = 31	CES28 = 96	CES53 = 95	CES78 = 85
CES04 = 69	CES29 = 93	CES54 = 89	CES79 = 93
CES05 = 48	CES30 = 81	CES55 = 86	CES80 = 93
CES06 = 50	CES31 = 95	CES56 = 90	CES81 = 80
CES07 = 41	CES32 = 93	CES57 = 87	CES82 = 96
CES08 = 40	CES33 = 91	CES58 = 87	CES83 = 95
CES09 = 29	CES34 = 95	CES59 = 96	CES84 = 93
CES10 = 73	CES35 = 96	CES60 = 89	CES85 = 81
CES11 = 56	CES36 = 74	CES61 = 89	CES86 = 85
CES12 = 62	CES37 = 95	CES62 = 78	CES87 = 93
CES13 = 42	CES38 = 76	CES63 = 89	CES88 = 96
CES14 = 74	CES39 = 98	CES64 = 84	CES89 = 87
CES15 = 71	CES40 = 98	CES65 = 86	CES90 = 93
CES16 = 47	CES41 = 92	CES66 = 81	CES91 = 68
CES17 = 48	CES42 = 95	CES67 = 80	CES92 = 78
CES18 = 56	CES43 = 96	CES68 = 85	CES93 = 86
CES19 = 70	CES44 = 99	CES69 = 85	CES94 = 79
CES20 = 65	CES45 = 100	CES70 = 84	CES95 = 82
CES21 = 85	CES46 = 96	CES71 = 75	CES96 = 93
CES22 = 77	CES47 = 91	CES72 = 92	CES97 = 96
CES23 = 91	CES48 = 84	CES73 = 80	CES98 = 94
CES24 = 90	CES49 = 97	CES74 = 89	CES99 = 92
CES25 = 70	CES50 = 95	CES75 = 78	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)