

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P982742

Luminaire Tested: 22CZ-LD5-29-UNV-L940-HRP-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P982742
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 22CZ-LD5-29-UNV-L940-HRP-CD1-U
Description: METALUX CRUZE 2x2 2900LM PACKAGE 90CRI 4000K TROFFER LENS WITH HRP FILM INSERT
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2276.6 lumens
Efficiency: N/A
Efficacy: 108.9 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.3 / 1.4
Luminous Opening: Rectangular (W 2' x L: 2' x H: 0')
CIE Type: Direct

Input Watts (W): 20.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P982742

CATALOG NUMBER: 22CZ-LD5-29-UNV-L940-HRP-CD1-U

Luminous Intensity Polar Plot

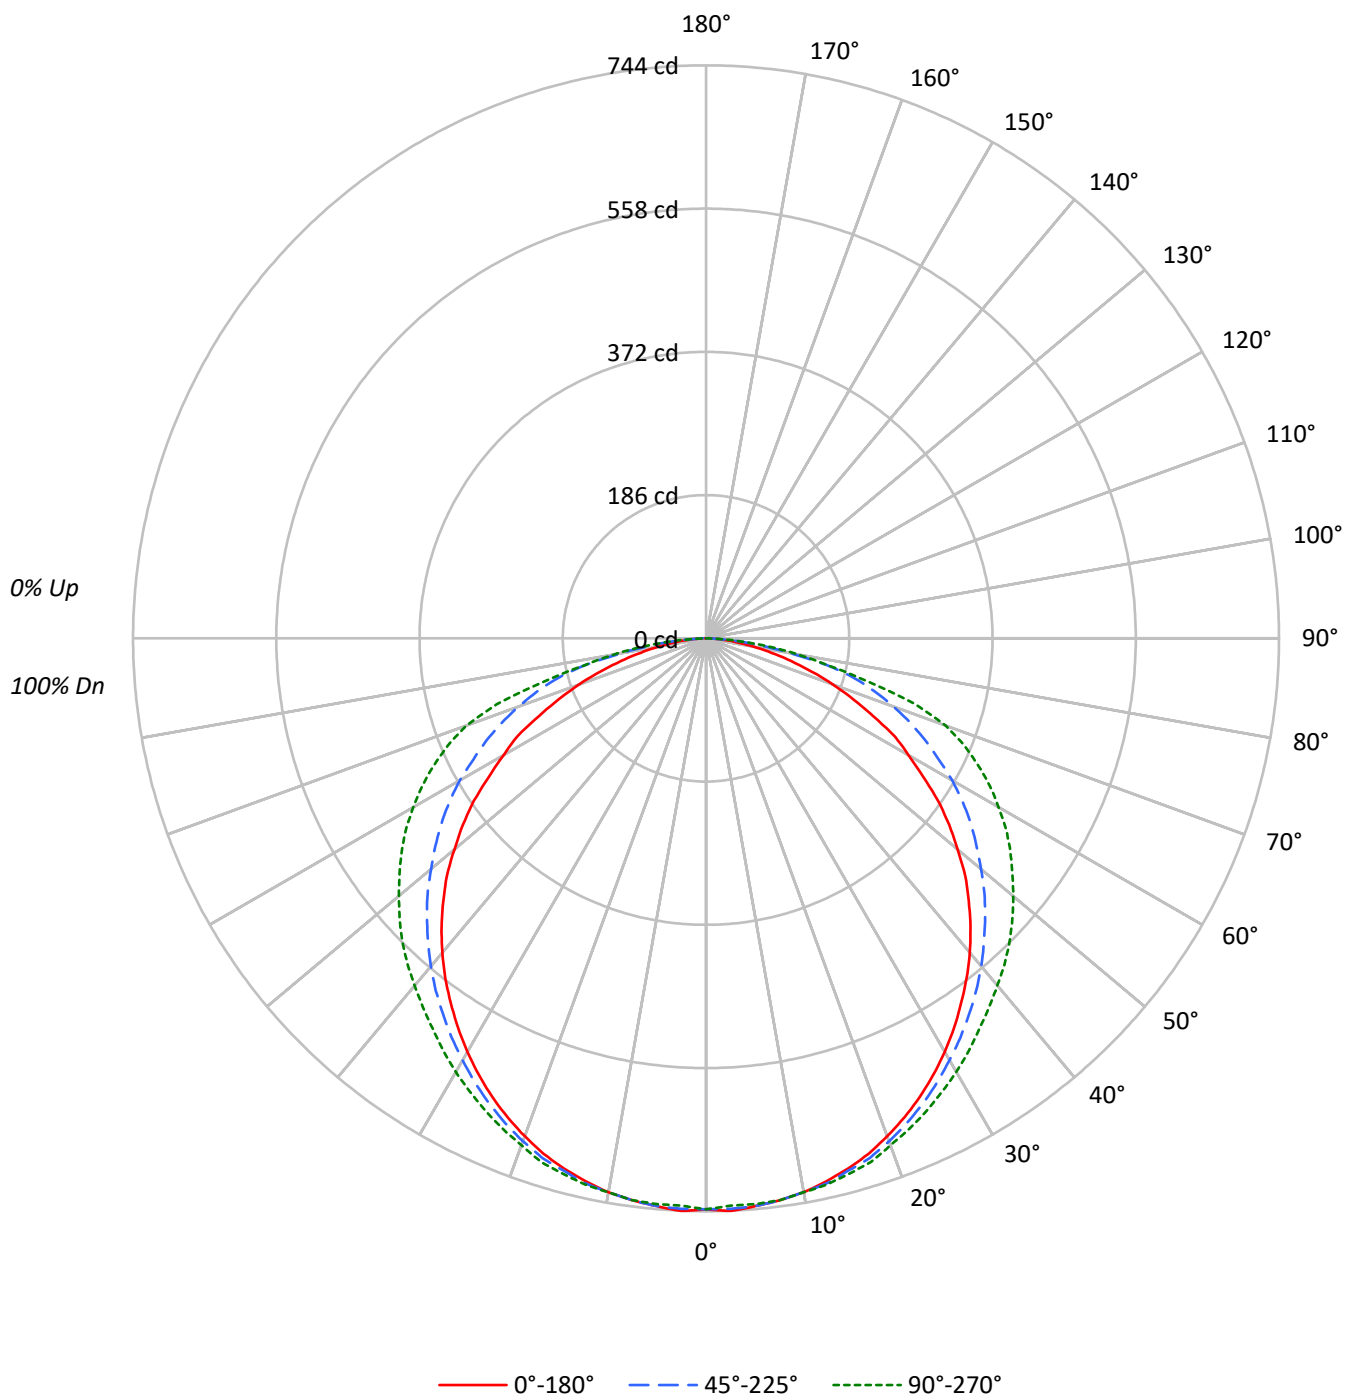

TEST NUMBER: P982742

CATALOG NUMBER: 22CZ-LD5-29-UNV-L940-HRP-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	108	103	99	95	105	101	97	93	97	93	90		93	90	87		83
2	98	89	82	76	95	87	81	75	84	78	73		80	76	72		68
3	89	78	69	63	86	76	68	62	73	67	61		71	65	60		57
4	81	69	60	53	79	67	59	52	65	57	52		63	56	51		48
5	75	61	52	45	72	60	51	45	58	50	44		56	49	44		41
6	69	55	46	39	67	54	45	39	52	44	39		50	44	38		36
7	64	50	41	34	62	49	40	34	47	40	34		46	39	34		32
8	59	45	37	31	58	45	36	31	43	36	30		42	35	30		28
9	55	42	33	28	54	41	33	27	40	32	27		39	32	27		25
10	52	38	30	25	50	38	30	25	37	30	25		36	29	25		23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1995	1995	1995
5°	1999	1999	1991
10°	1996	1996	1996
15°	1986	1993	2004
20°	1970	1990	2006
25°	1950	1979	2011
30°	1927	1965	2020
35°	1898	1957	2032
40°	1872	1953	2068
45°	1836	1950	2121
50°	1786	1951	2179
55°	1727	1969	2263
60°	1635	1988	2362
65°	1527	2004	2481
70°	1383	2037	2605
75°	1189	2068	2281
80°	970	1731	1880
85°	800	1263	1389

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 70°

Luminance: 2605 cd/sqm

TEST NUMBER: P982742

CATALOG NUMBER: 22CZ-LD5-29-UNV-L940-HRP-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	70.3	3.1
10°-20°	202.1	8.9
20°-30°	307.3	13.5
30°-40°	373.9	16.4
40°-50°	398.3	17.5
50°-60°	376.7	16.5
60°-70°	310.5	13.6
70°-80°	191.0	8.4
80°-90°	46.6	2.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	579.7	25.5
0°-40°	953.6	41.9
0°-60°	1728.5	75.9
0°-90°	2276.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2276.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	741	741	741	741	741	
5°	740	740	740	739	737	70
15°	713	714	715	718	720	201
25°	657	660	666	673	677	303
35°	578	583	596	610	619	362
45°	482	490	512	541	557	372
55°	368	382	420	461	482	328
65°	240	263	315	365	390	238
75°	114	146	199	217	219	123
85°	26	34	41	44	45	30
90°	0	0	0	0	0	

TEST NUMBER: P982742

CATALOG NUMBER: 22CZ-LD5-29-UNV-L940-HRP-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	741.4	741.4	741.4	741.4	741.4
2.5°	744.1	742.7	741.4	738.6	737.2
5°	740.0	740.0	740.0	738.6	737.2
7.5°	735.8	735.8	735.8	735.8	735.8
10°	730.4	730.4	730.4	730.4	730.4
12.5°	722.2	723.6	724.9	724.9	726.3
15°	712.7	714.1	715.4	718.1	719.5
17.5°	701.8	703.2	707.3	710.0	712.7
20°	688.1	689.5	695.0	697.8	700.5
22.5°	673.2	675.9	681.3	686.8	689.5
25°	656.9	659.6	666.4	673.2	677.2
27.5°	639.1	641.8	650.1	659.6	663.6
30°	620.0	622.7	632.3	643.3	650.1
32.5°	599.6	603.7	614.6	628.2	635.0
35°	577.8	583.2	595.6	610.5	618.7
37.5°	556.0	561.5	576.4	594.1	603.7
40°	532.8	539.6	556.0	576.4	588.6
42.5°	508.3	516.5	534.2	558.7	573.7
45°	482.4	490.5	512.4	541.0	557.4
47.5°	456.6	466.1	490.5	521.9	539.6
50°	426.5	437.4	466.1	502.9	520.6
52.5°	397.9	411.6	442.8	482.4	501.5
55°	368.0	381.6	419.7	460.6	482.4
57.5°	333.9	350.2	395.1	438.8	462.0
60°	303.8	320.3	369.3	415.7	438.8
62.5°	276.7	291.6	340.7	391.1	415.7
65°	239.8	263.1	314.8	365.2	389.7
67.5°	207.1	233.0	287.5	335.2	362.5
70°	175.8	203.0	258.9	305.2	331.1
72.5°	144.4	174.5	230.3	271.2	284.8
75°	114.4	145.8	198.9	216.7	219.4
77.5°	87.2	118.5	160.8	159.4	162.1
80°	62.6	90.0	111.7	115.8	121.3
82.5°	42.3	62.6	72.3	79.1	84.5
85°	25.9	34.1	40.9	43.6	45.0
87.5°	12.2	13.6	13.6	10.9	10.9
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-7

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L940-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L940-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-7
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L940-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 940 SMOOTH LENS

Spectral Parameters

CCT (K): 3955
 CIE u' : 0.2264
 CIE v' : 0.5014
 Duv: -0.0009
 CIE x: 0.3818
 CIE y: 0.3758
 CIE z: 0.2424
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 579
 Purity: 27.35334
 R_f: 90.3
 R_g: 99.3

CRI (Ra): 93.6
 R1: 95.0
 R2: 96.2
 R3: 95.3
 R4: 94.7
 R5: 93.8
 R6: 93.5
 R7: 94.0
 R8: 86.7
 R9: 65.5
 R10: 88.9
 R11: 94.8
 R12: 71.7
 R13: 95.4
 R14: 96.7
 R15: 92.2



Test Conditions

Stabilization Time: 22M
 Operation Time: 1H 22M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-7

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-7

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



REPORT NUMBER: SP3-2508-516-7

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.77

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.69

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

TM-30-18

Summary

$R_f = 90.3$
 $R_g = 99.3$
 CIE $R_a = 93.6$
 $R_9 = 65.5$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 93	CES51 = 97	CES76 = 85
CES02 = 62	CES27 = 90	CES52 = 99	CES77 = 87
CES03 = 31	CES28 = 95	CES53 = 97	CES78 = 82
CES04 = 69	CES29 = 96	CES54 = 92	CES79 = 93
CES05 = 49	CES30 = 89	CES55 = 90	CES80 = 92
CES06 = 50	CES31 = 97	CES56 = 94	CES81 = 80
CES07 = 42	CES32 = 89	CES57 = 92	CES82 = 96
CES08 = 41	CES33 = 98	CES58 = 92	CES83 = 96
CES09 = 29	CES34 = 93	CES59 = 97	CES84 = 93
CES10 = 74	CES35 = 95	CES60 = 91	CES85 = 80
CES11 = 57	CES36 = 77	CES61 = 91	CES86 = 84
CES12 = 63	CES37 = 94	CES62 = 83	CES87 = 91
CES13 = 43	CES38 = 83	CES63 = 91	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 88	CES89 = 85
CES15 = 71	CES40 = 98	CES65 = 87	CES90 = 96
CES16 = 47	CES41 = 96	CES66 = 84	CES91 = 70
CES17 = 49	CES42 = 92	CES67 = 83	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 86	CES93 = 85
CES19 = 71	CES44 = 99	CES69 = 87	CES94 = 76
CES20 = 66	CES45 = 97	CES70 = 84	CES95 = 81
CES21 = 85	CES46 = 97	CES71 = 76	CES96 = 92
CES22 = 78	CES47 = 94	CES72 = 93	CES97 = 95
CES23 = 91	CES48 = 89	CES73 = 78	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 90	CES99 = 93
CES25 = 71	CES50 = 98	CES75 = 79	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)