

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P982661

Luminaire Tested: 22CZ-LD5-20-UNV-L950-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P982661
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 22CZ-LD5-20-UNV-L950-CD1-U
Description: METALUX CRUZE 2x2 2000LM PACKAGE 90CRI 5000K TROFFER STANDARD LENS
Light Source: 5000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1894.0 lumens
Efficiency: N/A
Efficacy: 126.3 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.26 / 1.34
Luminous Opening: Rectangular (W 2' x L: 2' x H: 0')
CIE Type: Direct

Input Watts (W): 15
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P982661

CATALOG NUMBER: 22CZ-LD5-20-UNV-L950-CD1-U

Luminous Intensity Polar Plot

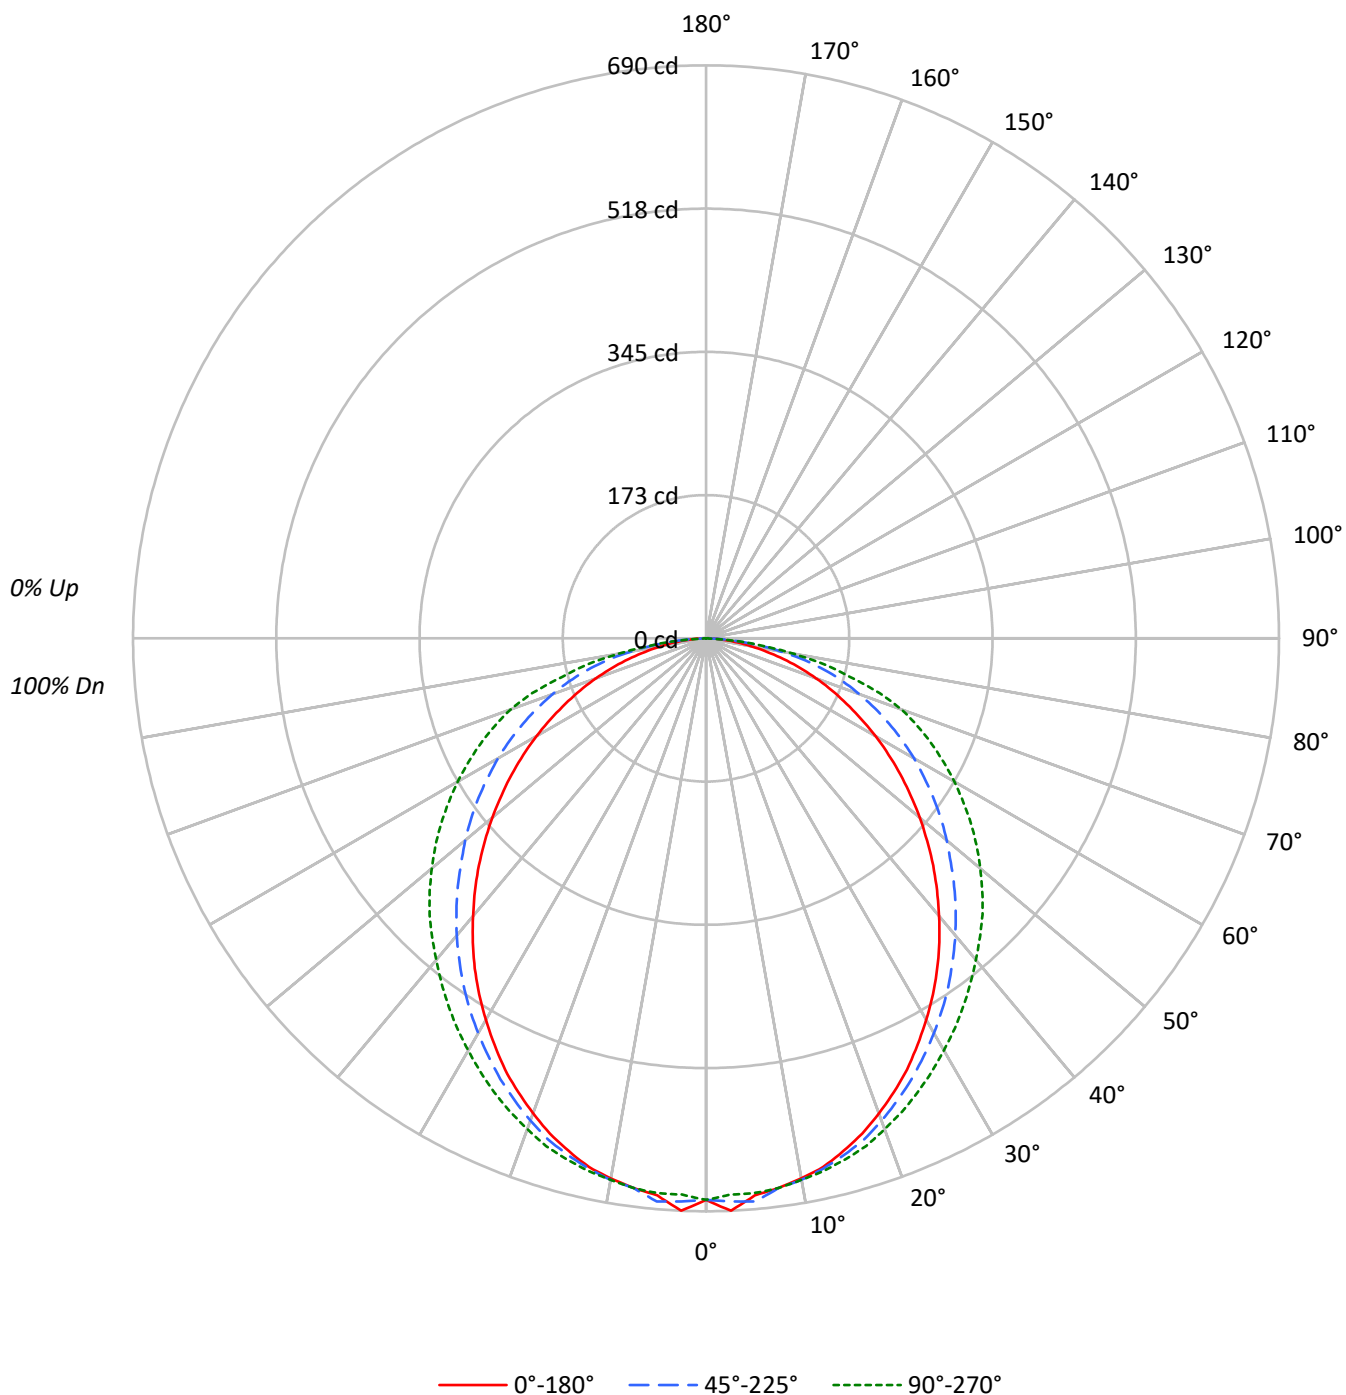

TEST NUMBER: P982661

CATALOG NUMBER: 22CZ-LD5-20-UNV-L950-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	108	104	99	95	106	101	97	94	97	94	91		93	90	88		89
2	98	90	83	77	96	88	82	76	84	79	74		81	77	73		78
3	90	79	70	64	87	77	69	63	74	68	62		71	66	61		69
4	82	70	61	54	80	68	60	54	66	59	53		64	57	52		61
5	75	62	53	46	73	61	53	46	59	51	46		57	50	45		55
6	70	56	47	41	68	55	47	40	53	46	40		52	45	40		50
7	65	51	42	36	63	50	42	36	48	41	35		47	40	35		46
8	60	46	38	32	58	46	38	32	44	37	32		43	36	31		42
9	56	43	34	29	55	42	34	29	41	34	29		40	33	28		39
10	53	39	31	26	51	39	31	26	38	31	26		37	30	26		36

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1819	1819	1819
5°	1819	1838	1811
10°	1805	1809	1809
15°	1781	1794	1809
20°	1743	1770	1801
25°	1701	1739	1791
30°	1648	1706	1780
35°	1595	1673	1776
40°	1533	1640	1776
45°	1472	1609	1791
50°	1407	1585	1804
55°	1340	1568	1828
60°	1269	1556	1859
65°	1190	1549	1906
70°	1109	1544	1971
75°	1005	1542	1867
80°	871	1427	1657
85°	741	1081	1050

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 70°

Luminance: 1971 cd/sqm

TEST NUMBER: P982661

CATALOG NUMBER: 22CZ-LD5-20-UNV-L950-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	64.1	3.4
10°-20°	181.6	9.6
20°-30°	270.2	14.3
30°-40°	319.5	16.9
40°-50°	328.4	17.3
50°-60°	300.1	15.8
60°-70°	240.1	12.7
70°-80°	150.7	8.0
80°-90°	39.3	2.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	515.9	27.2
0°-40°	835.5	44.1
0°-60°	1464.0	77.3
0°-90°	1894.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1894.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	676	676	676	676	676	
5°	673	673	681	676	670	64
15°	639	640	644	648	649	180
25°	573	577	586	596	603	263
35°	485	492	509	529	541	303
45°	387	397	423	454	471	298
55°	286	299	334	371	390	255
65°	187	204	243	280	299	186
75°	97	115	148	170	180	103
85°	24	30	35	34	34	28
90°	0	0	0	0	0	

TEST NUMBER: P982661

CATALOG NUMBER: 22CZ-LD5-20-UNV-L950-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	676.1	676.1	676.1	676.1	676.1
2.5°	689.9	687.1	678.8	673.3	670.5
5°	673.3	673.3	680.6	676.1	670.5
7.5°	667.7	667.7	667.7	681.6	667.7
10°	660.4	661.3	662.2	667.7	662.2
12.5°	652.1	652.1	653.9	655.7	656.7
15°	639.2	640.1	643.8	647.5	649.3
17.5°	625.4	628.1	632.8	637.4	641.0
20°	608.8	612.5	618.0	625.4	629.0
22.5°	591.3	595.0	602.3	610.6	617.0
25°	572.9	576.6	585.8	595.9	603.2
27.5°	551.7	556.3	567.4	581.2	588.5
30°	530.5	536.1	549.0	564.6	572.9
32.5°	508.4	514.8	529.6	547.0	557.2
35°	485.4	491.8	509.4	528.7	540.6
37.5°	461.4	468.8	488.1	510.3	523.2
40°	436.5	444.9	467.0	490.9	505.6
42.5°	411.7	420.9	444.9	473.4	488.1
45°	386.8	397.0	422.7	454.1	470.7
47.5°	361.0	373.0	399.7	434.7	451.3
50°	336.2	348.1	378.5	414.5	431.0
52.5°	310.4	324.2	356.5	393.2	410.8
55°	285.6	299.4	334.3	371.2	389.6
57.5°	260.7	274.5	311.3	349.1	367.5
60°	235.8	250.5	289.2	326.0	345.4
62.5°	210.9	226.5	266.2	303.9	322.3
65°	186.9	203.6	243.2	280.0	299.4
67.5°	164.0	181.4	220.1	256.0	275.4
70°	140.9	158.4	196.2	231.2	250.5
72.5°	118.9	136.3	173.1	204.5	219.2
75°	96.7	115.1	148.3	170.4	179.6
77.5°	75.5	94.0	122.5	137.2	147.4
80°	56.2	71.8	92.1	103.1	106.9
82.5°	38.7	51.6	64.5	67.3	69.1
85°	24.0	30.4	35.0	34.0	34.0
87.5°	11.1	12.0	10.2	7.4	4.6
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-8

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L950-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L950-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-8
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L950-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 950 SMOOTH LENS

Spectral Parameters

CCT (K): 5019
 CIE u' : 0.2113
 CIE v' : 0.4842
 Duv: -0.0002
 CIE x: 0.3445
 CIE y: 0.3508
 CIE z: 0.3046
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 572
 Purity: 8.636369
 R_f: 89.8
 R_g: 98.5

CRI (Ra): 94.6
 R1: 96.4
 R2: 98.4
 R3: 96.9
 R4: 94.5
 R5: 94.5
 R6: 93.5
 R7: 93.6
 R8: 89.4
 R9: 74.6
 R10: 94.2
 R11: 95.5
 R12: 70.8
 R13: 98.0
 R14: 98.0
 R15: 95.0



Test Conditions

Stabilization Time: M
 Operation Time: 1H 0M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-8

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-8

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP3-2508-516-8

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	249	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	269	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	296	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	325	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	347	NR	640	221	NR	770	4	NR	900	0	NR
385	0	NR	515	363	NR	645	210	NR	775	4	NR	905	0	NR
390	1	NR	520	371	NR	650	186	NR	780	3	NR	910	0	NR
395	3	NR	525	378	NR	655	155	NR	785	3	NR	915	0	NR
400	4	NR	530	381	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	383	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	385	NR	670	102	NR	800	2	NR	930	0	NR
415	10	NR	545	389	NR	675	84	NR	805	1	NR	935	0	NR
420	17	NR	550	391	NR	680	72	NR	810	1	NR	940	0	NR
425	29	NR	555	392	NR	685	62	NR	815	1	NR	945	0	NR
430	53	NR	560	393	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	394	NR	695	45	NR	825	1	NR	955	0	NR
440	173	NR	570	391	NR	700	39	NR	830	1	NR	960	0	NR
445	321	NR	575	389	NR	705	33	NR	835	1	NR	965	0	NR
450	597	NR	580	385	NR	710	28	NR	840	1	NR	970	0	NR
455	795	NR	585	382	NR	715	24	NR	845	1	NR	975	0	NR
460	615	NR	590	375	NR	720	21	NR	850	0	NR	980	0	NR
465	438	NR	595	367	NR	725	17	NR	855	0	NR	985	0	NR
470	372	NR	600	361	NR	730	15	NR	860	0	NR	990	0	NR
475	290	NR	605	355	NR	735	13	NR	865	0	NR	995	0	NR
480	236	NR	610	383	NR	740	11	NR	870	0	NR	1000	0	NR
485	232	NR	615	408	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-8

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 2.11

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	249	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	269	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	296	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	325	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	347	NR	640	221	NR	770	4	NR	900	0	NR
385	0	NR	515	363	NR	645	210	NR	775	4	NR	905	0	NR
390	1	NR	520	371	NR	650	186	NR	780	3	NR	910	0	NR
395	3	NR	525	378	NR	655	155	NR	785	3	NR	915	0	NR
400	4	NR	530	381	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	383	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	385	NR	670	102	NR	800	2	NR	930	0	NR
415	10	NR	545	389	NR	675	84	NR	805	1	NR	935	0	NR
420	17	NR	550	391	NR	680	72	NR	810	1	NR	940	0	NR
425	29	NR	555	392	NR	685	62	NR	815	1	NR	945	0	NR
430	53	NR	560	393	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	394	NR	695	45	NR	825	1	NR	955	0	NR
440	173	NR	570	391	NR	700	39	NR	830	1	NR	960	0	NR
445	321	NR	575	389	NR	705	33	NR	835	1	NR	965	0	NR
450	597	NR	580	385	NR	710	28	NR	840	1	NR	970	0	NR
455	795	NR	585	382	NR	715	24	NR	845	1	NR	975	0	NR
460	615	NR	590	375	NR	720	21	NR	850	0	NR	980	0	NR
465	438	NR	595	367	NR	725	17	NR	855	0	NR	985	0	NR
470	372	NR	600	361	NR	730	15	NR	860	0	NR	990	0	NR
475	290	NR	605	355	NR	735	13	NR	865	0	NR	995	0	NR
480	236	NR	610	383	NR	740	11	NR	870	0	NR	1000	0	NR
485	232	NR	615	408	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-8

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 4.62

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	249	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	269	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	296	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	325	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	347	NR	640	221	NR	770	4	NR	900	0	NR
385	0	NR	515	363	NR	645	210	NR	775	4	NR	905	0	NR
390	1	NR	520	371	NR	650	186	NR	780	3	NR	910	0	NR
395	3	NR	525	378	NR	655	155	NR	785	3	NR	915	0	NR
400	4	NR	530	381	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	383	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	385	NR	670	102	NR	800	2	NR	930	0	NR
415	10	NR	545	389	NR	675	84	NR	805	1	NR	935	0	NR
420	17	NR	550	391	NR	680	72	NR	810	1	NR	940	0	NR
425	29	NR	555	392	NR	685	62	NR	815	1	NR	945	0	NR
430	53	NR	560	393	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	394	NR	695	45	NR	825	1	NR	955	0	NR
440	173	NR	570	391	NR	700	39	NR	830	1	NR	960	0	NR
445	321	NR	575	389	NR	705	33	NR	835	1	NR	965	0	NR
450	597	NR	580	385	NR	710	28	NR	840	1	NR	970	0	NR
455	795	NR	585	382	NR	715	24	NR	845	1	NR	975	0	NR
460	615	NR	590	375	NR	720	21	NR	850	0	NR	980	0	NR
465	438	NR	595	367	NR	725	17	NR	855	0	NR	985	0	NR
470	372	NR	600	361	NR	730	15	NR	860	0	NR	990	0	NR
475	290	NR	605	355	NR	735	13	NR	865	0	NR	995	0	NR
480	236	NR	610	383	NR	740	11	NR	870	0	NR	1000	0	NR
485	232	NR	615	408	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-8

TM-30-18

Summary

$R_f = 89.8$
 $R_g = 98.5$
 $\text{CIE } R_a = 94.6$
 $R_9 = 74.6$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 96	CES51 = 93	CES76 = 88
CES02 = 61	CES27 = 88	CES52 = 97	CES77 = 87
CES03 = 31	CES28 = 96	CES53 = 95	CES78 = 85
CES04 = 69	CES29 = 93	CES54 = 89	CES79 = 93
CES05 = 48	CES30 = 81	CES55 = 86	CES80 = 93
CES06 = 50	CES31 = 95	CES56 = 90	CES81 = 80
CES07 = 41	CES32 = 93	CES57 = 87	CES82 = 96
CES08 = 40	CES33 = 91	CES58 = 87	CES83 = 95
CES09 = 29	CES34 = 95	CES59 = 96	CES84 = 93
CES10 = 73	CES35 = 96	CES60 = 89	CES85 = 81
CES11 = 56	CES36 = 74	CES61 = 89	CES86 = 85
CES12 = 62	CES37 = 95	CES62 = 78	CES87 = 93
CES13 = 42	CES38 = 76	CES63 = 89	CES88 = 96
CES14 = 74	CES39 = 98	CES64 = 84	CES89 = 87
CES15 = 71	CES40 = 98	CES65 = 86	CES90 = 93
CES16 = 47	CES41 = 92	CES66 = 81	CES91 = 68
CES17 = 48	CES42 = 95	CES67 = 80	CES92 = 78
CES18 = 56	CES43 = 96	CES68 = 85	CES93 = 86
CES19 = 70	CES44 = 99	CES69 = 85	CES94 = 79
CES20 = 65	CES45 = 100	CES70 = 84	CES95 = 82
CES21 = 85	CES46 = 96	CES71 = 75	CES96 = 93
CES22 = 77	CES47 = 91	CES72 = 92	CES97 = 96
CES23 = 91	CES48 = 84	CES73 = 80	CES98 = 94
CES24 = 90	CES49 = 97	CES74 = 89	CES99 = 92
CES25 = 70	CES50 = 95	CES75 = 78	



Color Rendition by Hue-Angle Bin


Measure Comparisons



(END OF REPORT)