

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P982955

Luminaire Tested: 24CZ-LD5-75-UNV-L935-S-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P982955
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24CZ-LD5-75-UNV-L935-S-CD1-U
Description: METALUX CRUZE 2x4 7500LM PACKAGE 90CRI 3500K TROFFER SMOOTH LENS
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7432.8 lumens
Efficiency: N/A
Efficacy: 134.2 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.23 / 1.33
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 55.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P982955

CATALOG NUMBER: 24CZ-LD5-75-UNV-L935-S-CD1-U

Luminous Intensity Polar Plot

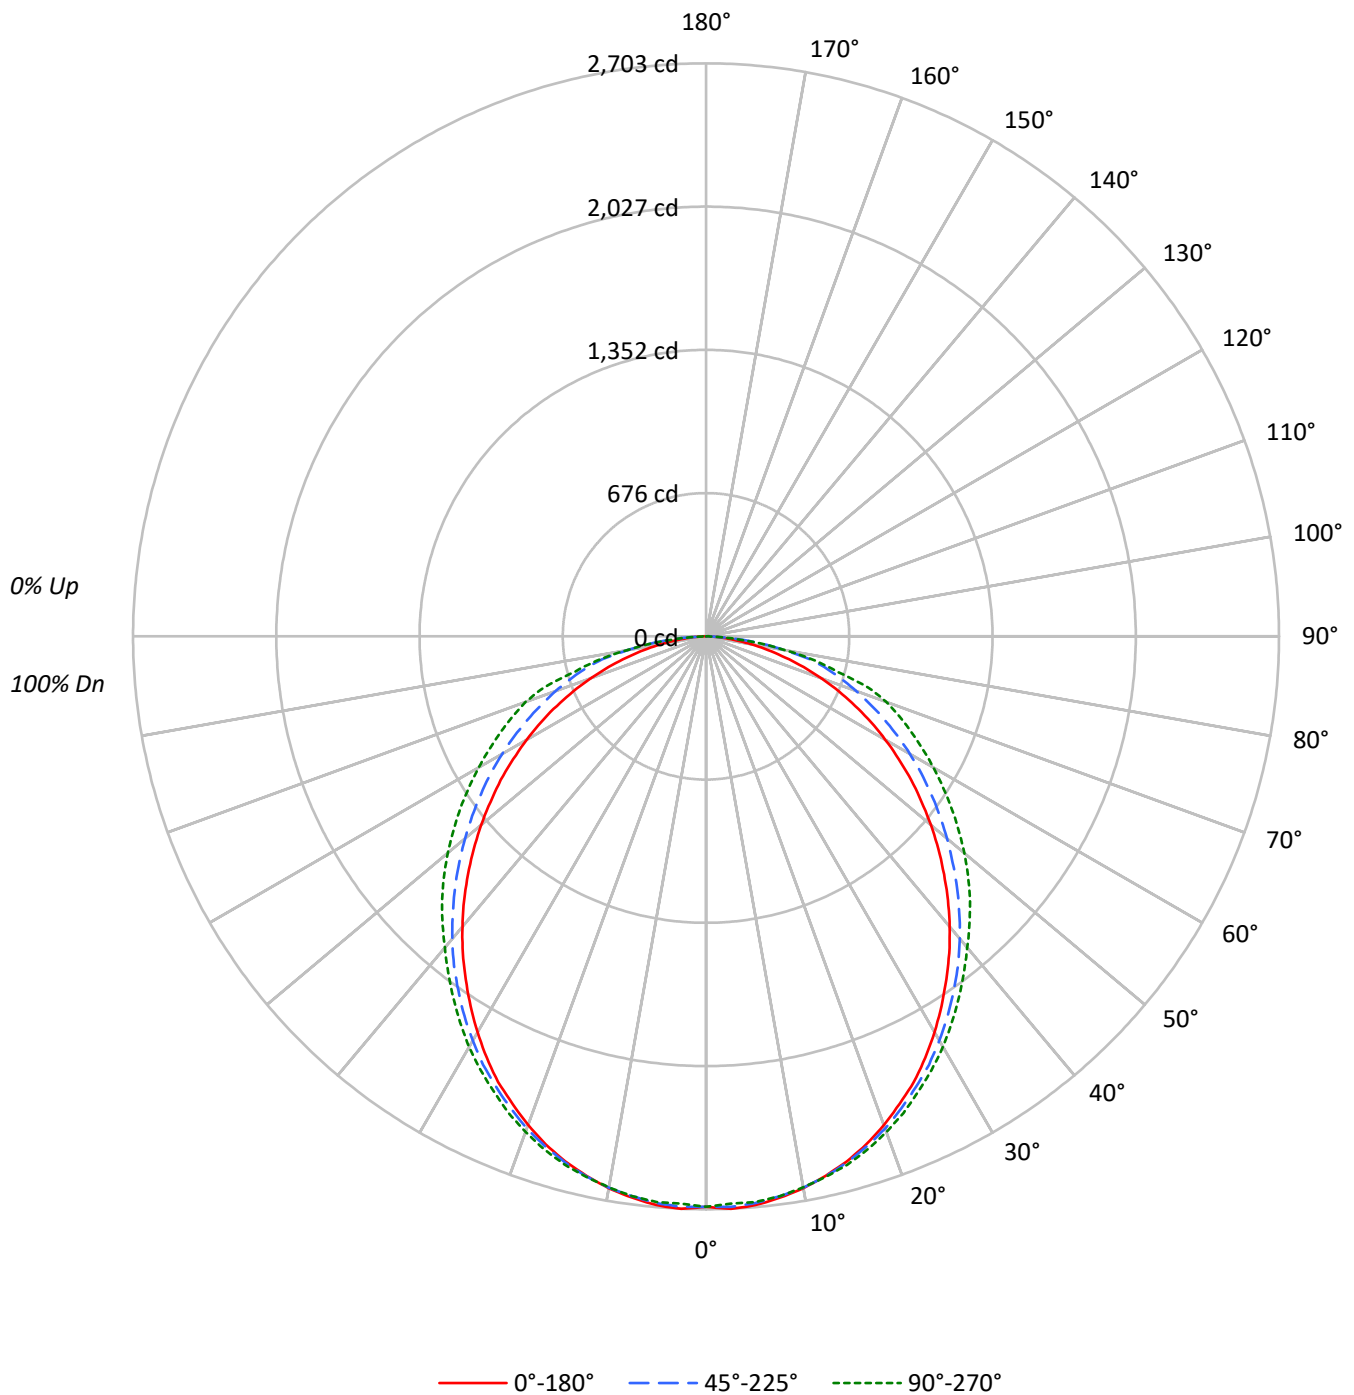

TEST NUMBER: P982955

CATALOG NUMBER: 24CZ-LD5-75-UNV-L935-S-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	108	104	99	95	106	101	97	94	97	94	91		93	90	88		89
2	99	90	83	77	96	88	82	76	85	79	75		81	77	73		78
3	90	79	71	64	87	77	70	64	74	68	62		72	66	61		69
4	82	70	61	54	80	69	60	54	66	59	53		64	58	52		62
5	76	63	53	47	73	61	53	47	59	52	46		57	51	45		55
6	70	56	47	41	68	55	47	41	54	46	40		52	45	40		50
7	65	51	42	36	63	50	42	36	49	41	36		47	41	35		46
8	60	47	38	32	59	46	38	32	45	37	32		43	37	32		42
9	56	43	35	29	55	42	34	29	41	34	29		40	33	29		39
10	53	40	32	26	52	39	31	26	38	31	26		37	31	26		36

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3620	3620	3620
5°	3638	3624	3618
10°	3612	3609	3605
15°	3573	3579	3593
20°	3513	3538	3562
25°	3444	3481	3517
30°	3351	3420	3473
35°	3246	3347	3416
40°	3141	3271	3367
45°	3021	3186	3351
50°	2899	3106	3329
55°	2773	3040	3318
60°	2629	2988	3334
65°	2472	2953	3401
70°	2277	2967	3561
75°	2019	3073	3317
80°	1686	2913	2989
85°	1260	2330	2138

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 72.5°

Luminance: 3585 cd/sqm

TEST NUMBER: P982955

CATALOG NUMBER: 24CZ-LD5-75-UNV-L935-S-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	254.4	3.4
10°-20°	723.5	9.7
20°-30°	1078.3	14.5
30°-40°	1269.3	17.1
40°-50°	1289.9	17.4
50°-60°	1159.7	15.6
60°-70°	916.2	12.3
70°-80°	581.2	7.8
80°-90°	160.4	2.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2056.2	27.7
0°-40°	3325.5	44.7
0°-60°	5775.0	77.7
0°-90°	7432.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7432.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2691	2691	2691	2691	2691	
5°	2693	2671	2683	2678	2678	255
15°	2565	2552	2570	2577	2580	722
25°	2320	2317	2345	2359	2369	1067
35°	1976	1988	2038	2060	2080	1236
45°	1588	1610	1674	1724	1761	1225
55°	1182	1212	1296	1380	1415	1056
65°	777	816	927	1029	1068	769
75°	388	455	591	643	638	413
85°	82	141	151	138	138	100
90°	0	0	0	0	0	

TEST NUMBER: P982955

CATALOG NUMBER: 24CZ-LD5-75-UNV-L935-S-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2690.8	2690.8	2690.8	2690.8	2690.8
2.5°	2703.2	2683.4	2693.3	2688.4	2678.4
5°	2693.3	2671.1	2683.4	2678.4	2678.4
7.5°	2671.1	2653.7	2663.7	2661.1	2663.7
10°	2643.8	2626.5	2641.4	2641.4	2638.9
12.5°	2606.8	2591.9	2609.2	2609.2	2611.7
15°	2564.7	2552.3	2569.6	2577.1	2579.5
17.5°	2512.8	2500.4	2522.6	2530.1	2537.5
20°	2453.3	2448.5	2470.7	2478.2	2488.0
22.5°	2386.6	2386.6	2408.9	2418.8	2433.6
25°	2319.9	2317.4	2344.6	2359.4	2369.3
27.5°	2240.7	2243.1	2277.8	2292.6	2305.0
30°	2156.6	2161.5	2201.1	2218.4	2235.7
32.5°	2067.5	2077.5	2122.0	2141.8	2159.1
35°	1976.1	1988.5	2037.9	2060.2	2079.9
37.5°	1884.6	1901.9	1953.8	1976.1	1998.3
40°	1788.1	1802.9	1862.3	1889.5	1916.8
42.5°	1689.2	1709.0	1768.3	1807.9	1840.0
45°	1587.8	1610.0	1674.3	1723.8	1760.9
47.5°	1486.4	1516.1	1577.8	1644.7	1676.8
50°	1384.9	1414.6	1483.9	1558.1	1590.3
52.5°	1281.1	1310.8	1389.9	1466.6	1501.2
55°	1182.2	1211.9	1295.9	1380.1	1414.6
57.5°	1078.3	1110.4	1204.4	1291.0	1325.6
60°	976.9	1009.1	1110.4	1202.0	1239.0
62.5°	877.9	912.6	1019.0	1115.4	1152.5
65°	776.6	816.2	927.4	1028.8	1068.4
67.5°	677.6	722.2	838.4	944.8	986.8
70°	578.7	630.7	754.3	863.1	905.2
72.5°	482.3	539.1	670.2	779.1	801.3
75°	388.3	455.1	591.1	643.0	638.0
77.5°	299.2	373.4	502.1	512.0	526.8
80°	217.6	299.2	375.9	395.7	385.8
82.5°	143.5	225.1	269.6	259.7	257.2
85°	81.6	141.0	150.9	138.5	138.5
87.5°	34.6	56.9	49.4	37.1	34.6
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-6

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L935-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L935-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-6
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L935-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 935 SMOOTH LENS

Spectral Parameters

CCT (K): 3412
 CIE u' : 0.2386
 CIE v' : 0.5111
 Duv: -0.0015
 CIE x: 0.4087
 CIE y: 0.3890
 CIE z: 0.2023
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 581
 Purity: 39.41044
 R_f: 92.6
 R_g: 102

CRI (Ra): 96.3
 R1: 99.2
 R2: 97.9
 R3: 94.7
 R4: 96.6
 R5: 98.4
 R6: 96.1
 R7: 95.6
 R8: 92.0
 R9: 78.4
 R10: 93.0
 R11: 94.5
 R12: 81.5
 R13: 99.0
 R14: 95.8
 R15: 96.7



Test Conditions


Stabilization Time: 20M
 Operation Time: 1H 20M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-6

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-6

Photopic Flux vs. Wavelength

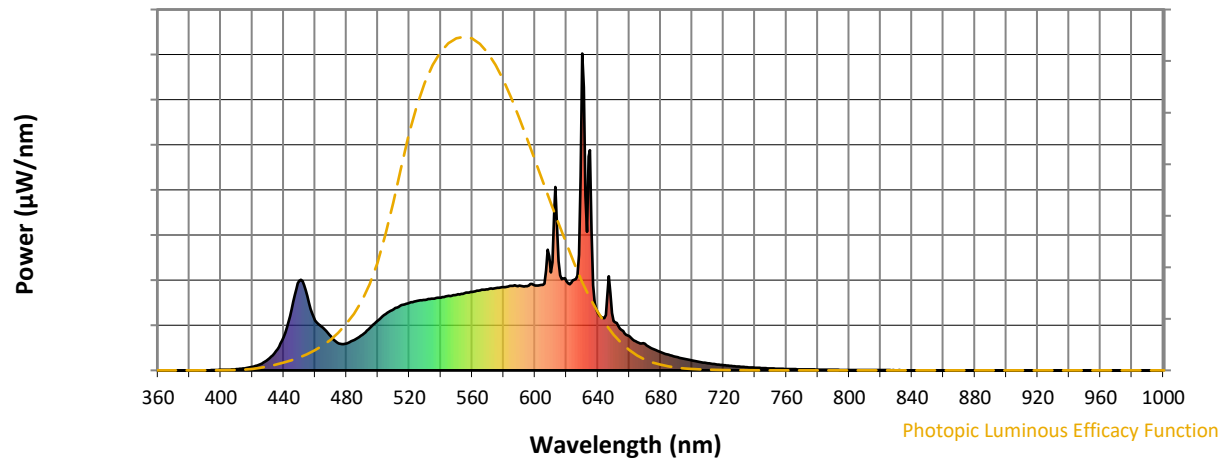

Photopic Lumens: NR

λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	112	NR	620	281	NR	750	6	NR	880	0	NR
365	0	NR	495	134	NR	625	286	NR	755	5	NR	885	0	NR
370	0	NR	500	157	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	178	NR	635	695	NR	765	4	NR	895	0	NR
380	0	NR	510	193	NR	640	181	NR	770	3	NR	900	0	NR
385	0	NR	515	206	NR	645	175	NR	775	3	NR	905	0	NR
390	0	NR	520	213	NR	650	156	NR	780	2	NR	910	0	NR
395	1	NR	525	219	NR	655	127	NR	785	2	NR	915	0	NR
400	2	NR	530	223	NR	660	108	NR	790	2	NR	920	0	NR
405	2	NR	535	226	NR	665	89	NR	795	2	NR	925	0	NR
410	4	NR	540	230	NR	670	84	NR	800	1	NR	930	0	NR
415	6	NR	545	235	NR	675	67	NR	805	1	NR	935	0	NR
420	11	NR	550	239	NR	680	57	NR	810	1	NR	940	0	NR
425	19	NR	555	243	NR	685	50	NR	815	1	NR	945	0	NR
430	34	NR	560	248	NR	690	42	NR	820	1	NR	950	0	NR
435	60	NR	565	253	NR	695	36	NR	825	1	NR	955	0	NR
440	106	NR	570	256	NR	700	31	NR	830	0	NR	960	0	NR
445	193	NR	575	260	NR	705	26	NR	835	0	NR	965	0	NR
450	283	NR	580	263	NR	710	22	NR	840	0	NR	970	0	NR
455	234	NR	585	266	NR	715	19	NR	845	0	NR	975	0	NR
460	157	NR	590	267	NR	720	16	NR	850	0	NR	980	0	NR
465	134	NR	595	266	NR	725	14	NR	855	0	NR	985	0	NR
470	107	NR	600	268	NR	730	12	NR	860	0	NR	990	0	NR
475	85	NR	605	269	NR	735	10	NR	865	0	NR	995	0	NR
480	85	NR	610	309	NR	740	8	NR	870	0	NR	1000	0	NR
485	96	NR	615	345	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-6

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.61

λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)
360	0	NR	490	112	NR	620	281	NR	750	6	NR	880	0	NR
365	0	NR	495	134	NR	625	286	NR	755	5	NR	885	0	NR
370	0	NR	500	157	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	178	NR	635	695	NR	765	4	NR	895	0	NR
380	0	NR	510	193	NR	640	181	NR	770	3	NR	900	0	NR
385	0	NR	515	206	NR	645	175	NR	775	3	NR	905	0	NR
390	0	NR	520	213	NR	650	156	NR	780	2	NR	910	0	NR
395	1	NR	525	219	NR	655	127	NR	785	2	NR	915	0	NR
400	2	NR	530	223	NR	660	108	NR	790	2	NR	920	0	NR
405	2	NR	535	226	NR	665	89	NR	795	2	NR	925	0	NR
410	4	NR	540	230	NR	670	84	NR	800	1	NR	930	0	NR
415	6	NR	545	235	NR	675	67	NR	805	1	NR	935	0	NR
420	11	NR	550	239	NR	680	57	NR	810	1	NR	940	0	NR
425	19	NR	555	243	NR	685	50	NR	815	1	NR	945	0	NR
430	34	NR	560	248	NR	690	42	NR	820	1	NR	950	0	NR
435	60	NR	565	253	NR	695	36	NR	825	1	NR	955	0	NR
440	106	NR	570	256	NR	700	31	NR	830	0	NR	960	0	NR
445	193	NR	575	260	NR	705	26	NR	835	0	NR	965	0	NR
450	283	NR	580	263	NR	710	22	NR	840	0	NR	970	0	NR
455	234	NR	585	266	NR	715	19	NR	845	0	NR	975	0	NR
460	157	NR	590	267	NR	720	16	NR	850	0	NR	980	0	NR
465	134	NR	595	266	NR	725	14	NR	855	0	NR	985	0	NR
470	107	NR	600	268	NR	730	12	NR	860	0	NR	990	0	NR
475	85	NR	605	269	NR	735	10	NR	865	0	NR	995	0	NR
480	85	NR	610	309	NR	740	8	NR	870	0	NR	1000	0	NR
485	96	NR	615	345	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-6

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.24

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	112	NR	620	281	NR	750	6	NR	880	0	NR
365	0	NR	495	134	NR	625	286	NR	755	5	NR	885	0	NR
370	0	NR	500	157	NR	630	1000	NR	760	4	NR	890	0	NR
375	0	NR	505	178	NR	635	695	NR	765	4	NR	895	0	NR
380	0	NR	510	193	NR	640	181	NR	770	3	NR	900	0	NR
385	0	NR	515	206	NR	645	175	NR	775	3	NR	905	0	NR
390	0	NR	520	213	NR	650	156	NR	780	2	NR	910	0	NR
395	1	NR	525	219	NR	655	127	NR	785	2	NR	915	0	NR
400	2	NR	530	223	NR	660	108	NR	790	2	NR	920	0	NR
405	2	NR	535	226	NR	665	89	NR	795	2	NR	925	0	NR
410	4	NR	540	230	NR	670	84	NR	800	1	NR	930	0	NR
415	6	NR	545	235	NR	675	67	NR	805	1	NR	935	0	NR
420	11	NR	550	239	NR	680	57	NR	810	1	NR	940	0	NR
425	19	NR	555	243	NR	685	50	NR	815	1	NR	945	0	NR
430	34	NR	560	248	NR	690	42	NR	820	1	NR	950	0	NR
435	60	NR	565	253	NR	695	36	NR	825	1	NR	955	0	NR
440	106	NR	570	256	NR	700	31	NR	830	0	NR	960	0	NR
445	193	NR	575	260	NR	705	26	NR	835	0	NR	965	0	NR
450	283	NR	580	263	NR	710	22	NR	840	0	NR	970	0	NR
455	234	NR	585	266	NR	715	19	NR	845	0	NR	975	0	NR
460	157	NR	590	267	NR	720	16	NR	850	0	NR	980	0	NR
465	134	NR	595	266	NR	725	14	NR	855	0	NR	985	0	NR
470	107	NR	600	268	NR	730	12	NR	860	0	NR	990	0	NR
475	85	NR	605	269	NR	735	10	NR	865	0	NR	995	0	NR
480	85	NR	610	309	NR	740	8	NR	870	0	NR	1000	0	NR
485	96	NR	615	345	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-6

TM-30-18

Summary

$R_f = 92.6$
 $R_g = 102$
 $\text{CIE } R_a = 96.3$
 $R_9 = 78.4$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 94	CES51 = 97	CES76 = 88
CES02 = 63	CES27 = 93	CES52 = 96	CES77 = 88
CES03 = 32	CES28 = 96	CES53 = 95	CES78 = 84
CES04 = 70	CES29 = 95	CES54 = 95	CES79 = 92
CES05 = 50	CES30 = 96	CES55 = 95	CES80 = 92
CES06 = 51	CES31 = 95	CES56 = 98	CES81 = 77
CES07 = 43	CES32 = 87	CES57 = 98	CES82 = 96
CES08 = 42	CES33 = 97	CES58 = 98	CES83 = 95
CES09 = 29	CES34 = 93	CES59 = 100	CES84 = 95
CES10 = 75	CES35 = 96	CES60 = 94	CES85 = 82
CES11 = 58	CES36 = 84	CES61 = 95	CES86 = 84
CES12 = 64	CES37 = 93	CES62 = 90	CES87 = 92
CES13 = 44	CES38 = 91	CES63 = 95	CES88 = 99
CES14 = 74	CES39 = 98	CES64 = 95	CES89 = 86
CES15 = 72	CES40 = 96	CES65 = 92	CES90 = 98
CES16 = 48	CES41 = 97	CES66 = 93	CES91 = 77
CES17 = 49	CES42 = 90	CES67 = 92	CES92 = 81
CES18 = 56	CES43 = 91	CES68 = 91	CES93 = 88
CES19 = 71	CES44 = 99	CES69 = 92	CES94 = 78
CES20 = 67	CES45 = 94	CES70 = 89	CES95 = 86
CES21 = 86	CES46 = 95	CES71 = 85	CES96 = 93
CES22 = 78	CES47 = 90	CES72 = 95	CES97 = 93
CES23 = 91	CES48 = 96	CES73 = 84	CES98 = 96
CES24 = 90	CES49 = 93	CES74 = 91	CES99 = 97
CES25 = 71	CES50 = 97	CES75 = 86	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)