

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P982884

Luminaire Tested: 24CZ-LD5-30-UNV-L940-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P982884
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24CZ-LD5-30-UNV-L940-CD1-U
Description: METALUX CRUZE 2x4 3000LM PACKAGE 90CRI 4000K TROFFER STANDARD LENS
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2904.0 lumens
Efficiency: N/A
Efficacy: 130.2 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.26 / 1.35
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 22.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P982884

CATALOG NUMBER: 24CZ-LD5-30-UNV-L940-CD1-U

Luminous Intensity Polar Plot

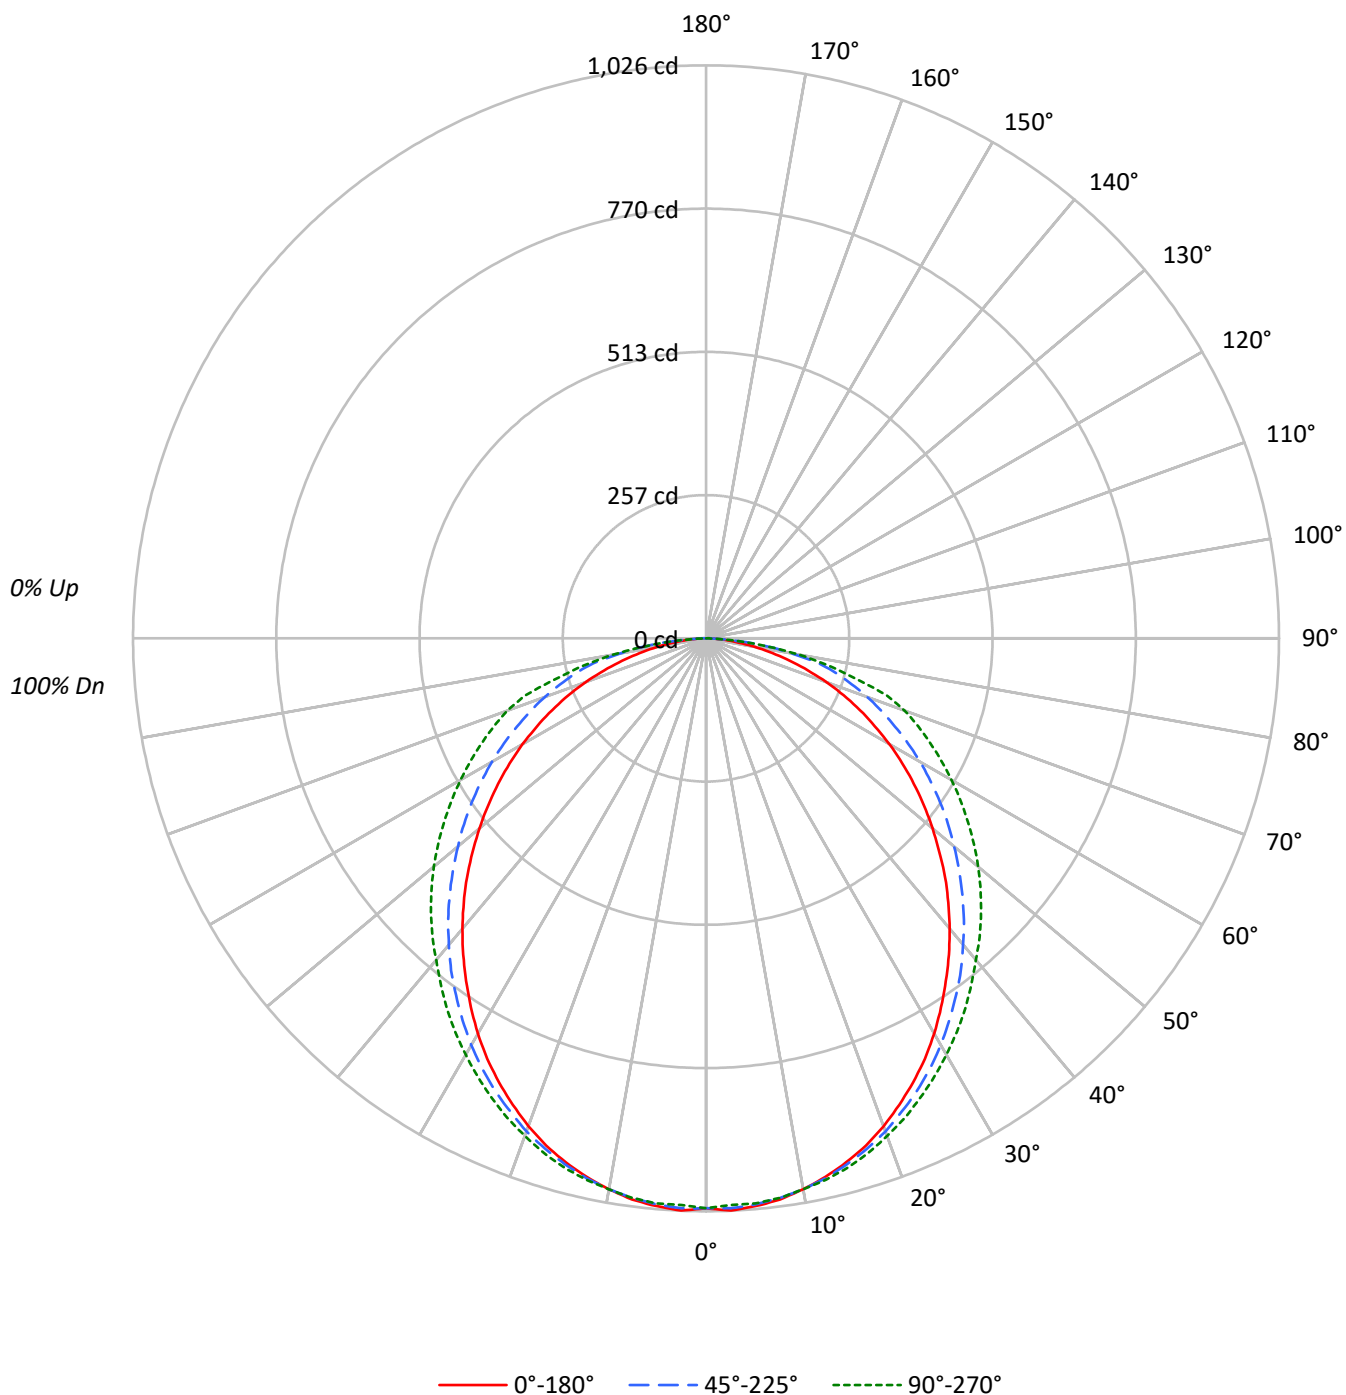

TEST NUMBER: P982884

CATALOG NUMBER: 24CZ-LD5-30-UNV-L940-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	108	103	99	95	106	101	97	93	97	93	90		93	90	88		89
2	98	90	83	77	96	88	81	76	84	79	74		81	76	72		78
3	89	79	70	63	87	77	69	63	74	67	62		71	65	61		69
4	82	69	60	54	79	68	60	53	66	58	52		63	57	52		61
5	75	62	53	46	73	61	52	46	59	51	45		57	50	45		55
6	69	56	47	40	67	55	46	40	53	45	40		51	44	39		50
7	64	51	42	35	63	50	41	35	48	41	35		47	40	35		45
8	60	46	38	32	58	45	37	32	44	37	31		43	36	31		42
9	56	42	34	28	55	42	34	28	41	33	28		40	33	28		39
10	52	39	31	26	51	39	31	26	38	31	26		37	30	26		36

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1373	1373	1373
5°	1378	1374	1372
10°	1369	1369	1369
15°	1353	1358	1366
20°	1331	1345	1358
25°	1302	1327	1348
30°	1269	1306	1337
35°	1230	1282	1329
40°	1192	1258	1320
45°	1152	1235	1325
50°	1108	1214	1332
55°	1066	1200	1342
60°	1021	1191	1366
65°	969	1189	1409
70°	902	1209	1489
75°	806	1258	1428
80°	689	1202	1309
85°	534	960	915

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 72.5°

Luminance: 1516 cd/sqm

TEST NUMBER: P982884

CATALOG NUMBER: 24CZ-LD5-30-UNV-L940-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	96.5	3.3
10°-20°	274.7	9.5
20°-30°	410.6	14.1
30°-40°	486.9	16.8
40°-50°	500.7	17.2
50°-60°	458.0	15.8
60°-70°	369.4	12.7
70°-80°	239.8	8.3
80°-90°	67.5	2.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	781.8	26.9
0°-40°	1268.7	43.7
0°-60°	2227.3	76.7
0°-90°	2904.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2904.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1020	1020	1020	1020	1020	
5°	1020	1014	1018	1016	1016	97
15°	971	966	975	979	981	274
25°	877	877	894	901	908	404
35°	749	756	780	796	809	469
45°	606	616	649	679	696	467
55°	454	469	512	552	572	406
65°	304	322	373	422	443	301
75°	155	184	242	272	275	165
85°	35	57	62	61	59	42
90°	0	0	0	0	0	

TEST NUMBER: P982884

CATALOG NUMBER: 24CZ-LD5-30-UNV-L940-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1020.5	1020.5	1020.5	1020.5	1020.5
2.5°	1025.5	1017.5	1021.5	1019.5	1015.6
5°	1020.5	1013.6	1017.5	1015.6	1015.6
7.5°	1013.6	1006.7	1010.6	1010.6	1010.6
10°	1001.7	995.8	1001.7	1001.7	1001.7
12.5°	987.9	983.0	989.9	990.9	992.8
15°	971.1	966.2	975.1	979.0	981.0
17.5°	952.3	948.4	958.3	963.2	966.2
20°	929.6	926.6	939.5	944.4	948.4
22.5°	903.9	903.9	916.8	922.7	929.6
25°	877.2	877.2	894.0	901.0	907.9
27.5°	848.6	849.6	868.4	878.3	885.2
30°	817.0	821.0	840.7	852.6	860.5
32.5°	783.4	788.4	811.1	825.9	835.8
35°	748.8	755.8	780.4	796.2	809.1
37.5°	714.2	723.2	749.8	767.6	780.4
40°	678.7	688.6	716.2	737.0	751.8
42.5°	642.1	653.0	683.6	707.3	725.1
45°	605.6	616.4	649.0	678.7	696.5
47.5°	567.0	579.9	614.5	649.0	666.8
50°	529.5	543.4	579.9	617.4	636.2
52.5°	492.0	507.8	546.3	585.8	604.6
55°	454.4	469.2	511.7	552.2	572.0
57.5°	416.9	432.7	477.1	519.6	540.4
60°	379.4	396.2	442.6	487.0	507.8
62.5°	340.8	358.6	408.0	454.4	475.2
65°	304.3	322.1	373.4	421.8	442.6
67.5°	266.7	286.5	339.8	389.2	411.0
70°	229.2	250.9	307.2	356.6	378.4
72.5°	191.7	216.4	273.7	323.0	338.9
75°	155.1	183.8	242.0	271.7	274.6
77.5°	121.5	151.2	206.5	218.3	224.3
80°	88.9	121.5	155.1	169.9	168.9
82.5°	59.3	92.8	111.6	113.6	111.6
85°	34.6	57.3	62.2	61.3	59.3
87.5°	14.8	22.7	19.8	16.8	13.8
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-7

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L940-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L940-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-7
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L940-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 940 SMOOTH LENS

Spectral Parameters

CCT (K): 3955
 CIE u' : 0.2264
 CIE v' : 0.5014
 Duv: -0.0009
 CIE x: 0.3818
 CIE y: 0.3758
 CIE z: 0.2424
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 579
 Purity: 27.35334
 R_f: 90.3
 R_g: 99.3

CRI (Ra): 93.6
 R1: 95.0
 R2: 96.2
 R3: 95.3
 R4: 94.7
 R5: 93.8
 R6: 93.5
 R7: 94.0
 R8: 86.7
 R9: 65.5
 R10: 88.9
 R11: 94.8
 R12: 71.7
 R13: 95.4
 R14: 96.7
 R15: 92.2



Test Conditions

Stabilization Time: 22M
 Operation Time: 1H 22M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-7

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-7

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP3-2508-516-7

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.77

λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.69

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

TM-30-18

Summary

$R_f = 90.3$
 $R_g = 99.3$
 $CIE\ R_a = 93.6$
 $R_9 = 65.5$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 93	CES51 = 97	CES76 = 85
CES02 = 62	CES27 = 90	CES52 = 99	CES77 = 87
CES03 = 31	CES28 = 95	CES53 = 97	CES78 = 82
CES04 = 69	CES29 = 96	CES54 = 92	CES79 = 93
CES05 = 49	CES30 = 89	CES55 = 90	CES80 = 92
CES06 = 50	CES31 = 97	CES56 = 94	CES81 = 80
CES07 = 42	CES32 = 89	CES57 = 92	CES82 = 96
CES08 = 41	CES33 = 98	CES58 = 92	CES83 = 96
CES09 = 29	CES34 = 93	CES59 = 97	CES84 = 93
CES10 = 74	CES35 = 95	CES60 = 91	CES85 = 80
CES11 = 57	CES36 = 77	CES61 = 91	CES86 = 84
CES12 = 63	CES37 = 94	CES62 = 83	CES87 = 91
CES13 = 43	CES38 = 83	CES63 = 91	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 88	CES89 = 85
CES15 = 71	CES40 = 98	CES65 = 87	CES90 = 96
CES16 = 47	CES41 = 96	CES66 = 84	CES91 = 70
CES17 = 49	CES42 = 92	CES67 = 83	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 86	CES93 = 85
CES19 = 71	CES44 = 99	CES69 = 87	CES94 = 76
CES20 = 66	CES45 = 97	CES70 = 84	CES95 = 81
CES21 = 85	CES46 = 97	CES71 = 76	CES96 = 92
CES22 = 78	CES47 = 94	CES72 = 93	CES97 = 95
CES23 = 91	CES48 = 89	CES73 = 78	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 90	CES99 = 93
CES25 = 71	CES50 = 98	CES75 = 79	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)