

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P982891

Luminaire Tested: 24CZ-LD5-45SE-UNV-L940-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P982891
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24CZ-LD5-45SE-UNV-L940-CD1-U
Description: METALUX CRUZE 2x4 4500LM STANDARD EFFICACY PACKAGE 90CRI 4000K TROFFER STANDARD
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4311.0 lumens
Efficiency: N/A
Efficacy: 123.2 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.26 / 1.35
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 35
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P982891

CATALOG NUMBER: 24CZ-LD5-45SE-UNV-L940-CD1-U

Luminous Intensity Polar Plot

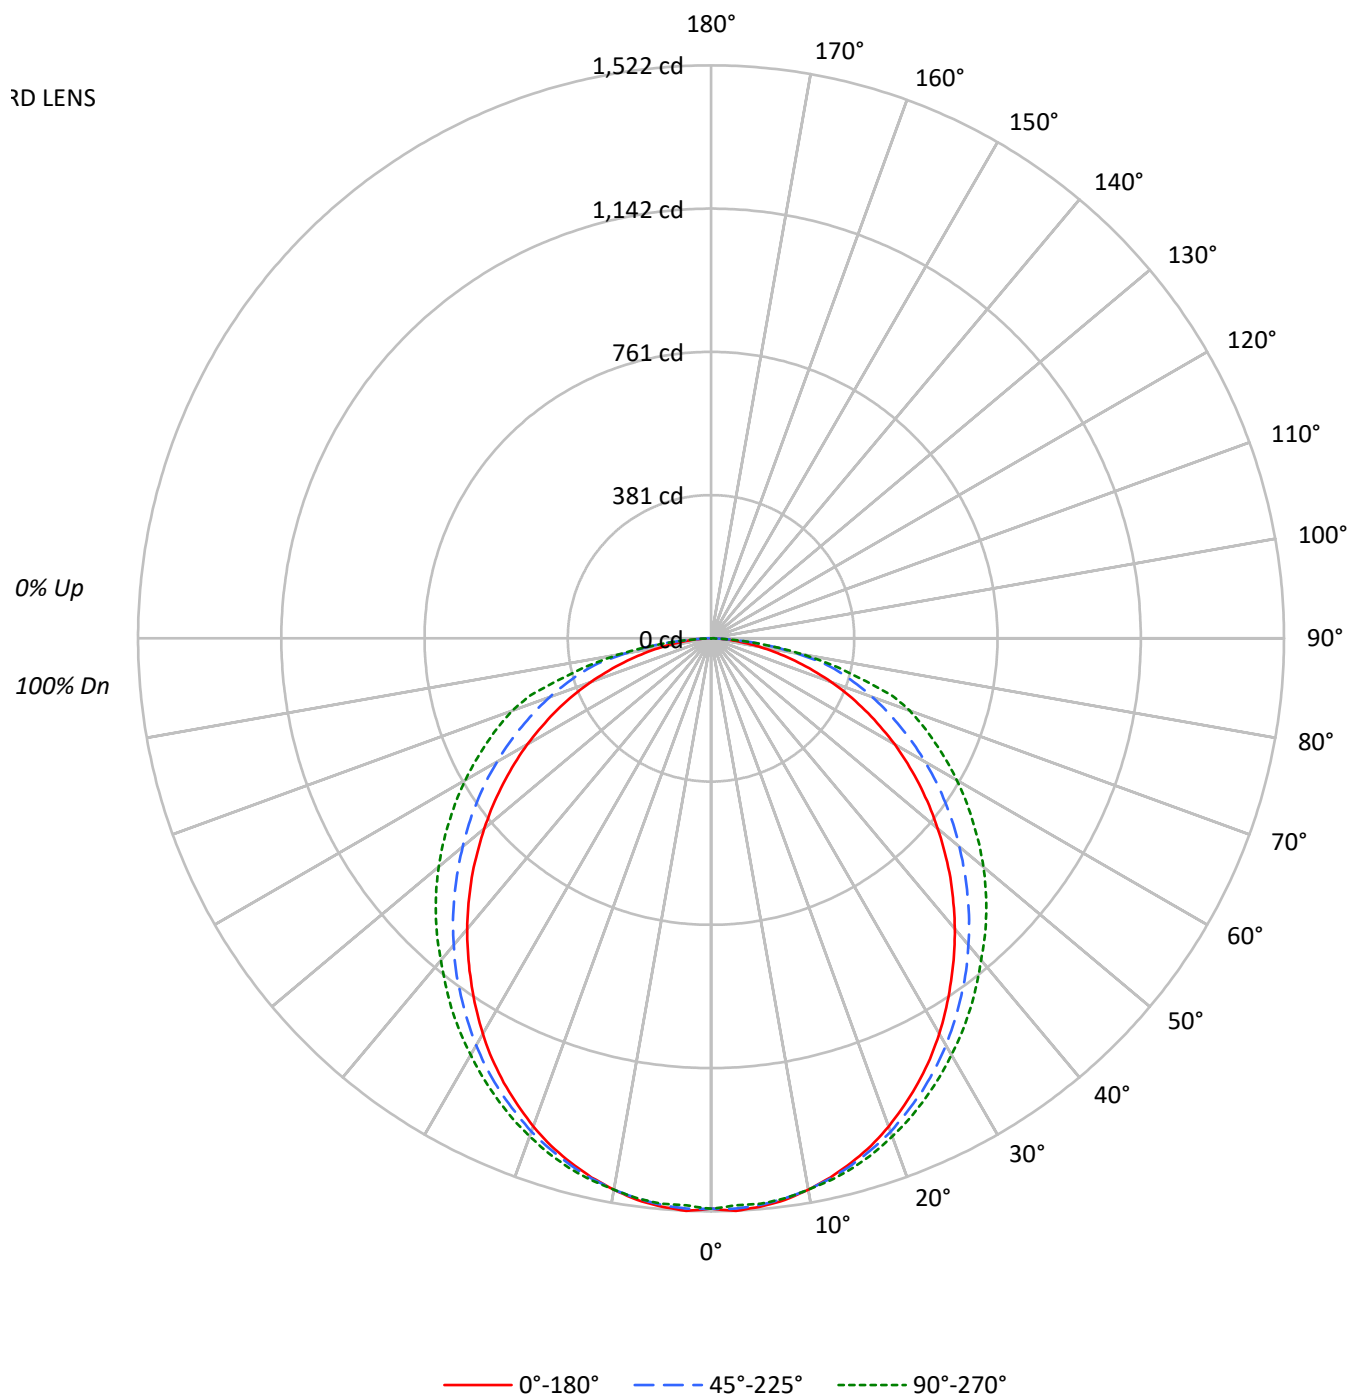

TEST NUMBER: P982891

CATALOG NUMBER: 24CZ-LD5-45SE-UNV-L940-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	108	103	99	95	106	101	97	93	97	93	90	93	90	88	89	87	85	83		
2	98	90	83	77	96	88	81	76	84	79	74	81	76	72	78	74	71	68		
3	89	79	70	63	87	77	69	63	74	67	62	71	65	61	69	64	60	57		
4	82	69	60	54	79	68	60	53	66	58	52	63	57	52	61	56	51	49		
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42		
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	50	44	39	37		
7	64	51	42	35	63	50	41	35	48	41	35	47	40	35	45	39	35	33		
8	60	46	38	32	58	45	37	32	44	37	31	43	36	31	42	36	31	29		
9	56	42	34	28	55	42	34	28	41	33	28	40	33	28	39	32	28	26		
10	52	39	31	26	51	39	31	26	38	31	26	37	30	26	36	30	25	24		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2038	2038	2038
5°	2046	2040	2036
10°	2032	2032	2032
15°	2008	2016	2029
20°	1976	1997	2016
25°	1933	1970	2001
30°	1884	1939	1985
35°	1826	1903	1973
40°	1770	1867	1960
45°	1711	1833	1967
50°	1645	1802	1977
55°	1582	1782	1992
60°	1516	1768	2028
65°	1438	1765	2092
70°	1338	1794	2210
75°	1197	1868	2119
80°	1023	1784	1943
85°	792	1426	1359

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 72.5°

Luminance: 2251 cd/sqm

TEST NUMBER: P982891

CATALOG NUMBER: 24CZ-LD5-45SE-UNV-L940-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	143.3	3.3
10°-20°	407.8	9.5
20°-30°	609.5	14.1
30°-40°	722.8	16.8
40°-50°	743.3	17.2
50°-60°	679.9	15.8
60°-70°	548.4	12.7
70°-80°	356.0	8.3
80°-90°	100.2	2.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1160.5	26.9
0°-40°	1883.3	43.7
0°-60°	3306.5	76.7
0°-90°	4311.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4311.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1515	1515	1515	1515	1515	
5°	1515	1505	1510	1508	1508	144
15°	1442	1434	1448	1453	1456	406
25°	1302	1302	1327	1338	1348	600
35°	1112	1122	1159	1182	1201	696
45°	899	915	964	1008	1034	693
55°	675	697	760	820	849	603
65°	452	478	554	626	657	447
75°	230	273	359	403	408	246
85°	51	85	92	91	88	62
90°	0	0	0	0	0	

TEST NUMBER: P982891

CATALOG NUMBER: 24CZ-LD5-45SE-UNV-L940-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1514.9	1514.9	1514.9	1514.9	1514.9
2.5°	1522.3	1510.5	1516.4	1513.5	1507.6
5°	1514.9	1504.7	1510.5	1507.6	1507.6
7.5°	1504.7	1494.4	1500.2	1500.2	1500.2
10°	1487.1	1478.3	1487.1	1487.1	1487.1
12.5°	1466.5	1459.2	1469.5	1471.0	1473.9
15°	1441.6	1434.3	1447.5	1453.3	1456.3
17.5°	1413.8	1407.9	1422.6	1429.9	1434.3
20°	1380.0	1375.6	1394.6	1402.0	1407.9
22.5°	1341.9	1341.9	1360.9	1369.7	1380.0
25°	1302.3	1302.3	1327.2	1337.5	1347.7
27.5°	1259.7	1261.2	1289.1	1303.8	1314.0
30°	1212.8	1218.7	1248.0	1265.6	1277.4
32.5°	1163.0	1170.3	1204.0	1226.0	1240.7
35°	1111.6	1121.9	1158.6	1182.0	1201.1
37.5°	1060.3	1073.5	1113.1	1139.5	1158.6
40°	1007.5	1022.2	1063.2	1094.0	1116.0
42.5°	953.2	969.4	1014.8	1050.0	1076.5
45°	899.0	915.1	963.5	1007.5	1033.9
47.5°	841.8	860.9	912.2	963.5	989.9
50°	786.1	806.6	860.9	916.6	944.4
52.5°	730.4	753.8	811.0	869.7	897.5
55°	674.6	696.6	759.6	819.8	849.1
57.5°	618.9	642.4	708.3	771.4	802.2
60°	563.2	588.1	657.0	723.0	753.8
62.5°	506.0	532.3	605.7	674.6	705.4
65°	451.7	478.1	554.4	626.2	657.0
67.5°	395.9	425.3	504.5	577.8	610.1
70°	340.2	372.5	456.1	529.4	561.7
72.5°	284.5	321.2	406.2	479.6	503.0
75°	230.3	272.8	359.3	403.3	407.7
77.5°	180.4	224.4	306.5	324.1	332.9
80°	132.0	180.4	230.3	252.2	250.8
82.5°	88.0	137.8	165.7	168.7	165.7
85°	51.3	85.1	92.4	90.9	88.0
87.5°	22.0	33.7	29.4	24.9	20.5
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-7

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L940-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L940-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-7
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L940-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 940 SMOOTH LENS

Spectral Parameters

CCT (K): 3955
 CIE u' : 0.2264
 CIE v' : 0.5014
 Duv: -0.0009
 CIE x: 0.3818
 CIE y: 0.3758
 CIE z: 0.2424
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 579
 Purity: 27.35334
 R_f: 90.3
 R_g: 99.3

CRI (Ra): 93.6
 R1: 95.0
 R2: 96.2
 R3: 95.3
 R4: 94.7
 R5: 93.8
 R6: 93.5
 R7: 94.0
 R8: 86.7
 R9: 65.5
 R10: 88.9
 R11: 94.8
 R12: 71.7
 R13: 95.4
 R14: 96.7
 R15: 92.2



Test Conditions

Stabilization Time: 22M
 Operation Time: 1H 22M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-7

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-7

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP3-2508-516-7

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.77

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Melanopic Flux vs. Wavelength


Melanopic Lumens: NR
M/P: 3.69

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

TM-30-18

Summary

$R_f = 90.3$
 $R_g = 99.3$
 $\text{CIE } R_a = 93.6$
 $R_9 = 65.5$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 93	CES51 = 97	CES76 = 85
CES02 = 62	CES27 = 90	CES52 = 99	CES77 = 87
CES03 = 31	CES28 = 95	CES53 = 97	CES78 = 82
CES04 = 69	CES29 = 96	CES54 = 92	CES79 = 93
CES05 = 49	CES30 = 89	CES55 = 90	CES80 = 92
CES06 = 50	CES31 = 97	CES56 = 94	CES81 = 80
CES07 = 42	CES32 = 89	CES57 = 92	CES82 = 96
CES08 = 41	CES33 = 98	CES58 = 92	CES83 = 96
CES09 = 29	CES34 = 93	CES59 = 97	CES84 = 93
CES10 = 74	CES35 = 95	CES60 = 91	CES85 = 80
CES11 = 57	CES36 = 77	CES61 = 91	CES86 = 84
CES12 = 63	CES37 = 94	CES62 = 83	CES87 = 91
CES13 = 43	CES38 = 83	CES63 = 91	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 88	CES89 = 85
CES15 = 71	CES40 = 98	CES65 = 87	CES90 = 96
CES16 = 47	CES41 = 96	CES66 = 84	CES91 = 70
CES17 = 49	CES42 = 92	CES67 = 83	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 86	CES93 = 85
CES19 = 71	CES44 = 99	CES69 = 87	CES94 = 76
CES20 = 66	CES45 = 97	CES70 = 84	CES95 = 81
CES21 = 85	CES46 = 97	CES71 = 76	CES96 = 92
CES22 = 78	CES47 = 94	CES72 = 93	CES97 = 95
CES23 = 91	CES48 = 89	CES73 = 78	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 90	CES99 = 93
CES25 = 71	CES50 = 98	CES75 = 79	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)