

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P983037

Luminaire Tested: 24CZ-LD5-50SE-UNV-L940-HRP-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P983037
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24CZ-LD5-50SE-UNV-L940-HRP-CD1-U
Description: METALUX CRUZE 2x4 5000LM STANDARD EFFICACY PACKAGE 90CRI 4000K TROFFER LENS WITH FILM INSERT
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4044.0 lumens
Efficiency: N/A
Efficacy: 102.1 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.29 / 1.4
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 39.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P983037

CATALOG NUMBER: 24CZ-LD5-50SE-UNV-L940-HRP-CD1-U

Luminous Intensity Polar Plot

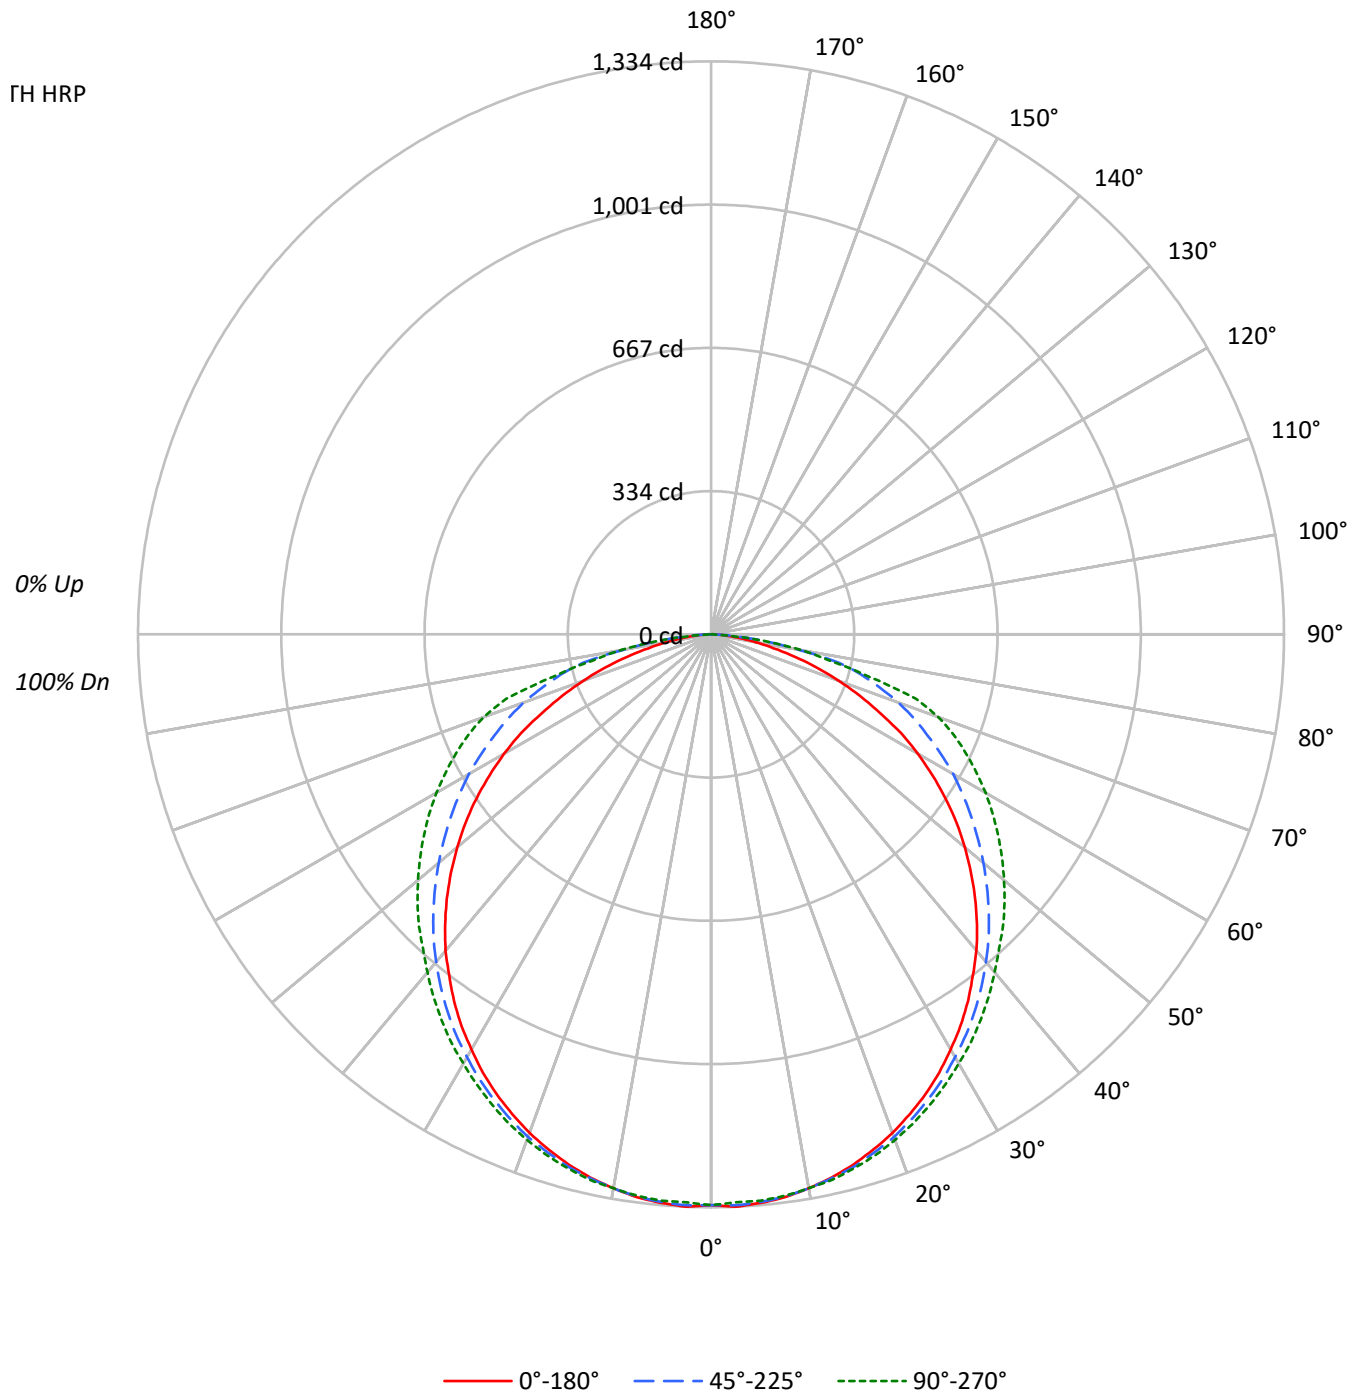

TEST NUMBER: P983037

CATALOG NUMBER: 24CZ-LD5-50SE-UNV-L940-HRP-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	108	103	99	95	105	101	97	93	97	93	90		93	90	87		89	87	85	83
2	98	89	82	76	95	87	81	75	84	78	74		81	76	72		77	74	70	68
3	89	78	70	63	86	76	69	62	73	67	61		71	65	60		68	63	59	57
4	81	69	60	53	79	68	59	52	65	58	52		63	56	51		60	55	50	48
5	75	61	52	45	72	60	52	45	58	50	44		56	49	44		54	48	43	41
6	69	55	46	39	67	54	45	39	52	45	39		51	44	38		49	43	38	36
7	64	50	41	35	62	49	41	34	48	40	34		46	39	34		45	38	34	32
8	59	45	37	31	58	45	36	31	43	36	31		42	35	30		41	35	30	28
9	55	42	33	28	54	41	33	28	40	33	27		39	32	27		38	32	27	25
10	52	38	30	25	51	38	30	25	37	30	25		36	29	25		35	29	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1788	1788	1788
5°	1795	1792	1788
10°	1789	1789	1789
15°	1781	1788	1793
20°	1769	1783	1793
25°	1754	1775	1792
30°	1733	1766	1793
35°	1713	1759	1798
40°	1689	1750	1804
45°	1655	1740	1829
50°	1614	1733	1864
55°	1564	1735	1914
60°	1496	1753	1986
65°	1384	1770	2085
70°	1247	1826	2215
75°	1054	1882	1981
80°	819	1611	1664
85°	588	1096	962

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 72.5°

Luminance: 2240 cd/sqm

TEST NUMBER: P983037

CATALOG NUMBER: 24CZ-LD5-50SE-UNV-L940-HRP-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	125.9	3.1
10°-20°	361.6	8.9
20°-30°	550.0	13.6
30°-40°	668.2	16.5
40°-50°	705.2	17.4
50°-60°	662.7	16.4
60°-70°	545.5	13.5
70°-80°	343.7	8.5
80°-90°	81.2	2.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1037.6	25.7
0°-40°	1705.7	42.2
0°-60°	3073.7	76.0
0°-90°	4044.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4044.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1329	1329	1329	1329	1329	
5°	1329	1322	1327	1325	1324	126
15°	1278	1273	1284	1287	1287	361
25°	1181	1180	1195	1202	1207	544
35°	1043	1048	1071	1084	1095	652
45°	870	884	915	941	961	670
55°	667	691	740	792	816	595
65°	435	476	556	627	655	432
75°	203	265	362	395	381	216
85°	38	64	71	66	62	48
90°	0	0	0	0	0	

TEST NUMBER: P983037

CATALOG NUMBER: 24CZ-LD5-50SE-UNV-L940-HRP-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1328.7	1328.7	1328.7	1328.7	1328.7
2.5°	1333.9	1325.2	1330.5	1328.7	1323.5
5°	1328.7	1321.8	1326.9	1325.2	1323.5
7.5°	1321.8	1314.8	1320.1	1318.3	1318.3
10°	1309.7	1304.4	1309.7	1309.7	1309.7
12.5°	1295.8	1290.6	1297.5	1299.2	1301.0
15°	1278.4	1273.3	1283.7	1287.1	1287.1
17.5°	1257.6	1254.2	1264.6	1268.0	1271.6
20°	1235.2	1233.4	1245.5	1249.0	1252.5
22.5°	1209.1	1209.1	1221.3	1224.8	1231.7
25°	1181.4	1179.7	1195.3	1202.3	1207.4
27.5°	1150.2	1150.2	1167.6	1176.3	1181.4
30°	1115.6	1119.1	1136.4	1146.8	1153.8
32.5°	1081.0	1084.5	1105.2	1117.4	1126.0
35°	1042.8	1048.1	1070.6	1084.5	1094.9
37.5°	1001.3	1009.9	1034.2	1049.8	1061.9
40°	961.4	968.4	996.1	1013.4	1027.3
42.5°	916.4	928.5	956.3	977.1	992.6
45°	869.7	883.5	914.6	940.7	961.4
47.5°	821.1	838.5	871.4	906.0	926.8
50°	770.9	790.0	828.0	869.7	890.4
52.5°	720.6	741.5	783.0	831.5	854.0
55°	666.9	691.2	739.7	791.7	815.9
57.5°	611.5	639.2	694.7	753.6	777.8
60°	556.1	585.5	651.3	710.2	737.9
62.5°	498.9	531.8	602.8	670.4	696.4
65°	434.8	476.4	556.1	627.1	654.8
67.5°	375.9	419.2	511.0	582.0	611.5
70°	317.0	367.2	464.2	535.3	563.0
72.5°	258.1	317.0	412.3	485.0	500.6
75°	202.7	265.0	362.1	394.9	381.1
77.5°	149.0	218.3	304.9	287.5	284.1
80°	105.7	173.3	207.9	209.6	214.8
82.5°	67.6	128.2	135.1	136.9	138.6
85°	38.1	64.1	71.0	65.9	62.3
87.5°	17.3	20.8	17.3	12.1	10.4
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-7

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L940-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L940-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-7
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L940-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 940 SMOOTH LENS

Spectral Parameters

CCT (K): 3955
 CIE u' : 0.2264
 CIE v' : 0.5014
 Duv: -0.0009
 CIE x: 0.3818
 CIE y: 0.3758
 CIE z: 0.2424
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 579
 Purity: 27.35334
 R_f: 90.3
 R_g: 99.3

CRI (Ra): 93.6
 R1: 95.0
 R2: 96.2
 R3: 95.3
 R4: 94.7
 R5: 93.8
 R6: 93.5
 R7: 94.0
 R8: 86.7
 R9: 65.5
 R10: 88.9
 R11: 94.8
 R12: 71.7
 R13: 95.4
 R14: 96.7
 R15: 92.2



Test Conditions

Stabilization Time: 22M
 Operation Time: 1H 22M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-7

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-7

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP3-2508-516-7

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.77

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.69

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	171	NR	620	355	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	352	NR	755	7	NR	885	0	NR
370	0	NR	500	230	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	257	NR	635	711	NR	765	5	NR	895	0	NR
380	0	NR	510	278	NR	640	235	NR	770	4	NR	900	0	NR
385	0	NR	515	295	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	305	NR	650	198	NR	780	3	NR	910	0	NR
395	2	NR	525	313	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	318	NR	660	142	NR	790	2	NR	920	0	NR
405	4	NR	535	323	NR	665	120	NR	795	2	NR	925	0	NR
410	6	NR	540	327	NR	670	110	NR	800	2	NR	930	0	NR
415	9	NR	545	333	NR	675	91	NR	805	2	NR	935	0	NR
420	15	NR	550	339	NR	680	77	NR	810	1	NR	940	0	NR
425	27	NR	555	343	NR	685	67	NR	815	1	NR	945	0	NR
430	48	NR	560	349	NR	690	57	NR	820	1	NR	950	0	NR
435	87	NR	565	355	NR	695	49	NR	825	1	NR	955	0	NR
440	155	NR	570	358	NR	700	42	NR	830	1	NR	960	0	NR
445	291	NR	575	363	NR	705	36	NR	835	1	NR	965	0	NR
450	475	NR	580	365	NR	710	30	NR	840	1	NR	970	0	NR
455	466	NR	585	367	NR	715	26	NR	845	1	NR	975	0	NR
460	308	NR	590	367	NR	720	22	NR	850	0	NR	980	0	NR
465	246	NR	595	364	NR	725	19	NR	855	0	NR	985	0	NR
470	202	NR	600	363	NR	730	16	NR	860	0	NR	990	0	NR
475	152	NR	605	361	NR	735	14	NR	865	0	NR	995	0	NR
480	140	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	152	NR	615	418	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-7

TM-30-18

Summary

$R_f = 90.3$
 $R_g = 99.3$
 $\text{CIE } R_a = 93.6$
 $R_9 = 65.5$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 93	CES51 = 97	CES76 = 85
CES02 = 62	CES27 = 90	CES52 = 99	CES77 = 87
CES03 = 31	CES28 = 95	CES53 = 97	CES78 = 82
CES04 = 69	CES29 = 96	CES54 = 92	CES79 = 93
CES05 = 49	CES30 = 89	CES55 = 90	CES80 = 92
CES06 = 50	CES31 = 97	CES56 = 94	CES81 = 80
CES07 = 42	CES32 = 89	CES57 = 92	CES82 = 96
CES08 = 41	CES33 = 98	CES58 = 92	CES83 = 96
CES09 = 29	CES34 = 93	CES59 = 97	CES84 = 93
CES10 = 74	CES35 = 95	CES60 = 91	CES85 = 80
CES11 = 57	CES36 = 77	CES61 = 91	CES86 = 84
CES12 = 63	CES37 = 94	CES62 = 83	CES87 = 91
CES13 = 43	CES38 = 83	CES63 = 91	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 88	CES89 = 85
CES15 = 71	CES40 = 98	CES65 = 87	CES90 = 96
CES16 = 47	CES41 = 96	CES66 = 84	CES91 = 70
CES17 = 49	CES42 = 92	CES67 = 83	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 86	CES93 = 85
CES19 = 71	CES44 = 99	CES69 = 87	CES94 = 76
CES20 = 66	CES45 = 97	CES70 = 84	CES95 = 81
CES21 = 85	CES46 = 97	CES71 = 76	CES96 = 92
CES22 = 78	CES47 = 94	CES72 = 93	CES97 = 95
CES23 = 91	CES48 = 89	CES73 = 78	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 90	CES99 = 93
CES25 = 71	CES50 = 98	CES75 = 79	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)