

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P982976

Luminaire Tested: 24CZ-LD5-35-UNV-L950-S-CD1-U

Issue Date: 04/23/2025

Test Information

Test Method: LM-79-2019
Report Number: P982976
Test Lab: INNOVATION CENTER(P3)
Issue Date: 04/23/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24CZ-LD5-35-UNV-L950-S-CD1-U
Description: METALUX CRUZE 2x4 3500LM PACKAGE 90CRI 5000K TROFFER SMOOTH LENS
Light Source: 5000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3588.9 lumens
Efficiency: N/A
Efficacy: 132.9 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.23 / 1.33
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 27
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P982976

CATALOG NUMBER: 24CZ-LD5-35-UNV-L950-S-CD1-U

Luminous Intensity Polar Plot

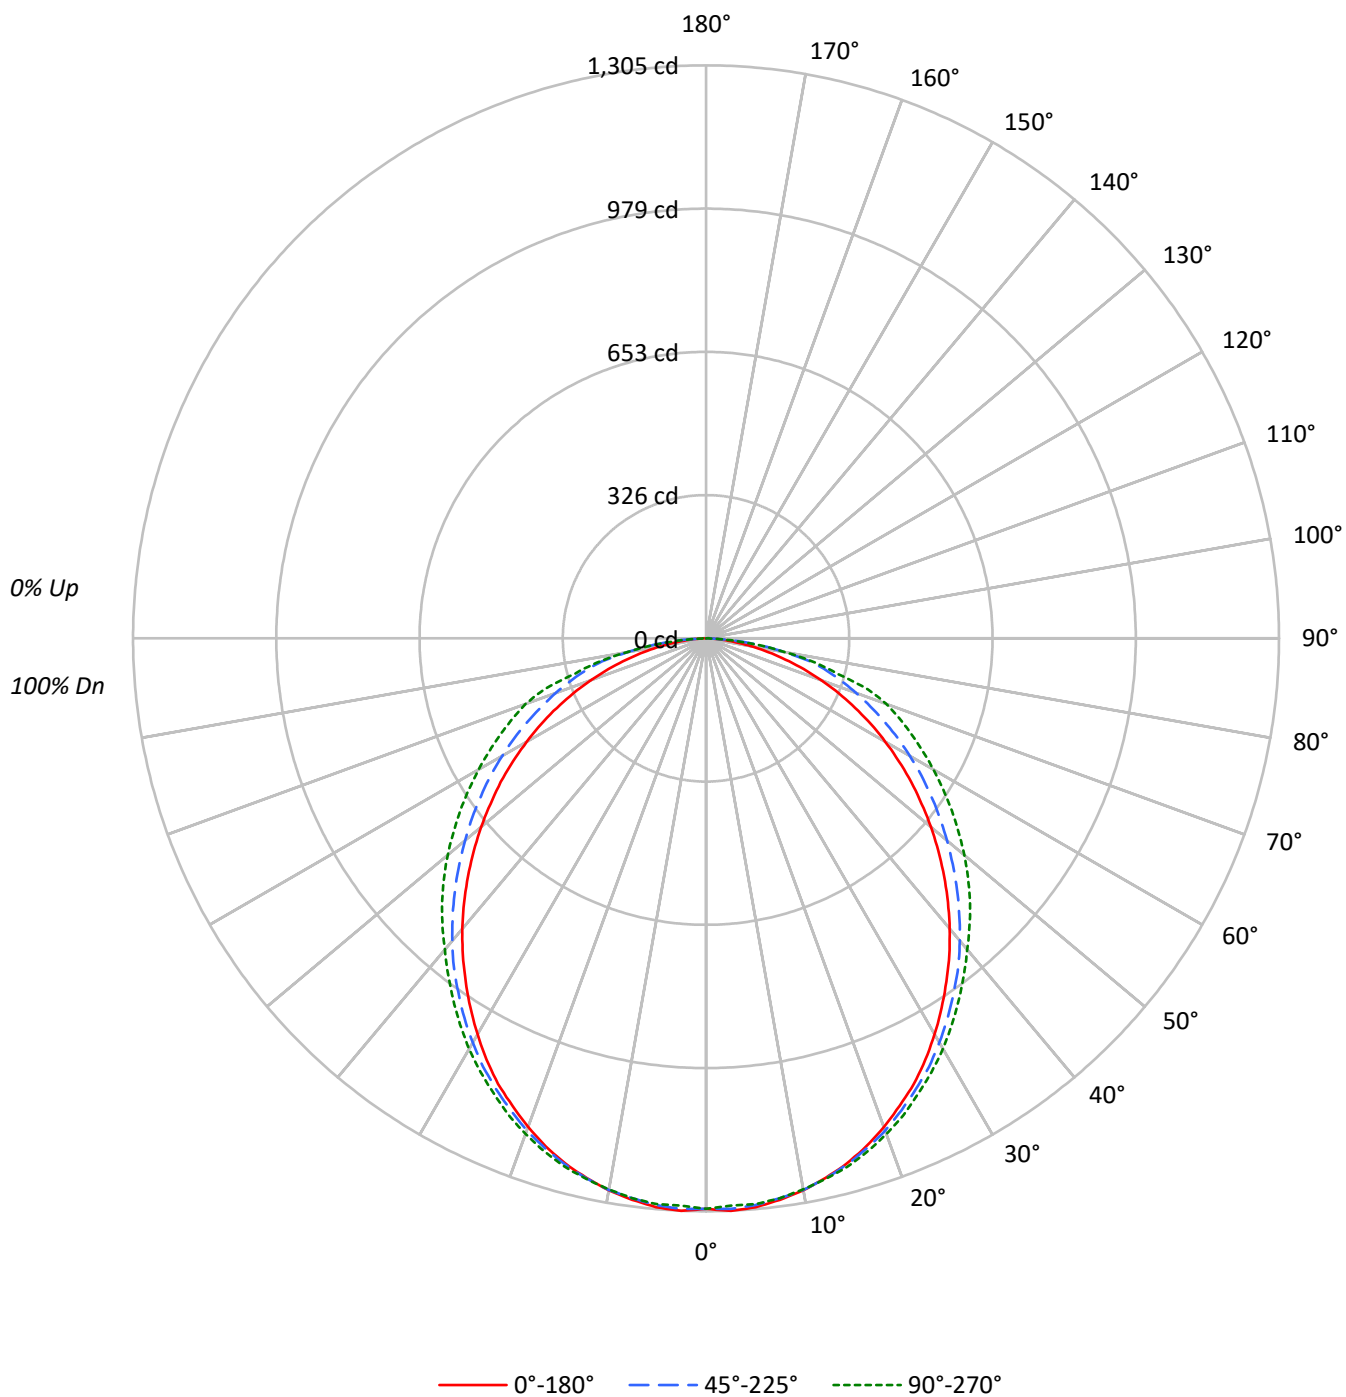

TEST NUMBER: P982976

CATALOG NUMBER: 24CZ-LD5-35-UNV-L950-S-CD1-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	108	104	99	95	106	101	97	94	97	94	91		93	90	88		89
2	99	90	83	77	96	88	82	76	85	79	75		81	77	73		78
3	90	79	71	64	87	77	70	64	74	68	62		72	66	61		69
4	82	70	61	54	80	69	60	54	66	59	53		64	58	52		62
5	76	63	53	47	73	61	53	47	59	52	46		57	51	45		55
6	70	56	47	41	68	55	47	41	54	46	40		52	45	40		50
7	65	51	42	36	63	50	42	36	49	41	36		47	41	35		46
8	60	47	38	32	59	46	38	32	45	37	32		43	37	32		42
9	56	43	35	29	55	42	34	29	41	34	29		40	33	29		39
10	53	40	32	26	52	39	31	26	38	31	26		37	31	26		36

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1748	1748	1748
5°	1756	1750	1747
10°	1744	1743	1741
15°	1725	1728	1735
20°	1696	1708	1720
25°	1663	1681	1698
30°	1618	1651	1677
35°	1567	1616	1650
40°	1516	1579	1626
45°	1459	1538	1618
50°	1400	1500	1607
55°	1339	1468	1602
60°	1269	1443	1610
65°	1194	1426	1642
70°	1099	1433	1720
75°	975	1484	1602
80°	814	1406	1444
85°	608	1125	1033

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 72.5°

Luminance: 1731 cd/sqm

TEST NUMBER: P982976

CATALOG NUMBER: 24CZ-LD5-35-UNV-L950-S-CD1-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	122.8	3.4
10°-20°	349.4	9.7
20°-30°	520.6	14.5
30°-40°	612.9	17.1
40°-50°	622.8	17.4
50°-60°	559.9	15.6
60°-70°	442.4	12.3
70°-80°	280.6	7.8
80°-90°	77.5	2.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	992.8	27.7
0°-40°	1605.7	44.7
0°-60°	2788.4	77.7
0°-90°	3588.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3588.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1299	1299	1299	1299	1299	
5°	1300	1290	1296	1293	1293	123
15°	1238	1232	1241	1244	1246	349
25°	1120	1119	1132	1139	1144	515
35°	954	960	984	995	1004	597
45°	767	777	808	832	850	592
55°	571	585	626	666	683	510
65°	375	394	448	497	516	371
75°	188	220	285	310	308	200
85°	39	68	73	67	67	48
90°	0	0	0	0	0	

TEST NUMBER: P982976

CATALOG NUMBER: 24CZ-LD5-35-UNV-L950-S-CD1-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1299.2	1299.2	1299.2	1299.2	1299.2
2.5°	1305.2	1295.7	1300.5	1298.1	1293.3
5°	1300.5	1289.7	1295.7	1293.3	1293.3
7.5°	1289.7	1281.3	1286.1	1284.9	1286.1
10°	1276.6	1268.2	1275.4	1275.4	1274.2
12.5°	1258.7	1251.5	1259.8	1259.8	1261.1
15°	1238.4	1232.4	1240.7	1244.3	1245.5
17.5°	1213.3	1207.3	1218.0	1221.7	1225.2
20°	1184.6	1182.2	1193.0	1196.6	1201.3
22.5°	1152.4	1152.4	1163.1	1167.9	1175.1
25°	1120.1	1118.9	1132.1	1139.2	1144.0
27.5°	1081.9	1083.1	1099.8	1107.0	1113.0
30°	1041.3	1043.7	1062.8	1071.2	1079.5
32.5°	998.3	1003.1	1024.6	1034.1	1042.5
35°	954.2	960.1	984.0	994.7	1004.3
37.5°	910.0	918.3	943.4	954.2	964.9
40°	863.4	870.5	899.2	912.4	925.5
42.5°	815.6	825.2	853.8	872.9	888.4
45°	766.6	777.4	808.5	832.3	850.3
47.5°	717.7	732.0	761.9	794.1	809.6
50°	668.7	683.0	716.5	752.3	767.9
52.5°	618.6	632.9	671.1	708.1	724.8
55°	570.8	585.2	625.7	666.4	683.0
57.5°	520.7	536.2	581.5	623.3	640.1
60°	471.7	487.2	536.2	580.4	598.3
62.5°	423.9	440.6	492.0	538.6	556.5
65°	375.0	394.1	447.8	496.8	515.9
67.5°	327.2	348.7	404.8	456.2	476.5
70°	279.4	304.5	364.2	416.8	437.1
72.5°	232.9	260.3	323.6	376.2	386.9
75°	187.5	219.7	285.4	310.5	308.1
77.5°	144.5	180.3	242.4	247.2	254.3
80°	105.1	144.5	181.5	191.1	186.3
82.5°	69.3	108.7	130.2	125.4	124.2
85°	39.4	68.1	72.9	66.9	66.9
87.5°	16.7	27.5	23.9	17.9	16.7
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP3-2508-516-8

Test Date: 09/03/2025

Luminaire Tested: 24CZ-LD5-65-S-UNV-L950-CD1-U

Data in this report applies to families of products including 24CZ-LD5-65-S-UNV-L950-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP3-2508-516-8
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP3 - 3M SPHERE
 Measurement Geometry: 4π
 Issue Date: 09/05/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **24CZ-LD5-65-S-UNV-L950-CD1-U**
 Description: 2X4 CRUZE SB 6500LM 950 SMOOTH LENS

Spectral Parameters

CCT (K): 5019
 CIE u' : 0.2113
 CIE v' : 0.4842
 Duv: -0.0002
 CIE x: 0.3445
 CIE y: 0.3508
 CIE z: 0.3046
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 572
 Purity: 8.636369
 R_f: 89.8
 R_g: 98.5

CRI (Ra): 94.6
 R1: 96.4
 R2: 98.4
 R3: 96.9
 R4: 94.5
 R5: 94.5
 R6: 93.5
 R7: 93.6
 R8: 89.4
 R9: 74.6
 R10: 94.2
 R11: 95.5
 R12: 70.8
 R13: 98.0
 R14: 98.0
 R15: 95.0



Test Conditions

Stabilization Time: M
 Operation Time: 1H 0M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP3-2508-516-8

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	3M SPHERE IN02505	7/1/2025	1/1/2026
Power Meter	XITRON INXT2011006	1/20/2025	1/20/2026
AC Power Source	CHROMA 61604 IN6064A	10/22/2024	10/22/2025
DC Power Source	EYSIGHT N5770A IN0534	10/22/2024	10/22/2025
Sphere Thermometer	TANDD IN4036E	10/22/2024	10/22/2025

REPORT NUMBER: SP3-2508-516-8

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP3-2508-516-8

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W/nm	Lumens (ϕ/nm)	λ (nm)	Power W/nm	Lumens (ϕ/nm)	λ (nm)	Power W/nm	Lumens (ϕ/nm)	λ (nm)	Power W/nm	Lumens (ϕ/nm)	λ (nm)	Power W/nm	Lumens (ϕ/nm)
360	0	NR	490	249	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	269	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	296	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	325	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	347	NR	640	221	NR	770	4	NR	900	0	NR
385	0	NR	515	363	NR	645	210	NR	775	4	NR	905	0	NR
390	1	NR	520	371	NR	650	186	NR	780	3	NR	910	0	NR
395	3	NR	525	378	NR	655	155	NR	785	3	NR	915	0	NR
400	4	NR	530	381	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	383	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	385	NR	670	102	NR	800	2	NR	930	0	NR
415	10	NR	545	389	NR	675	84	NR	805	1	NR	935	0	NR
420	17	NR	550	391	NR	680	72	NR	810	1	NR	940	0	NR
425	29	NR	555	392	NR	685	62	NR	815	1	NR	945	0	NR
430	53	NR	560	393	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	394	NR	695	45	NR	825	1	NR	955	0	NR
440	173	NR	570	391	NR	700	39	NR	830	1	NR	960	0	NR
445	321	NR	575	389	NR	705	33	NR	835	1	NR	965	0	NR
450	597	NR	580	385	NR	710	28	NR	840	1	NR	970	0	NR
455	795	NR	585	382	NR	715	24	NR	845	1	NR	975	0	NR
460	615	NR	590	375	NR	720	21	NR	850	0	NR	980	0	NR
465	438	NR	595	367	NR	725	17	NR	855	0	NR	985	0	NR
470	372	NR	600	361	NR	730	15	NR	860	0	NR	990	0	NR
475	290	NR	605	355	NR	735	13	NR	865	0	NR	995	0	NR
480	236	NR	610	383	NR	740	11	NR	870	0	NR	1000	0	NR
485	232	NR	615	408	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-8

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 2.11

λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)
360	0	NR	490	249	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	269	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	296	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	325	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	347	NR	640	221	NR	770	4	NR	900	0	NR
385	0	NR	515	363	NR	645	210	NR	775	4	NR	905	0	NR
390	1	NR	520	371	NR	650	186	NR	780	3	NR	910	0	NR
395	3	NR	525	378	NR	655	155	NR	785	3	NR	915	0	NR
400	4	NR	530	381	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	383	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	385	NR	670	102	NR	800	2	NR	930	0	NR
415	10	NR	545	389	NR	675	84	NR	805	1	NR	935	0	NR
420	17	NR	550	391	NR	680	72	NR	810	1	NR	940	0	NR
425	29	NR	555	392	NR	685	62	NR	815	1	NR	945	0	NR
430	53	NR	560	393	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	394	NR	695	45	NR	825	1	NR	955	0	NR
440	173	NR	570	391	NR	700	39	NR	830	1	NR	960	0	NR
445	321	NR	575	389	NR	705	33	NR	835	1	NR	965	0	NR
450	597	NR	580	385	NR	710	28	NR	840	1	NR	970	0	NR
455	795	NR	585	382	NR	715	24	NR	845	1	NR	975	0	NR
460	615	NR	590	375	NR	720	21	NR	850	0	NR	980	0	NR
465	438	NR	595	367	NR	725	17	NR	855	0	NR	985	0	NR
470	372	NR	600	361	NR	730	15	NR	860	0	NR	990	0	NR
475	290	NR	605	355	NR	735	13	NR	865	0	NR	995	0	NR
480	236	NR	610	383	NR	740	11	NR	870	0	NR	1000	0	NR
485	232	NR	615	408	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-8

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 4.62

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	249	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	269	NR	625	339	NR	755	7	NR	885	0	NR
370	0	NR	500	296	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	325	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	347	NR	640	221	NR	770	4	NR	900	0	NR
385	0	NR	515	363	NR	645	210	NR	775	4	NR	905	0	NR
390	1	NR	520	371	NR	650	186	NR	780	3	NR	910	0	NR
395	3	NR	525	378	NR	655	155	NR	785	3	NR	915	0	NR
400	4	NR	530	381	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	383	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	385	NR	670	102	NR	800	2	NR	930	0	NR
415	10	NR	545	389	NR	675	84	NR	805	1	NR	935	0	NR
420	17	NR	550	391	NR	680	72	NR	810	1	NR	940	0	NR
425	29	NR	555	392	NR	685	62	NR	815	1	NR	945	0	NR
430	53	NR	560	393	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	394	NR	695	45	NR	825	1	NR	955	0	NR
440	173	NR	570	391	NR	700	39	NR	830	1	NR	960	0	NR
445	321	NR	575	389	NR	705	33	NR	835	1	NR	965	0	NR
450	597	NR	580	385	NR	710	28	NR	840	1	NR	970	0	NR
455	795	NR	585	382	NR	715	24	NR	845	1	NR	975	0	NR
460	615	NR	590	375	NR	720	21	NR	850	0	NR	980	0	NR
465	438	NR	595	367	NR	725	17	NR	855	0	NR	985	0	NR
470	372	NR	600	361	NR	730	15	NR	860	0	NR	990	0	NR
475	290	NR	605	355	NR	735	13	NR	865	0	NR	995	0	NR
480	236	NR	610	383	NR	740	11	NR	870	0	NR	1000	0	NR
485	232	NR	615	408	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP3-2508-516-8

TM-30-18

Summary

$R_f = 89.8$
 $R_g = 98.5$
 $CIE R_a = 94.6$
 $R_9 = 74.6$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 96	CES51 = 93	CES76 = 88
CES02 = 61	CES27 = 88	CES52 = 97	CES77 = 87
CES03 = 31	CES28 = 96	CES53 = 95	CES78 = 85
CES04 = 69	CES29 = 93	CES54 = 89	CES79 = 93
CES05 = 48	CES30 = 81	CES55 = 86	CES80 = 93
CES06 = 50	CES31 = 95	CES56 = 90	CES81 = 80
CES07 = 41	CES32 = 93	CES57 = 87	CES82 = 96
CES08 = 40	CES33 = 91	CES58 = 87	CES83 = 95
CES09 = 29	CES34 = 95	CES59 = 96	CES84 = 93
CES10 = 73	CES35 = 96	CES60 = 89	CES85 = 81
CES11 = 56	CES36 = 74	CES61 = 89	CES86 = 85
CES12 = 62	CES37 = 95	CES62 = 78	CES87 = 93
CES13 = 42	CES38 = 76	CES63 = 89	CES88 = 96
CES14 = 74	CES39 = 98	CES64 = 84	CES89 = 87
CES15 = 71	CES40 = 98	CES65 = 86	CES90 = 93
CES16 = 47	CES41 = 92	CES66 = 81	CES91 = 68
CES17 = 48	CES42 = 95	CES67 = 80	CES92 = 78
CES18 = 56	CES43 = 96	CES68 = 85	CES93 = 86
CES19 = 70	CES44 = 99	CES69 = 85	CES94 = 79
CES20 = 65	CES45 = 100	CES70 = 84	CES95 = 82
CES21 = 85	CES46 = 96	CES71 = 75	CES96 = 93
CES22 = 77	CES47 = 91	CES72 = 92	CES97 = 96
CES23 = 91	CES48 = 84	CES73 = 80	CES98 = 94
CES24 = 90	CES49 = 97	CES74 = 89	CES99 = 92
CES25 = 70	CES50 = 95	CES75 = 78	



Color Rendition by Hue-Angle Bin


Measure Comparisons



(END OF REPORT)