

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975137

Luminaire Tested: 12EN-LD2-08-UNV-L840-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975137
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 12EN-LD2-08-UNV-L840-CD1
Description: METALUX ENCOUNTER 1x2 800LM PACKAGE 80CRI 4000K TROFFER
Light Source: 4000K CCT, 80+ CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 840.0 lumens
Efficiency: N/A
Efficacy: 84.8 lumens/watt
Spacing Criteria (0/90/45): 1.26 / 1.26 / 1.38
Luminous Opening: Rectangular (W 1' x L: 2' x H: 0')
CIE Type: Direct

Input Watts (W): 9.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P975137

CATALOG NUMBER: 12EN-LD2-08-UNV-L840-CD1

Luminous Intensity Polar Plot

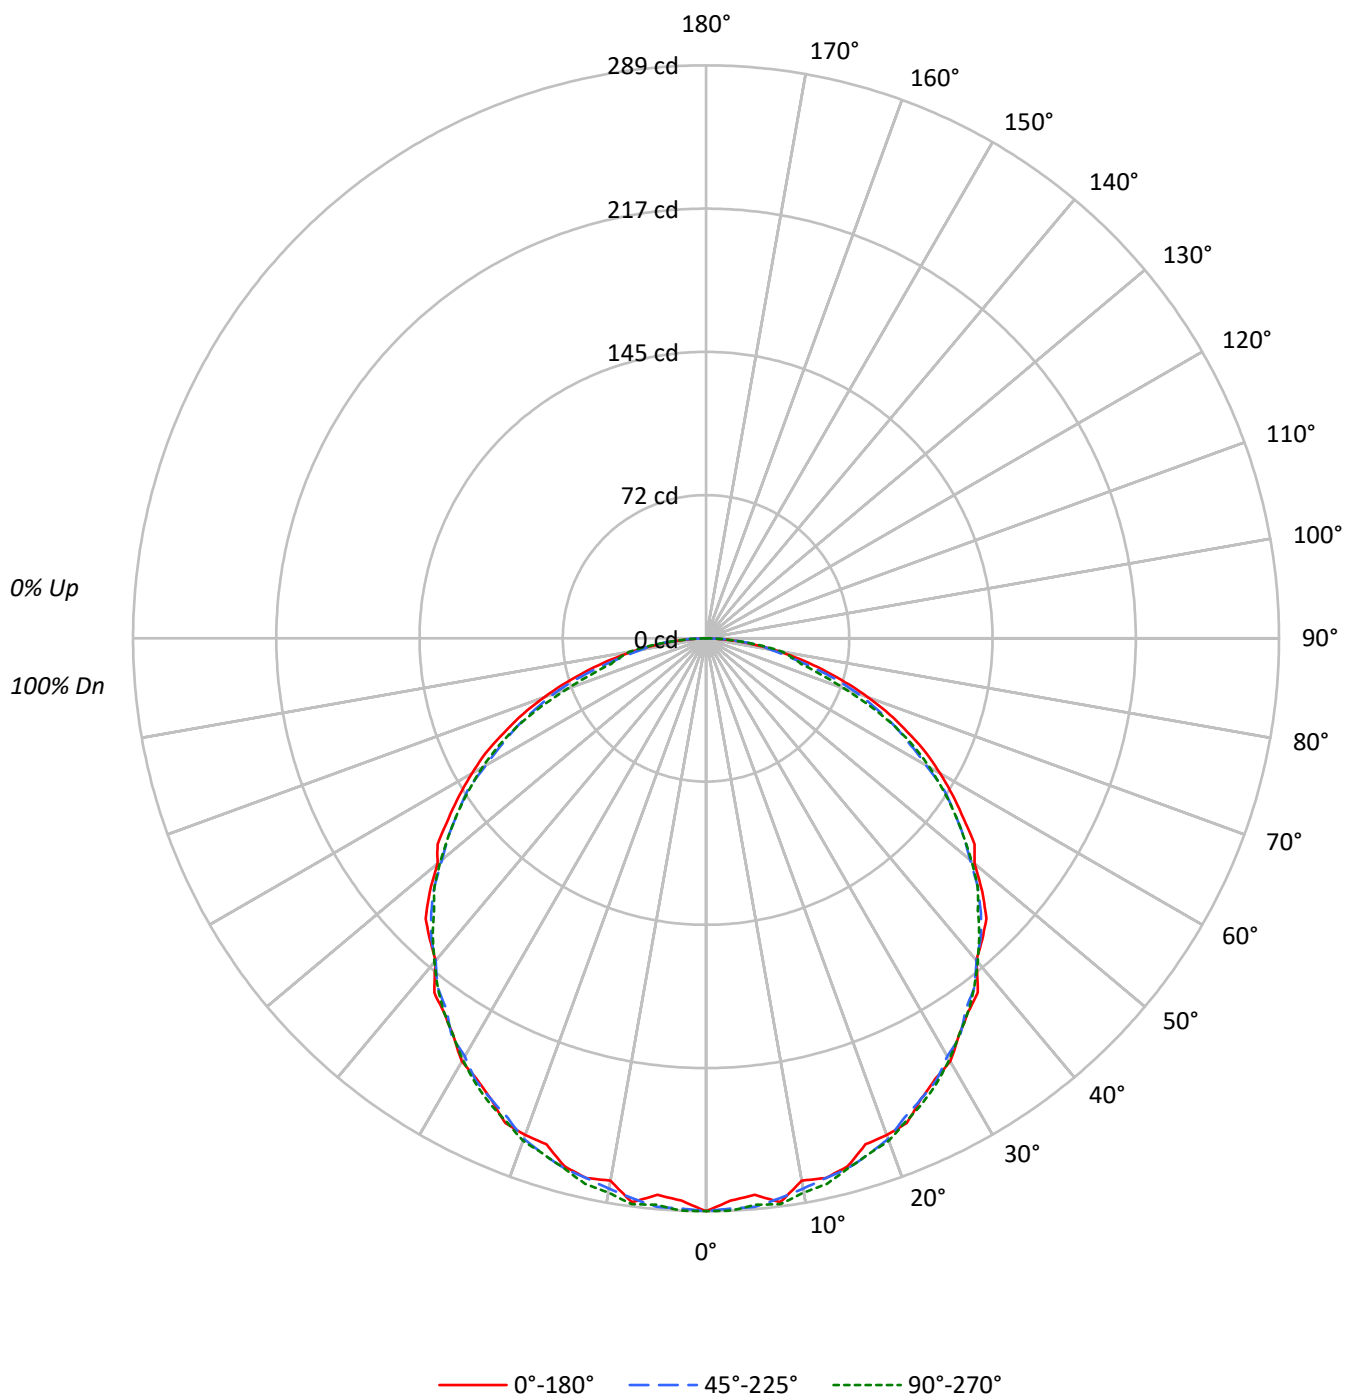

TEST NUMBER: P975137

CATALOG NUMBER: 12EN-LD2-08-UNV-L840-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	109	104	99	95	106	101	97	94	97	94	91		93	90	88		90
2	99	90	83	77	96	88	82	76	85	79	75		81	77	73		78
3	90	79	71	64	87	77	70	63	74	68	62		72	66	61		69
4	82	70	61	54	80	69	60	54	66	59	53		64	57	52		61
5	75	62	53	46	73	61	53	46	59	52	46		57	50	45		55
6	70	56	47	40	68	55	47	40	53	46	40		52	45	40		50
7	64	51	42	36	63	50	42	36	48	41	35		47	40	35		46
8	60	46	38	32	58	46	37	32	44	37	31		43	36	31		42
9	56	42	34	29	55	42	34	28	41	33	28		40	33	28		39
10	52	39	31	26	51	39	31	26	38	31	26		37	30	26		36

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1555	1555	1555
5°	1522	1555	1549
10°	1518	1540	1551
15°	1536	1542	1542
20°	1527	1539	1545
25°	1523	1523	1536
30°	1531	1513	1525
35°	1513	1500	1513
40°	1490	1490	1497
45°	1522	1492	1476
50°	1480	1455	1464
55°	1488	1432	1432
60°	1468	1381	1403
65°	1429	1338	1338
70°	1366	1287	1175
75°	1260	1133	1029
80°	1125	1032	1221
85°	932	1062	1000

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1522 cd/sqm

TEST NUMBER: P975137

CATALOG NUMBER: 12EN-LD2-08-UNV-L840-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	27.3	3.3
10°-20°	78.0	9.3
20°-30°	118.7	14.1
30°-40°	143.8	17.1
40°-50°	150.9	18.0
50°-60°	138.0	16.4
60°-70°	105.5	12.6
70°-80°	59.3	7.1
80°-90°	18.5	2.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	224.0	26.7
0°-40°	367.8	43.8
0°-60°	656.7	78.2
0°-90°	840.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	840.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	289	289	289	289	289	
5°	282	287	288	290	287	27
15°	276	276	277	277	277	77
25°	256	258	256	259	259	119
35°	230	229	228	230	230	144
45°	200	197	196	194	194	152
55°	159	157	153	153	153	142
65°	112	109	105	104	105	111
75°	61	59	54	50	50	64
85°	15	15	17	16	16	18
90°	0	0	0	0	0	

TEST NUMBER: P975137

CATALOG NUMBER: 12EN-LD2-08-UNV-L840-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	288.9	288.9	288.9	288.9	288.9
2.5°	283.8	287.8	287.8	290.0	288.9
5°	281.8	286.8	287.8	290.0	286.8
7.5°	286.8	285.8	284.8	286.8	287.8
10°	277.7	281.8	281.8	286.8	283.8
12.5°	278.8	279.8	278.8	278.8	281.8
15°	275.7	275.7	276.7	276.7	276.7
17.5°	267.6	271.7	272.7	273.7	272.7
20°	266.6	267.6	268.7	269.7	269.7
22.5°	264.6	262.6	261.6	265.6	263.6
25°	256.5	257.6	256.5	258.6	258.6
27.5°	250.5	250.5	251.5	250.5	252.5
30°	246.4	245.4	243.4	245.4	245.4
32.5°	237.4	238.4	238.4	237.4	237.4
35°	230.3	229.3	228.3	230.3	230.3
37.5°	225.2	220.2	222.2	221.2	222.2
40°	212.1	215.1	212.1	212.1	213.1
42.5°	206.1	205.1	205.1	204.0	204.0
45°	200.0	197.0	196.0	193.9	193.9
47.5°	188.9	188.9	185.9	183.9	185.9
50°	176.8	177.8	173.8	172.7	174.8
52.5°	170.7	167.7	163.7	164.7	163.7
55°	158.6	156.6	152.6	152.6	152.6
57.5°	147.5	146.5	142.5	141.4	141.4
60°	136.4	134.4	128.3	129.3	130.3
62.5°	125.3	122.3	116.2	118.2	118.2
65°	112.2	109.1	105.1	104.1	105.1
67.5°	100.1	95.9	92.9	91.9	89.9
70°	86.8	84.8	81.8	75.7	74.7
72.5°	73.7	70.7	68.7	61.6	60.6
75°	60.6	58.6	54.5	50.5	49.5
77.5°	48.5	47.5	42.4	42.4	44.4
80°	36.3	35.3	33.3	37.4	39.4
82.5°	25.2	24.2	27.3	28.3	28.3
85°	15.1	15.1	17.2	16.2	16.2
87.5°	6.1	7.1	7.1	8.1	8.1
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-3

Test Date: 07/15/2025

Luminaire Tested: 14EN-LD2-51-UNV-L940-CD1-U

Data in this report applies to families of products including 14EN-LD2-51-UNV-L940-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-457-3
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/15/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **14EN-LD2-51-UNV-L940-CD1-U**
 Description: 1x4 ENCOUNTER 5100LM WITH LIGHTNING BOARDS

Spectral Parameters

CCT (K): 3853
 CIE u' : 0.2278
 CIE v' : 0.5044
 Duv: 0.0001
 CIE x: 0.3872
 CIE y: 0.3810
 CIE z: 0.2318
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 579
 Purity: 30.54407
 R_f: 91.2
 R_g: 99.8

CRI (Ra): 93.4
 R1: 94.4
 R2: 95.6
 R3: 95.4
 R4: 94.7
 R5: 93.7
 R6: 93.8
 R7: 93.9
 R8: 85.8
 R9: 62.8
 R10: 88.3
 R11: 95.1
 R12: 75.5
 R13: 94.6
 R14: 96.8
 R15: 91.2



Test Conditions

Stabilization Time: 35M
 Operation Time: 1H 35M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-457-3

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-3

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-3

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	168	NR	620	331	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	331	NR	755	6	NR	885	0	NR
370	0	NR	500	227	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	248	NR	635	646	NR	765	5	NR	895	0	NR
380	0	NR	510	263	NR	640	219	NR	770	4	NR	900	0	NR
385	0	NR	515	272	NR	645	210	NR	775	3	NR	905	0	NR
390	1	NR	520	277	NR	650	183	NR	780	3	NR	910	0	NR
395	2	NR	525	283	NR	655	155	NR	785	3	NR	915	0	NR
400	3	NR	530	288	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	294	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	301	NR	670	102	NR	800	2	NR	930	0	NR
415	11	NR	545	308	NR	675	84	NR	805	1	NR	935	0	NR
420	19	NR	550	315	NR	680	72	NR	810	1	NR	940	0	NR
425	34	NR	555	322	NR	685	61	NR	815	1	NR	945	0	NR
430	57	NR	560	327	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	331	NR	695	45	NR	825	1	NR	955	0	NR
440	163	NR	570	334	NR	700	39	NR	830	1	NR	960	0	NR
445	293	NR	575	337	NR	705	33	NR	835	1	NR	965	0	NR
450	428	NR	580	339	NR	710	28	NR	840	1	NR	970	0	NR
455	351	NR	585	341	NR	715	23	NR	845	0	NR	975	0	NR
460	229	NR	590	342	NR	720	19	NR	850	0	NR	980	0	NR
465	192	NR	595	339	NR	725	16	NR	855	0	NR	985	0	NR
470	152	NR	600	338	NR	730	13	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	125	NR	610	361	NR	740	10	NR	870	0	NR	1000	0	NR
485	144	NR	615	378	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-3

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.74

λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)
360	0	NR	490	168	NR	620	331	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	331	NR	755	6	NR	885	0	NR
370	0	NR	500	227	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	248	NR	635	646	NR	765	5	NR	895	0	NR
380	0	NR	510	263	NR	640	219	NR	770	4	NR	900	0	NR
385	0	NR	515	272	NR	645	210	NR	775	3	NR	905	0	NR
390	1	NR	520	277	NR	650	183	NR	780	3	NR	910	0	NR
395	2	NR	525	283	NR	655	155	NR	785	3	NR	915	0	NR
400	3	NR	530	288	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	294	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	301	NR	670	102	NR	800	2	NR	930	0	NR
415	11	NR	545	308	NR	675	84	NR	805	1	NR	935	0	NR
420	19	NR	550	315	NR	680	72	NR	810	1	NR	940	0	NR
425	34	NR	555	322	NR	685	61	NR	815	1	NR	945	0	NR
430	57	NR	560	327	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	331	NR	695	45	NR	825	1	NR	955	0	NR
440	163	NR	570	334	NR	700	39	NR	830	1	NR	960	0	NR
445	293	NR	575	337	NR	705	33	NR	835	1	NR	965	0	NR
450	428	NR	580	339	NR	710	28	NR	840	1	NR	970	0	NR
455	351	NR	585	341	NR	715	23	NR	845	0	NR	975	0	NR
460	229	NR	590	342	NR	720	19	NR	850	0	NR	980	0	NR
465	192	NR	595	339	NR	725	16	NR	855	0	NR	985	0	NR
470	152	NR	600	338	NR	730	13	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	125	NR	610	361	NR	740	10	NR	870	0	NR	1000	0	NR
485	144	NR	615	378	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-3

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.58

λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	168	NR	620	331	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	331	NR	755	6	NR	885	0	NR
370	0	NR	500	227	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	248	NR	635	646	NR	765	5	NR	895	0	NR
380	0	NR	510	263	NR	640	219	NR	770	4	NR	900	0	NR
385	0	NR	515	272	NR	645	210	NR	775	3	NR	905	0	NR
390	1	NR	520	277	NR	650	183	NR	780	3	NR	910	0	NR
395	2	NR	525	283	NR	655	155	NR	785	3	NR	915	0	NR
400	3	NR	530	288	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	294	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	301	NR	670	102	NR	800	2	NR	930	0	NR
415	11	NR	545	308	NR	675	84	NR	805	1	NR	935	0	NR
420	19	NR	550	315	NR	680	72	NR	810	1	NR	940	0	NR
425	34	NR	555	322	NR	685	61	NR	815	1	NR	945	0	NR
430	57	NR	560	327	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	331	NR	695	45	NR	825	1	NR	955	0	NR
440	163	NR	570	334	NR	700	39	NR	830	1	NR	960	0	NR
445	293	NR	575	337	NR	705	33	NR	835	1	NR	965	0	NR
450	428	NR	580	339	NR	710	28	NR	840	1	NR	970	0	NR
455	351	NR	585	341	NR	715	23	NR	845	0	NR	975	0	NR
460	229	NR	590	342	NR	720	19	NR	850	0	NR	980	0	NR
465	192	NR	595	339	NR	725	16	NR	855	0	NR	985	0	NR
470	152	NR	600	338	NR	730	13	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	125	NR	610	361	NR	740	10	NR	870	0	NR	1000	0	NR
485	144	NR	615	378	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-3



TM-30-18

Summary

$R_f = 91.2$
 $R_g = 99.8$
 $CIE R_a = 93.4$
 $R_9 = 62.8$



Color Vector Graphics

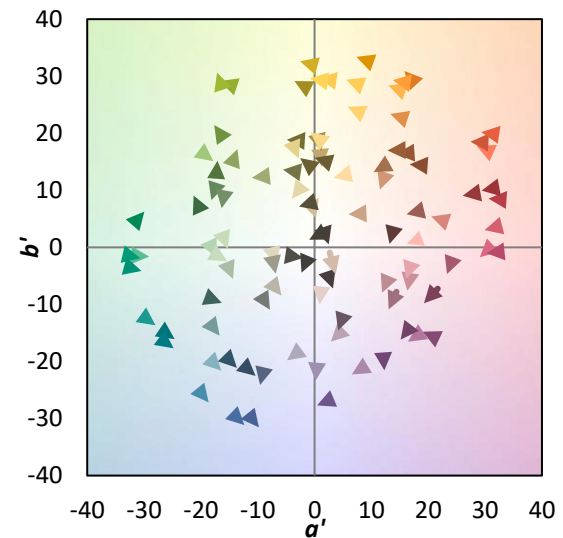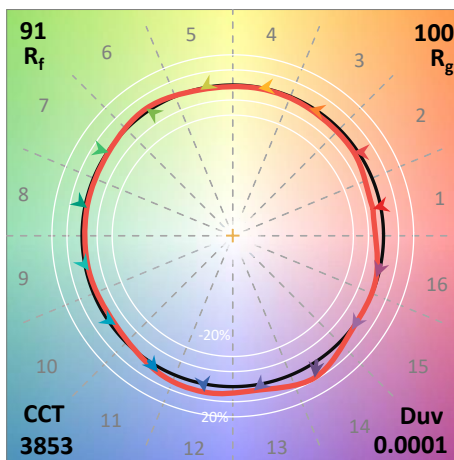

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 93	CES51 = 98	CES76 = 86
CES02 = 62	CES27 = 92	CES52 = 99	CES77 = 88
CES03 = 31	CES28 = 96	CES53 = 97	CES78 = 82
CES04 = 69	CES29 = 95	CES54 = 94	CES79 = 93
CES05 = 49	CES30 = 94	CES55 = 93	CES80 = 92
CES06 = 50	CES31 = 96	CES56 = 95	CES81 = 79
CES07 = 42	CES32 = 88	CES57 = 94	CES82 = 96
CES08 = 41	CES33 = 98	CES58 = 95	CES83 = 95
CES09 = 29	CES34 = 93	CES59 = 97	CES84 = 94
CES10 = 74	CES35 = 96	CES60 = 93	CES85 = 81
CES11 = 57	CES36 = 82	CES61 = 92	CES86 = 83
CES12 = 63	CES37 = 94	CES62 = 88	CES87 = 91
CES13 = 43	CES38 = 89	CES63 = 93	CES88 = 97
CES14 = 74	CES39 = 99	CES64 = 91	CES89 = 85
CES15 = 71	CES40 = 97	CES65 = 89	CES90 = 97
CES16 = 47	CES41 = 97	CES66 = 88	CES91 = 73
CES17 = 49	CES42 = 93	CES67 = 87	CES92 = 77
CES18 = 56	CES43 = 93	CES68 = 88	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 89	CES94 = 75
CES20 = 66	CES45 = 96	CES70 = 86	CES95 = 82
CES21 = 85	CES46 = 96	CES71 = 81	CES96 = 92
CES22 = 78	CES47 = 93	CES72 = 94	CES97 = 94
CES23 = 91	CES48 = 93	CES73 = 80	CES98 = 94
CES24 = 90	CES49 = 95	CES74 = 92	CES99 = 93
CES25 = 71	CES50 = 99	CES75 = 82	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)