

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975146

Luminaire Tested: 12EN-LD2-13-UNV-L950-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975146
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 12EN-LD2-13-UNV-L950-CD1
Description: METALUX ENCOUNTER 1x2 1300LM PACKAGE 90CRI 5000K TROFFER
Light Source: 5000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1344.9 lumens
Efficiency: N/A
Efficacy: 110.2 lumens/watt
Spacing Criteria (0/90/45): 1.26 / 1.26 / 1.38
Luminous Opening: Rectangular (W 1' x L: 2' x H: 0')
CIE Type: Direct

Input Watts (W): 12.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P975146

CATALOG NUMBER: 12EN-LD2-13-UNV-L950-CD1

Luminous Intensity Polar Plot

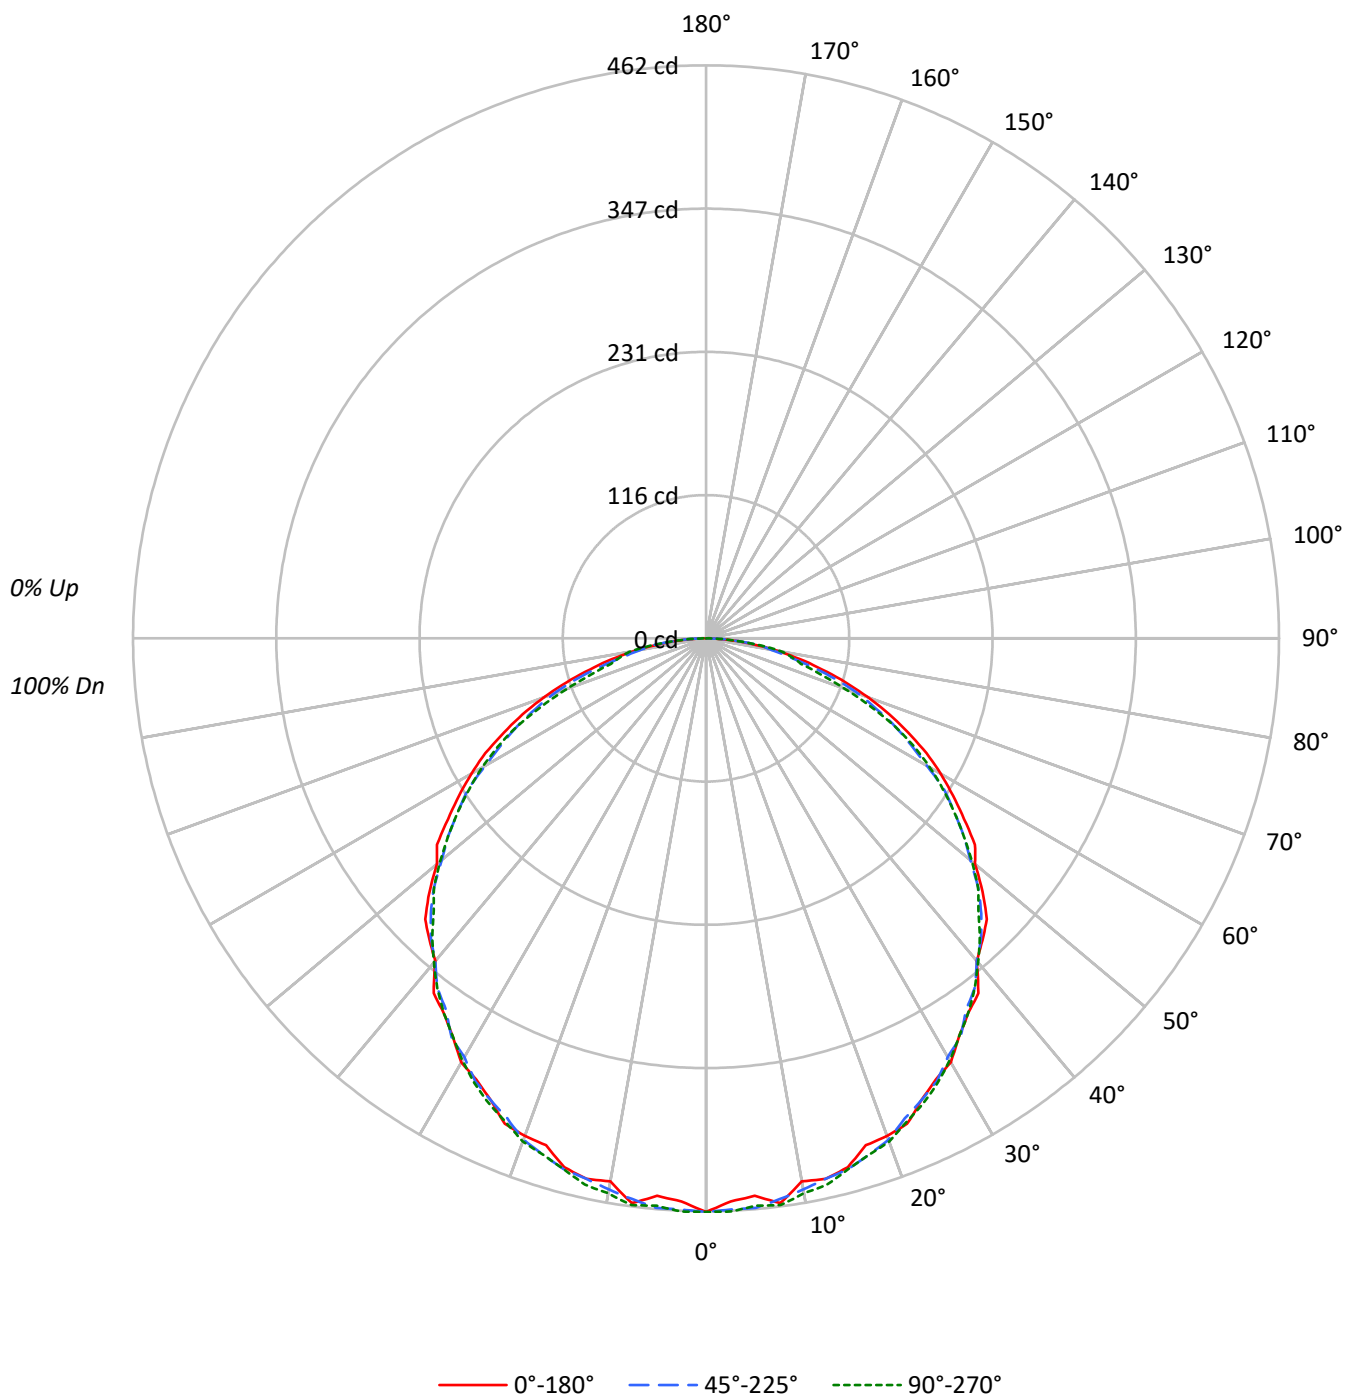

TEST NUMBER: P975146

CATALOG NUMBER: 12EN-LD2-13-UNV-L950-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	109	104	99	95	106	101	97	94	97	94	91		93	90	88		90	87	85	83
2	99	90	83	77	96	88	82	76	85	79	75		81	77	73		78	75	71	69
3	90	79	71	64	87	77	70	63	74	68	62		72	66	61		69	64	60	58
4	82	70	61	54	80	69	60	54	66	59	53		64	57	52		61	56	52	49
5	75	62	53	46	73	61	53	46	59	52	46		57	50	45		55	49	45	43
6	70	56	47	40	68	55	47	40	53	46	40		52	45	40		50	44	39	37
7	64	51	42	36	63	50	42	36	48	41	35		47	40	35		46	39	35	33
8	60	46	38	32	58	46	37	32	44	37	31		43	36	31		42	36	31	29
9	56	42	34	29	55	42	34	28	41	33	28		40	33	28		39	32	28	26
10	53	39	31	26	51	39	31	26	38	31	26		37	30	26		36	30	25	24

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2489	2489	2489
5°	2438	2490	2481
10°	2430	2466	2483
15°	2460	2469	2469
20°	2445	2464	2473
25°	2439	2439	2458
30°	2452	2422	2442
35°	2422	2401	2422
40°	2386	2386	2398
45°	2437	2388	2363
50°	2370	2329	2343
55°	2383	2292	2292
60°	2351	2212	2246
65°	2287	2143	2143
70°	2187	2060	1882
75°	2017	1815	1647
80°	1804	1652	1953
85°	1494	1698	1599

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2437 cd/sqm

TEST NUMBER: P975146

CATALOG NUMBER: 12EN-LD2-13-UNV-L950-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	43.7	3.3
10°-20°	124.9	9.3
20°-30°	190.1	14.1
30°-40°	230.3	17.1
40°-50°	241.6	18.0
50°-60°	221.0	16.4
60°-70°	168.9	12.6
70°-80°	94.9	7.1
80°-90°	29.6	2.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	358.7	26.7
0°-40°	589.0	43.8
0°-60°	1051.6	78.2
0°-90°	1344.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1344.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	462	462	462	462	462	
5°	451	459	461	464	459	43
15°	442	442	443	443	443	124
25°	411	412	411	414	414	190
35°	369	367	366	369	369	231
45°	320	315	314	310	310	244
55°	254	251	244	244	244	227
65°	180	175	168	167	168	178
75°	97	94	87	81	79	103
85°	24	24	28	26	26	28
90°	0	0	0	0	0	

TEST NUMBER: P975146

CATALOG NUMBER: 12EN-LD2-13-UNV-L950-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	462.5	462.5	462.5	462.5	462.5
2.5°	454.4	460.9	460.9	464.3	462.5
5°	451.2	459.3	460.9	464.3	459.3
7.5°	459.3	457.7	456.0	459.3	460.9
10°	444.7	451.2	451.2	459.3	454.4
12.5°	446.3	448.0	446.3	446.3	451.2
15°	441.5	441.5	443.1	443.1	443.1
17.5°	428.6	435.0	436.6	438.3	436.6
20°	426.9	428.6	430.2	431.8	431.8
22.5°	423.7	420.5	418.9	425.3	422.1
25°	410.8	412.4	410.8	414.0	414.0
27.5°	401.1	401.1	402.7	401.1	404.3
30°	394.6	393.0	389.8	393.0	393.0
32.5°	380.1	381.7	381.7	380.1	380.1
35°	368.7	367.1	365.5	368.7	368.7
37.5°	360.7	352.6	355.8	354.2	355.8
40°	339.6	344.5	339.6	339.6	341.3
42.5°	329.9	328.3	328.3	326.7	326.7
45°	320.2	315.4	313.8	310.5	310.5
47.5°	302.5	302.5	297.6	294.4	297.6
50°	283.1	284.7	278.2	276.6	279.8
52.5°	273.4	268.5	262.0	263.7	262.0
55°	254.0	250.7	244.3	244.3	244.3
57.5°	236.2	234.6	228.1	226.5	226.5
60°	218.4	215.2	205.5	207.1	208.7
62.5°	200.6	195.8	186.1	189.3	189.3
65°	179.6	174.8	168.3	166.7	168.3
67.5°	160.2	153.6	148.7	147.1	143.9
70°	139.0	135.8	130.9	121.2	119.6
72.5°	118.0	113.2	109.9	98.6	97.0
75°	97.0	93.8	87.3	80.8	79.2
77.5°	77.6	76.0	67.9	67.9	71.1
80°	58.2	56.6	53.3	59.8	63.0
82.5°	40.4	38.8	43.6	45.3	45.3
85°	24.2	24.2	27.5	25.9	25.9
87.5°	9.7	11.3	11.3	12.9	12.9
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-4

Test Date: 07/15/2025

Luminaire Tested: 14EN-LD2-51-UNV-L950-CD1-U

Data in this report applies to families of products including 14EN-LD2-51-UNV-L950-CD1-U


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-457-4
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/15/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **14EN-LD2-51-UNV-L950-CD1-U**
 Description: 1x4 ENCOUNTER 5100LM WITH LIGHTNING BOARDS

Spectral Parameters

CCT (K): 4838
 CIE u' : 0.2122
 CIE v' : 0.4888
 Duv: 0.0015
 CIE x: 0.3502
 CIE y: 0.3586
 CIE z: 0.2912
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 573
 Purity: 12.68613
 R_f: 91.2
 R_g: 100.8

CRI (Ra): 93.6
 R1: 94.4
 R2: 94.8
 R3: 93.6
 R4: 94.8
 R5: 93.3
 R6: 91.9
 R7: 95.9
 R8: 89.8
 R9: 69.6
 R10: 86.3
 R11: 94.3
 R12: 70.2
 R13: 94.4
 R14: 96.0
 R15: 92.2

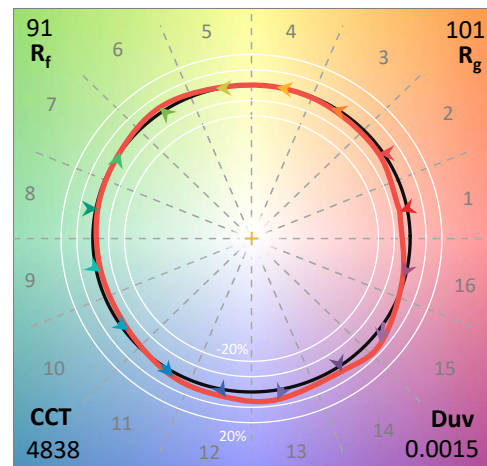

Test Conditions


Stabilization Time: M
 Operation Time: 1H 0M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-457-4


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-4

CIE 1931 Chromaticity Diagram

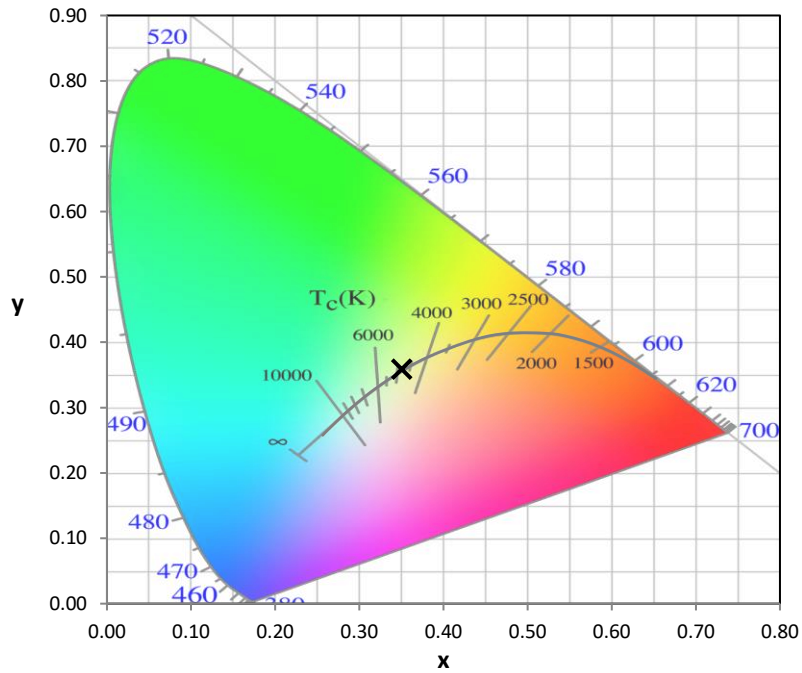


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

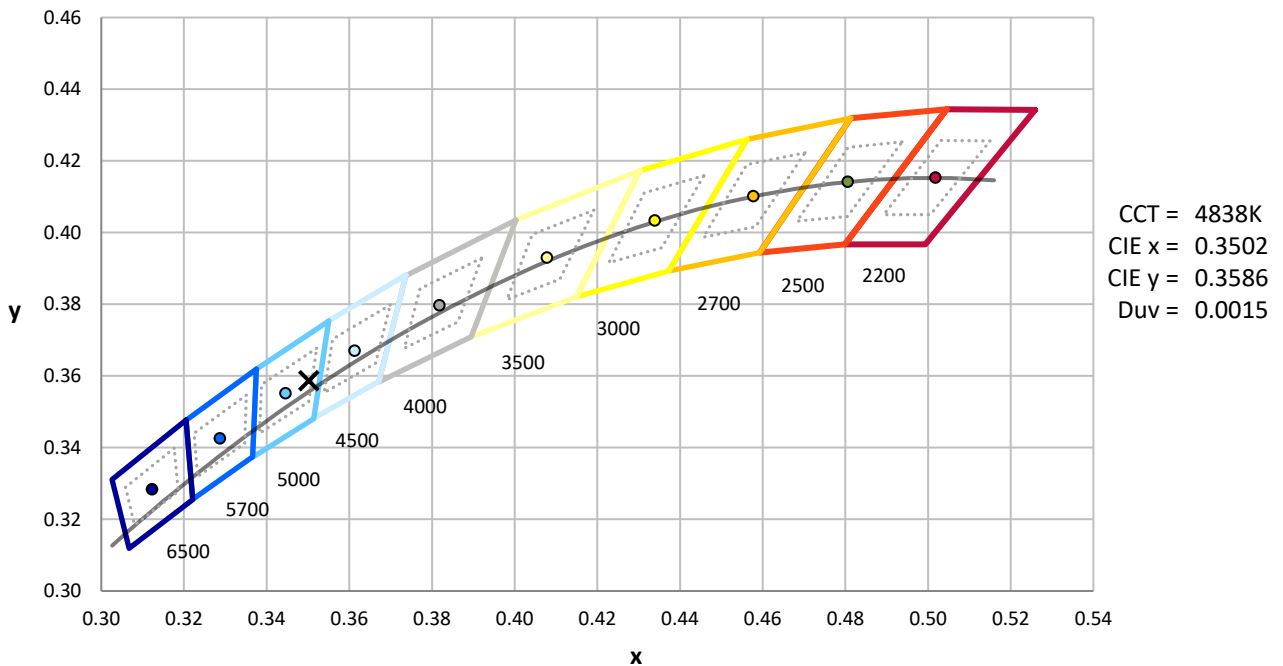

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-4

Photopic Flux vs. Wavelength

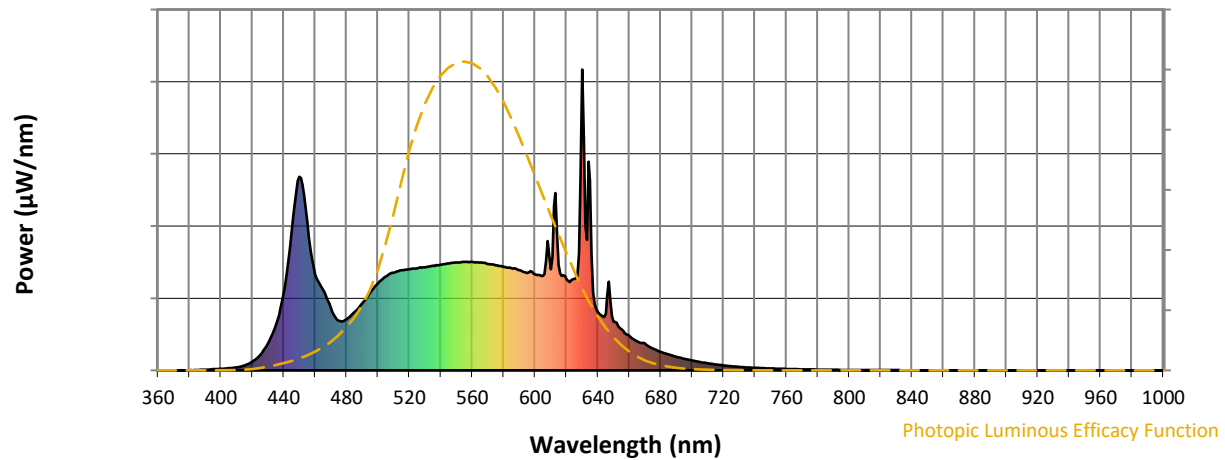


Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4

Scotopic Flux vs. Wavelength

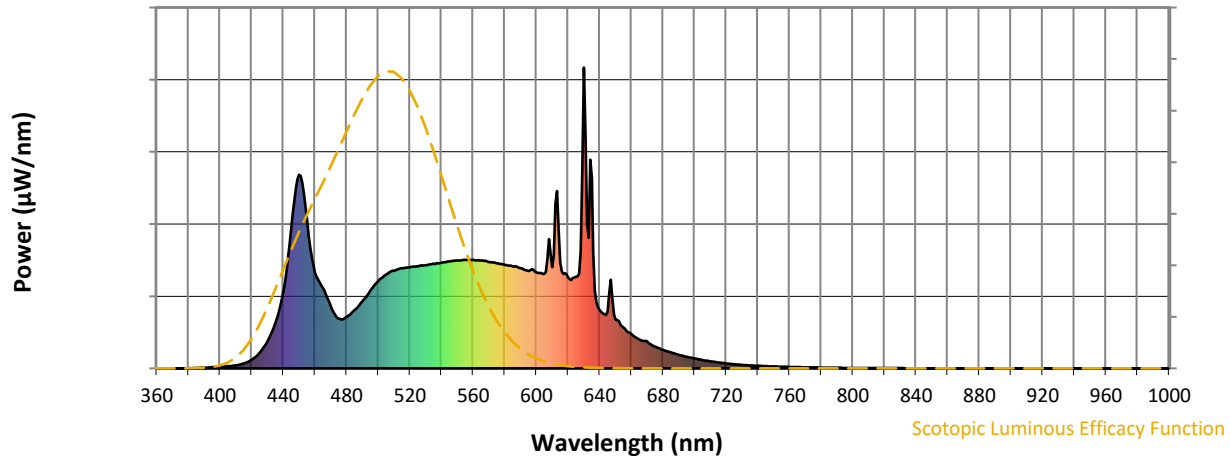


Scotopic Lumens: NR

S/P: 2.02

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4

Melanopic Flux vs. Wavelength

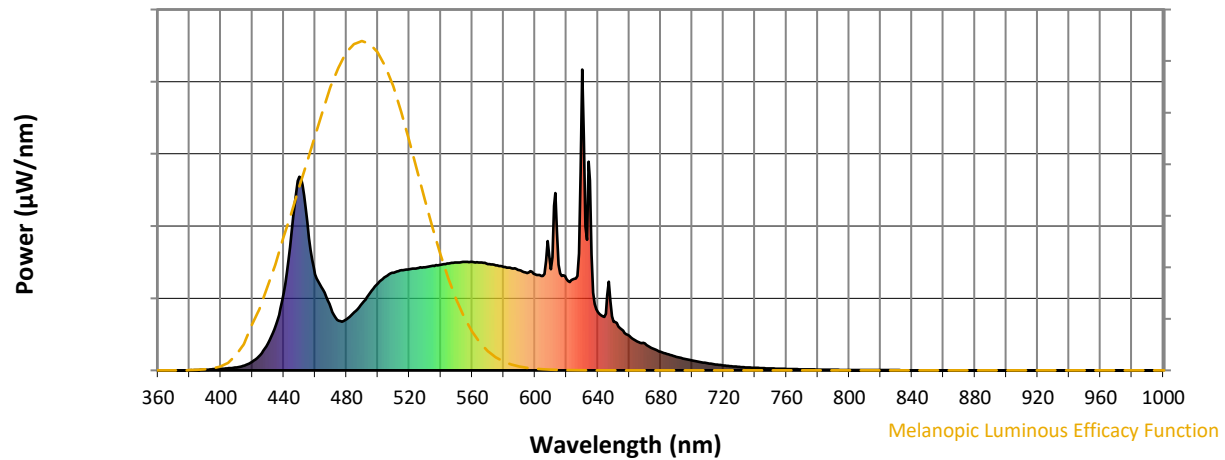

Melanopic Lumens: NR

M/P: 4.31


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4





TM-30-18

Summary

$R_f = 91.2$
 $R_g = 100.8$
 $CIE R_a = 93.6$
 $R_9 = 69.6$

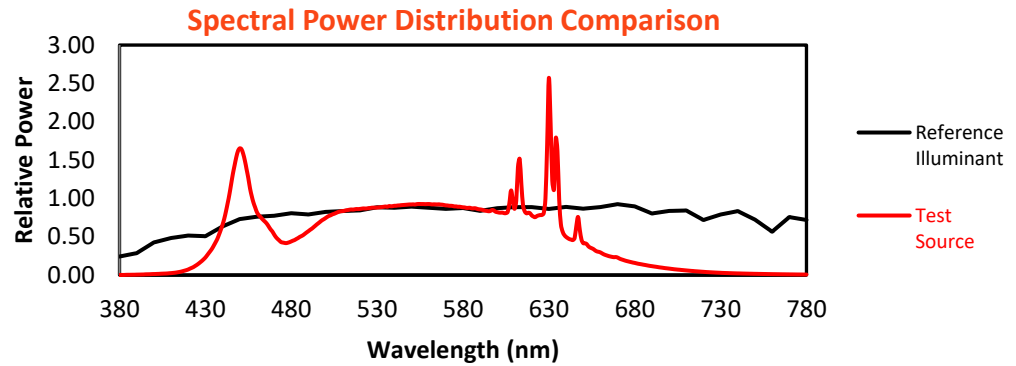


Color Vector Graphics

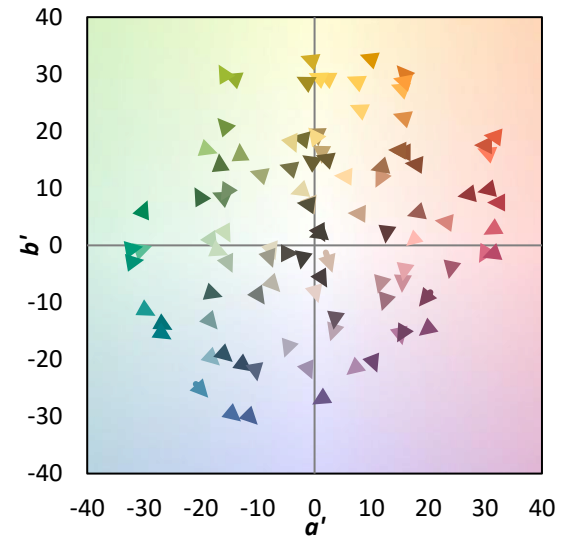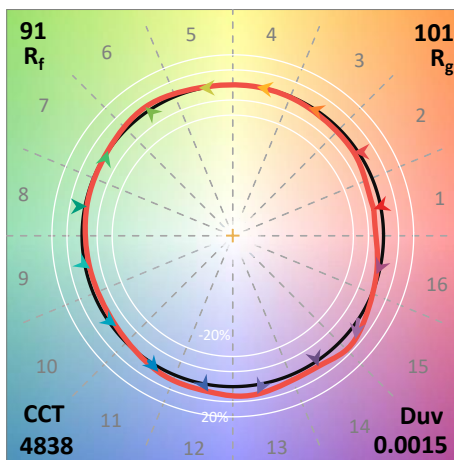
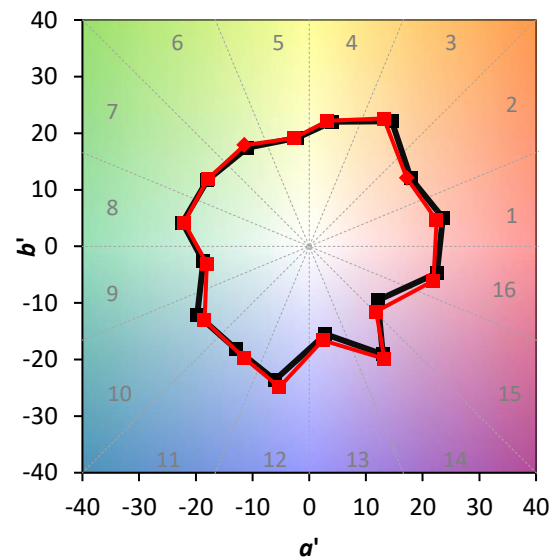
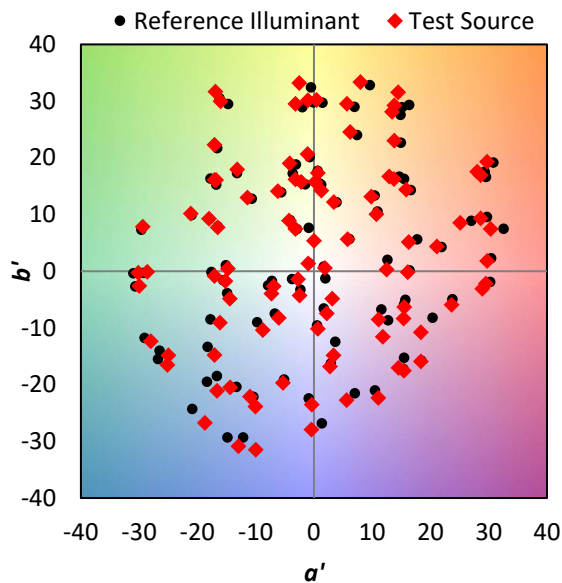




Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 90	CES51 = 99	CES76 = 83
CES02 = 61	CES27 = 93	CES52 = 98	CES77 = 88
CES03 = 31	CES28 = 94	CES53 = 96	CES78 = 80
CES04 = 69	CES29 = 92	CES54 = 96	CES79 = 95
CES05 = 48	CES30 = 98	CES55 = 94	CES80 = 92
CES06 = 50	CES31 = 93	CES56 = 95	CES81 = 84
CES07 = 41	CES32 = 86	CES57 = 94	CES82 = 96
CES08 = 40	CES33 = 96	CES58 = 95	CES83 = 96
CES09 = 29	CES34 = 90	CES59 = 98	CES84 = 93
CES10 = 73	CES35 = 94	CES60 = 94	CES85 = 84
CES11 = 56	CES36 = 84	CES61 = 93	CES86 = 87
CES12 = 62	CES37 = 93	CES62 = 90	CES87 = 90
CES13 = 42	CES38 = 92	CES63 = 93	CES88 = 97
CES14 = 74	CES39 = 98	CES64 = 91	CES89 = 86
CES15 = 71	CES40 = 96	CES65 = 89	CES90 = 98
CES16 = 47	CES41 = 98	CES66 = 88	CES91 = 75
CES17 = 48	CES42 = 91	CES67 = 87	CES92 = 79
CES18 = 56	CES43 = 91	CES68 = 88	CES93 = 88
CES19 = 70	CES44 = 99	CES69 = 89	CES94 = 78
CES20 = 65	CES45 = 94	CES70 = 84	CES95 = 83
CES21 = 85	CES46 = 95	CES71 = 80	CES96 = 92
CES22 = 77	CES47 = 94	CES72 = 93	CES97 = 93
CES23 = 91	CES48 = 95	CES73 = 78	CES98 = 93
CES24 = 90	CES49 = 94	CES74 = 93	CES99 = 94
CES25 = 70	CES50 = 99	CES75 = 81	

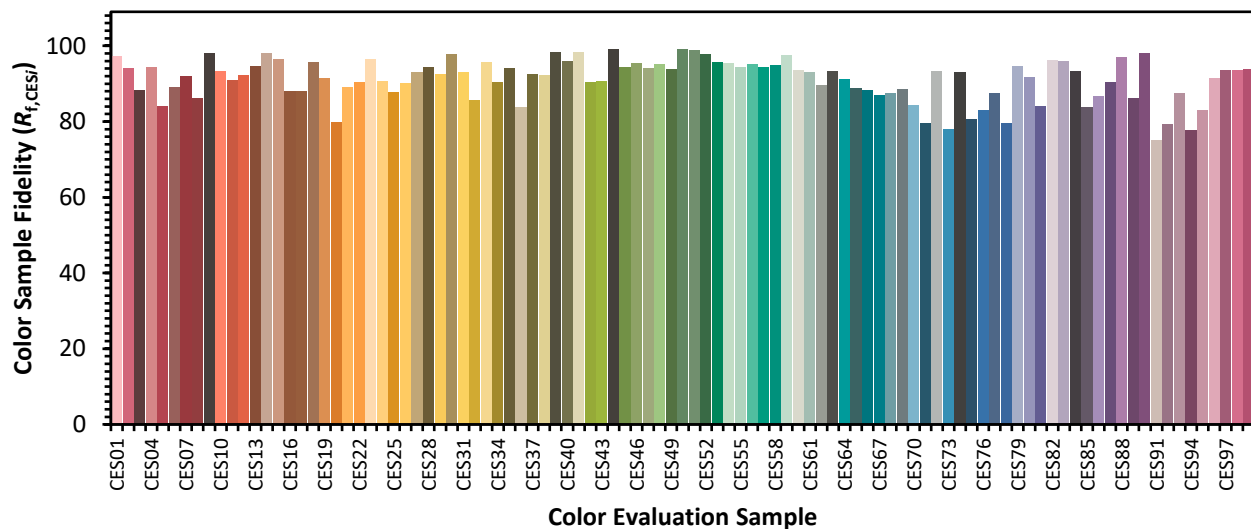

Color Rendition by Hue-Angle Bin

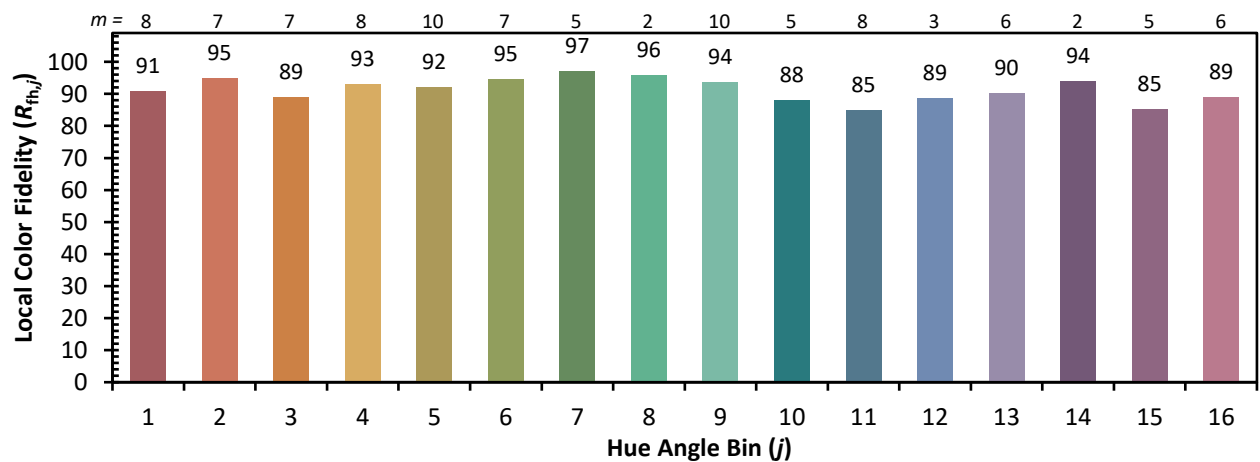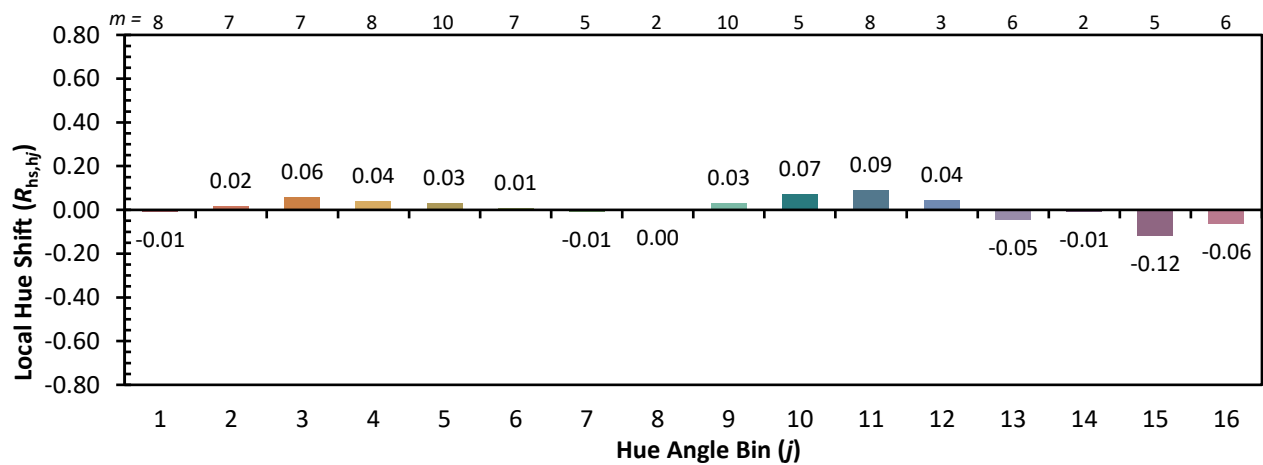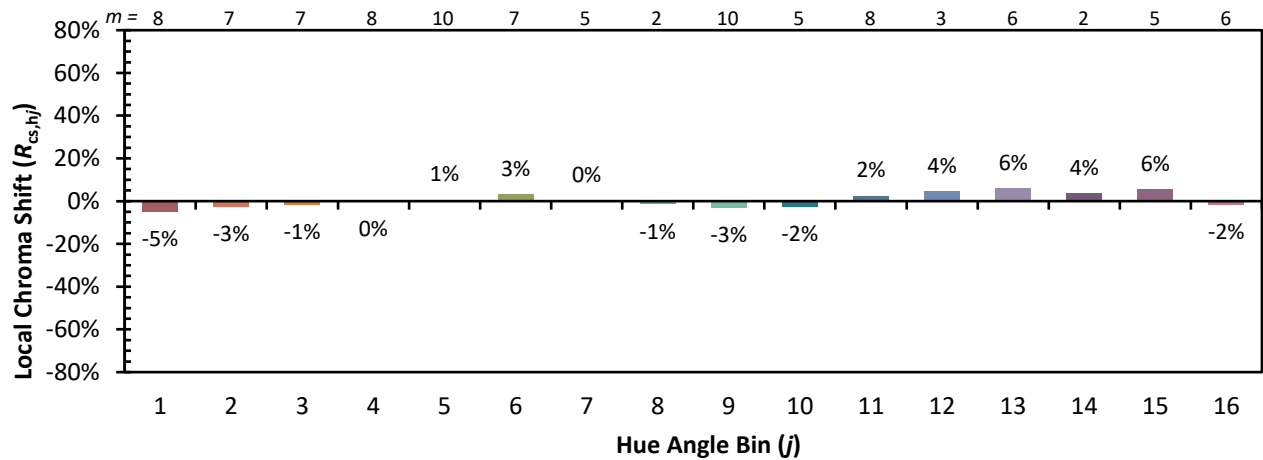

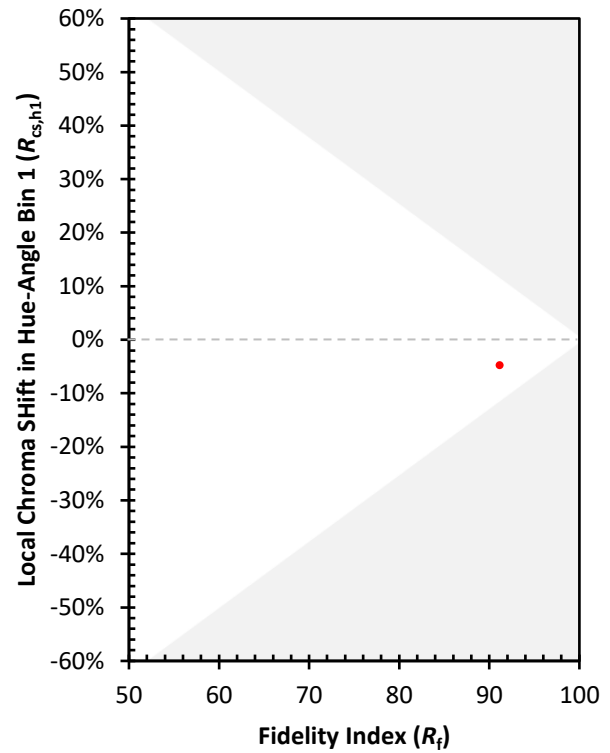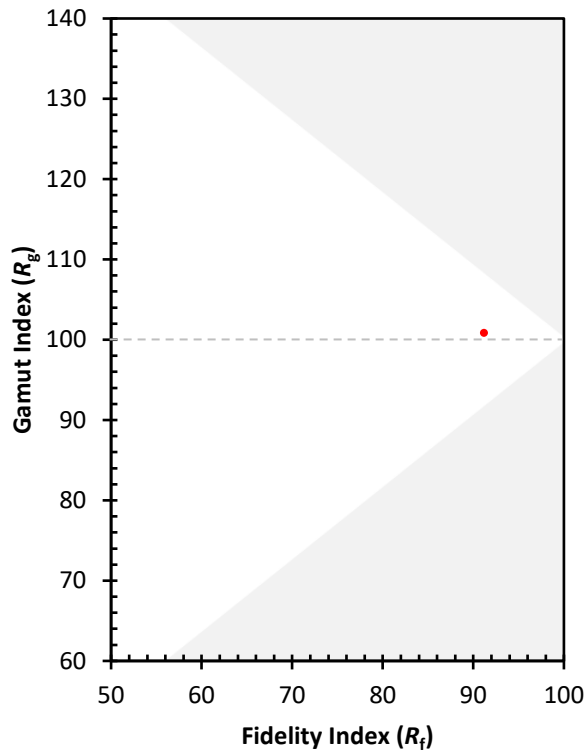Measure Comparisons


(END OF REPORT)