

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975334

Luminaire Tested: 22EN-LD2-34-UNV-L950-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975334
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 22EN-LD2-34-UNV-L950-CD1
Description: METALUX ENCOUNTER 2x2 3400LM PACKAGE 90CRI 5000K STANDARD TROFFER
Light Source: 5000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3470.9 lumens
Efficiency: N/A
Efficacy: 121.8 lumens/watt
Spacing Criteria (0/90/45): 1.27 / 1.29 / 1.39
Luminous Opening: Rectangular (W 1.67' x L: 1.83' x H: 0')
CIE Type: Direct

Input Watts (W): 28.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P975334

CATALOG NUMBER: 22EN-LD2-34-UNV-L950-CD1

Luminous Intensity Polar Plot

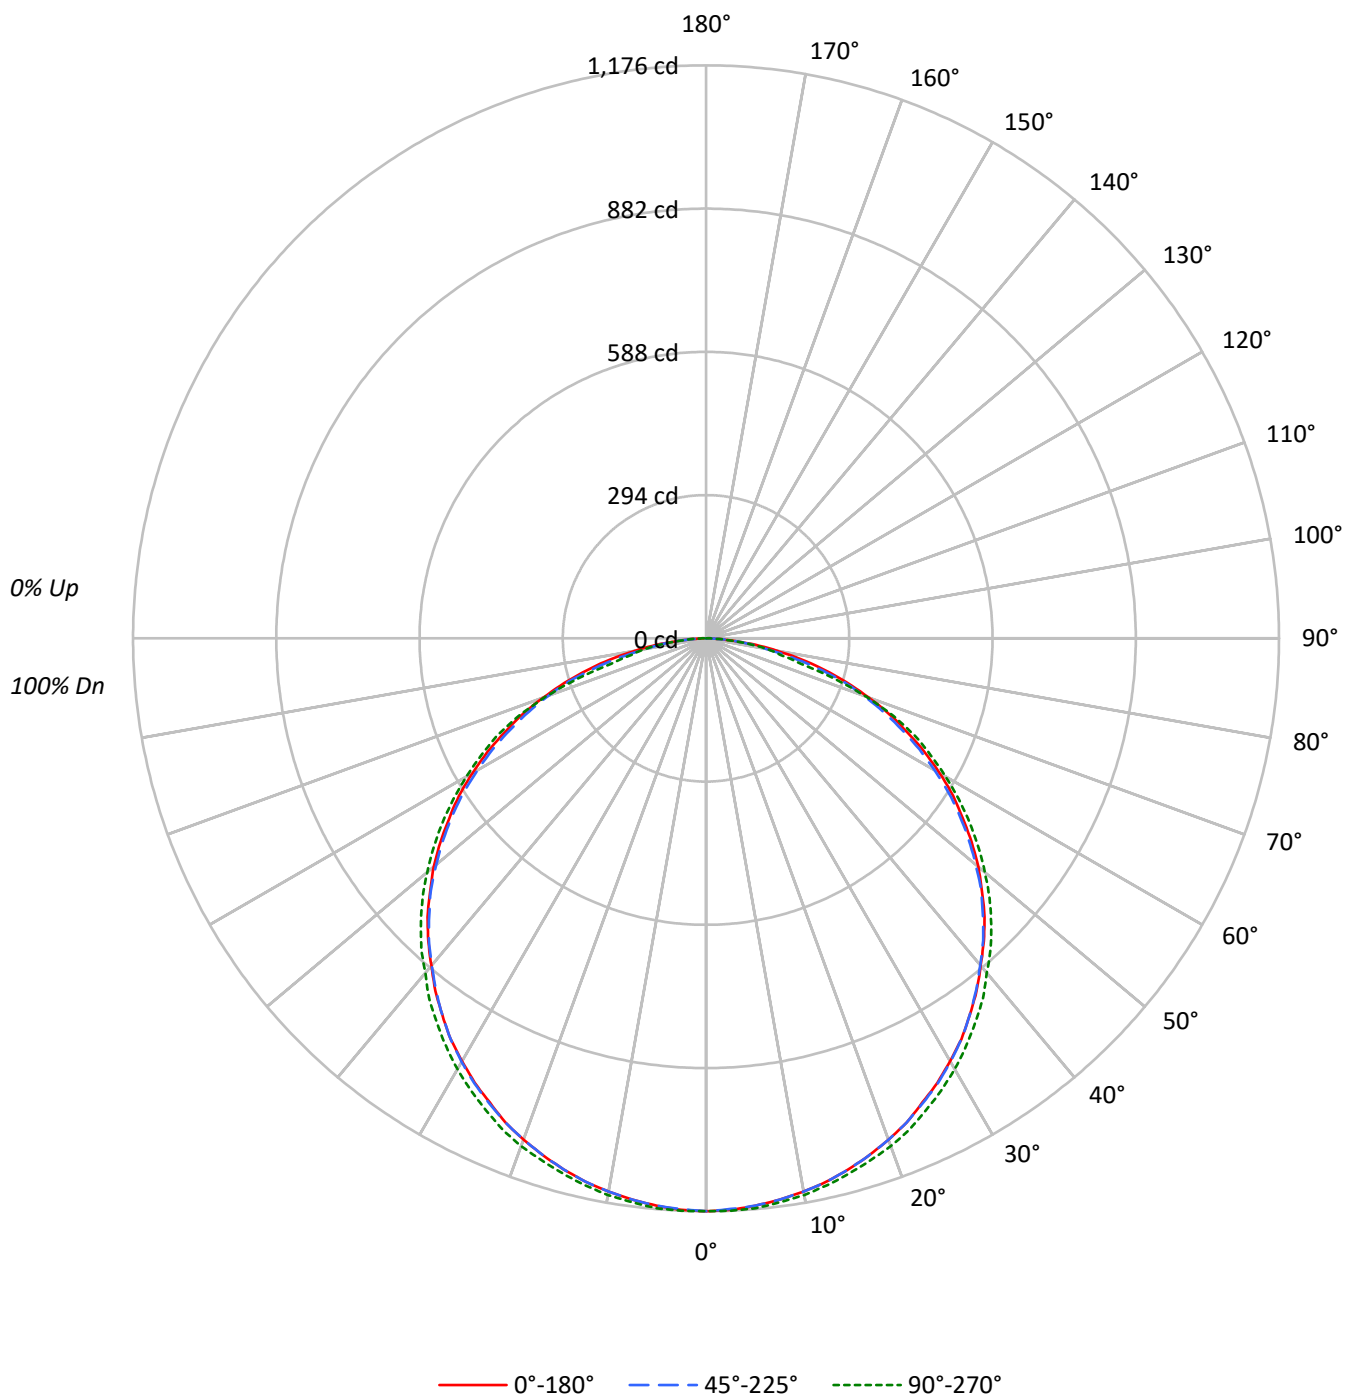

TEST NUMBER: P975334

CATALOG NUMBER: 22EN-LD2-34-UNV-L950-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	109	104	99	95	106	101	98	94	97	94	91	93	91	88	90	88	86	83		
2	99	90	83	77	96	88	82	76	85	79	75	81	77	73	78	75	71	69		
3	90	79	71	64	87	77	70	63	74	68	62	72	66	61	69	64	60	58		
4	82	70	61	54	80	68	60	54	66	59	53	64	57	52	61	56	51	49		
5	75	62	53	46	73	61	53	46	59	51	46	57	50	45	55	49	45	42		
6	69	56	47	40	68	55	46	40	53	46	40	51	45	39	50	44	39	37		
7	64	51	42	36	63	50	41	35	48	41	35	47	40	35	45	39	35	33		
8	60	46	38	32	58	45	37	32	44	37	31	43	36	31	42	36	31	29		
9	56	42	34	28	54	42	34	28	41	33	28	39	33	28	38	32	28	26		
10	52	39	31	26	51	39	31	26	38	30	26	37	30	25	36	30	25	24		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4142	4142	4142
5°	4133	4133	4152
10°	4124	4124	4149
15°	4115	4115	4147
20°	4105	4105	4157
25°	4085	4092	4153
30°	4075	4082	4153
35°	4059	4059	4142
40°	4033	4025	4122
45°	4027	4002	4124
50°	3997	3959	4094
55°	3950	3908	4058
60°	3900	3814	4000
65°	3794	3692	3941
70°	3657	3547	3603
75°	3445	3228	2752
80°	3031	2532	2637
85°	2199	2134	2061

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 45°

Luminance: 4124 cd/sqm

TEST NUMBER: P975334

CATALOG NUMBER: 22EN-LD2-34-UNV-L950-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	111.2	3.2
10°-20°	319.2	9.2
20°-30°	487.3	14.0
30°-40°	593.5	17.1
40°-50°	624.7	18.0
50°-60°	575.1	16.6
60°-70°	447.7	12.9
70°-80°	248.5	7.2
80°-90°	63.9	1.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	917.6	26.4
0°-40°	1511.1	43.5
0°-60°	2710.9	78.1
0°-90°	3470.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3470.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1176	1176	1176	1176	1176	
5°	1169	1169	1169	1172	1174	111
15°	1128	1128	1128	1134	1137	319
25°	1051	1053	1053	1062	1068	485
35°	944	944	944	954	963	591
45°	808	803	803	816	828	622
55°	643	642	636	647	661	576
65°	455	450	443	457	473	451
75°	253	248	237	211	202	267
85°	54	51	53	51	51	69
90°	0	0	0	0	0	

TEST NUMBER: P975334

CATALOG NUMBER: 22EN-LD2-34-UNV-L950-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1175.8	1175.8	1175.8	1175.8	1175.8
2.5°	1174.1	1172.3	1172.3	1175.8	1175.8
5°	1168.8	1168.8	1168.8	1172.3	1174.1
7.5°	1161.6	1161.6	1161.6	1167.0	1167.0
10°	1153.0	1151.2	1153.0	1156.5	1160.0
12.5°	1142.4	1140.6	1142.4	1145.9	1149.4
15°	1128.3	1128.3	1128.3	1133.6	1137.1
17.5°	1112.5	1110.7	1112.5	1117.8	1123.1
20°	1094.9	1094.9	1094.9	1101.9	1109.0
22.5°	1075.7	1073.8	1075.7	1084.5	1091.4
25°	1050.9	1052.8	1052.8	1061.6	1068.5
27.5°	1028.2	1026.4	1029.8	1037.0	1045.8
30°	1001.8	1001.8	1003.6	1012.4	1021.0
32.5°	975.4	973.7	975.4	984.2	993.0
35°	943.9	943.9	943.9	954.3	963.1
37.5°	912.2	910.3	910.3	921.0	933.2
40°	877.0	875.3	875.3	887.6	896.4
42.5°	843.6	841.9	841.9	852.4	864.7
45°	808.4	803.3	803.3	815.5	827.8
47.5°	768.1	764.6	766.2	776.9	789.2
50°	729.4	724.1	722.4	734.7	747.0
52.5°	687.2	685.4	680.1	690.7	704.8
55°	643.2	641.6	636.3	646.7	660.8
57.5°	601.1	595.8	590.5	599.2	615.2
60°	553.6	548.3	541.3	553.6	567.7
62.5°	506.1	499.2	493.8	504.5	520.2
65°	455.2	449.9	442.9	457.0	472.8
67.5°	407.7	402.5	393.7	406.0	416.5
70°	355.1	347.9	344.4	346.3	349.8
72.5°	304.1	300.5	295.3	281.2	277.7
75°	253.1	247.8	237.2	211.0	202.2
77.5°	202.2	198.5	179.3	156.4	156.4
80°	149.4	147.6	124.8	128.3	130.0
82.5°	101.9	98.4	91.5	89.6	89.6
85°	54.4	51.0	52.8	51.0	51.0
87.5°	21.1	21.1	22.9	21.1	21.1
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-4

Test Date: 07/15/2025

Luminaire Tested: 14EN-LD2-51-UNV-L950-CD1-U

Data in this report applies to families of products including 14EN-LD2-51-UNV-L950-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-457-4
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/15/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **14EN-LD2-51-UNV-L950-CD1-U**
 Description: 1x4 ENCOUNTER 5100LM WITH LIGHTNING BOARDS

Spectral Parameters

CCT (K): 4838
 CIE u' : 0.2122
 CIE v' : 0.4888
 Duv: 0.0015
 CIE x: 0.3502
 CIE y: 0.3586
 CIE z: 0.2912
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 573
 Purity: 12.68613
 R_f: 91.2
 R_g: 100.8

CRI (Ra): 93.6
 R1: 94.4
 R2: 94.8
 R3: 93.6
 R4: 94.8
 R5: 93.3
 R6: 91.9
 R7: 95.9
 R8: 89.8
 R9: 69.6
 R10: 86.3
 R11: 94.3
 R12: 70.2
 R13: 94.4
 R14: 96.0
 R15: 92.2



Test Conditions

Stabilization Time: M
 Operation Time: 1H 0M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-457-4

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-4

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-4

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 2.02

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 4.31

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4

TM-30-18

Summary

$R_f = 91.2$
 $R_g = 100.8$
 $CIE R_a = 93.6$
 $R_9 = 69.6$



Color Vector Graphics




Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 90	CES51 = 99	CES76 = 83
CES02 = 61	CES27 = 93	CES52 = 98	CES77 = 88
CES03 = 31	CES28 = 94	CES53 = 96	CES78 = 80
CES04 = 69	CES29 = 92	CES54 = 96	CES79 = 95
CES05 = 48	CES30 = 98	CES55 = 94	CES80 = 92
CES06 = 50	CES31 = 93	CES56 = 95	CES81 = 84
CES07 = 41	CES32 = 86	CES57 = 94	CES82 = 96
CES08 = 40	CES33 = 96	CES58 = 95	CES83 = 96
CES09 = 29	CES34 = 90	CES59 = 98	CES84 = 93
CES10 = 73	CES35 = 94	CES60 = 94	CES85 = 84
CES11 = 56	CES36 = 84	CES61 = 93	CES86 = 87
CES12 = 62	CES37 = 93	CES62 = 90	CES87 = 90
CES13 = 42	CES38 = 92	CES63 = 93	CES88 = 97
CES14 = 74	CES39 = 98	CES64 = 91	CES89 = 86
CES15 = 71	CES40 = 96	CES65 = 89	CES90 = 98
CES16 = 47	CES41 = 98	CES66 = 88	CES91 = 75
CES17 = 48	CES42 = 91	CES67 = 87	CES92 = 79
CES18 = 56	CES43 = 91	CES68 = 88	CES93 = 88
CES19 = 70	CES44 = 99	CES69 = 89	CES94 = 78
CES20 = 65	CES45 = 94	CES70 = 84	CES95 = 83
CES21 = 85	CES46 = 95	CES71 = 80	CES96 = 92
CES22 = 77	CES47 = 94	CES72 = 93	CES97 = 93
CES23 = 91	CES48 = 95	CES73 = 78	CES98 = 93
CES24 = 90	CES49 = 94	CES74 = 93	CES99 = 94
CES25 = 70	CES50 = 99	CES75 = 81	



Color Rendition by Hue-Angle Bin

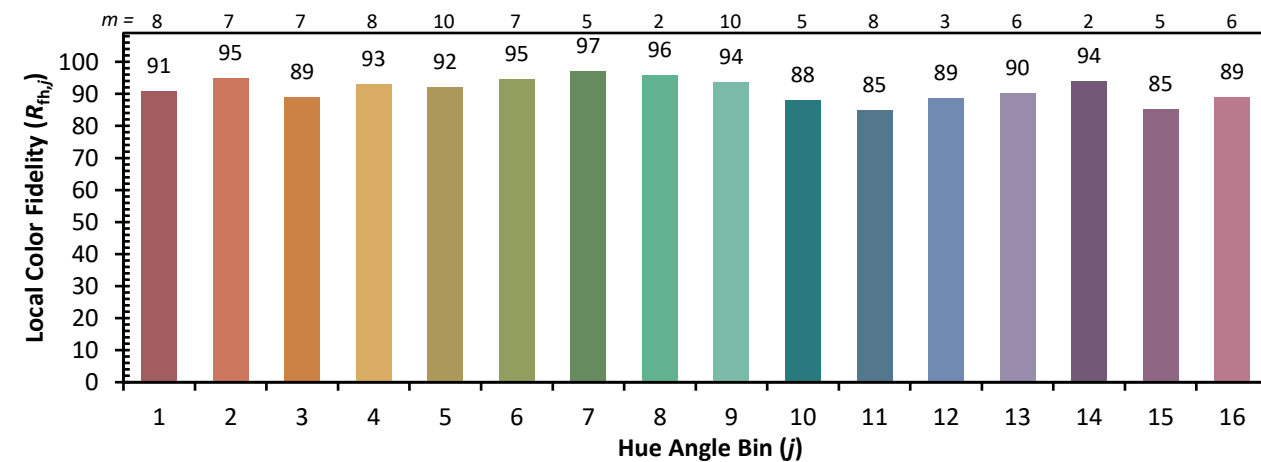

Measure Comparisons



(END OF REPORT)