

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975426

Luminaire Tested: 24EN-LD2-67-UNV-L935-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975426
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24EN-LD2-67-UNV-L935-CD1
Description: METALUX ENCOUNTER 2x4 6700LM PACKAGE 90CRI 3500K STANDARD TROFFER
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6595.8 lumens
Efficiency: N/A
Efficacy: 117.6 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.4
Luminous Opening: Rectangular (W 1.83' x L: 3.83' x H: 0')
CIE Type: Direct

Input Watts (W): 56.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P975426

CATALOG NUMBER: 24EN-LD2-67-UNV-L935-CD1

Luminous Intensity Polar Plot

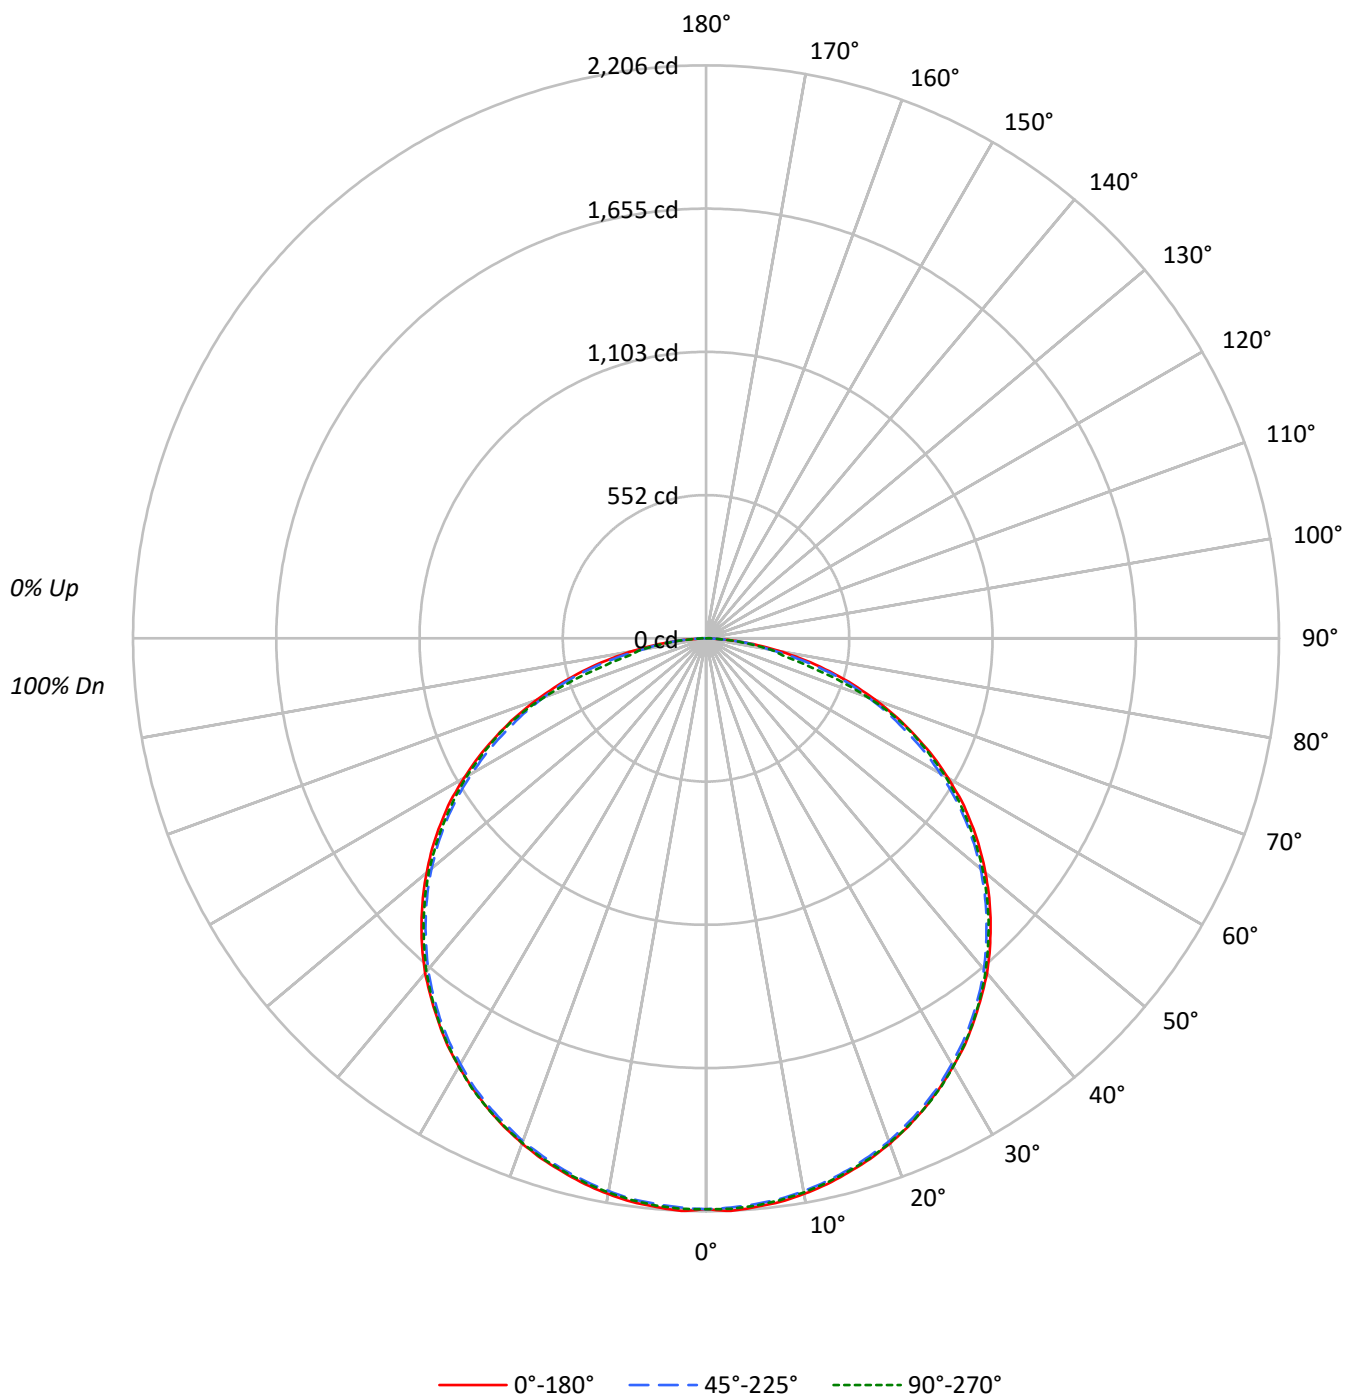

TEST NUMBER: P975426

CATALOG NUMBER: 24EN-LD2-67-UNV-L935-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	109	104	99	95	106	101	97	94	97	94	91		93	90	88		90
2	98	90	83	77	96	88	82	76	84	79	74		81	77	73		78
3	90	79	70	64	87	77	69	63	74	67	62		71	66	61		69
4	82	70	61	54	79	68	60	53	66	58	53		63	57	52		61
5	75	62	53	46	73	61	52	46	59	51	45		57	50	45		55
6	69	56	47	40	67	55	46	40	53	45	40		51	44	39		50
7	64	50	42	35	62	50	41	35	48	40	35		47	40	35		45
8	60	46	37	31	58	45	37	31	44	36	31		43	36	31		41
9	56	42	34	28	54	42	34	28	40	33	28		39	33	28		38
10	52	39	31	26	51	38	31	25	37	30	25		36	30	25		35

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3367	3367	3367
5°	3379	3362	3371
10°	3378	3361	3369
15°	3374	3359	3367
20°	3374	3358	3369
25°	3370	3354	3370
30°	3366	3347	3366
35°	3363	3340	3357
40°	3365	3328	3348
45°	3356	3307	3331
50°	3346	3287	3317
55°	3335	3253	3286
60°	3293	3191	3259
65°	3227	3091	3206
70°	3110	2981	2974
75°	2927	2797	2365
80°	2576	2188	2249
85°	2033	1916	1770

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3356 cd/sqm

TEST NUMBER: P975426

CATALOG NUMBER: 24EN-LD2-67-UNV-L935-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	208.2	3.2
10°-20°	598.8	9.1
20°-30°	916.2	13.9
30°-40°	1119.9	17.0
40°-50°	1183.5	17.9
50°-60°	1096.5	16.6
60°-70°	859.1	13.0
70°-80°	485.7	7.4
80°-90°	127.9	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1723.2	26.1
0°-40°	2843.1	43.1
0°-60°	5123.1	77.7
0°-90°	6595.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6595.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2198	2198	2198	2198	2198	
5°	2198	2191	2187	2186	2193	209
15°	2128	2119	2118	2117	2124	601
25°	1994	1986	1984	1984	1994	919
35°	1798	1790	1786	1786	1796	1126
45°	1549	1538	1527	1527	1538	1195
55°	1249	1235	1218	1221	1231	1115
65°	890	874	853	864	885	880
75°	495	481	473	422	400	520
85°	116	109	109	103	101	136
90°	0	0	0	0	0	

TEST NUMBER: P975426

CATALOG NUMBER: 24EN-LD2-67-UNV-L935-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2198.0	2198.0	2198.0	2198.0	2198.0
2.5°	2206.3	2196.7	2193.9	2191.3	2198.0
5°	2198.0	2191.3	2186.9	2185.6	2192.6
7.5°	2188.5	2180.2	2177.4	2174.6	2181.5
10°	2172.0	2163.7	2160.9	2159.4	2166.3
12.5°	2152.7	2142.9	2141.6	2140.3	2147.0
15°	2127.7	2119.4	2118.1	2116.8	2123.6
17.5°	2101.6	2093.4	2090.6	2089.3	2098.8
20°	2070.0	2061.7	2060.2	2058.9	2067.1
22.5°	2034.1	2025.9	2023.1	2024.4	2032.6
25°	1994.2	1985.7	1984.4	1984.4	1994.2
27.5°	1949.9	1941.7	1941.7	1941.7	1952.8
30°	1903.3	1896.3	1892.2	1893.5	1903.3
32.5°	1854.9	1843.8	1841.2	1842.5	1852.3
35°	1798.4	1790.2	1786.1	1786.1	1795.6
37.5°	1740.5	1732.2	1726.8	1726.8	1736.4
40°	1682.8	1670.2	1664.7	1661.9	1674.5
42.5°	1617.9	1608.3	1595.9	1595.9	1606.8
45°	1549.1	1538.0	1526.9	1526.9	1538.0
47.5°	1478.7	1467.7	1455.3	1455.3	1466.4
50°	1404.3	1393.2	1379.5	1379.5	1391.9
52.5°	1328.5	1316.2	1301.0	1299.4	1312.0
55°	1248.7	1234.8	1218.3	1221.1	1230.6
57.5°	1167.3	1149.3	1132.8	1132.8	1148.0
60°	1075.0	1059.8	1041.8	1044.6	1064.0
62.5°	986.7	967.4	949.6	956.3	973.0
65°	890.3	873.8	853.0	864.1	884.7
67.5°	795.3	777.2	760.7	774.4	784.2
70°	694.5	678.0	665.7	665.7	664.2
72.5°	594.1	578.9	576.0	549.8	533.3
75°	494.6	481.0	472.7	421.7	399.6
77.5°	391.3	387.2	361.2	307.3	300.4
80°	292.1	295.0	248.1	249.4	255.0
82.5°	201.2	197.1	186.0	177.8	174.9
85°	115.7	109.0	109.0	103.3	100.7
87.5°	38.6	42.8	42.8	42.8	44.1
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-2

Test Date: 07/10/2025

Luminaire Tested: 14EN-LD2-51-UNV-L935-CD1-U


Data in this report applies to families of products including 14EN-LD2-51-UNV-L935-CD1-U

REPORT NUMBER: SP1-2506-457-2


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-2

CIE 1931 Chromaticity Diagram

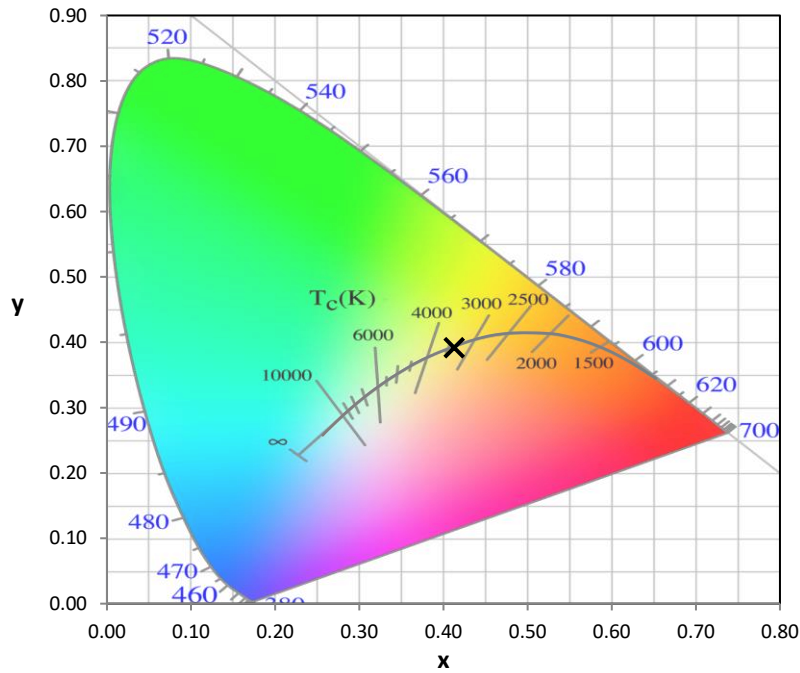


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

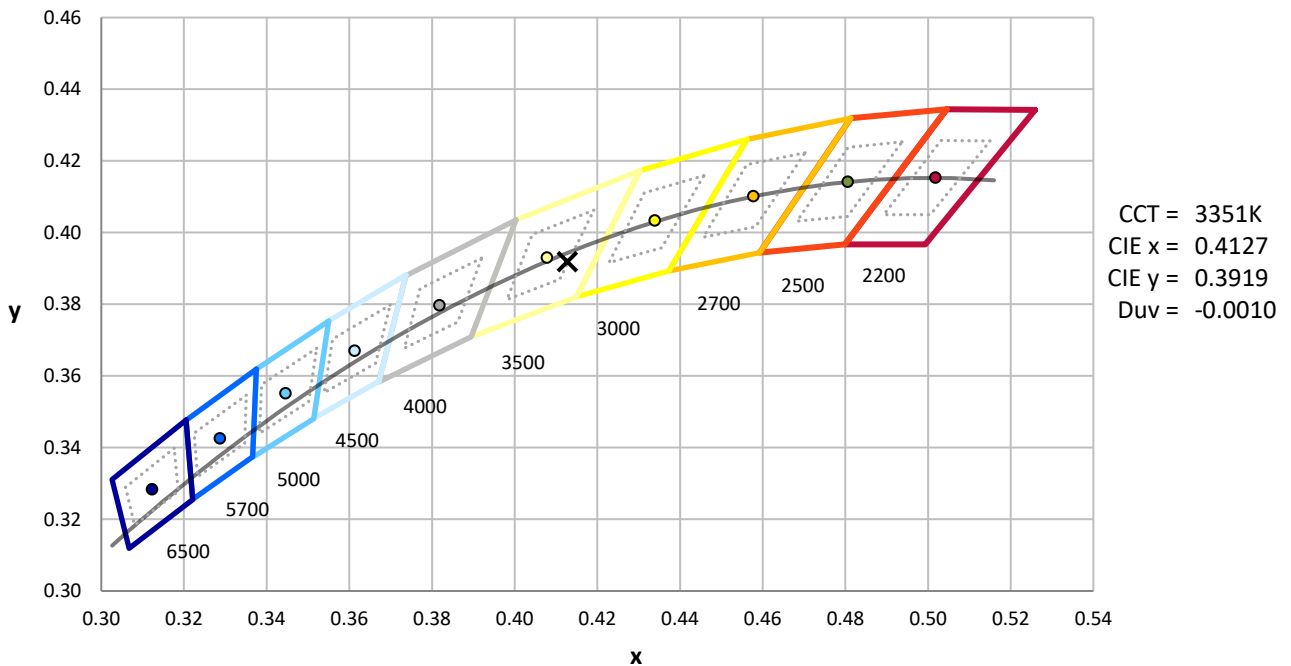

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-2

Photopic Flux vs. Wavelength

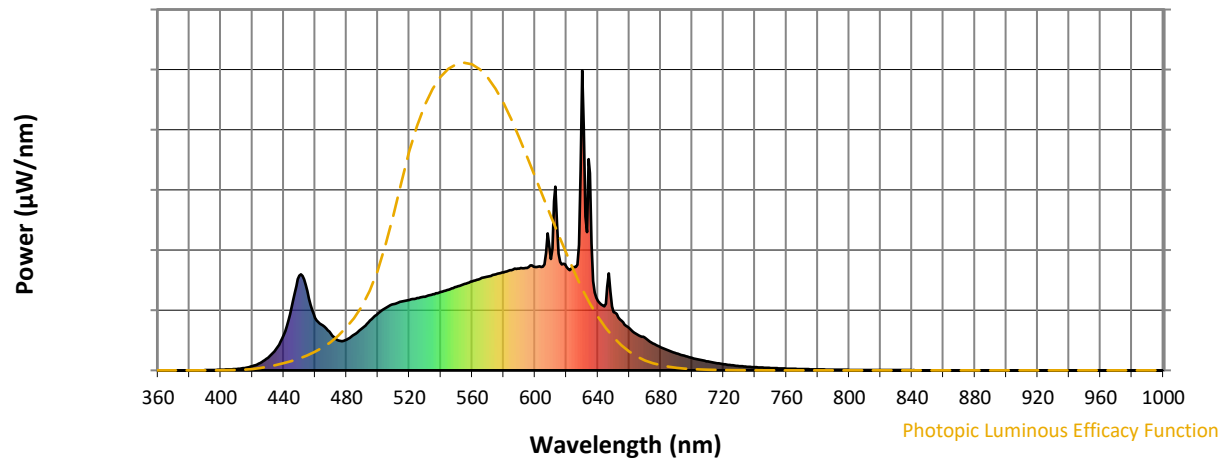


Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	140	NR	620	345	NR	750	8	NR	880	0	NR
365	0	NR	495	166	NR	625	344	NR	755	7	NR	885	0	NR
370	0	NR	500	190	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	208	NR	635	658	NR	765	5	NR	895	0	NR
380	0	NR	510	221	NR	640	232	NR	770	4	NR	900	0	NR
385	0	NR	515	230	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	235	NR	650	194	NR	780	3	NR	910	0	NR
395	1	NR	525	241	NR	655	165	NR	785	3	NR	915	0	NR
400	2	NR	530	246	NR	660	141	NR	790	2	NR	920	0	NR
405	3	NR	535	254	NR	665	120	NR	795	2	NR	925	0	NR
410	5	NR	540	262	NR	670	109	NR	800	2	NR	930	0	NR
415	8	NR	545	269	NR	675	90	NR	805	1	NR	935	0	NR
420	14	NR	550	279	NR	680	77	NR	810	1	NR	940	0	NR
425	25	NR	555	288	NR	685	66	NR	815	1	NR	945	0	NR
430	42	NR	560	297	NR	690	57	NR	820	1	NR	950	0	NR
435	71	NR	565	305	NR	695	49	NR	825	1	NR	955	0	NR
440	117	NR	570	313	NR	700	42	NR	830	1	NR	960	0	NR
445	211	NR	575	320	NR	705	35	NR	835	1	NR	965	0	NR
450	316	NR	580	327	NR	710	30	NR	840	1	NR	970	0	NR
455	265	NR	585	334	NR	715	25	NR	845	1	NR	975	0	NR
460	175	NR	590	340	NR	720	21	NR	850	0	NR	980	0	NR
465	149	NR	595	342	NR	725	17	NR	855	0	NR	985	0	NR
470	122	NR	600	345	NR	730	14	NR	860	0	NR	990	0	NR
475	99	NR	605	346	NR	735	12	NR	865	0	NR	995	0	NR
480	103	NR	610	371	NR	740	11	NR	870	0	NR	1000	0	NR
485	120	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-2

Scotopic Flux vs. Wavelength

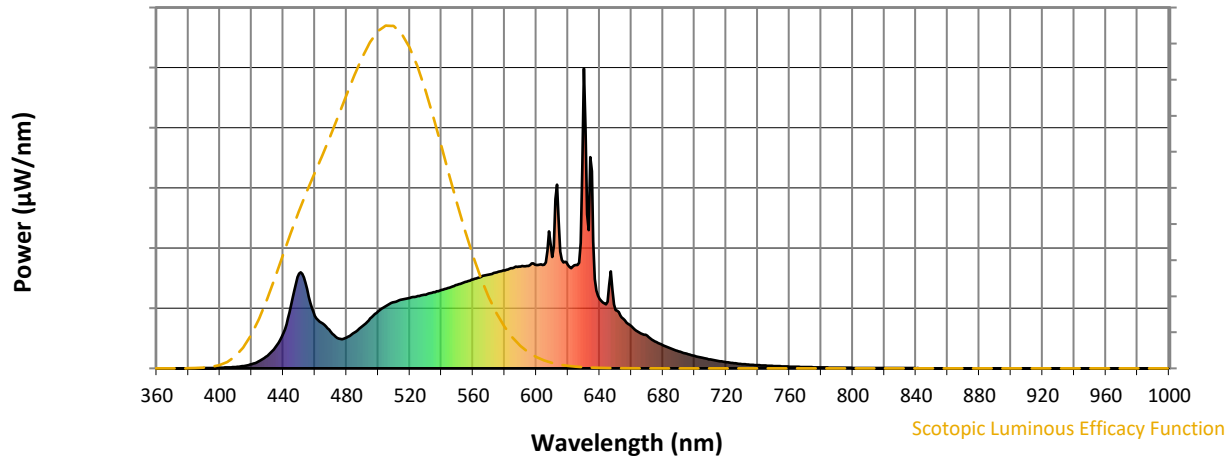


Scotopic Lumens: NR

S/P: 1.57

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	140	NR	620	345	NR	750	8	NR	880	0	NR
365	0	NR	495	166	NR	625	344	NR	755	7	NR	885	0	NR
370	0	NR	500	190	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	208	NR	635	658	NR	765	5	NR	895	0	NR
380	0	NR	510	221	NR	640	232	NR	770	4	NR	900	0	NR
385	0	NR	515	230	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	235	NR	650	194	NR	780	3	NR	910	0	NR
395	1	NR	525	241	NR	655	165	NR	785	3	NR	915	0	NR
400	2	NR	530	246	NR	660	141	NR	790	2	NR	920	0	NR
405	3	NR	535	254	NR	665	120	NR	795	2	NR	925	0	NR
410	5	NR	540	262	NR	670	109	NR	800	2	NR	930	0	NR
415	8	NR	545	269	NR	675	90	NR	805	1	NR	935	0	NR
420	14	NR	550	279	NR	680	77	NR	810	1	NR	940	0	NR
425	25	NR	555	288	NR	685	66	NR	815	1	NR	945	0	NR
430	42	NR	560	297	NR	690	57	NR	820	1	NR	950	0	NR
435	71	NR	565	305	NR	695	49	NR	825	1	NR	955	0	NR
440	117	NR	570	313	NR	700	42	NR	830	1	NR	960	0	NR
445	211	NR	575	320	NR	705	35	NR	835	1	NR	965	0	NR
450	316	NR	580	327	NR	710	30	NR	840	1	NR	970	0	NR
455	265	NR	585	334	NR	715	25	NR	845	1	NR	975	0	NR
460	175	NR	590	340	NR	720	21	NR	850	0	NR	980	0	NR
465	149	NR	595	342	NR	725	17	NR	855	0	NR	985	0	NR
470	122	NR	600	345	NR	730	14	NR	860	0	NR	990	0	NR
475	99	NR	605	346	NR	735	12	NR	865	0	NR	995	0	NR
480	103	NR	610	371	NR	740	11	NR	870	0	NR	1000	0	NR
485	120	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-2

Melanopic Flux vs. Wavelength

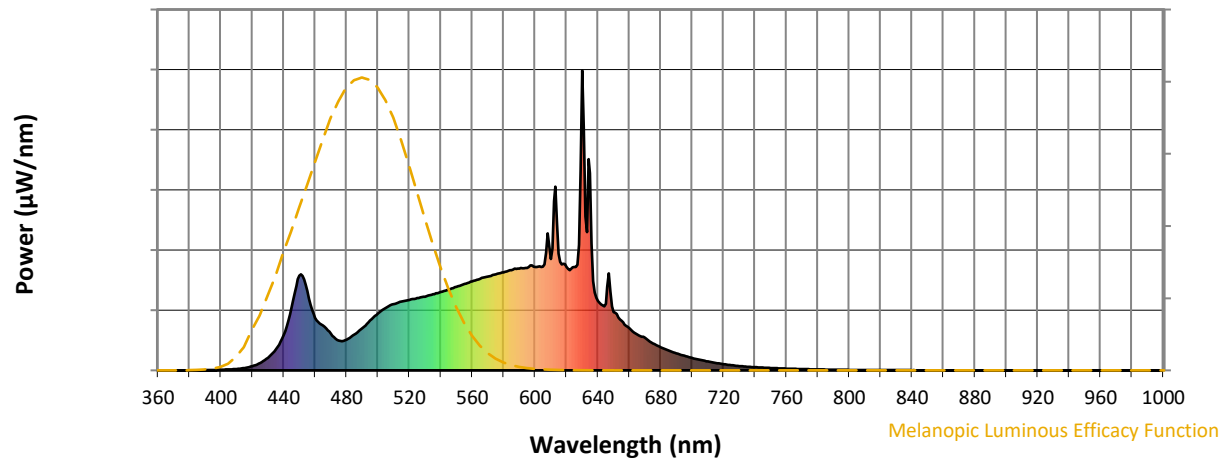

Melanopic Lumens: NR

M/P: 3.16


λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	140	NR	620	345	NR	750	8	NR	880	0	NR
365	0	NR	495	166	NR	625	344	NR	755	7	NR	885	0	NR
370	0	NR	500	190	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	208	NR	635	658	NR	765	5	NR	895	0	NR
380	0	NR	510	221	NR	640	232	NR	770	4	NR	900	0	NR
385	0	NR	515	230	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	235	NR	650	194	NR	780	3	NR	910	0	NR
395	1	NR	525	241	NR	655	165	NR	785	3	NR	915	0	NR
400	2	NR	530	246	NR	660	141	NR	790	2	NR	920	0	NR
405	3	NR	535	254	NR	665	120	NR	795	2	NR	925	0	NR
410	5	NR	540	262	NR	670	109	NR	800	2	NR	930	0	NR
415	8	NR	545	269	NR	675	90	NR	805	1	NR	935	0	NR
420	14	NR	550	279	NR	680	77	NR	810	1	NR	940	0	NR
425	25	NR	555	288	NR	685	66	NR	815	1	NR	945	0	NR
430	42	NR	560	297	NR	690	57	NR	820	1	NR	950	0	NR
435	71	NR	565	305	NR	695	49	NR	825	1	NR	955	0	NR
440	117	NR	570	313	NR	700	42	NR	830	1	NR	960	0	NR
445	211	NR	575	320	NR	705	35	NR	835	1	NR	965	0	NR
450	316	NR	580	327	NR	710	30	NR	840	1	NR	970	0	NR
455	265	NR	585	334	NR	715	25	NR	845	1	NR	975	0	NR
460	175	NR	590	340	NR	720	21	NR	850	0	NR	980	0	NR
465	149	NR	595	342	NR	725	17	NR	855	0	NR	985	0	NR
470	122	NR	600	345	NR	730	14	NR	860	0	NR	990	0	NR
475	99	NR	605	346	NR	735	12	NR	865	0	NR	995	0	NR
480	103	NR	610	371	NR	740	11	NR	870	0	NR	1000	0	NR
485	120	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-2





TM-30-18

Summary

$R_f = 91.3$
 $R_g = 99.9$
 $CIE\ R_a = 93.4$
 $R_9 = 57.9$

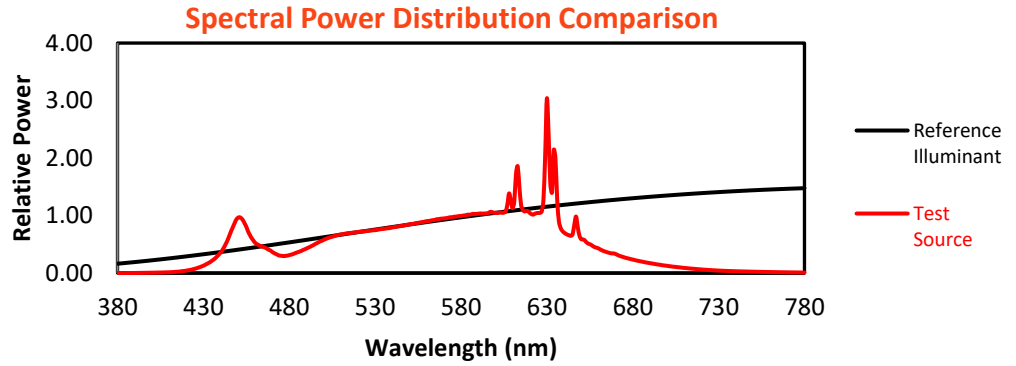


Color Vector Graphics

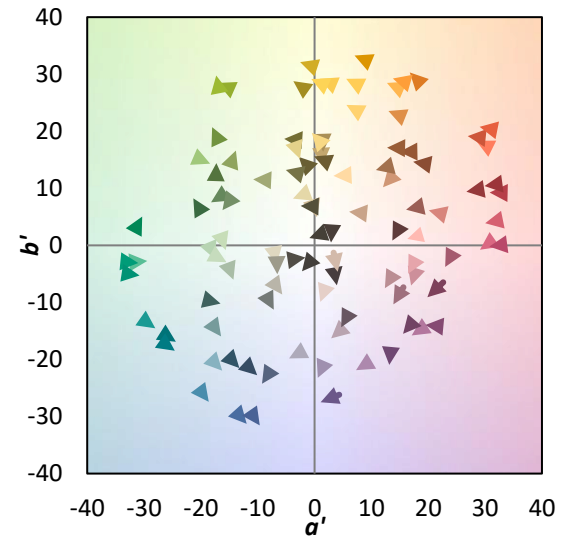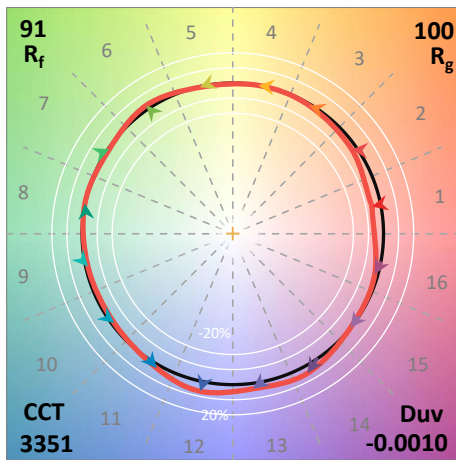
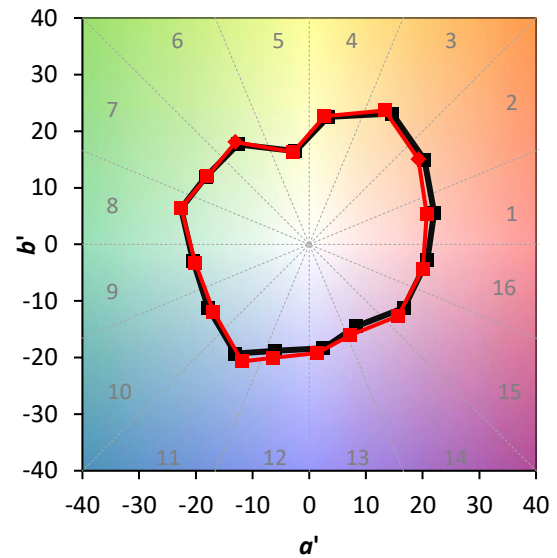
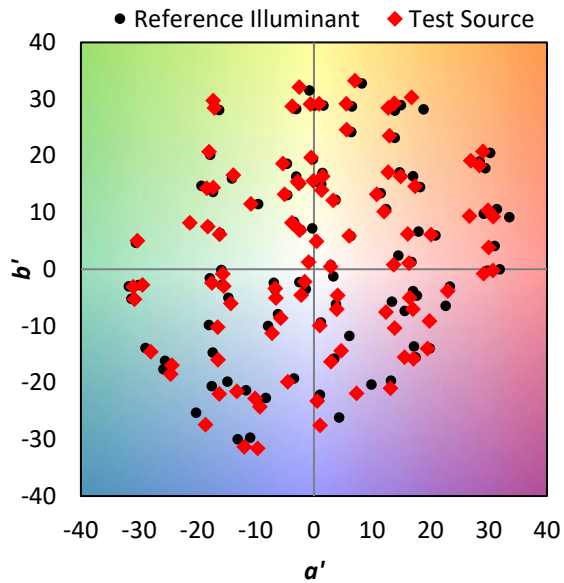


Individual Sample Fidelity Index ($R_{f,i}$)



CES01 = 86	CES26 = 93	CES51 = 98	CES76 = 88
CES02 = 63	CES27 = 93	CES52 = 98	CES77 = 87
CES03 = 31	CES28 = 96	CES53 = 97	CES78 = 85
CES04 = 70	CES29 = 95	CES54 = 95	CES79 = 91
CES05 = 50	CES30 = 96	CES55 = 94	CES80 = 92
CES06 = 51	CES31 = 95	CES56 = 96	CES81 = 75
CES07 = 43	CES32 = 87	CES57 = 95	CES82 = 96
CES08 = 41	CES33 = 97	CES58 = 96	CES83 = 94
CES09 = 29	CES34 = 94	CES59 = 97	CES84 = 95
CES10 = 75	CES35 = 96	CES60 = 94	CES85 = 80
CES11 = 58	CES36 = 84	CES61 = 93	CES86 = 79
CES12 = 64	CES37 = 95	CES62 = 90	CES87 = 91
CES13 = 44	CES38 = 91	CES63 = 94	CES88 = 97
CES14 = 74	CES39 = 98	CES64 = 92	CES89 = 83
CES15 = 72	CES40 = 96	CES65 = 90	CES90 = 97
CES16 = 48	CES41 = 97	CES66 = 91	CES91 = 77
CES17 = 49	CES42 = 94	CES67 = 90	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 89	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 91	CES94 = 73
CES20 = 67	CES45 = 96	CES70 = 87	CES95 = 83
CES21 = 86	CES46 = 96	CES71 = 84	CES96 = 91
CES22 = 78	CES47 = 91	CES72 = 94	CES97 = 95
CES23 = 91	CES48 = 93	CES73 = 82	CES98 = 94
CES24 = 90	CES49 = 95	CES74 = 91	CES99 = 91
CES25 = 71	CES50 = 99	CES75 = 86	

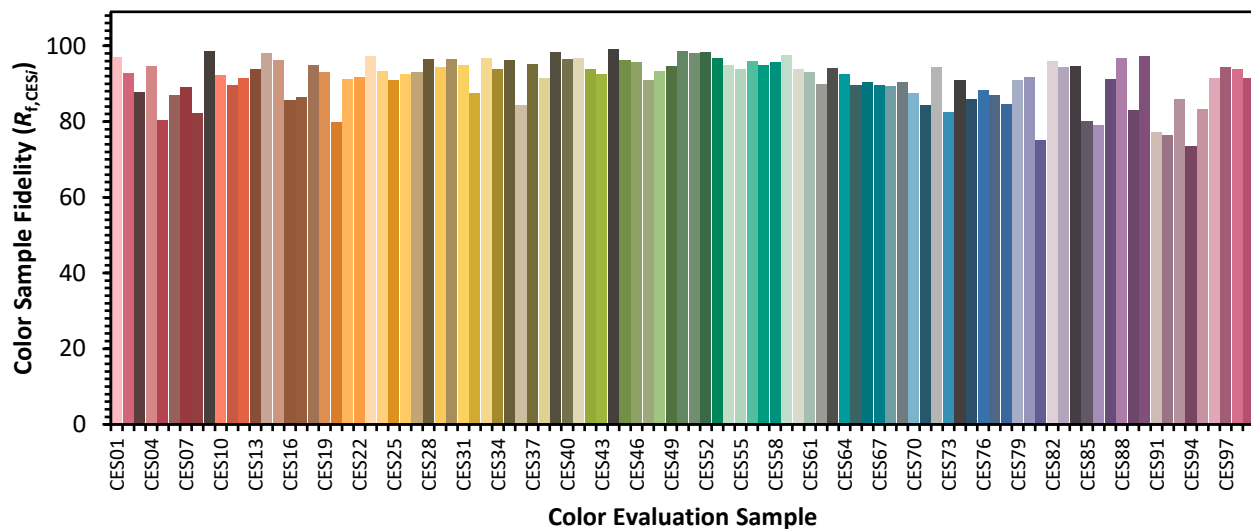

Color Rendition by Hue-Angle Bin

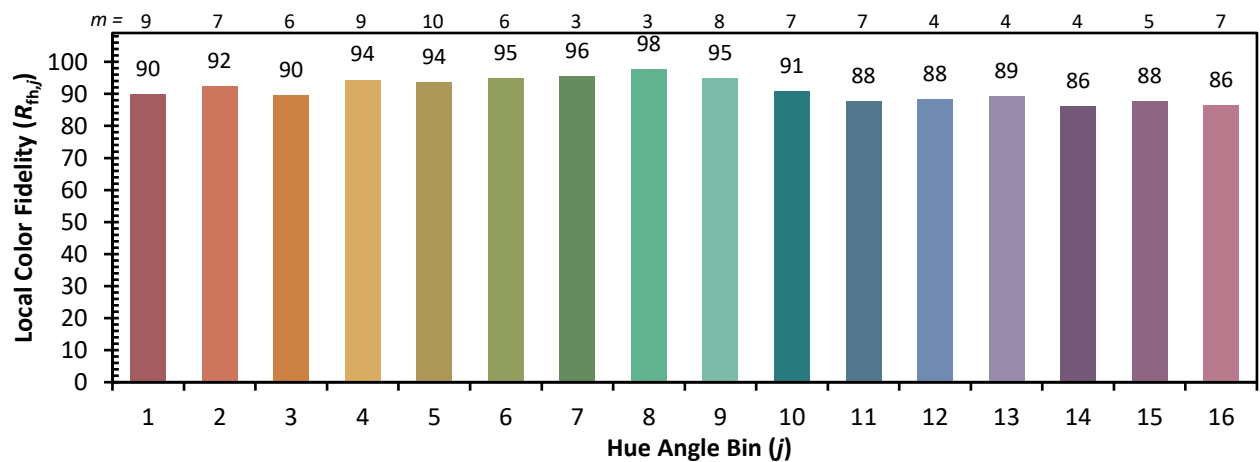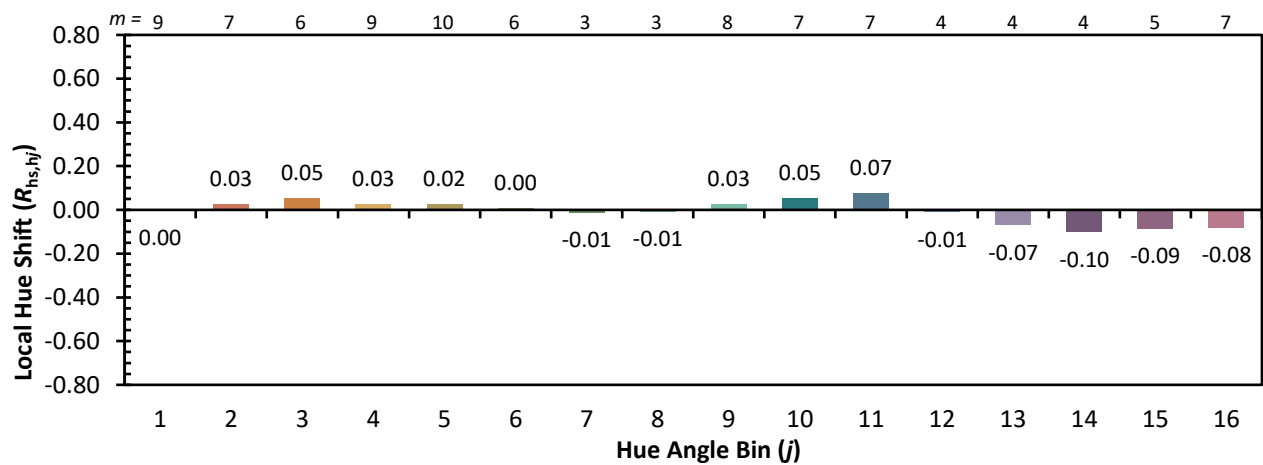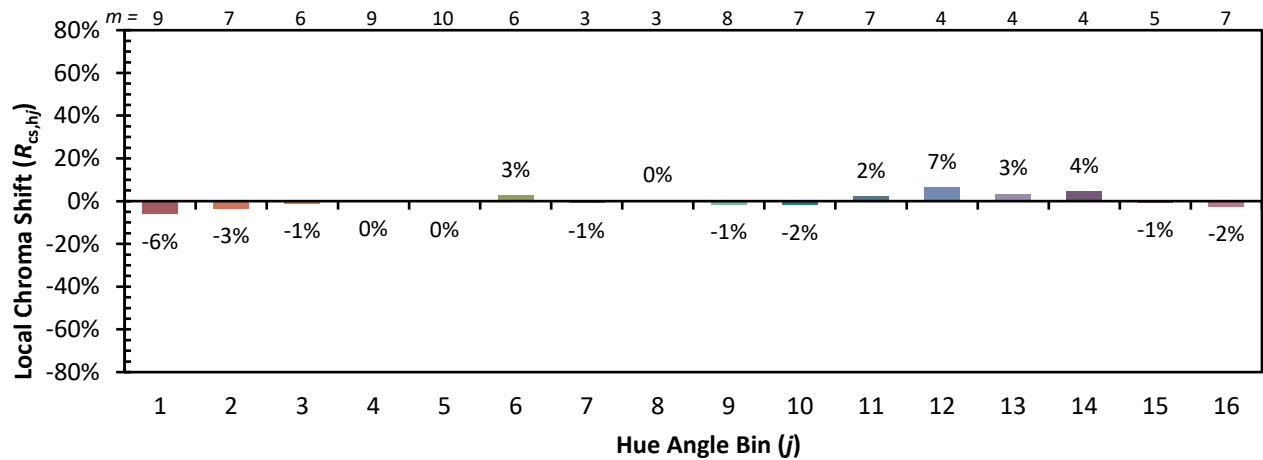

Measure Comparisons

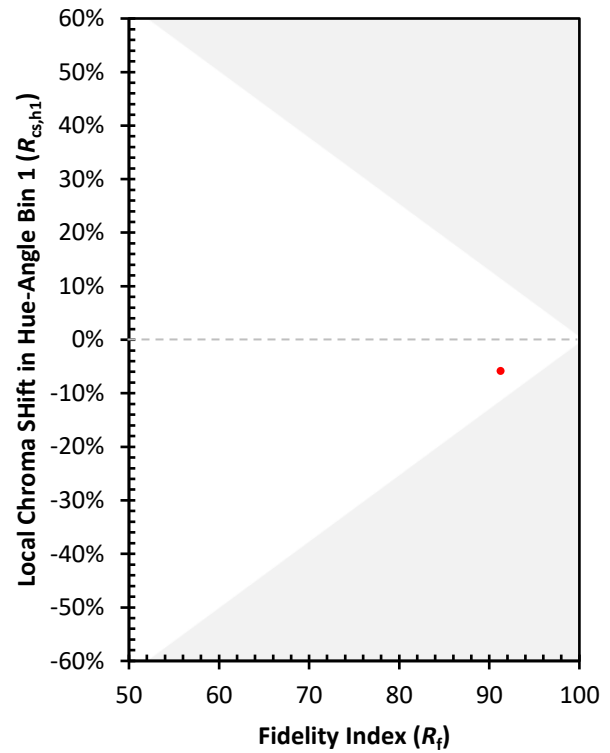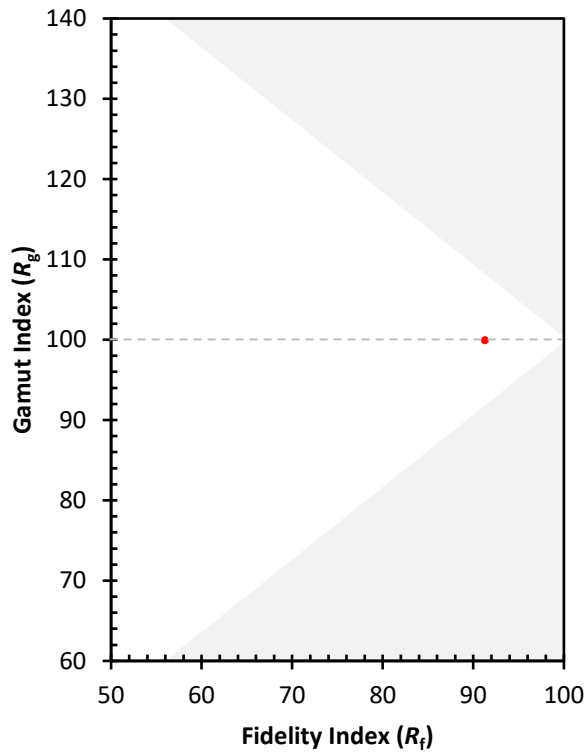

(END OF REPORT)