

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975428

Luminaire Tested: 24EN-LD2-74-UNV-L935-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975428
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24EN-LD2-74-UNV-L935-CD1
Description: METALUX ENCOUNTER 2x4 7400LM PACKAGE 90CRI 3500K STANDARD TROFFER
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7333.7 lumens
Efficiency: N/A
Efficacy: 115.3 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.4
Luminous Opening: Rectangular (W 1.83' x L: 3.83' x H: 0')
CIE Type: Direct

Input Watts (W): 63.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P975428

CATALOG NUMBER: 24EN-LD2-74-UNV-L935-CD1

Luminous Intensity Polar Plot

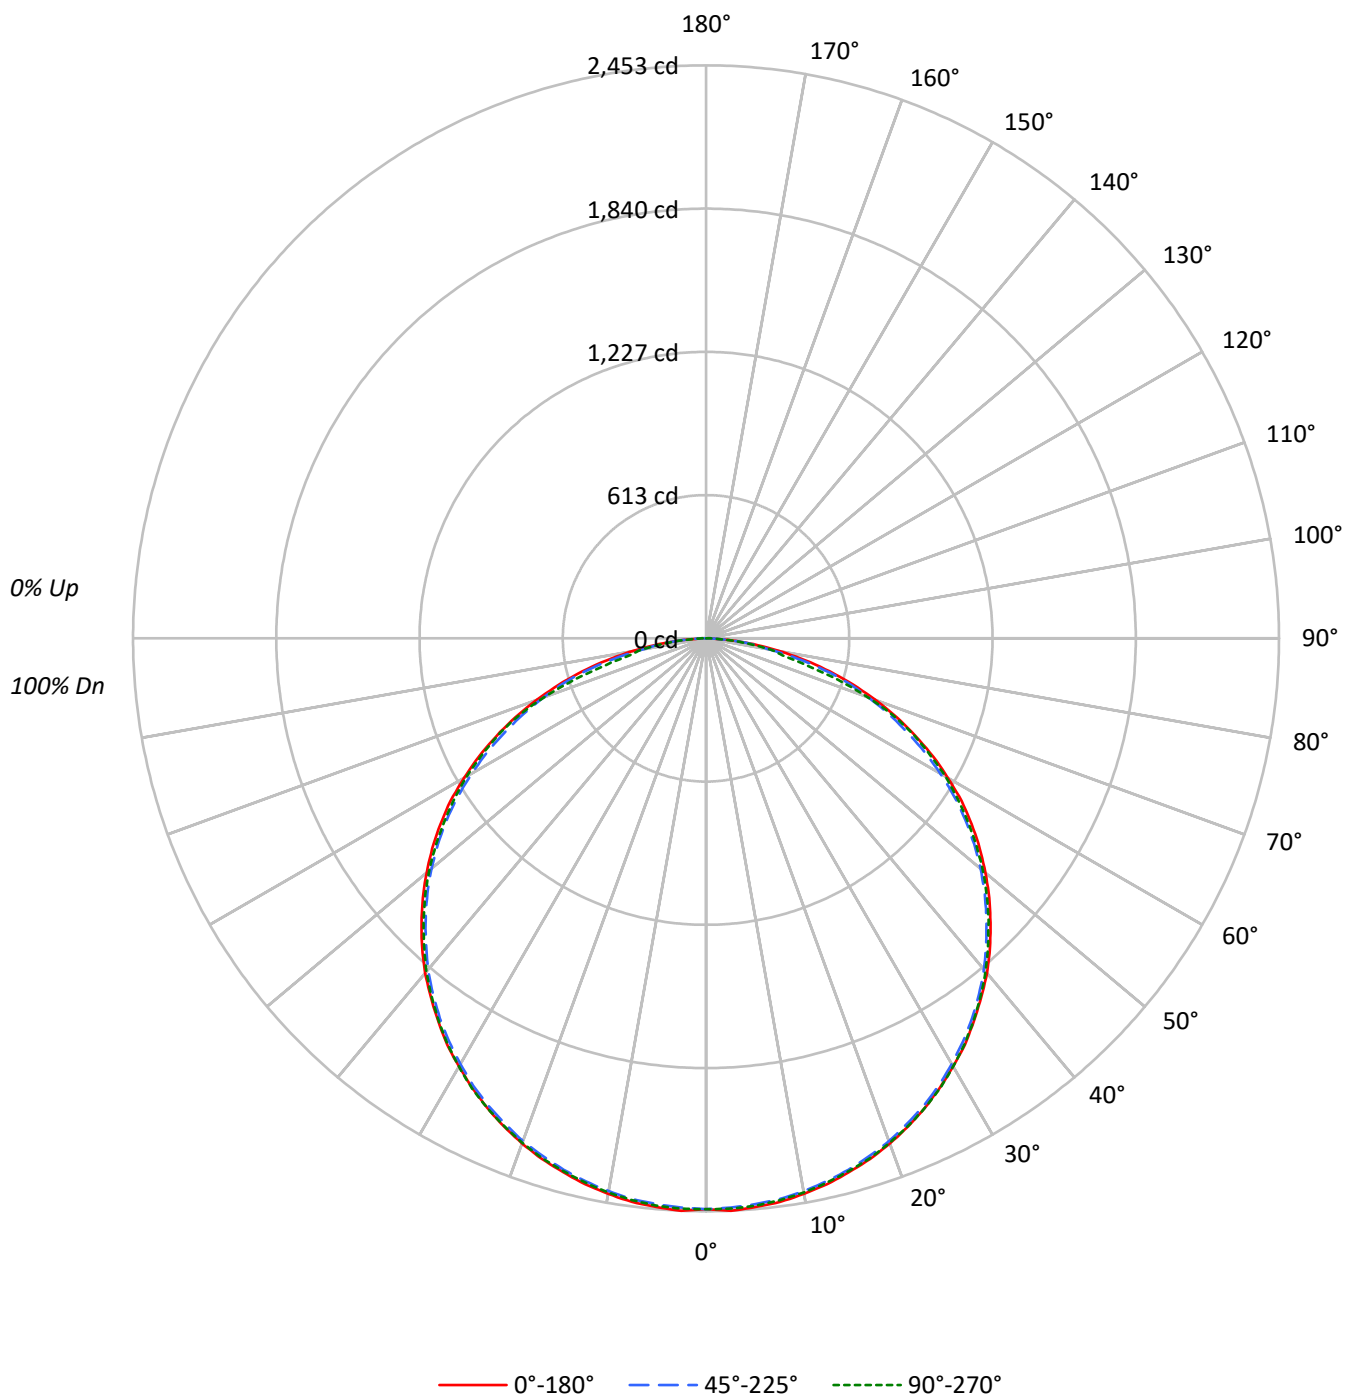

TEST NUMBER: P975428

CATALOG NUMBER: 24EN-LD2-74-UNV-L935-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	109	104	99	95	106	101	97	94	97	94	91		93	90	88		90
2	98	90	83	77	96	88	82	76	84	79	74		81	77	73		78
3	90	79	70	64	87	77	69	63	74	67	62		71	66	61		69
4	82	70	61	54	79	68	60	53	66	58	53		63	57	52		61
5	75	62	53	46	73	61	52	46	59	51	45		57	50	45		55
6	69	56	47	40	67	55	46	40	53	45	40		51	44	39		50
7	64	50	42	35	62	50	41	35	48	40	35		47	40	35		45
8	60	46	37	31	58	45	37	31	44	36	31		43	36	31		41
9	56	42	34	28	54	42	34	28	40	33	28		39	33	28		38
10	52	39	31	26	51	38	31	25	37	30	25		36	30	25		35

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3743	3743	3743
5°	3758	3739	3748
10°	3756	3737	3746
15°	3751	3734	3744
20°	3752	3734	3746
25°	3747	3729	3747
30°	3743	3721	3743
35°	3739	3713	3733
40°	3741	3701	3723
45°	3731	3678	3704
50°	3721	3655	3688
55°	3708	3617	3654
60°	3662	3549	3624
65°	3588	3437	3565
70°	3459	3315	3307
75°	3255	3110	2629
80°	2865	2433	2501
85°	2260	2128	1968

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3731 cd/sqm

TEST NUMBER: P975428

CATALOG NUMBER: 24EN-LD2-74-UNV-L935-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	231.5	3.2
10°-20°	665.8	9.1
20°-30°	1018.7	13.9
30°-40°	1245.2	17.0
40°-50°	1315.9	17.9
50°-60°	1219.2	16.6
60°-70°	955.2	13.0
70°-80°	540.0	7.4
80°-90°	142.2	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1916.0	26.1
0°-40°	3161.2	43.1
0°-60°	5696.3	77.7
0°-90°	7333.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7333.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2444	2444	2444	2444	2444	
5°	2444	2436	2432	2430	2438	232
15°	2366	2357	2355	2354	2361	668
25°	2217	2208	2206	2206	2217	1022
35°	2000	1990	1986	1986	1996	1252
45°	1722	1710	1698	1698	1710	1329
55°	1388	1373	1355	1358	1368	1240
65°	990	972	948	961	984	979
75°	550	535	526	469	444	579
85°	129	121	121	115	112	152
90°	0	0	0	0	0	

TEST NUMBER: P975428

CATALOG NUMBER: 24EN-LD2-74-UNV-L935-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2443.9	2443.9	2443.9	2443.9	2443.9
2.5°	2453.1	2442.5	2439.4	2436.5	2443.9
5°	2443.9	2436.5	2431.6	2430.2	2437.9
7.5°	2433.3	2424.2	2421.0	2417.9	2425.6
10°	2415.0	2405.8	2402.7	2401.0	2408.7
12.5°	2393.5	2382.6	2381.2	2379.7	2387.2
15°	2365.8	2356.6	2355.1	2353.7	2361.2
17.5°	2336.8	2327.6	2324.5	2323.0	2333.7
20°	2301.6	2292.4	2290.7	2289.3	2298.4
22.5°	2261.7	2252.6	2249.4	2250.9	2260.0
25°	2217.3	2207.9	2206.5	2206.5	2217.3
27.5°	2168.1	2158.9	2158.9	2158.9	2171.2
30°	2116.2	2108.5	2103.9	2105.4	2116.2
32.5°	2062.4	2050.1	2047.2	2048.6	2059.5
35°	1999.7	1990.5	1985.9	1985.9	1996.5
37.5°	1935.2	1926.0	1920.0	1920.0	1930.6
40°	1871.0	1857.0	1851.0	1847.9	1861.9
42.5°	1798.9	1788.3	1774.5	1774.5	1786.6
45°	1722.4	1710.1	1697.8	1697.8	1710.1
47.5°	1644.2	1631.9	1618.1	1618.1	1630.4
50°	1561.4	1549.1	1533.9	1533.9	1547.6
52.5°	1477.2	1463.4	1446.5	1444.8	1458.8
55°	1388.4	1372.9	1354.6	1357.7	1368.3
57.5°	1297.9	1277.8	1259.5	1259.5	1276.4
60°	1195.3	1178.4	1158.4	1161.5	1183.0
62.5°	1097.1	1075.6	1055.8	1063.3	1081.9
65°	989.9	971.6	948.4	960.7	983.7
67.5°	884.2	864.2	845.9	861.1	871.9
70°	772.3	753.9	740.2	740.2	738.5
72.5°	660.5	643.6	640.5	611.3	592.9
75°	550.0	534.8	525.6	468.9	444.3
77.5°	435.1	430.5	401.6	341.7	334.0
80°	324.8	328.0	275.8	277.3	283.6
82.5°	223.7	219.1	206.8	197.6	194.5
85°	128.6	121.1	121.1	114.9	112.0
87.5°	43.0	47.5	47.5	47.5	49.0
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-2

Test Date: 07/10/2025

Luminaire Tested: 14EN-LD2-51-UNV-L935-CD1-U

Data in this report applies to families of products including 14EN-LD2-51-UNV-L935-CD1-U


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-457-2
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/15/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **14EN-LD2-51-UNV-L935-CD1-U**
 Description: 1x4 ENCOUNTER 5100LM WITH LIGHTNING BOARDS

Spectral Parameters

CCT (K): 3351
 CIE u' : 0.2401
 CIE v' : 0.5129
 Duv: -0.0010
 CIE x: 0.4127
 CIE y: 0.3919
 CIE z: 0.1954
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 581
 Purity: 41.49069
 R_f: 91.3
 R_g: 99.9

CRI (Ra): 93.4
 R1: 94.4
 R2: 96.7
 R3: 97.5
 R4: 94.5
 R5: 94.2
 R6: 95.5
 R7: 91.8
 R8: 82.4
 R9: 57.9
 R10: 91.0
 R11: 95.6
 R12: 80.9
 R13: 95.0
 R14: 97.9
 R15: 90.2

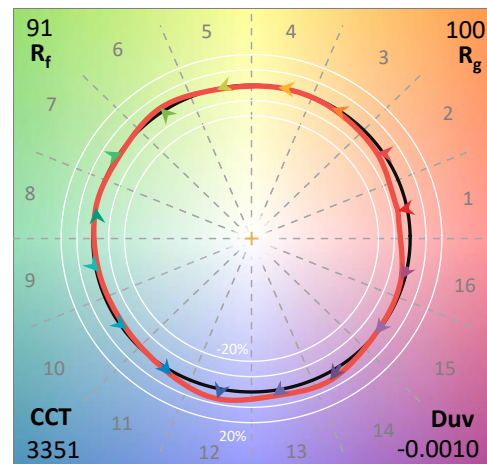

Test Conditions

Stabilization Time: 28M
 Operation Time: 1H 28M
 Sphere Temperature (°C): 24.0

REPORT NUMBER: SP1-2506-457-2

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-2

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	140	NR	620	345	NR	750	8	NR	880	0	NR
365	0	NR	495	166	NR	625	344	NR	755	7	NR	885	0	NR
370	0	NR	500	190	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	208	NR	635	658	NR	765	5	NR	895	0	NR
380	0	NR	510	221	NR	640	232	NR	770	4	NR	900	0	NR
385	0	NR	515	230	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	235	NR	650	194	NR	780	3	NR	910	0	NR
395	1	NR	525	241	NR	655	165	NR	785	3	NR	915	0	NR
400	2	NR	530	246	NR	660	141	NR	790	2	NR	920	0	NR
405	3	NR	535	254	NR	665	120	NR	795	2	NR	925	0	NR
410	5	NR	540	262	NR	670	109	NR	800	2	NR	930	0	NR
415	8	NR	545	269	NR	675	90	NR	805	1	NR	935	0	NR
420	14	NR	550	279	NR	680	77	NR	810	1	NR	940	0	NR
425	25	NR	555	288	NR	685	66	NR	815	1	NR	945	0	NR
430	42	NR	560	297	NR	690	57	NR	820	1	NR	950	0	NR
435	71	NR	565	305	NR	695	49	NR	825	1	NR	955	0	NR
440	117	NR	570	313	NR	700	42	NR	830	1	NR	960	0	NR
445	211	NR	575	320	NR	705	35	NR	835	1	NR	965	0	NR
450	316	NR	580	327	NR	710	30	NR	840	1	NR	970	0	NR
455	265	NR	585	334	NR	715	25	NR	845	1	NR	975	0	NR
460	175	NR	590	340	NR	720	21	NR	850	0	NR	980	0	NR
465	149	NR	595	342	NR	725	17	NR	855	0	NR	985	0	NR
470	122	NR	600	345	NR	730	14	NR	860	0	NR	990	0	NR
475	99	NR	605	346	NR	735	12	NR	865	0	NR	995	0	NR
480	103	NR	610	371	NR	740	11	NR	870	0	NR	1000	0	NR
485	120	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-2

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.57

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	140	NR	620	345	NR	750	8	NR	880	0	NR
365	0	NR	495	166	NR	625	344	NR	755	7	NR	885	0	NR
370	0	NR	500	190	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	208	NR	635	658	NR	765	5	NR	895	0	NR
380	0	NR	510	221	NR	640	232	NR	770	4	NR	900	0	NR
385	0	NR	515	230	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	235	NR	650	194	NR	780	3	NR	910	0	NR
395	1	NR	525	241	NR	655	165	NR	785	3	NR	915	0	NR
400	2	NR	530	246	NR	660	141	NR	790	2	NR	920	0	NR
405	3	NR	535	254	NR	665	120	NR	795	2	NR	925	0	NR
410	5	NR	540	262	NR	670	109	NR	800	2	NR	930	0	NR
415	8	NR	545	269	NR	675	90	NR	805	1	NR	935	0	NR
420	14	NR	550	279	NR	680	77	NR	810	1	NR	940	0	NR
425	25	NR	555	288	NR	685	66	NR	815	1	NR	945	0	NR
430	42	NR	560	297	NR	690	57	NR	820	1	NR	950	0	NR
435	71	NR	565	305	NR	695	49	NR	825	1	NR	955	0	NR
440	117	NR	570	313	NR	700	42	NR	830	1	NR	960	0	NR
445	211	NR	575	320	NR	705	35	NR	835	1	NR	965	0	NR
450	316	NR	580	327	NR	710	30	NR	840	1	NR	970	0	NR
455	265	NR	585	334	NR	715	25	NR	845	1	NR	975	0	NR
460	175	NR	590	340	NR	720	21	NR	850	0	NR	980	0	NR
465	149	NR	595	342	NR	725	17	NR	855	0	NR	985	0	NR
470	122	NR	600	345	NR	730	14	NR	860	0	NR	990	0	NR
475	99	NR	605	346	NR	735	12	NR	865	0	NR	995	0	NR
480	103	NR	610	371	NR	740	11	NR	870	0	NR	1000	0	NR
485	120	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-2

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.16

λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	140	NR	620	345	NR	750	8	NR	880	0	NR
365	0	NR	495	166	NR	625	344	NR	755	7	NR	885	0	NR
370	0	NR	500	190	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	208	NR	635	658	NR	765	5	NR	895	0	NR
380	0	NR	510	221	NR	640	232	NR	770	4	NR	900	0	NR
385	0	NR	515	230	NR	645	222	NR	775	4	NR	905	0	NR
390	1	NR	520	235	NR	650	194	NR	780	3	NR	910	0	NR
395	1	NR	525	241	NR	655	165	NR	785	3	NR	915	0	NR
400	2	NR	530	246	NR	660	141	NR	790	2	NR	920	0	NR
405	3	NR	535	254	NR	665	120	NR	795	2	NR	925	0	NR
410	5	NR	540	262	NR	670	109	NR	800	2	NR	930	0	NR
415	8	NR	545	269	NR	675	90	NR	805	1	NR	935	0	NR
420	14	NR	550	279	NR	680	77	NR	810	1	NR	940	0	NR
425	25	NR	555	288	NR	685	66	NR	815	1	NR	945	0	NR
430	42	NR	560	297	NR	690	57	NR	820	1	NR	950	0	NR
435	71	NR	565	305	NR	695	49	NR	825	1	NR	955	0	NR
440	117	NR	570	313	NR	700	42	NR	830	1	NR	960	0	NR
445	211	NR	575	320	NR	705	35	NR	835	1	NR	965	0	NR
450	316	NR	580	327	NR	710	30	NR	840	1	NR	970	0	NR
455	265	NR	585	334	NR	715	25	NR	845	1	NR	975	0	NR
460	175	NR	590	340	NR	720	21	NR	850	0	NR	980	0	NR
465	149	NR	595	342	NR	725	17	NR	855	0	NR	985	0	NR
470	122	NR	600	345	NR	730	14	NR	860	0	NR	990	0	NR
475	99	NR	605	346	NR	735	12	NR	865	0	NR	995	0	NR
480	103	NR	610	371	NR	740	11	NR	870	0	NR	1000	0	NR
485	120	NR	615	390	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-2


TM-30-18

Summary

$R_f = 91.3$
 $R_g = 99.9$
 $CIE R_a = 93.4$
 $R_9 = 57.9$



Color Vector Graphics

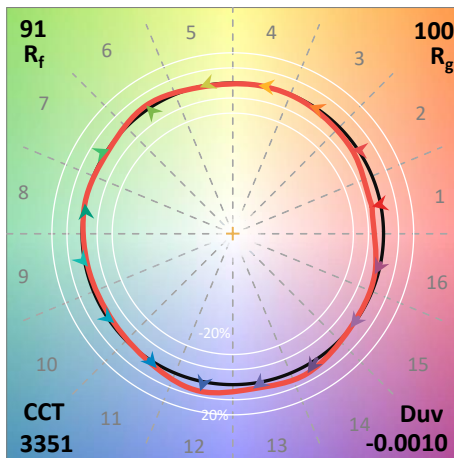

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 93	CES51 = 98	CES76 = 88
CES02 = 63	CES27 = 93	CES52 = 98	CES77 = 87
CES03 = 31	CES28 = 96	CES53 = 97	CES78 = 85
CES04 = 70	CES29 = 95	CES54 = 95	CES79 = 91
CES05 = 50	CES30 = 96	CES55 = 94	CES80 = 92
CES06 = 51	CES31 = 95	CES56 = 96	CES81 = 75
CES07 = 43	CES32 = 87	CES57 = 95	CES82 = 96
CES08 = 41	CES33 = 97	CES58 = 96	CES83 = 94
CES09 = 29	CES34 = 94	CES59 = 97	CES84 = 95
CES10 = 75	CES35 = 96	CES60 = 94	CES85 = 80
CES11 = 58	CES36 = 84	CES61 = 93	CES86 = 79
CES12 = 64	CES37 = 95	CES62 = 90	CES87 = 91
CES13 = 44	CES38 = 91	CES63 = 94	CES88 = 97
CES14 = 74	CES39 = 98	CES64 = 92	CES89 = 83
CES15 = 72	CES40 = 96	CES65 = 90	CES90 = 97
CES16 = 48	CES41 = 97	CES66 = 91	CES91 = 77
CES17 = 49	CES42 = 94	CES67 = 90	CES92 = 76
CES18 = 56	CES43 = 93	CES68 = 89	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 91	CES94 = 73
CES20 = 67	CES45 = 96	CES70 = 87	CES95 = 83
CES21 = 86	CES46 = 96	CES71 = 84	CES96 = 91
CES22 = 78	CES47 = 91	CES72 = 94	CES97 = 95
CES23 = 91	CES48 = 93	CES73 = 82	CES98 = 94
CES24 = 90	CES49 = 95	CES74 = 91	CES99 = 91
CES25 = 71	CES50 = 99	CES75 = 86	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)