

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975522

Luminaire Tested: 24ENA-LD2-45-UNV-L850-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975522
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24ENA-LD2-45-UNV-L850-CD1
Description: METALUX ENCOUNTER 2x4 4500LM PACKAGE 80CRI 5000K AIR VENTED TROFFER
Light Source: 5000K CCT, 80+ CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4538.8 lumens
Efficiency: N/A
Efficacy: 119.4 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.4
Luminous Opening: Rectangular (W 1.83' x L: 3.83' x H: 0')
CIE Type: Direct

Input Watts (W): 38
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P975522

CATALOG NUMBER: 24ENA-LD2-45-UNV-L850-CD1

Luminous Intensity Polar Plot

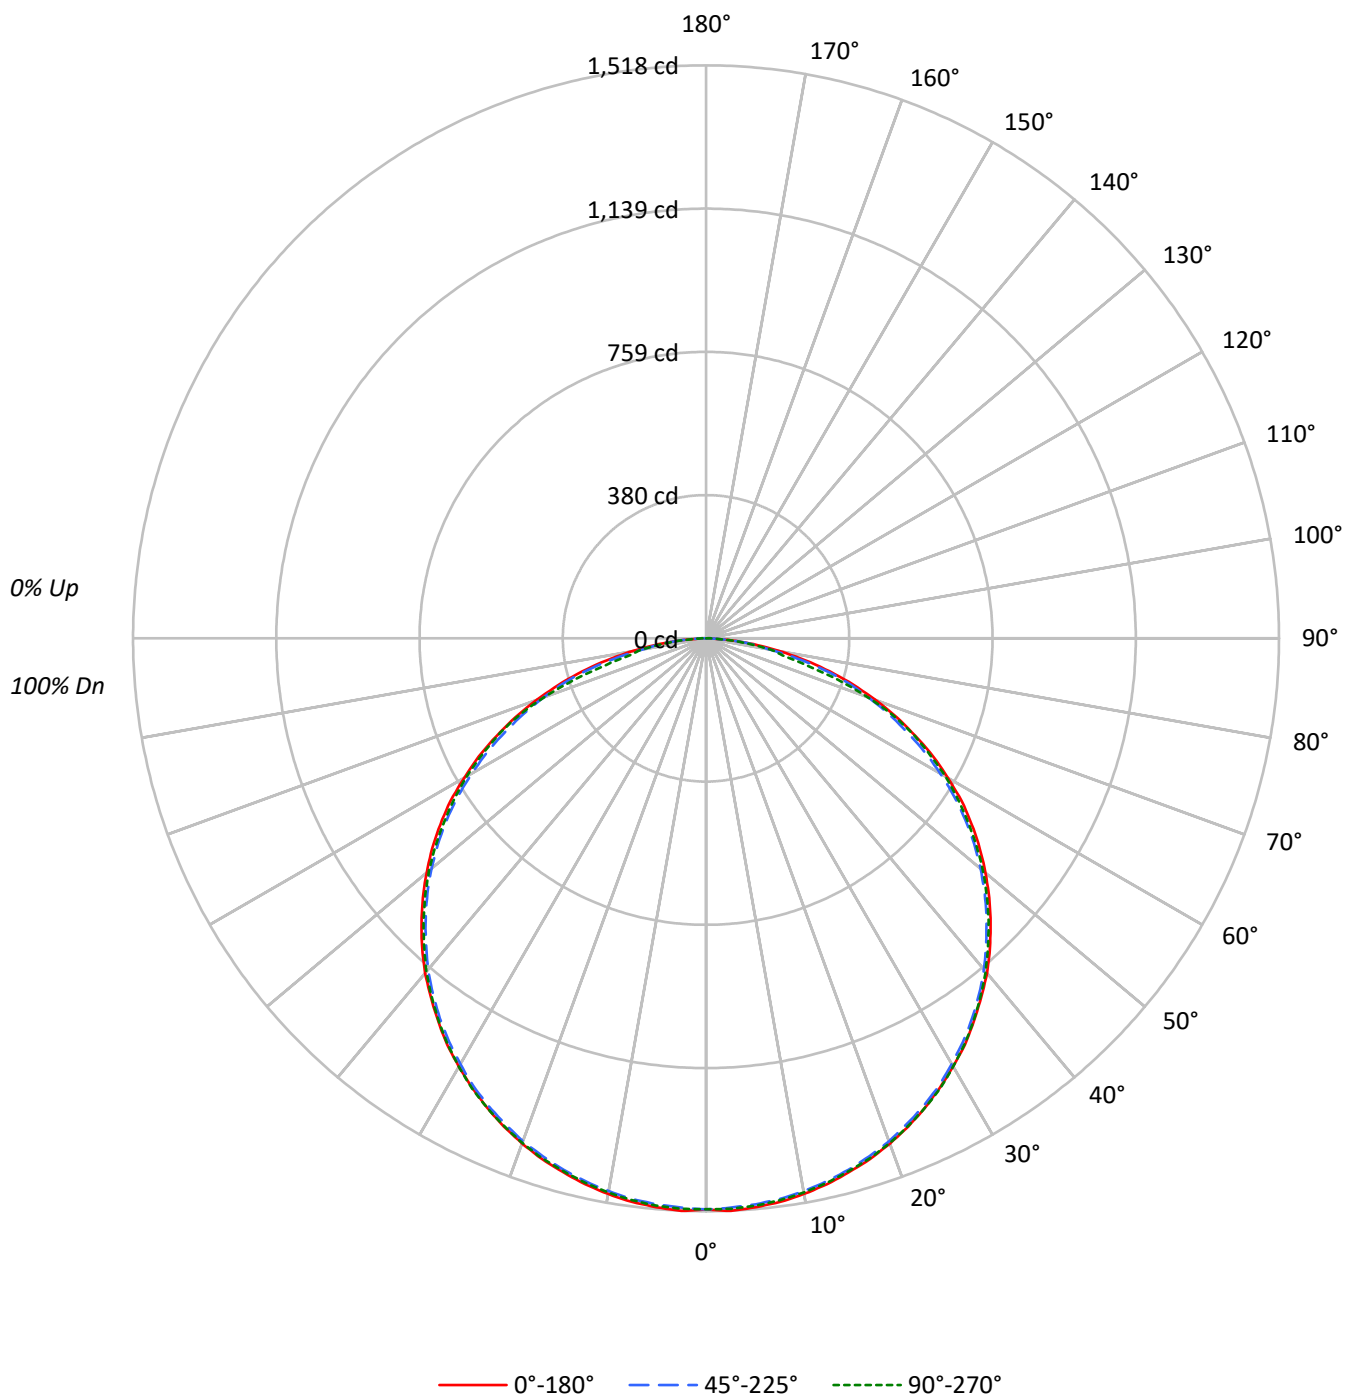

TEST NUMBER: P975522

CATALOG NUMBER: 24ENA-LD2-45-UNV-L850-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	109	104	99	95	106	101	97	94	97	94	91	93	90	88	90	87	85	83		
2	98	90	83	77	96	88	82	76	84	79	74	81	77	73	78	74	71	69		
3	90	79	70	64	87	77	69	63	74	67	62	71	66	61	69	64	60	58		
4	82	70	61	54	79	68	60	53	66	58	53	63	57	52	61	56	51	49		
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42		
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	50	44	39	37		
7	64	50	42	35	62	50	41	35	48	40	35	47	40	35	45	39	34	32		
8	60	46	37	31	58	45	37	31	44	36	31	43	36	31	41	35	31	29		
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26		
10	52	39	31	26	51	38	31	25	37	30	25	36	30	25	35	29	25	23		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2317	2317	2317
5°	2326	2314	2320
10°	2325	2313	2318
15°	2322	2311	2317
20°	2322	2311	2319
25°	2319	2308	2319
30°	2316	2303	2316
35°	2314	2298	2310
40°	2315	2291	2304
45°	2309	2276	2293
50°	2303	2262	2282
55°	2295	2239	2262
60°	2266	2196	2243
65°	2221	2127	2206
70°	2140	2052	2047
75°	2014	1925	1627
80°	1773	1506	1548
85°	1399	1318	1218

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2309 cd/sqm

TEST NUMBER: P975522

CATALOG NUMBER: 24ENA-LD2-45-UNV-L850-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	143.3	3.2
10°-20°	412.0	9.1
20°-30°	630.5	13.9
30°-40°	770.7	17.0
40°-50°	814.4	17.9
50°-60°	754.6	16.6
60°-70°	591.2	13.0
70°-80°	334.2	7.4
80°-90°	88.0	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1185.8	26.1
0°-40°	1956.5	43.1
0°-60°	3525.4	77.7
0°-90°	4538.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4538.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1513	1513	1513	1513	1513	
5°	1513	1508	1505	1504	1509	144
15°	1464	1458	1458	1457	1461	414
25°	1372	1366	1366	1366	1372	633
35°	1238	1232	1229	1229	1236	775
45°	1066	1058	1051	1051	1058	823
55°	859	850	838	840	847	767
65°	613	601	587	595	609	606
75°	340	331	325	290	275	358
85°	80	75	75	71	69	94
90°	0	0	0	0	0	

TEST NUMBER: P975522

CATALOG NUMBER: 24ENA-LD2-45-UNV-L850-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1512.6	1512.6	1512.6	1512.6	1512.6
2.5°	1518.2	1511.7	1509.7	1507.9	1512.6
5°	1512.6	1507.9	1504.9	1504.0	1508.8
7.5°	1506.0	1500.3	1498.4	1496.4	1501.2
10°	1494.6	1489.0	1487.0	1486.0	1490.7
12.5°	1481.3	1474.6	1473.7	1472.8	1477.5
15°	1464.2	1458.5	1457.6	1456.7	1461.3
17.5°	1446.2	1440.6	1438.6	1437.7	1444.3
20°	1424.4	1418.8	1417.7	1416.8	1422.5
22.5°	1399.8	1394.1	1392.2	1393.1	1398.7
25°	1372.3	1366.5	1365.6	1365.6	1372.3
27.5°	1341.8	1336.2	1336.2	1336.2	1343.8
30°	1309.7	1304.9	1302.1	1303.0	1309.7
32.5°	1276.4	1268.8	1267.0	1267.9	1274.6
35°	1237.6	1231.9	1229.1	1229.1	1235.6
37.5°	1197.7	1192.0	1188.3	1188.3	1194.9
40°	1158.0	1149.3	1145.6	1143.6	1152.3
42.5°	1113.3	1106.7	1098.2	1098.2	1105.7
45°	1066.0	1058.4	1050.7	1050.7	1058.4
47.5°	1017.6	1010.0	1001.4	1001.4	1009.1
50°	966.3	958.7	949.3	949.3	957.8
52.5°	914.2	905.7	895.3	894.2	902.9
55°	859.3	849.7	838.3	840.3	846.9
57.5°	803.2	790.9	779.5	779.5	790.0
60°	739.8	729.3	716.9	718.9	732.2
62.5°	679.0	665.7	653.4	658.1	669.6
65°	612.7	601.3	587.0	594.6	608.8
67.5°	547.2	534.9	523.5	532.9	539.6
70°	477.9	466.6	458.1	458.1	457.0
72.5°	408.8	398.3	396.4	378.3	367.0
75°	340.4	331.0	325.3	290.2	275.0
77.5°	269.3	266.5	248.5	211.5	206.7
80°	201.0	203.0	170.7	171.6	175.5
82.5°	138.5	135.6	128.0	122.3	120.4
85°	79.6	75.0	75.0	71.1	69.3
87.5°	26.6	29.4	29.4	29.4	30.3
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-4

Test Date: 07/15/2025

Luminaire Tested: 14EN-LD2-51-UNV-L950-CD1-U

Data in this report applies to families of products including 14EN-LD2-51-UNV-L950-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-457-4
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/15/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **14EN-LD2-51-UNV-L950-CD1-U**
 Description: 1x4 ENCOUNTER 5100LM WITH LIGHTNING BOARDS

Spectral Parameters

CCT (K): 4838
 CIE u' : 0.2122
 CIE v' : 0.4888
 Duv: 0.0015
 CIE x: 0.3502
 CIE y: 0.3586
 CIE z: 0.2912
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 573
 Purity: 12.68613
 R_f: 91.2
 R_g: 100.8

CRI (Ra): 93.6
 R1: 94.4
 R2: 94.8
 R3: 93.6
 R4: 94.8
 R5: 93.3
 R6: 91.9
 R7: 95.9
 R8: 89.8
 R9: 69.6
 R10: 86.3
 R11: 94.3
 R12: 70.2
 R13: 94.4
 R14: 96.0
 R15: 92.2



Test Conditions

Stabilization Time: M
 Operation Time: 1H 0M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-457-4

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-4

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-4

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4

Scotopic Flux vs. Wavelength




Scotopic Lumens: NR

S/P: 2.02

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4

Melanopic Flux vs. Wavelength

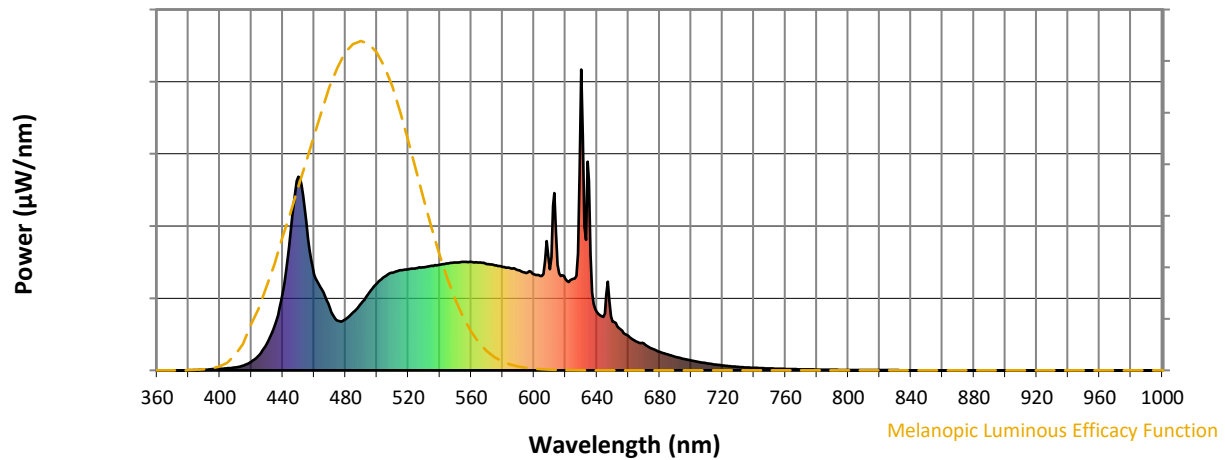

Melanopic Lumens: NR

M/P: 4.31

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4



TM-30-18

Summary

$R_f = 91.2$
 $R_g = 100.8$
 $CIE R_a = 93.6$
 $R_9 = 69.6$



Color Vector Graphics

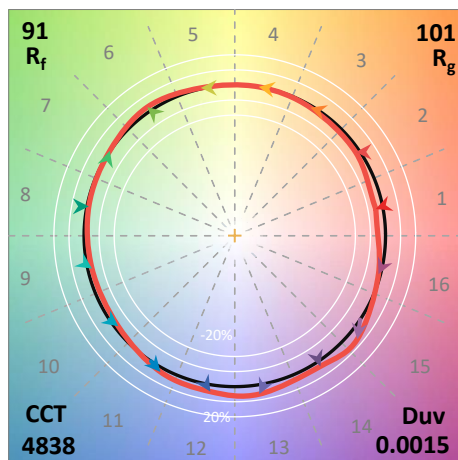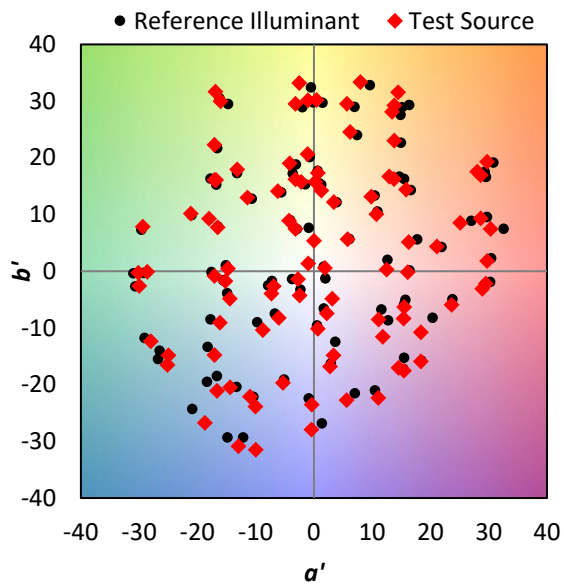

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 90	CES51 = 99	CES76 = 83
CES02 = 61	CES27 = 93	CES52 = 98	CES77 = 88
CES03 = 31	CES28 = 94	CES53 = 96	CES78 = 80
CES04 = 69	CES29 = 92	CES54 = 96	CES79 = 95
CES05 = 48	CES30 = 98	CES55 = 94	CES80 = 92
CES06 = 50	CES31 = 93	CES56 = 95	CES81 = 84
CES07 = 41	CES32 = 86	CES57 = 94	CES82 = 96
CES08 = 40	CES33 = 96	CES58 = 95	CES83 = 96
CES09 = 29	CES34 = 90	CES59 = 98	CES84 = 93
CES10 = 73	CES35 = 94	CES60 = 94	CES85 = 84
CES11 = 56	CES36 = 84	CES61 = 93	CES86 = 87
CES12 = 62	CES37 = 93	CES62 = 90	CES87 = 90
CES13 = 42	CES38 = 92	CES63 = 93	CES88 = 97
CES14 = 74	CES39 = 98	CES64 = 91	CES89 = 86
CES15 = 71	CES40 = 96	CES65 = 89	CES90 = 98
CES16 = 47	CES41 = 98	CES66 = 88	CES91 = 75
CES17 = 48	CES42 = 91	CES67 = 87	CES92 = 79
CES18 = 56	CES43 = 91	CES68 = 88	CES93 = 88
CES19 = 70	CES44 = 99	CES69 = 89	CES94 = 78
CES20 = 65	CES45 = 94	CES70 = 84	CES95 = 83
CES21 = 85	CES46 = 95	CES71 = 80	CES96 = 92
CES22 = 77	CES47 = 94	CES72 = 93	CES97 = 93
CES23 = 91	CES48 = 95	CES73 = 78	CES98 = 93
CES24 = 90	CES49 = 94	CES74 = 93	CES99 = 94
CES25 = 70	CES50 = 99	CES75 = 81	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)