

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975492

Luminaire Tested: 24ENA-LD2-45-UNV-L930-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975492
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24ENA-LD2-45-UNV-L930-CD1
Description: METALUX ENCOUNTER 2x4 4500LM PACKAGE 90CRI 3000K AIR VENTED TROFFER
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4401.8 lumens
Efficiency: N/A
Efficacy: 115.8 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.4
Luminous Opening: Rectangular (W 1.83' x L: 3.83' x H: 0')
CIE Type: Direct

Input Watts (W): 38
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P975492

CATALOG NUMBER: 24ENA-LD2-45-UNV-L930-CD1

Luminous Intensity Polar Plot

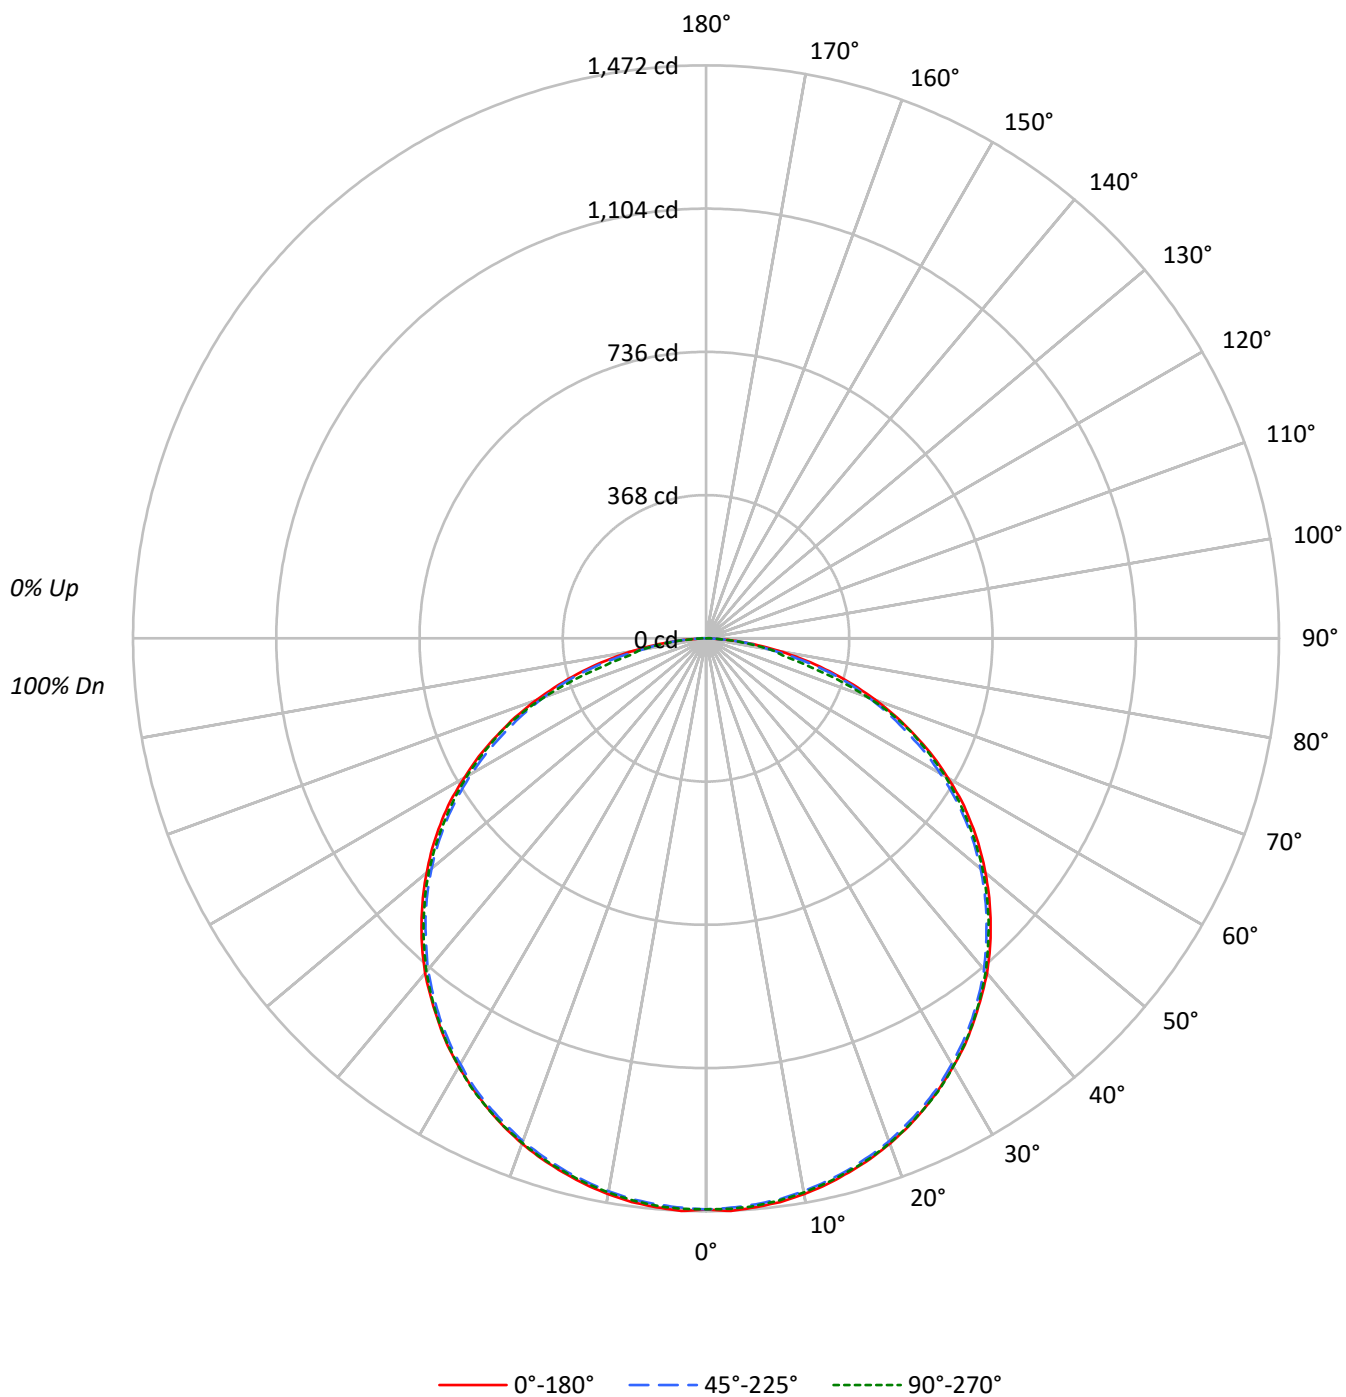

TEST NUMBER: P975492

CATALOG NUMBER: 24ENA-LD2-45-UNV-L930-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	109	104	99	95	106	101	97	94	97	94	91		93	90	88		90	87	85	83
2	98	90	83	77	96	88	82	76	84	79	74		81	77	73		78	74	71	69
3	90	79	70	64	87	77	69	63	74	67	62		71	66	61		69	64	60	58
4	82	70	61	54	79	68	60	53	66	58	53		63	57	52		61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	45		57	50	45		55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40		51	44	39		50	44	39	37
7	64	50	42	35	62	50	41	35	48	40	35		47	40	35		45	39	34	32
8	60	46	37	31	58	45	37	31	44	36	31		43	36	31		41	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28		39	33	28		38	32	28	26
10	52	39	31	26	51	38	31	25	37	30	25		36	30	25		35	29	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2247	2247	2247
5°	2255	2244	2250
10°	2254	2243	2249
15°	2252	2242	2247
20°	2252	2241	2249
25°	2249	2238	2249
30°	2246	2233	2246
35°	2244	2229	2241
40°	2245	2221	2234
45°	2239	2207	2223
50°	2233	2194	2213
55°	2225	2171	2193
60°	2198	2130	2175
65°	2154	2063	2140
70°	2076	1990	1985
75°	1953	1867	1578
80°	1720	1461	1501
85°	1357	1278	1181

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2239 cd/sqm

TEST NUMBER: P975492

CATALOG NUMBER: 24ENA-LD2-45-UNV-L930-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.9	3.2
10°-20°	399.6	9.1
20°-30°	611.5	13.9
30°-40°	747.4	17.0
40°-50°	789.8	17.9
50°-60°	731.8	16.6
60°-70°	573.3	13.0
70°-80°	324.1	7.4
80°-90°	85.3	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1150.0	26.1
0°-40°	1897.4	43.1
0°-60°	3419.0	77.7
0°-90°	4401.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4401.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1467	1467	1467	1467	1467	
5°	1467	1462	1460	1459	1463	139
15°	1420	1414	1414	1413	1417	401
25°	1331	1325	1324	1324	1331	614
35°	1200	1195	1192	1192	1198	751
45°	1034	1026	1019	1019	1026	798
55°	833	824	813	815	821	744
65°	594	583	569	577	590	587
75°	330	321	316	281	267	347
85°	77	73	73	69	67	91
90°	0	0	0	0	0	

TEST NUMBER: P975492

CATALOG NUMBER: 24ENA-LD2-45-UNV-L930-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1466.9	1466.9	1466.9	1466.9	1466.9
2.5°	1472.4	1466.0	1464.1	1462.4	1466.9
5°	1466.9	1462.4	1459.5	1458.6	1463.3
7.5°	1460.5	1455.0	1453.1	1451.3	1455.9
10°	1449.5	1444.0	1442.1	1441.1	1445.8
12.5°	1436.6	1430.1	1429.2	1428.4	1432.9
15°	1420.0	1414.5	1413.6	1412.7	1417.2
17.5°	1402.6	1397.1	1395.2	1394.3	1400.7
20°	1381.4	1375.9	1374.9	1374.0	1379.6
22.5°	1357.5	1352.0	1350.1	1351.0	1356.5
25°	1330.9	1325.2	1324.4	1324.4	1330.9
27.5°	1301.3	1295.8	1295.8	1295.8	1303.2
30°	1270.2	1265.6	1262.8	1263.7	1270.2
32.5°	1237.9	1230.5	1228.8	1229.6	1236.2
35°	1200.2	1194.7	1192.0	1192.0	1198.3
37.5°	1161.6	1156.1	1152.4	1152.4	1158.8
40°	1123.0	1114.6	1111.0	1109.1	1117.5
42.5°	1079.7	1073.3	1065.1	1065.1	1072.3
45°	1033.8	1026.4	1019.0	1019.0	1026.4
47.5°	986.9	979.5	971.2	971.2	978.6
50°	937.2	929.8	920.7	920.7	928.9
52.5°	886.6	878.4	868.2	867.2	875.6
55°	833.3	824.1	813.0	814.9	821.3
57.5°	779.0	767.0	756.0	756.0	766.1
60°	717.4	707.3	695.3	697.2	710.1
62.5°	658.5	645.6	633.7	638.2	649.4
65°	594.2	583.2	569.3	576.6	590.4
67.5°	530.7	518.7	507.7	516.8	523.3
70°	463.5	452.5	444.3	444.3	443.2
72.5°	396.5	386.3	384.4	366.9	355.9
75°	330.1	321.0	315.5	281.4	266.7
77.5°	261.2	258.4	241.0	205.1	200.5
80°	195.0	196.9	165.6	166.4	170.2
82.5°	134.3	131.5	124.1	118.6	116.7
85°	77.2	72.7	72.7	68.9	67.2
87.5°	25.8	28.5	28.5	28.5	29.4
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-1

Test Date: 07/15/2025

Luminaire Tested: 14EN-LD2-51-UNV-L930-CD1-U

Data in this report applies to families of products including 14EN-LD2-51-UNV-L930-CD1-U

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-457-1
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/15/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **14EN-LD2-51-UNV-L930-CD1-U**
 Description: 1x4 ENCOUNTER 5100LM WITH LIGHTNING BOARDS

Spectral Parameters

CCT (K): 2952
 CIE u' : 0.2521
 CIE v' : 0.5233
 Duv: 0.0007
 CIE x: 0.4415
 CIE y: 0.4074
 CIE z: 0.1512
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 582
 Purity: 54.78275
 R_f: 91.8
 R_g: 99.1

CRI (Ra): 93.2
 R1: 93.9
 R2: 96.6
 R3: 98.6
 R4: 94.8
 R5: 93.9
 R6: 96.9
 R7: 91.0
 R8: 79.7
 R9: 53.0
 R10: 91.2
 R11: 96.9
 R12: 85.5
 R13: 94.5
 R14: 98.2
 R15: 88.3



Test Conditions

Stabilization Time: 33M
 Operation Time: 1H 33M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-457-1

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-1

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3000K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-1

Photopic Flux vs. Wavelength




Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	108	NR	620	327	NR	750	7	NR	880	0	NR
365	0	NR	495	130	NR	625	330	NR	755	6	NR	885	0	NR
370	0	NR	500	150	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	166	NR	635	648	NR	765	5	NR	895	0	NR
380	0	NR	510	177	NR	640	220	NR	770	4	NR	900	0	NR
385	0	NR	515	185	NR	645	212	NR	775	3	NR	905	0	NR
390	0	NR	520	190	NR	650	184	NR	780	3	NR	910	0	NR
395	1	NR	525	196	NR	655	156	NR	785	2	NR	915	0	NR
400	1	NR	530	201	NR	660	133	NR	790	2	NR	920	0	NR
405	2	NR	535	208	NR	665	112	NR	795	2	NR	925	0	NR
410	3	NR	540	216	NR	670	103	NR	800	1	NR	930	0	NR
415	5	NR	545	223	NR	675	84	NR	805	1	NR	935	0	NR
420	10	NR	550	233	NR	680	72	NR	810	1	NR	940	0	NR
425	17	NR	555	243	NR	685	62	NR	815	1	NR	945	0	NR
430	29	NR	560	253	NR	690	53	NR	820	1	NR	950	0	NR
435	47	NR	565	262	NR	695	45	NR	825	1	NR	955	0	NR
440	77	NR	570	272	NR	700	38	NR	830	1	NR	960	0	NR
445	136	NR	575	282	NR	705	32	NR	835	1	NR	965	0	NR
450	193	NR	580	292	NR	710	27	NR	840	0	NR	970	0	NR
455	153	NR	585	301	NR	715	23	NR	845	0	NR	975	0	NR
460	105	NR	590	310	NR	720	19	NR	850	0	NR	980	0	NR
465	94	NR	595	314	NR	725	16	NR	855	0	NR	985	0	NR
470	78	NR	600	320	NR	730	13	NR	860	0	NR	990	0	NR
475	68	NR	605	323	NR	735	11	NR	865	0	NR	995	0	NR
480	74	NR	610	351	NR	740	10	NR	870	0	NR	1000	0	NR
485	89	NR	615	372	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-1

Scotopic Flux vs. Wavelength

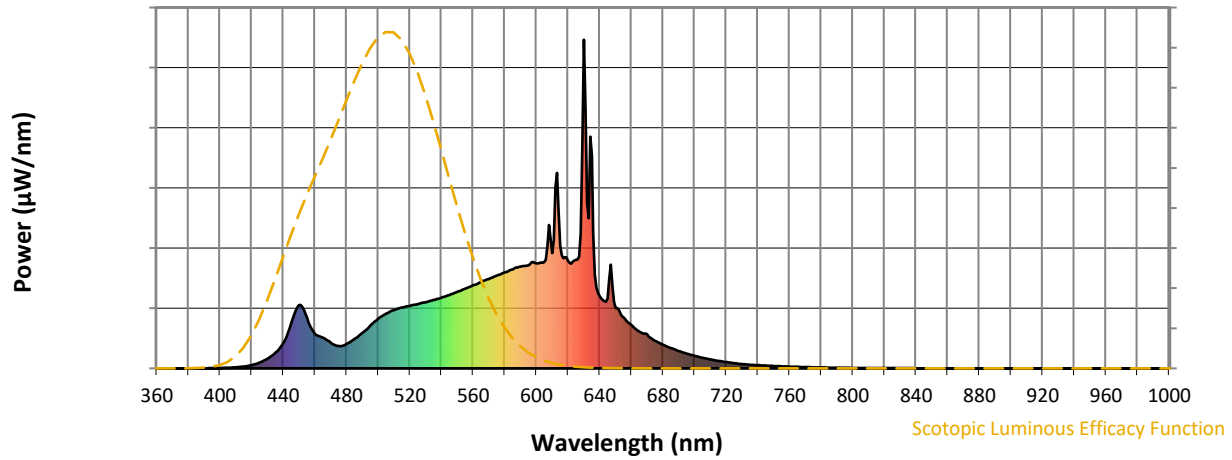


Scotopic Lumens: NR

S/P: 1.4

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	108	NR	620	327	NR	750	7	NR	880	0	NR
365	0	NR	495	130	NR	625	330	NR	755	6	NR	885	0	NR
370	0	NR	500	150	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	166	NR	635	648	NR	765	5	NR	895	0	NR
380	0	NR	510	177	NR	640	220	NR	770	4	NR	900	0	NR
385	0	NR	515	185	NR	645	212	NR	775	3	NR	905	0	NR
390	0	NR	520	190	NR	650	184	NR	780	3	NR	910	0	NR
395	1	NR	525	196	NR	655	156	NR	785	2	NR	915	0	NR
400	1	NR	530	201	NR	660	133	NR	790	2	NR	920	0	NR
405	2	NR	535	208	NR	665	112	NR	795	2	NR	925	0	NR
410	3	NR	540	216	NR	670	103	NR	800	1	NR	930	0	NR
415	5	NR	545	223	NR	675	84	NR	805	1	NR	935	0	NR
420	10	NR	550	233	NR	680	72	NR	810	1	NR	940	0	NR
425	17	NR	555	243	NR	685	62	NR	815	1	NR	945	0	NR
430	29	NR	560	253	NR	690	53	NR	820	1	NR	950	0	NR
435	47	NR	565	262	NR	695	45	NR	825	1	NR	955	0	NR
440	77	NR	570	272	NR	700	38	NR	830	1	NR	960	0	NR
445	136	NR	575	282	NR	705	32	NR	835	1	NR	965	0	NR
450	193	NR	580	292	NR	710	27	NR	840	0	NR	970	0	NR
455	153	NR	585	301	NR	715	23	NR	845	0	NR	975	0	NR
460	105	NR	590	310	NR	720	19	NR	850	0	NR	980	0	NR
465	94	NR	595	314	NR	725	16	NR	855	0	NR	985	0	NR
470	78	NR	600	320	NR	730	13	NR	860	0	NR	990	0	NR
475	68	NR	605	323	NR	735	11	NR	865	0	NR	995	0	NR
480	74	NR	610	351	NR	740	10	NR	870	0	NR	1000	0	NR
485	89	NR	615	372	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-1

Melanopic Flux vs. Wavelength

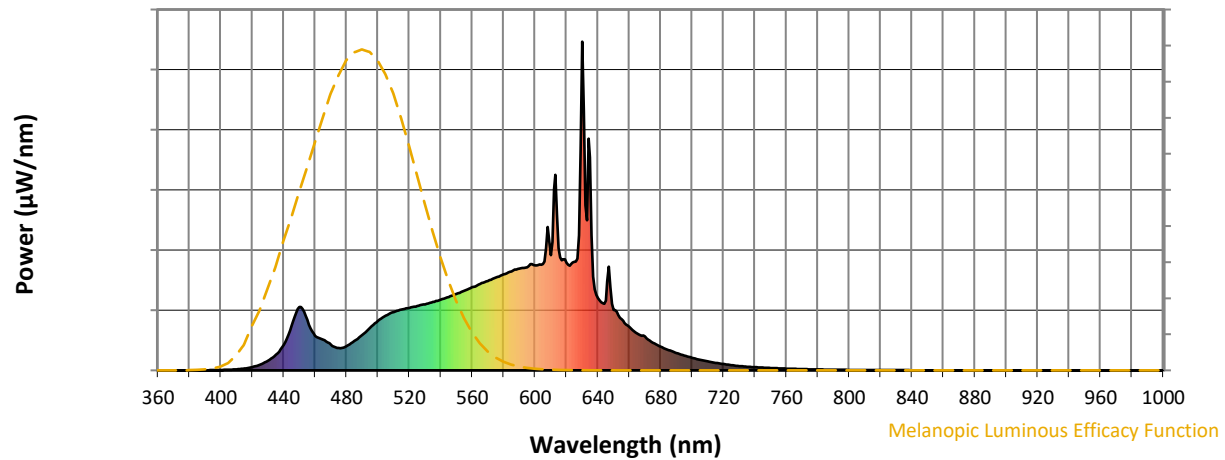
Melanopic Lumens: NR
M/P: 2.7


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	108	NR	620	327	NR	750	7	NR	880	0	NR
365	0	NR	495	130	NR	625	330	NR	755	6	NR	885	0	NR
370	0	NR	500	150	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	166	NR	635	648	NR	765	5	NR	895	0	NR
380	0	NR	510	177	NR	640	220	NR	770	4	NR	900	0	NR
385	0	NR	515	185	NR	645	212	NR	775	3	NR	905	0	NR
390	0	NR	520	190	NR	650	184	NR	780	3	NR	910	0	NR
395	1	NR	525	196	NR	655	156	NR	785	2	NR	915	0	NR
400	1	NR	530	201	NR	660	133	NR	790	2	NR	920	0	NR
405	2	NR	535	208	NR	665	112	NR	795	2	NR	925	0	NR
410	3	NR	540	216	NR	670	103	NR	800	1	NR	930	0	NR
415	5	NR	545	223	NR	675	84	NR	805	1	NR	935	0	NR
420	10	NR	550	233	NR	680	72	NR	810	1	NR	940	0	NR
425	17	NR	555	243	NR	685	62	NR	815	1	NR	945	0	NR
430	29	NR	560	253	NR	690	53	NR	820	1	NR	950	0	NR
435	47	NR	565	262	NR	695	45	NR	825	1	NR	955	0	NR
440	77	NR	570	272	NR	700	38	NR	830	1	NR	960	0	NR
445	136	NR	575	282	NR	705	32	NR	835	1	NR	965	0	NR
450	193	NR	580	292	NR	710	27	NR	840	0	NR	970	0	NR
455	153	NR	585	301	NR	715	23	NR	845	0	NR	975	0	NR
460	105	NR	590	310	NR	720	19	NR	850	0	NR	980	0	NR
465	94	NR	595	314	NR	725	16	NR	855	0	NR	985	0	NR
470	78	NR	600	320	NR	730	13	NR	860	0	NR	990	0	NR
475	68	NR	605	323	NR	735	11	NR	865	0	NR	995	0	NR
480	74	NR	610	351	NR	740	10	NR	870	0	NR	1000	0	NR
485	89	NR	615	372	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-1



TM-30-18

Summary

$R_f = 91.8$
 $R_g = 99.1$
 $CIE R_a = 93.2$
 $R_9 = 53.0$

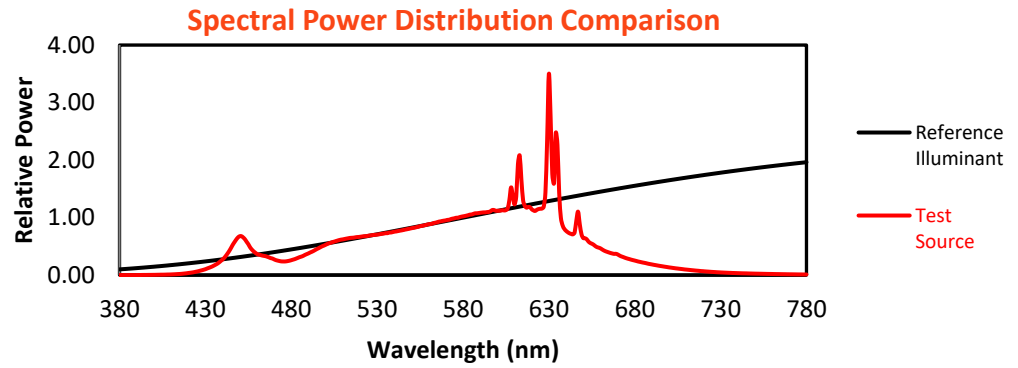

Color Vector Graphics

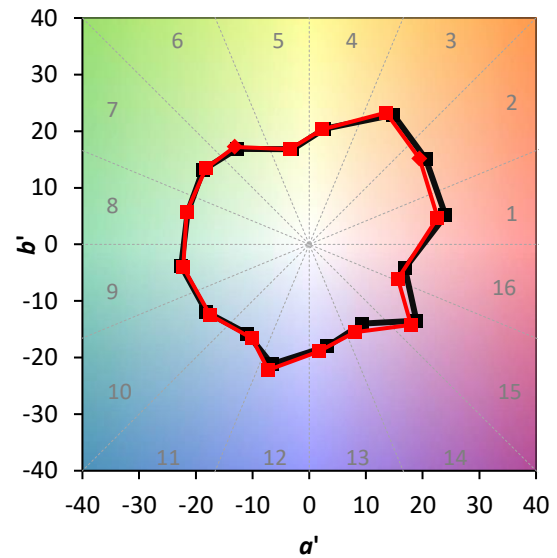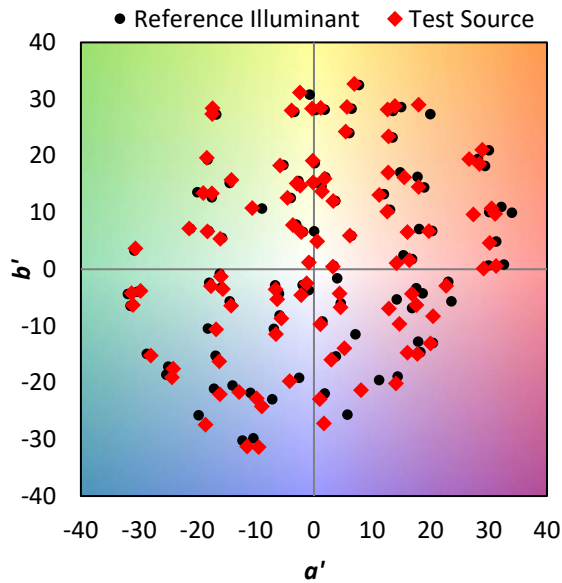

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 94	CES51 = 97	CES76 = 91
CES02 = 63	CES27 = 94	CES52 = 98	CES77 = 85
CES03 = 32	CES28 = 98	CES53 = 97	CES78 = 88
CES04 = 70	CES29 = 95	CES54 = 96	CES79 = 88
CES05 = 50	CES30 = 98	CES55 = 96	CES80 = 91
CES06 = 51	CES31 = 95	CES56 = 96	CES81 = 70
CES07 = 43	CES32 = 88	CES57 = 96	CES82 = 96
CES08 = 42	CES33 = 96	CES58 = 97	CES83 = 93
CES09 = 29	CES34 = 96	CES59 = 98	CES84 = 95
CES10 = 76	CES35 = 98	CES60 = 95	CES85 = 79
CES11 = 59	CES36 = 88	CES61 = 95	CES86 = 75
CES12 = 65	CES37 = 96	CES62 = 93	CES87 = 92
CES13 = 44	CES38 = 94	CES63 = 95	CES88 = 96
CES14 = 74	CES39 = 98	CES64 = 95	CES89 = 82
CES15 = 72	CES40 = 96	CES65 = 90	CES90 = 97
CES16 = 48	CES41 = 96	CES66 = 94	CES91 = 82
CES17 = 50	CES42 = 95	CES67 = 93	CES92 = 76
CES18 = 57	CES43 = 95	CES68 = 92	CES93 = 86
CES19 = 72	CES44 = 99	CES69 = 93	CES94 = 71
CES20 = 67	CES45 = 97	CES70 = 91	CES95 = 84
CES21 = 86	CES46 = 96	CES71 = 89	CES96 = 91
CES22 = 79	CES47 = 88	CES72 = 96	CES97 = 95
CES23 = 92	CES48 = 93	CES73 = 86	CES98 = 93
CES24 = 91	CES49 = 95	CES74 = 89	CES99 = 90
CES25 = 72	CES50 = 98	CES75 = 90	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)