

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975497

Luminaire Tested: 24ENA-LD2-70-UNV-L930-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975497
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24ENA-LD2-70-UNV-L930-CD1
Description: METALUX ENCOUNTER 2x4 7000LM PACKAGE 90CRI 3000K AIR VENTED TROFFER
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6640.7 lumens
Efficiency: N/A
Efficacy: 110.3 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.4
Luminous Opening: Rectangular (W 1.83' x L: 3.83' x H: 0')
CIE Type: Direct

Input Watts (W): 60.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P975497

CATALOG NUMBER: 24ENA-LD2-70-UNV-L930-CD1

Luminous Intensity Polar Plot

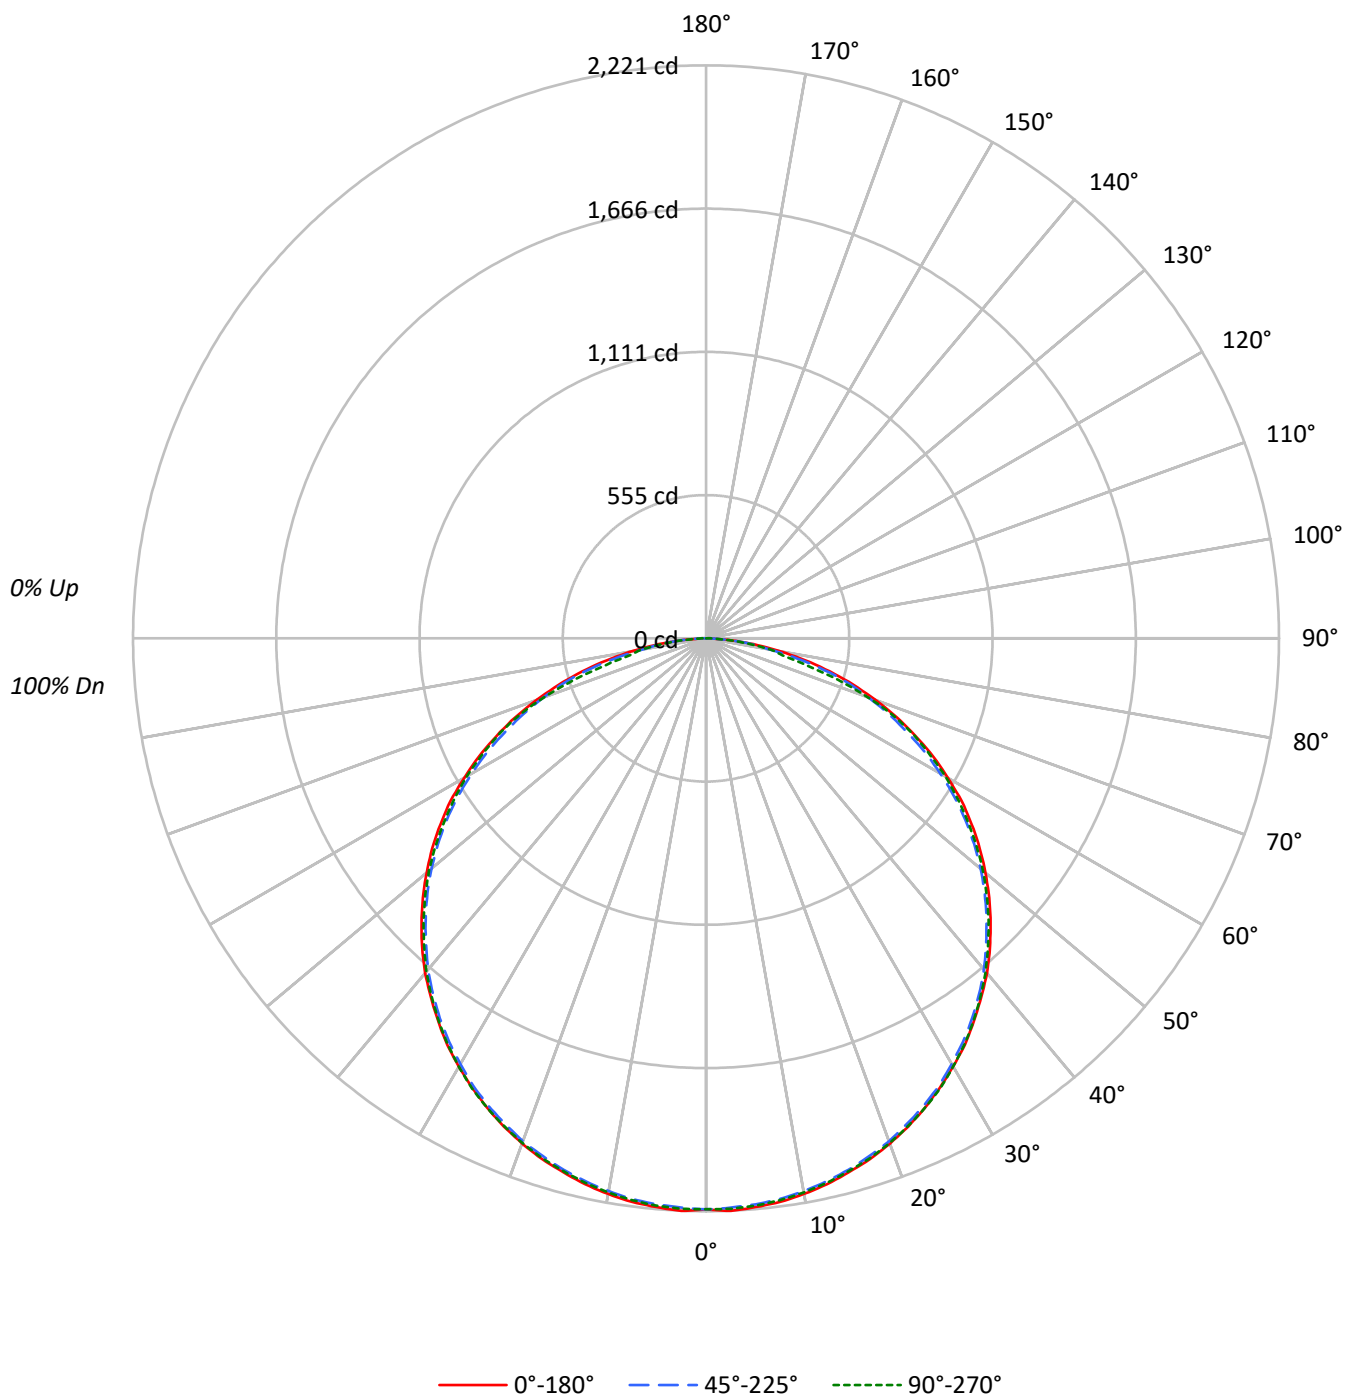

TEST NUMBER: P975497

CATALOG NUMBER: 24ENA-LD2-70-UNV-L930-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	109	104	99	95	106	101	97	94	97	94	91		93	90	88		90	87	85	83
2	98	90	83	77	96	88	82	76	84	79	74		81	77	73		78	74	71	69
3	90	79	70	64	87	77	69	63	74	67	62		71	66	61		69	64	60	58
4	82	70	61	54	79	68	60	53	66	58	53		63	57	52		61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	45		57	50	45		55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40		51	44	39		50	44	39	37
7	64	50	42	35	62	50	41	35	48	40	35		47	40	35		45	39	34	32
8	60	46	37	31	58	45	37	31	44	36	31		43	36	31		41	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28		39	33	28		38	32	28	26
10	52	39	31	26	51	38	31	25	37	30	25		36	30	25		35	29	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3390	3390	3390
5°	3403	3385	3394
10°	3401	3384	3392
15°	3397	3382	3390
20°	3397	3381	3392
25°	3393	3377	3393
30°	3389	3369	3389
35°	3386	3362	3380
40°	3387	3351	3371
45°	3378	3330	3354
50°	3369	3310	3339
55°	3357	3275	3309
60°	3316	3213	3281
65°	3249	3112	3228
70°	3132	3001	2995
75°	2947	2816	2381
80°	2594	2203	2265
85°	2047	1928	1782

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3378 cd/sqm

TEST NUMBER: P975497

CATALOG NUMBER: 24ENA-LD2-70-UNV-L930-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	3.2
10°-20°	602.9	9.1
20°-30°	922.5	13.9
30°-40°	1127.6	17.0
40°-50°	1191.5	17.9
50°-60°	1104.0	16.6
60°-70°	864.9	13.0
70°-80°	489.0	7.4
80°-90°	128.8	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1735.0	26.1
0°-40°	2862.5	43.1
0°-60°	5158.1	77.7
0°-90°	6640.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6640.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2213	2213	2213	2213	2213	
5°	2213	2206	2202	2201	2208	210
15°	2142	2134	2133	2131	2138	605
25°	2008	1999	1998	1998	2008	926
35°	1811	1802	1798	1798	1808	1134
45°	1560	1548	1537	1537	1548	1204
55°	1257	1243	1227	1229	1239	1123
65°	896	880	859	870	891	886
75°	498	484	476	425	402	524
85°	116	110	110	104	101	137
90°	0	0	0	0	0	

TEST NUMBER: P975497

CATALOG NUMBER: 24ENA-LD2-70-UNV-L930-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2213.0	2213.0	2213.0	2213.0	2213.0
2.5°	2221.3	2211.7	2208.9	2206.2	2213.0
5°	2213.0	2206.2	2201.9	2200.6	2207.5
7.5°	2203.4	2195.1	2192.3	2189.4	2196.4
10°	2186.8	2178.5	2175.6	2174.1	2181.1
12.5°	2167.3	2157.5	2156.2	2154.9	2161.7
15°	2142.2	2133.9	2132.6	2131.3	2138.1
17.5°	2116.0	2107.7	2104.8	2103.5	2113.1
20°	2084.1	2075.8	2074.2	2072.9	2081.2
22.5°	2048.0	2039.7	2036.9	2038.2	2046.5
25°	2007.8	1999.3	1998.0	1998.0	2007.8
27.5°	1963.2	1954.9	1954.9	1954.9	1966.1
30°	1916.3	1909.3	1905.1	1906.4	1916.3
32.5°	1867.5	1856.4	1853.8	1855.1	1864.9
35°	1810.7	1802.4	1798.2	1798.2	1807.9
37.5°	1752.4	1744.1	1738.6	1738.6	1748.2
40°	1694.2	1681.6	1676.1	1673.3	1685.9
42.5°	1628.9	1619.3	1606.8	1606.8	1617.7
45°	1559.6	1548.5	1537.3	1537.3	1548.5
47.5°	1488.8	1477.7	1465.2	1465.2	1476.4
50°	1413.9	1402.7	1389.0	1389.0	1401.4
52.5°	1337.6	1325.1	1309.8	1308.3	1321.0
55°	1257.2	1243.2	1226.6	1229.4	1239.0
57.5°	1175.2	1157.1	1140.5	1140.5	1155.8
60°	1082.4	1067.1	1048.9	1051.8	1071.2
62.5°	993.4	974.0	956.1	962.8	979.7
65°	896.4	879.8	858.8	870.0	890.7
67.5°	800.7	782.5	765.9	779.7	789.5
70°	699.3	682.7	670.2	670.2	668.7
72.5°	598.1	582.8	580.0	553.5	536.9
75°	498.0	484.3	475.9	424.6	402.3
77.5°	394.0	389.9	363.6	309.4	302.4
80°	294.1	297.0	249.8	251.1	256.8
82.5°	202.6	198.4	187.3	179.0	176.1
85°	116.5	109.7	109.7	104.0	101.4
87.5°	38.9	43.0	43.0	43.0	44.4
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-1

Test Date: 07/15/2025

Luminaire Tested: 14EN-LD2-51-UNV-L930-CD1-U

Data in this report applies to families of products including 14EN-LD2-51-UNV-L930-CD1-U


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-457-1
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/15/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **14EN-LD2-51-UNV-L930-CD1-U**
 Description: 1x4 ENCOUNTER 5100LM WITH LIGHTNING BOARDS

Spectral Parameters

CCT (K): 2952
 CIE u' : 0.2521
 CIE v' : 0.5233
 Duv: 0.0007
 CIE x: 0.4415
 CIE y: 0.4074
 CIE z: 0.1512
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 582
 Purity: 54.78275
 R_f: 91.8
 R_g: 99.1

CRI (Ra): 93.2
 R1: 93.9
 R2: 96.6
 R3: 98.6
 R4: 94.8
 R5: 93.9
 R6: 96.9
 R7: 91.0
 R8: 79.7
 R9: 53.0
 R10: 91.2
 R11: 96.9
 R12: 85.5
 R13: 94.5
 R14: 98.2
 R15: 88.3

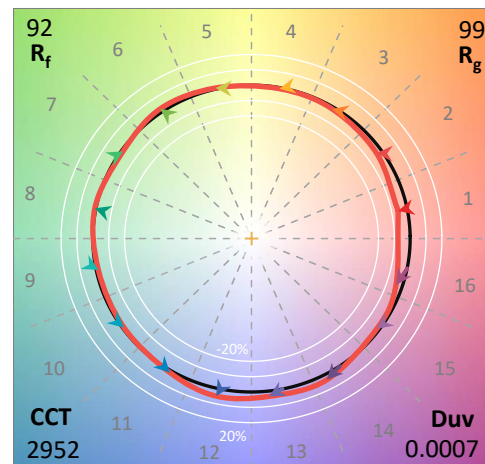

Test Conditions


Stabilization Time: 33M
 Operation Time: 1H 33M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-457-1


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-1

CIE 1931 Chromaticity Diagram

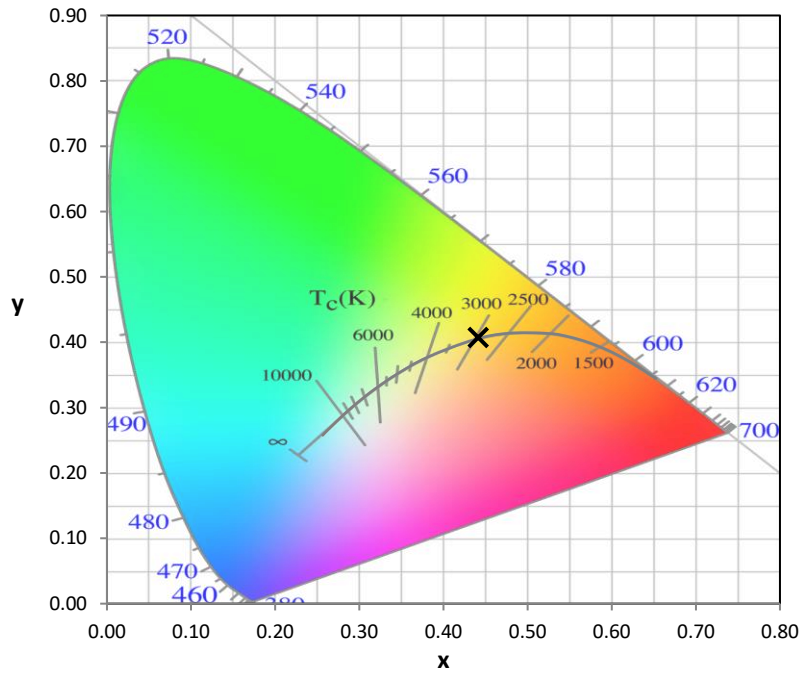


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

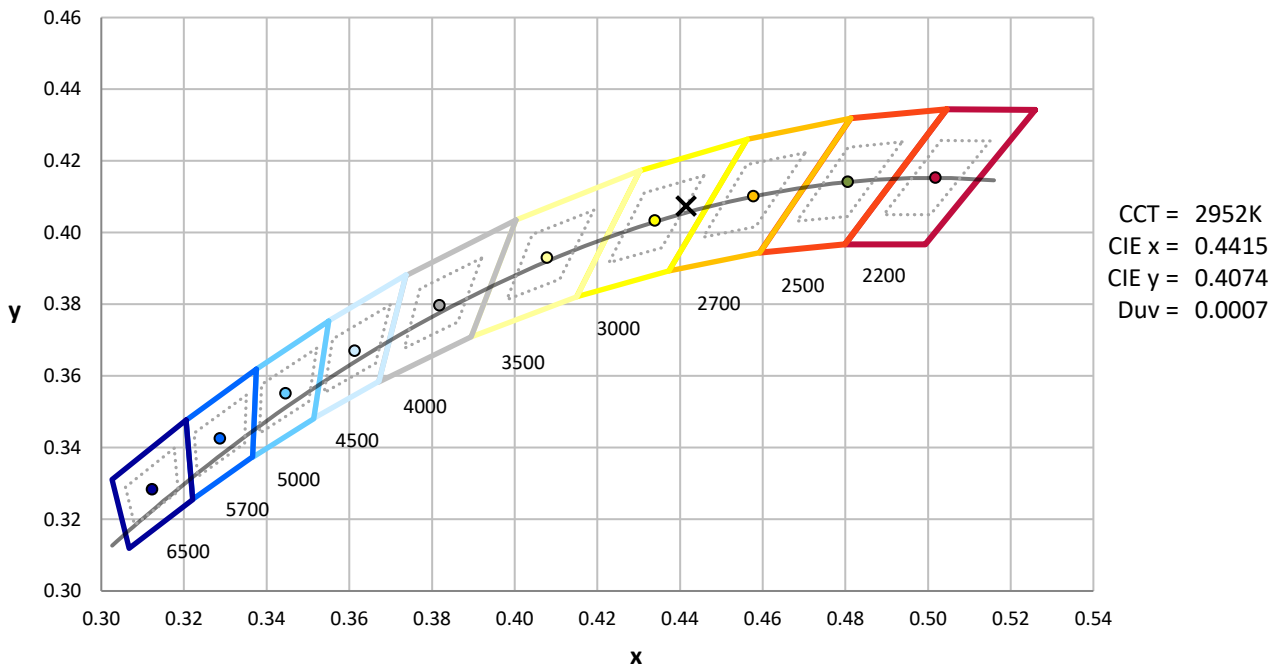

Point lies inside the ANSI 3000K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-1

Photopic Flux vs. Wavelength

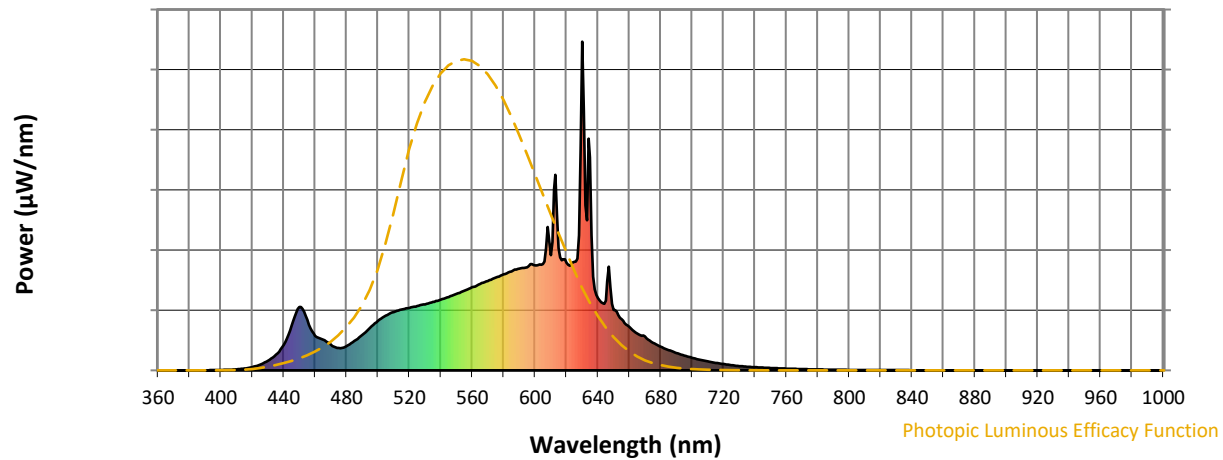


Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	108	NR	620	327	NR	750	7	NR	880	0	NR
365	0	NR	495	130	NR	625	330	NR	755	6	NR	885	0	NR
370	0	NR	500	150	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	166	NR	635	648	NR	765	5	NR	895	0	NR
380	0	NR	510	177	NR	640	220	NR	770	4	NR	900	0	NR
385	0	NR	515	185	NR	645	212	NR	775	3	NR	905	0	NR
390	0	NR	520	190	NR	650	184	NR	780	3	NR	910	0	NR
395	1	NR	525	196	NR	655	156	NR	785	2	NR	915	0	NR
400	1	NR	530	201	NR	660	133	NR	790	2	NR	920	0	NR
405	2	NR	535	208	NR	665	112	NR	795	2	NR	925	0	NR
410	3	NR	540	216	NR	670	103	NR	800	1	NR	930	0	NR
415	5	NR	545	223	NR	675	84	NR	805	1	NR	935	0	NR
420	10	NR	550	233	NR	680	72	NR	810	1	NR	940	0	NR
425	17	NR	555	243	NR	685	62	NR	815	1	NR	945	0	NR
430	29	NR	560	253	NR	690	53	NR	820	1	NR	950	0	NR
435	47	NR	565	262	NR	695	45	NR	825	1	NR	955	0	NR
440	77	NR	570	272	NR	700	38	NR	830	1	NR	960	0	NR
445	136	NR	575	282	NR	705	32	NR	835	1	NR	965	0	NR
450	193	NR	580	292	NR	710	27	NR	840	0	NR	970	0	NR
455	153	NR	585	301	NR	715	23	NR	845	0	NR	975	0	NR
460	105	NR	590	310	NR	720	19	NR	850	0	NR	980	0	NR
465	94	NR	595	314	NR	725	16	NR	855	0	NR	985	0	NR
470	78	NR	600	320	NR	730	13	NR	860	0	NR	990	0	NR
475	68	NR	605	323	NR	735	11	NR	865	0	NR	995	0	NR
480	74	NR	610	351	NR	740	10	NR	870	0	NR	1000	0	NR
485	89	NR	615	372	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-1

Scotopic Flux vs. Wavelength

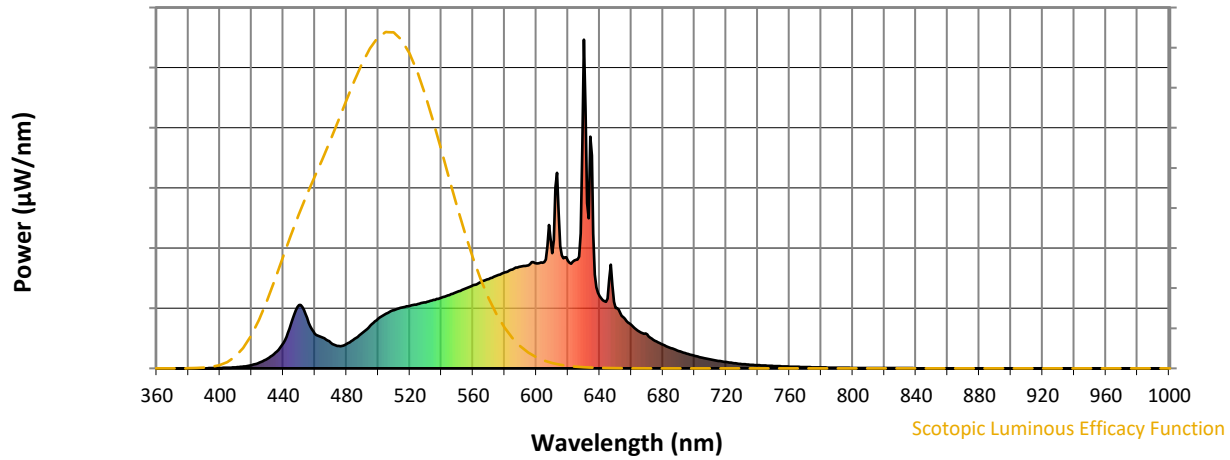


Scotopic Lumens: NR

S/P: 1.4

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	108	NR	620	327	NR	750	7	NR	880	0	NR
365	0	NR	495	130	NR	625	330	NR	755	6	NR	885	0	NR
370	0	NR	500	150	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	166	NR	635	648	NR	765	5	NR	895	0	NR
380	0	NR	510	177	NR	640	220	NR	770	4	NR	900	0	NR
385	0	NR	515	185	NR	645	212	NR	775	3	NR	905	0	NR
390	0	NR	520	190	NR	650	184	NR	780	3	NR	910	0	NR
395	1	NR	525	196	NR	655	156	NR	785	2	NR	915	0	NR
400	1	NR	530	201	NR	660	133	NR	790	2	NR	920	0	NR
405	2	NR	535	208	NR	665	112	NR	795	2	NR	925	0	NR
410	3	NR	540	216	NR	670	103	NR	800	1	NR	930	0	NR
415	5	NR	545	223	NR	675	84	NR	805	1	NR	935	0	NR
420	10	NR	550	233	NR	680	72	NR	810	1	NR	940	0	NR
425	17	NR	555	243	NR	685	62	NR	815	1	NR	945	0	NR
430	29	NR	560	253	NR	690	53	NR	820	1	NR	950	0	NR
435	47	NR	565	262	NR	695	45	NR	825	1	NR	955	0	NR
440	77	NR	570	272	NR	700	38	NR	830	1	NR	960	0	NR
445	136	NR	575	282	NR	705	32	NR	835	1	NR	965	0	NR
450	193	NR	580	292	NR	710	27	NR	840	0	NR	970	0	NR
455	153	NR	585	301	NR	715	23	NR	845	0	NR	975	0	NR
460	105	NR	590	310	NR	720	19	NR	850	0	NR	980	0	NR
465	94	NR	595	314	NR	725	16	NR	855	0	NR	985	0	NR
470	78	NR	600	320	NR	730	13	NR	860	0	NR	990	0	NR
475	68	NR	605	323	NR	735	11	NR	865	0	NR	995	0	NR
480	74	NR	610	351	NR	740	10	NR	870	0	NR	1000	0	NR
485	89	NR	615	372	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-1

Melanopic Flux vs. Wavelength

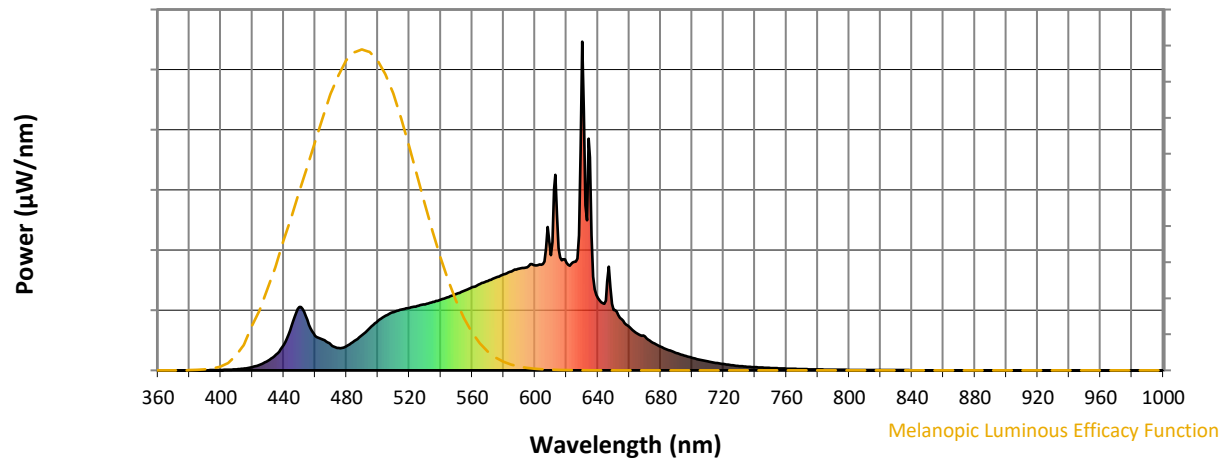

Melanopic Lumens: NR

M/P: 2.7


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	108	NR	620	327	NR	750	7	NR	880	0	NR
365	0	NR	495	130	NR	625	330	NR	755	6	NR	885	0	NR
370	0	NR	500	150	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	166	NR	635	648	NR	765	5	NR	895	0	NR
380	0	NR	510	177	NR	640	220	NR	770	4	NR	900	0	NR
385	0	NR	515	185	NR	645	212	NR	775	3	NR	905	0	NR
390	0	NR	520	190	NR	650	184	NR	780	3	NR	910	0	NR
395	1	NR	525	196	NR	655	156	NR	785	2	NR	915	0	NR
400	1	NR	530	201	NR	660	133	NR	790	2	NR	920	0	NR
405	2	NR	535	208	NR	665	112	NR	795	2	NR	925	0	NR
410	3	NR	540	216	NR	670	103	NR	800	1	NR	930	0	NR
415	5	NR	545	223	NR	675	84	NR	805	1	NR	935	0	NR
420	10	NR	550	233	NR	680	72	NR	810	1	NR	940	0	NR
425	17	NR	555	243	NR	685	62	NR	815	1	NR	945	0	NR
430	29	NR	560	253	NR	690	53	NR	820	1	NR	950	0	NR
435	47	NR	565	262	NR	695	45	NR	825	1	NR	955	0	NR
440	77	NR	570	272	NR	700	38	NR	830	1	NR	960	0	NR
445	136	NR	575	282	NR	705	32	NR	835	1	NR	965	0	NR
450	193	NR	580	292	NR	710	27	NR	840	0	NR	970	0	NR
455	153	NR	585	301	NR	715	23	NR	845	0	NR	975	0	NR
460	105	NR	590	310	NR	720	19	NR	850	0	NR	980	0	NR
465	94	NR	595	314	NR	725	16	NR	855	0	NR	985	0	NR
470	78	NR	600	320	NR	730	13	NR	860	0	NR	990	0	NR
475	68	NR	605	323	NR	735	11	NR	865	0	NR	995	0	NR
480	74	NR	610	351	NR	740	10	NR	870	0	NR	1000	0	NR
485	89	NR	615	372	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-1





TM-30-18

Summary

$R_f = 91.8$
 $R_g = 99.1$
 $CIE R_a = 93.2$
 $R_9 = 53.0$

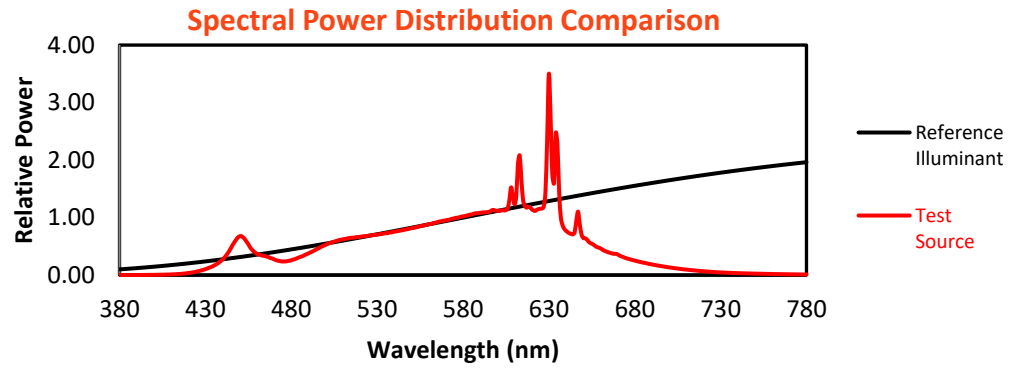


Color Vector Graphics

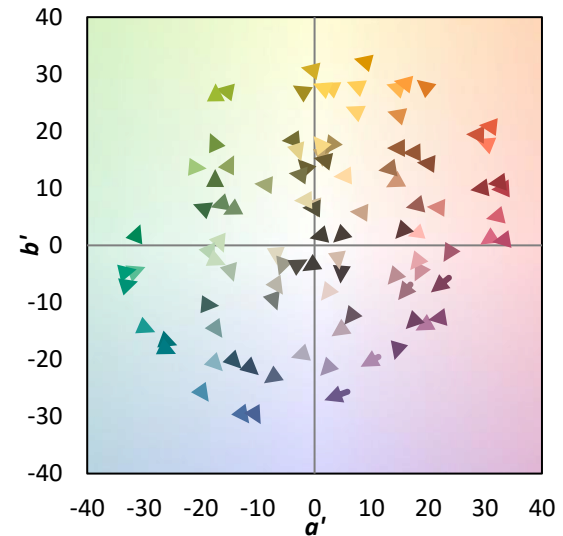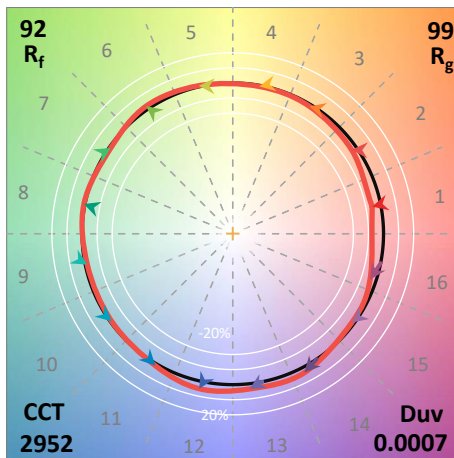
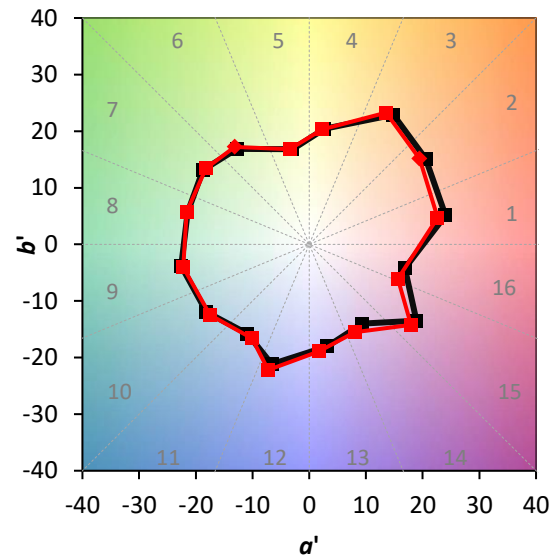
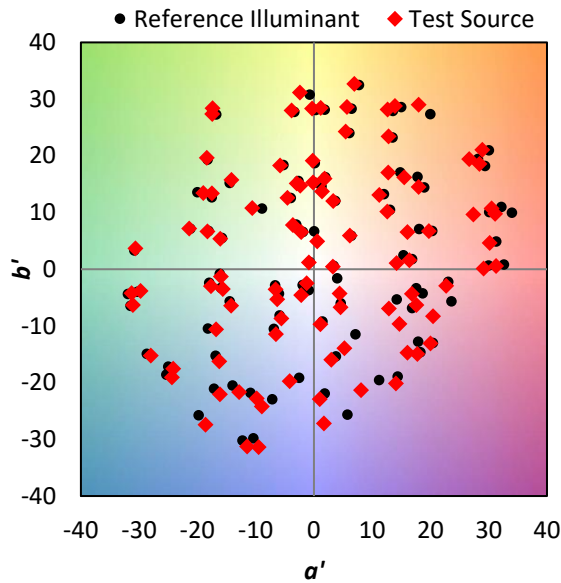


Individual Sample Fidelity Index ($R_{f,i}$)



CES01 = 86	CES26 = 94	CES51 = 97	CES76 = 91
CES02 = 63	CES27 = 94	CES52 = 98	CES77 = 85
CES03 = 32	CES28 = 98	CES53 = 97	CES78 = 88
CES04 = 70	CES29 = 95	CES54 = 96	CES79 = 88
CES05 = 50	CES30 = 98	CES55 = 96	CES80 = 91
CES06 = 51	CES31 = 95	CES56 = 96	CES81 = 70
CES07 = 43	CES32 = 88	CES57 = 96	CES82 = 96
CES08 = 42	CES33 = 96	CES58 = 97	CES83 = 93
CES09 = 29	CES34 = 96	CES59 = 98	CES84 = 95
CES10 = 76	CES35 = 98	CES60 = 95	CES85 = 79
CES11 = 59	CES36 = 88	CES61 = 95	CES86 = 75
CES12 = 65	CES37 = 96	CES62 = 93	CES87 = 92
CES13 = 44	CES38 = 94	CES63 = 95	CES88 = 96
CES14 = 74	CES39 = 98	CES64 = 95	CES89 = 82
CES15 = 72	CES40 = 96	CES65 = 90	CES90 = 97
CES16 = 48	CES41 = 96	CES66 = 94	CES91 = 82
CES17 = 50	CES42 = 95	CES67 = 93	CES92 = 76
CES18 = 57	CES43 = 95	CES68 = 92	CES93 = 86
CES19 = 72	CES44 = 99	CES69 = 93	CES94 = 71
CES20 = 67	CES45 = 97	CES70 = 91	CES95 = 84
CES21 = 86	CES46 = 96	CES71 = 89	CES96 = 91
CES22 = 79	CES47 = 88	CES72 = 96	CES97 = 95
CES23 = 92	CES48 = 93	CES73 = 86	CES98 = 93
CES24 = 91	CES49 = 95	CES74 = 89	CES99 = 90
CES25 = 72	CES50 = 98	CES75 = 90	

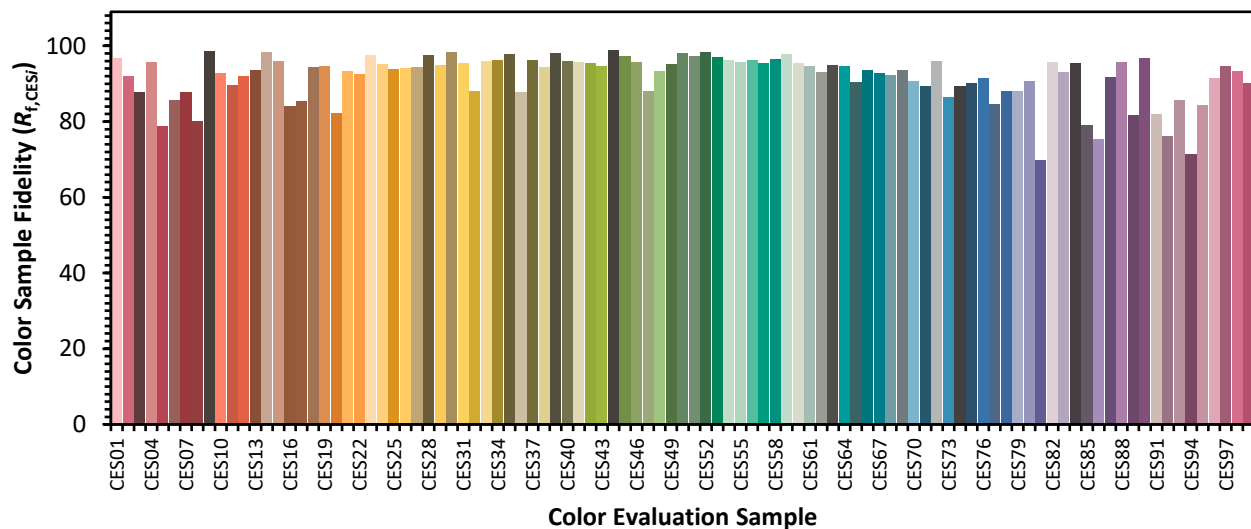

Color Rendition by Hue-Angle Bin

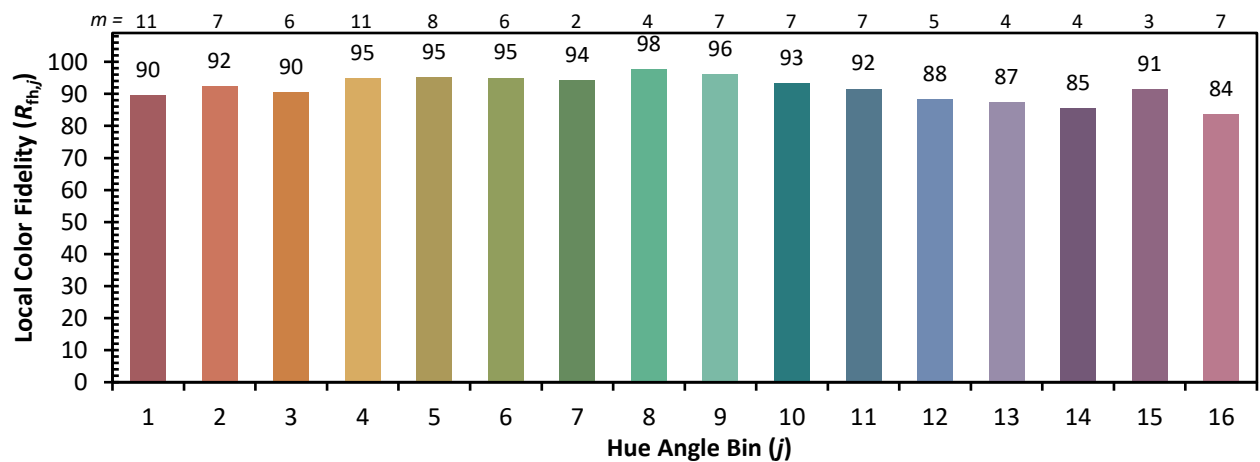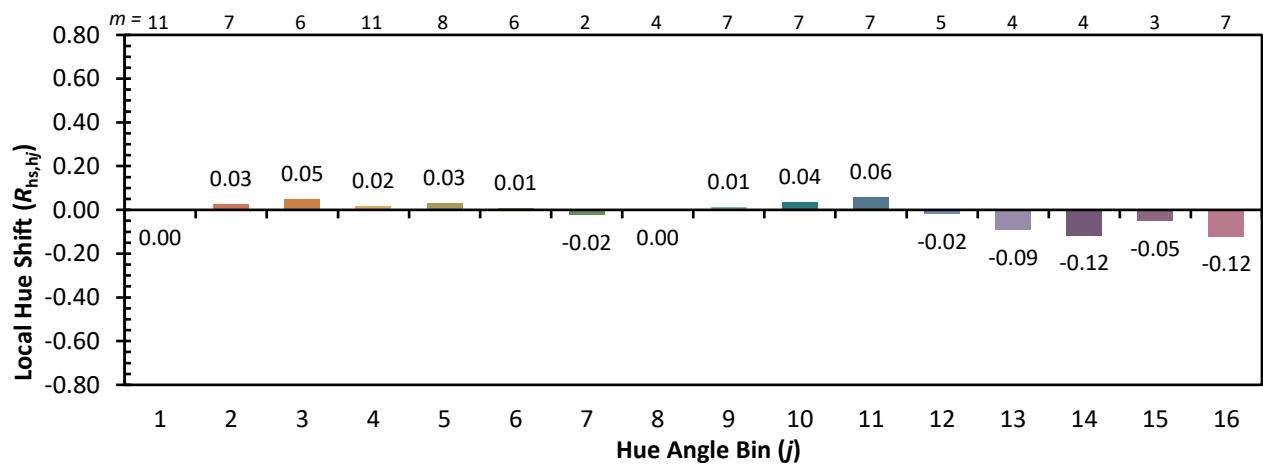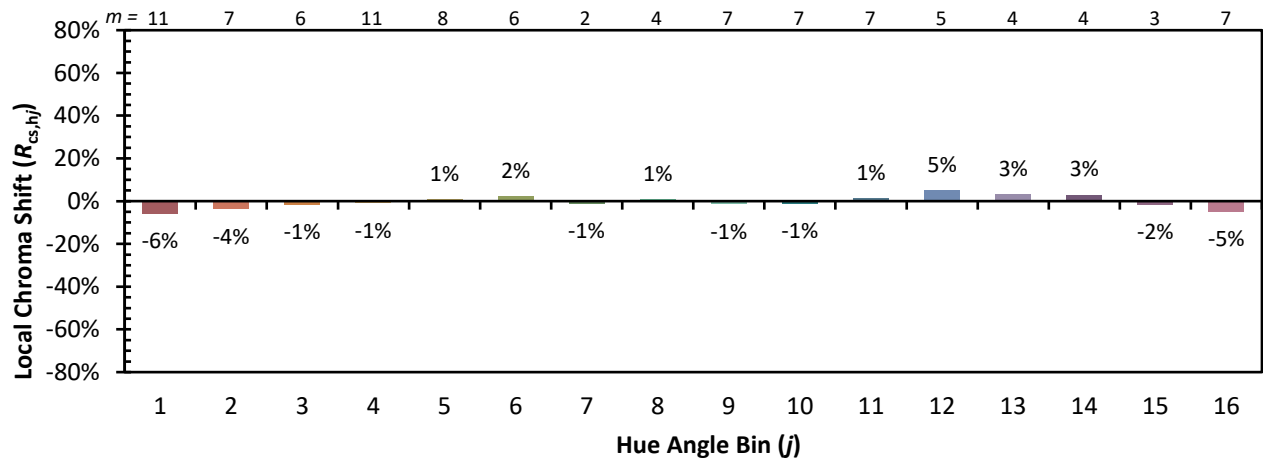

Measure Comparisons

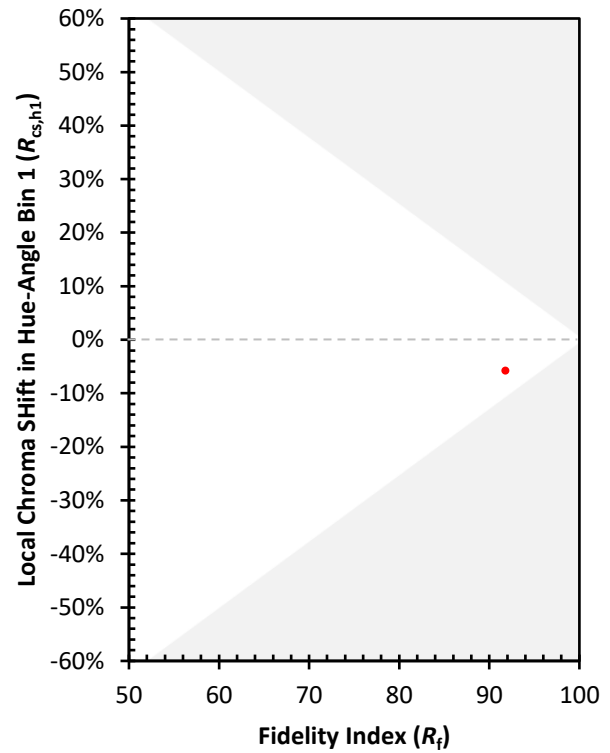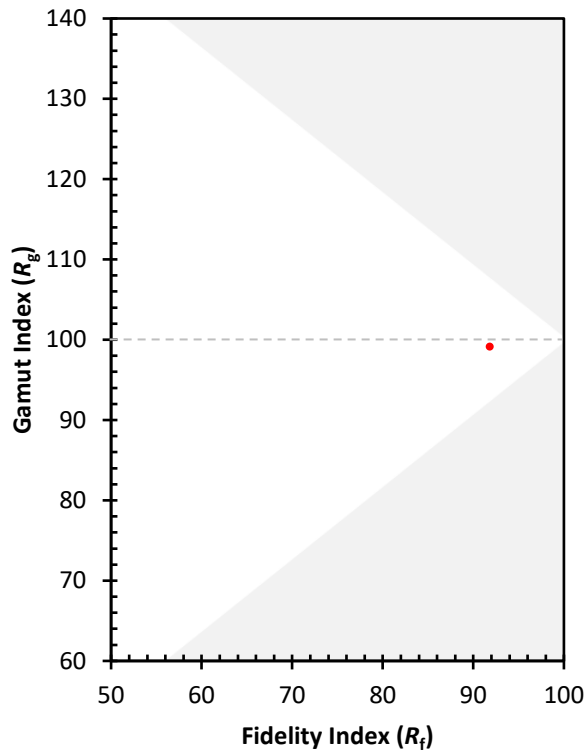

(END OF REPORT)