

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975516

Luminaire Tested: 24ENA-LD2-67-UNV-L940-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975516
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24ENA-LD2-67-UNV-L940-CD1
Description: METALUX ENCOUNTER 2x4 6700LM PACKAGE 90CRI 4000K AIR VENTED TROFFER
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6627.7 lumens
Efficiency: N/A
Efficacy: 118.1 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.4
Luminous Opening: Rectangular (W 1.83' x L: 3.83' x H: 0')
CIE Type: Direct

Input Watts (W): 56.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P975516

CATALOG NUMBER: 24ENA-LD2-67-UNV-L940-CD1

Luminous Intensity Polar Plot

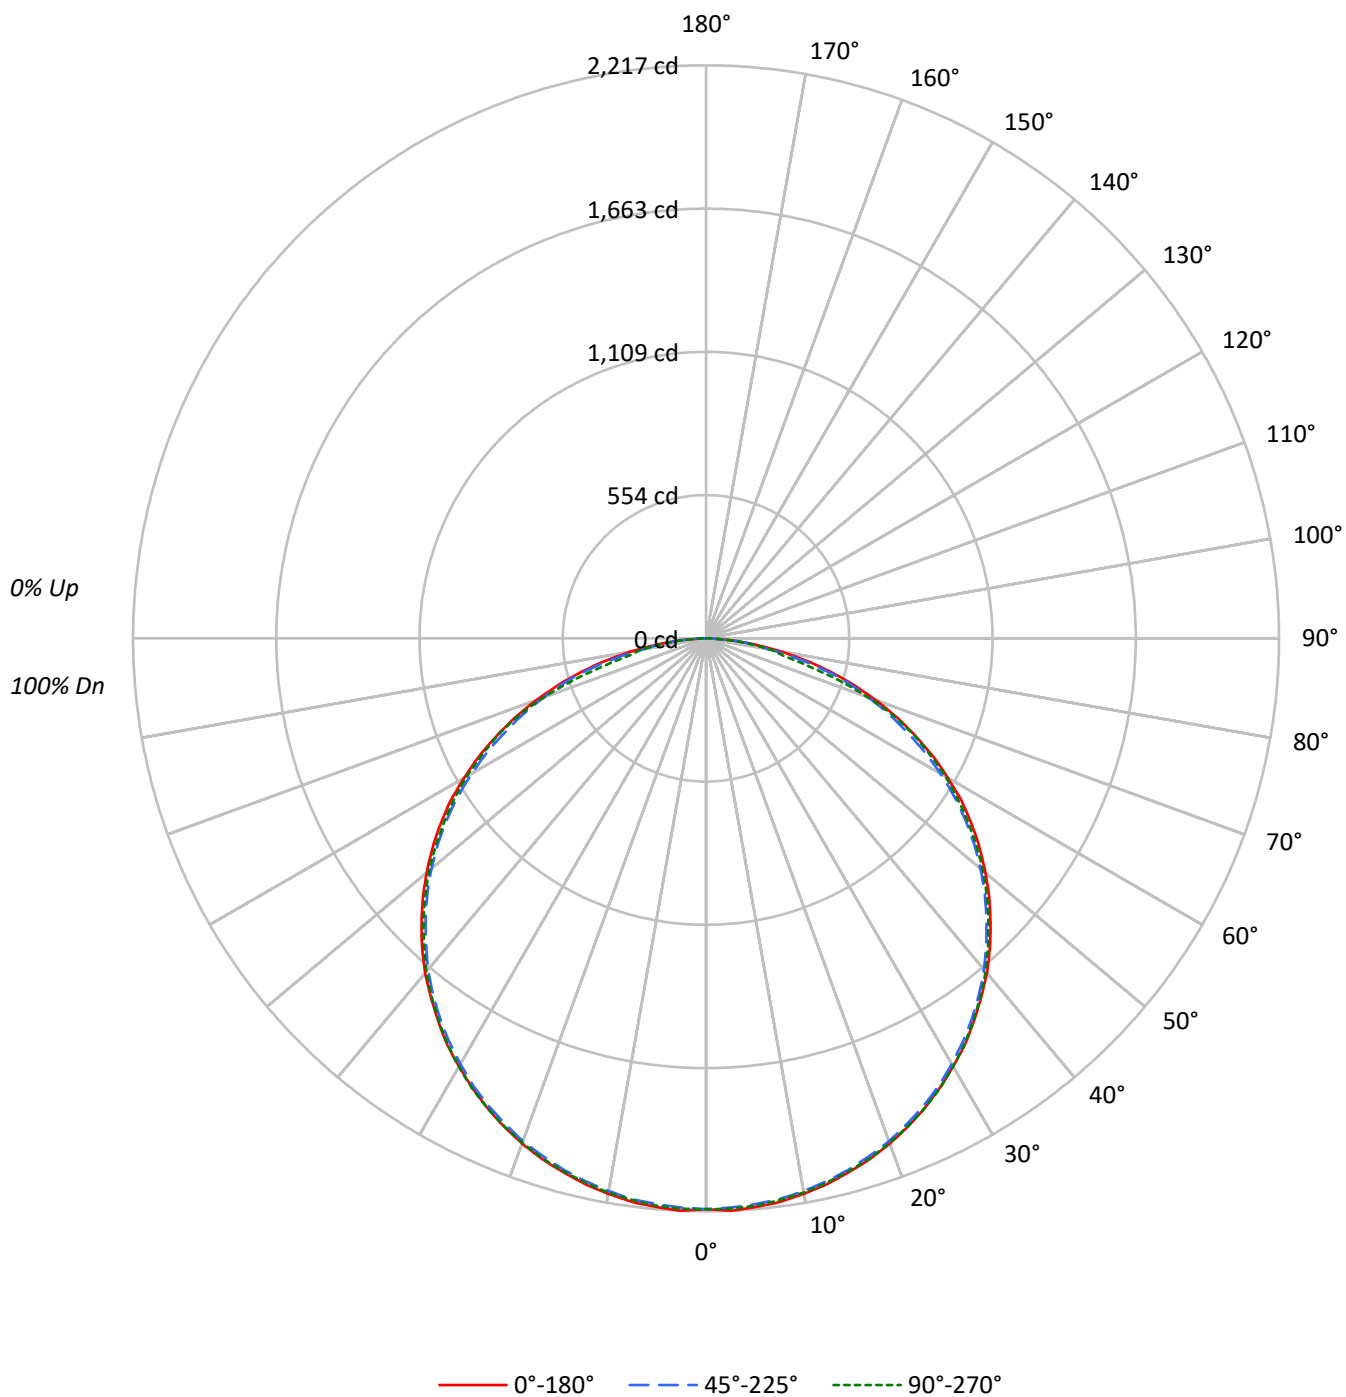

TEST NUMBER: P975516

CATALOG NUMBER: 24ENA-LD2-67-UNV-L940-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	109	104	99	95	106	101	97	94	97	94	91	93	90	88	90	87	85	83		
2	98	90	83	77	96	88	82	76	84	79	74	81	77	73	78	74	71	69		
3	90	79	70	64	87	77	69	63	74	67	62	71	66	61	69	64	60	58		
4	82	70	61	54	79	68	60	53	66	58	53	63	57	52	61	56	51	49		
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42		
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	50	44	39	37		
7	64	50	42	35	62	50	41	35	48	40	35	47	40	35	45	39	34	32		
8	60	46	37	31	58	45	37	31	44	36	31	43	36	31	41	35	31	29		
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26		
10	52	39	31	26	51	38	31	25	37	30	25	36	30	25	35	29	25	23		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3383	3383	3383
5°	3396	3379	3387
10°	3394	3377	3386
15°	3390	3375	3384
20°	3390	3374	3386
25°	3387	3370	3387
30°	3382	3363	3382
35°	3379	3356	3374
40°	3381	3345	3364
45°	3372	3323	3347
50°	3362	3303	3333
55°	3351	3269	3302
60°	3309	3207	3275
65°	3242	3106	3222
70°	3125	2996	2989
75°	2941	2811	2376
80°	2590	2199	2261
85°	2042	1924	1778

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3372 cd/sqm

TEST NUMBER: P975516

CATALOG NUMBER: 24ENA-LD2-67-UNV-L940-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.2	3.2
10°-20°	601.7	9.1
20°-30°	920.7	13.9
30°-40°	1125.4	17.0
40°-50°	1189.2	17.9
50°-60°	1101.8	16.6
60°-70°	863.2	13.0
70°-80°	488.0	7.4
80°-90°	128.5	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1731.6	26.1
0°-40°	2856.9	43.1
0°-60°	5148.0	77.7
0°-90°	6627.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6627.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2209	2209	2209	2209	2209	
5°	2209	2202	2198	2196	2203	210
15°	2138	2130	2128	2127	2134	604
25°	2004	1995	1994	1994	2004	924
35°	1807	1799	1795	1795	1804	1131
45°	1557	1545	1534	1534	1545	1201
55°	1255	1241	1224	1227	1237	1120
65°	895	878	857	868	889	885
75°	497	483	475	424	402	523
85°	116	110	110	104	101	137
90°	0	0	0	0	0	

TEST NUMBER: P975516

CATALOG NUMBER: 24ENA-LD2-67-UNV-L940-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2208.7	2208.7	2208.7	2208.7	2208.7
2.5°	2217.0	2207.4	2204.5	2201.9	2208.7
5°	2208.7	2201.9	2197.6	2196.2	2203.2
7.5°	2199.1	2190.8	2188.0	2185.1	2192.1
10°	2182.5	2174.2	2171.4	2169.9	2176.8
12.5°	2163.1	2153.3	2152.0	2150.7	2157.4
15°	2138.0	2129.7	2128.4	2127.1	2133.9
17.5°	2111.8	2103.6	2100.7	2099.4	2109.0
20°	2080.0	2071.7	2070.2	2068.9	2077.2
22.5°	2044.0	2035.7	2032.9	2034.2	2042.5
25°	2003.9	1995.4	1994.1	1994.1	2003.9
27.5°	1959.4	1951.1	1951.1	1951.1	1962.2
30°	1912.5	1905.5	1901.4	1902.7	1912.5
32.5°	1863.9	1852.7	1850.1	1851.4	1861.2
35°	1807.2	1798.9	1794.7	1794.7	1804.3
37.5°	1748.9	1740.6	1735.2	1735.2	1744.8
40°	1690.9	1678.3	1672.8	1670.0	1682.6
42.5°	1625.7	1616.1	1603.7	1603.7	1614.6
45°	1556.6	1545.4	1534.3	1534.3	1545.4
47.5°	1485.9	1474.8	1462.3	1462.3	1473.5
50°	1411.1	1400.0	1386.2	1386.2	1398.7
52.5°	1335.0	1322.5	1307.3	1305.8	1318.4
55°	1254.7	1240.8	1224.2	1227.0	1236.6
57.5°	1172.9	1154.8	1138.3	1138.3	1153.5
60°	1080.2	1065.0	1046.9	1049.7	1069.1
62.5°	991.5	972.1	954.2	960.9	977.7
65°	894.6	878.1	857.1	868.2	889.0
67.5°	799.1	781.0	764.4	778.2	788.0
70°	697.9	681.3	668.9	668.9	667.4
72.5°	596.9	581.7	578.8	552.4	535.9
75°	497.0	483.3	475.0	423.8	401.5
77.5°	393.2	389.1	362.9	308.8	301.8
80°	293.6	296.4	249.3	250.6	256.3
82.5°	202.2	198.0	186.9	178.6	175.8
85°	116.2	109.5	109.5	103.8	101.2
87.5°	38.8	43.0	43.0	43.0	44.3
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-3

Test Date: 07/15/2025

Luminaire Tested: 14EN-LD2-51-UNV-L940-CD1-U

Data in this report applies to families of products including 14EN-LD2-51-UNV-L940-CD1-U


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-457-3
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/15/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **14EN-LD2-51-UNV-L940-CD1-U**
 Description: 1x4 ENCOUNTER 5100LM WITH LIGHTNING BOARDS

Spectral Parameters

CCT (K): 3853
 CIE u' : 0.2278
 CIE v' : 0.5044
 Duv: 0.0001
 CIE x: 0.3872
 CIE y: 0.3810
 CIE z: 0.2318
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 579
 Purity: 30.54407
 R_f: 91.2
 R_g: 99.8

CRI (Ra): 93.4
 R1: 94.4
 R2: 95.6
 R3: 95.4
 R4: 94.7
 R5: 93.7
 R6: 93.8
 R7: 93.9
 R8: 85.8
 R9: 62.8
 R10: 88.3
 R11: 95.1
 R12: 75.5
 R13: 94.6
 R14: 96.8
 R15: 91.2

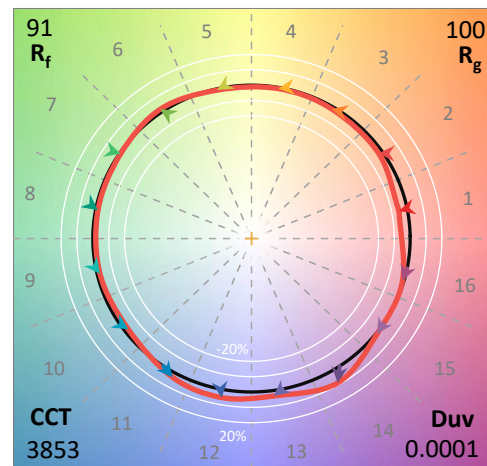

Test Conditions


Stabilization Time: 35M
 Operation Time: 1H 35M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-457-3


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-3

CIE 1931 Chromaticity Diagram

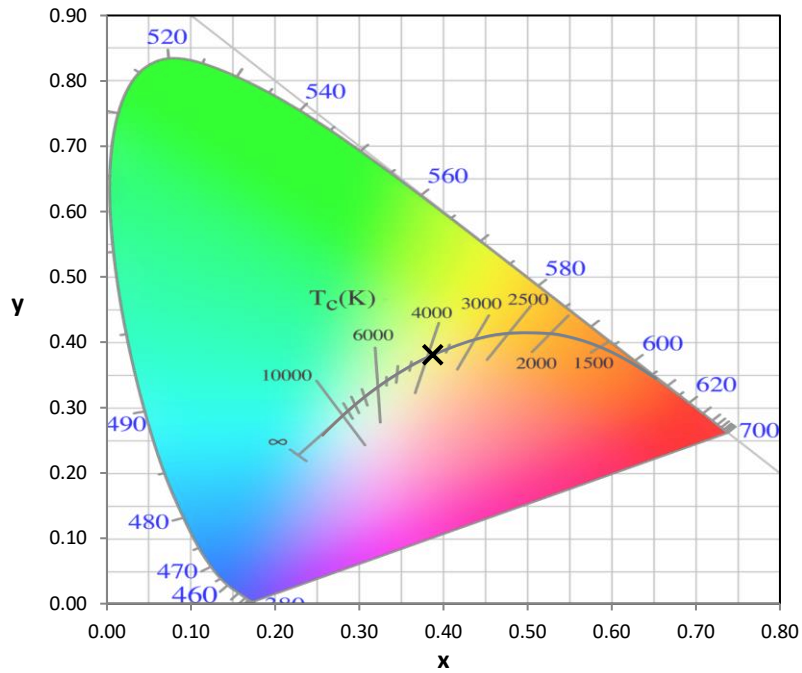


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

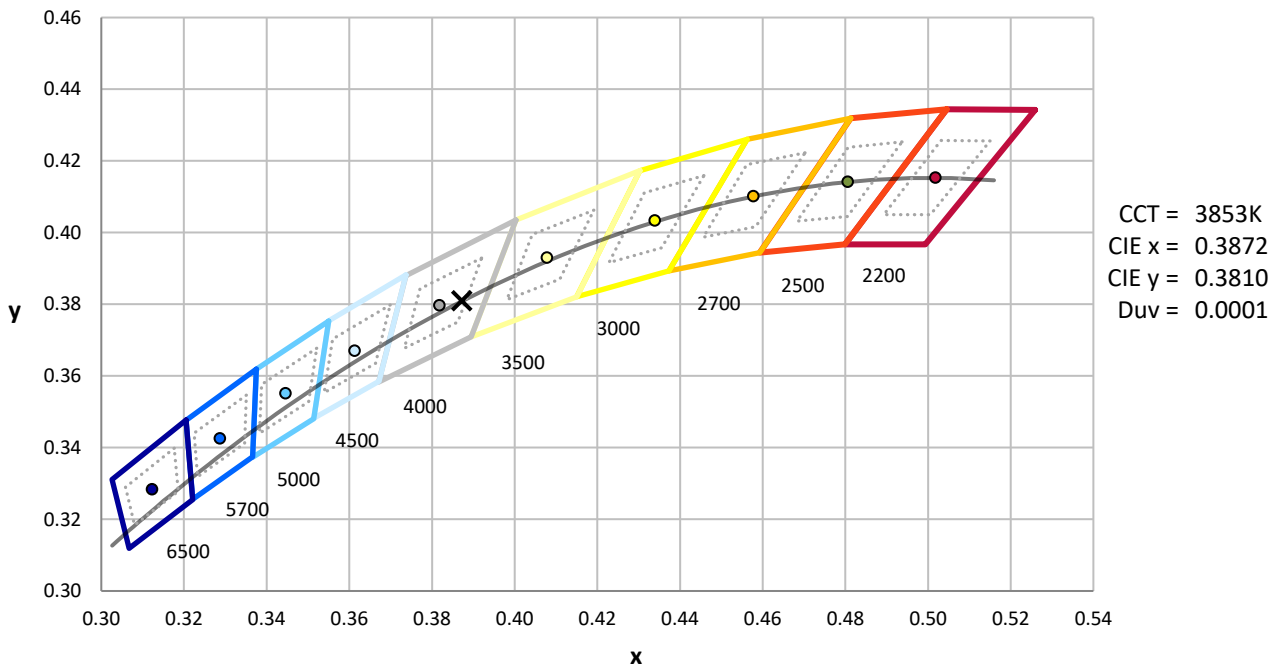

Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-3

Photopic Flux vs. Wavelength

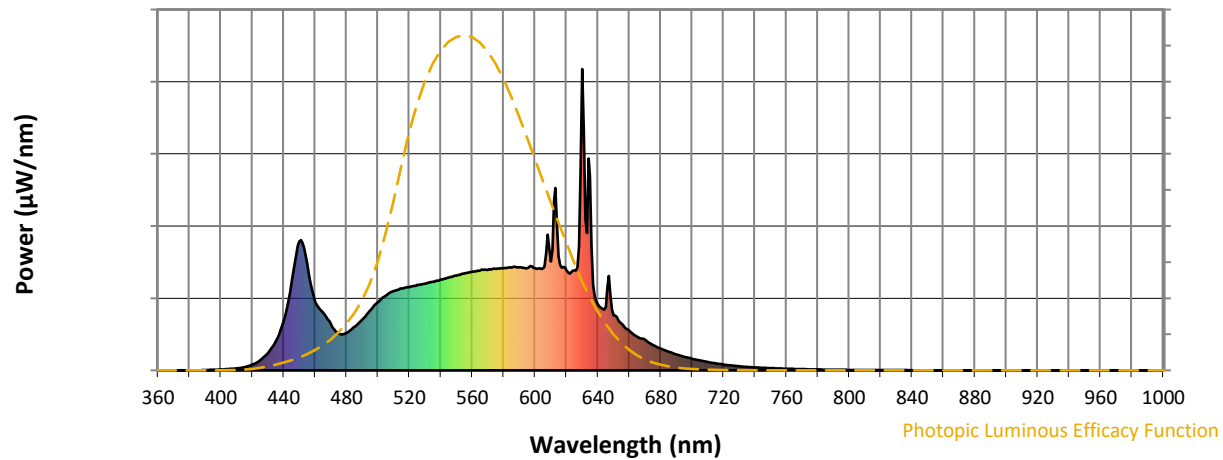


Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	168	NR	620	331	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	331	NR	755	6	NR	885	0	NR
370	0	NR	500	227	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	248	NR	635	646	NR	765	5	NR	895	0	NR
380	0	NR	510	263	NR	640	219	NR	770	4	NR	900	0	NR
385	0	NR	515	272	NR	645	210	NR	775	3	NR	905	0	NR
390	1	NR	520	277	NR	650	183	NR	780	3	NR	910	0	NR
395	2	NR	525	283	NR	655	155	NR	785	3	NR	915	0	NR
400	3	NR	530	288	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	294	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	301	NR	670	102	NR	800	2	NR	930	0	NR
415	11	NR	545	308	NR	675	84	NR	805	1	NR	935	0	NR
420	19	NR	550	315	NR	680	72	NR	810	1	NR	940	0	NR
425	34	NR	555	322	NR	685	61	NR	815	1	NR	945	0	NR
430	57	NR	560	327	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	331	NR	695	45	NR	825	1	NR	955	0	NR
440	163	NR	570	334	NR	700	39	NR	830	1	NR	960	0	NR
445	293	NR	575	337	NR	705	33	NR	835	1	NR	965	0	NR
450	428	NR	580	339	NR	710	28	NR	840	1	NR	970	0	NR
455	351	NR	585	341	NR	715	23	NR	845	0	NR	975	0	NR
460	229	NR	590	342	NR	720	19	NR	850	0	NR	980	0	NR
465	192	NR	595	339	NR	725	16	NR	855	0	NR	985	0	NR
470	152	NR	600	338	NR	730	13	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	125	NR	610	361	NR	740	10	NR	870	0	NR	1000	0	NR
485	144	NR	615	378	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-3

Scotopic Flux vs. Wavelength

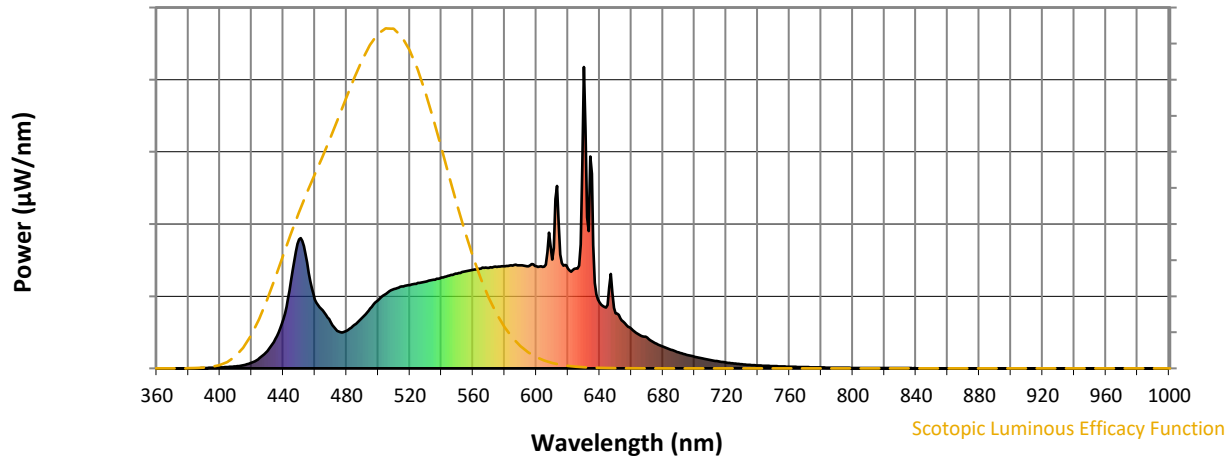


Scotopic Lumens: NR

S/P: 1.74

λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)
360	0	NR	490	168	NR	620	331	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	331	NR	755	6	NR	885	0	NR
370	0	NR	500	227	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	248	NR	635	646	NR	765	5	NR	895	0	NR
380	0	NR	510	263	NR	640	219	NR	770	4	NR	900	0	NR
385	0	NR	515	272	NR	645	210	NR	775	3	NR	905	0	NR
390	1	NR	520	277	NR	650	183	NR	780	3	NR	910	0	NR
395	2	NR	525	283	NR	655	155	NR	785	3	NR	915	0	NR
400	3	NR	530	288	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	294	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	301	NR	670	102	NR	800	2	NR	930	0	NR
415	11	NR	545	308	NR	675	84	NR	805	1	NR	935	0	NR
420	19	NR	550	315	NR	680	72	NR	810	1	NR	940	0	NR
425	34	NR	555	322	NR	685	61	NR	815	1	NR	945	0	NR
430	57	NR	560	327	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	331	NR	695	45	NR	825	1	NR	955	0	NR
440	163	NR	570	334	NR	700	39	NR	830	1	NR	960	0	NR
445	293	NR	575	337	NR	705	33	NR	835	1	NR	965	0	NR
450	428	NR	580	339	NR	710	28	NR	840	1	NR	970	0	NR
455	351	NR	585	341	NR	715	23	NR	845	0	NR	975	0	NR
460	229	NR	590	342	NR	720	19	NR	850	0	NR	980	0	NR
465	192	NR	595	339	NR	725	16	NR	855	0	NR	985	0	NR
470	152	NR	600	338	NR	730	13	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	125	NR	610	361	NR	740	10	NR	870	0	NR	1000	0	NR
485	144	NR	615	378	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-3

Melanopic Flux vs. Wavelength

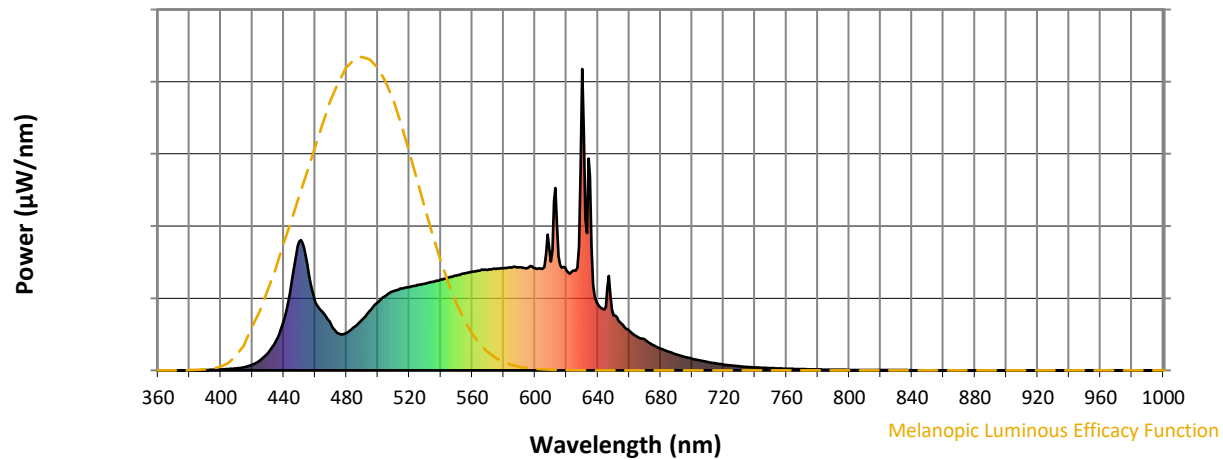
Melanopic Lumens: NR
M/P: 3.58

λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	168	NR	620	331	NR	750	8	NR	880	0	NR
365	0	NR	495	199	NR	625	331	NR	755	6	NR	885	0	NR
370	0	NR	500	227	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	248	NR	635	646	NR	765	5	NR	895	0	NR
380	0	NR	510	263	NR	640	219	NR	770	4	NR	900	0	NR
385	0	NR	515	272	NR	645	210	NR	775	3	NR	905	0	NR
390	1	NR	520	277	NR	650	183	NR	780	3	NR	910	0	NR
395	2	NR	525	283	NR	655	155	NR	785	3	NR	915	0	NR
400	3	NR	530	288	NR	660	132	NR	790	2	NR	920	0	NR
405	5	NR	535	294	NR	665	111	NR	795	2	NR	925	0	NR
410	7	NR	540	301	NR	670	102	NR	800	2	NR	930	0	NR
415	11	NR	545	308	NR	675	84	NR	805	1	NR	935	0	NR
420	19	NR	550	315	NR	680	72	NR	810	1	NR	940	0	NR
425	34	NR	555	322	NR	685	61	NR	815	1	NR	945	0	NR
430	57	NR	560	327	NR	690	53	NR	820	1	NR	950	0	NR
435	97	NR	565	331	NR	695	45	NR	825	1	NR	955	0	NR
440	163	NR	570	334	NR	700	39	NR	830	1	NR	960	0	NR
445	293	NR	575	337	NR	705	33	NR	835	1	NR	965	0	NR
450	428	NR	580	339	NR	710	28	NR	840	1	NR	970	0	NR
455	351	NR	585	341	NR	715	23	NR	845	0	NR	975	0	NR
460	229	NR	590	342	NR	720	19	NR	850	0	NR	980	0	NR
465	192	NR	595	339	NR	725	16	NR	855	0	NR	985	0	NR
470	152	NR	600	338	NR	730	13	NR	860	0	NR	990	0	NR
475	122	NR	605	337	NR	735	11	NR	865	0	NR	995	0	NR
480	125	NR	610	361	NR	740	10	NR	870	0	NR	1000	0	NR
485	144	NR	615	378	NR	745	9	NR	875	0	NR			


REPORT NUMBER: SP1-2506-457-3

TM-30-18





Summary

$R_f = 91.2$
 $R_g = 99.8$
 $CIE R_a = 93.4$
 $R_9 = 62.8$

Spectral Power Distribution Comparison

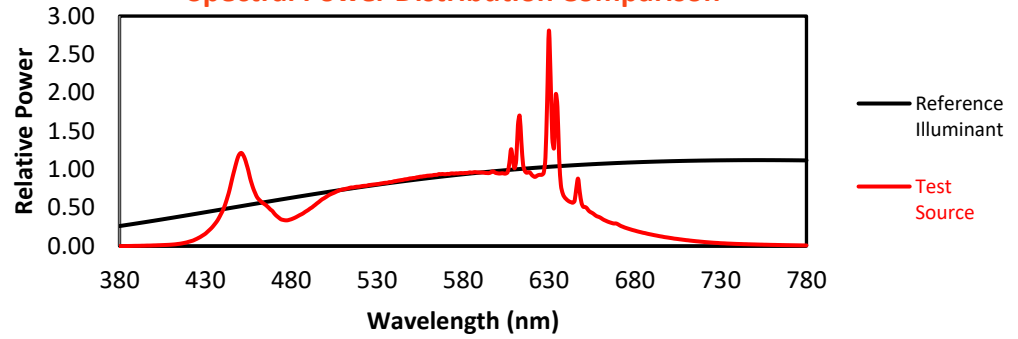


Color Vector Graphics

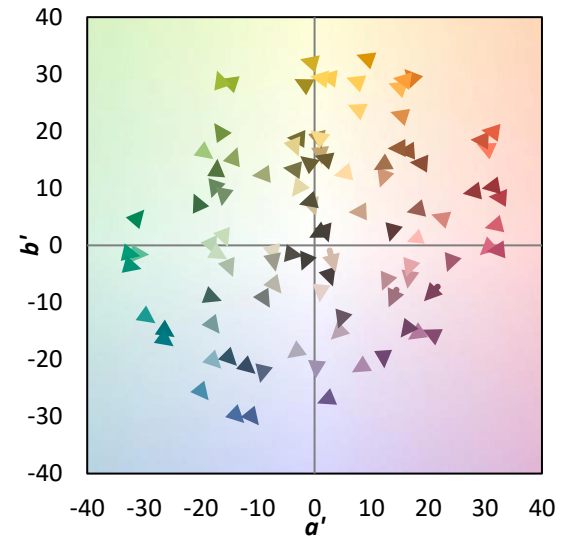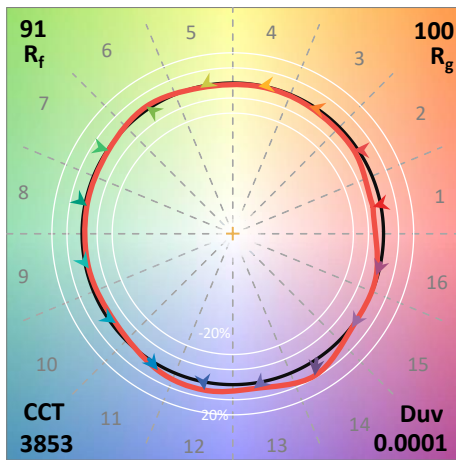
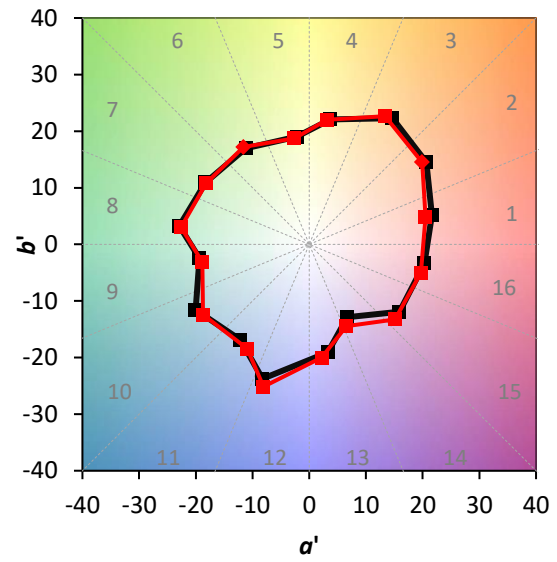
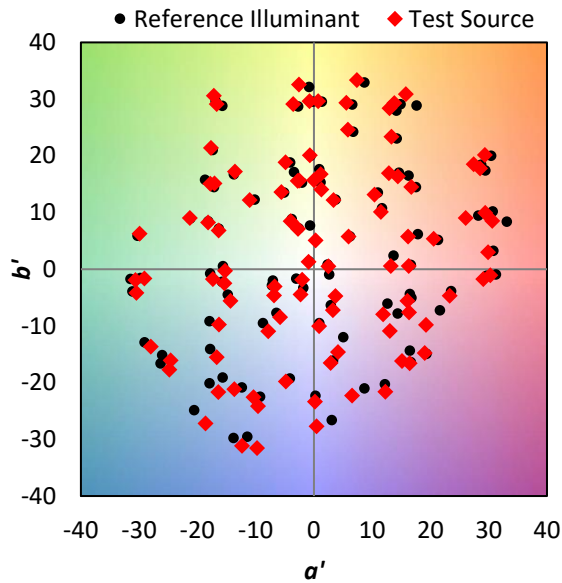


Individual Sample Fidelity Index ($R_{f,i}$)



CES01 = 86	CES26 = 93	CES51 = 98	CES76 = 86
CES02 = 62	CES27 = 92	CES52 = 99	CES77 = 88
CES03 = 31	CES28 = 96	CES53 = 97	CES78 = 82
CES04 = 69	CES29 = 95	CES54 = 94	CES79 = 93
CES05 = 49	CES30 = 94	CES55 = 93	CES80 = 92
CES06 = 50	CES31 = 96	CES56 = 95	CES81 = 79
CES07 = 42	CES32 = 88	CES57 = 94	CES82 = 96
CES08 = 41	CES33 = 98	CES58 = 95	CES83 = 95
CES09 = 29	CES34 = 93	CES59 = 97	CES84 = 94
CES10 = 74	CES35 = 96	CES60 = 93	CES85 = 81
CES11 = 57	CES36 = 82	CES61 = 92	CES86 = 83
CES12 = 63	CES37 = 94	CES62 = 88	CES87 = 91
CES13 = 43	CES38 = 89	CES63 = 93	CES88 = 97
CES14 = 74	CES39 = 99	CES64 = 91	CES89 = 85
CES15 = 71	CES40 = 97	CES65 = 89	CES90 = 97
CES16 = 47	CES41 = 97	CES66 = 88	CES91 = 73
CES17 = 49	CES42 = 93	CES67 = 87	CES92 = 77
CES18 = 56	CES43 = 93	CES68 = 88	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 89	CES94 = 75
CES20 = 66	CES45 = 96	CES70 = 86	CES95 = 82
CES21 = 85	CES46 = 96	CES71 = 81	CES96 = 92
CES22 = 78	CES47 = 93	CES72 = 94	CES97 = 94
CES23 = 91	CES48 = 93	CES73 = 80	CES98 = 94
CES24 = 90	CES49 = 95	CES74 = 92	CES99 = 93
CES25 = 71	CES50 = 99	CES75 = 82	

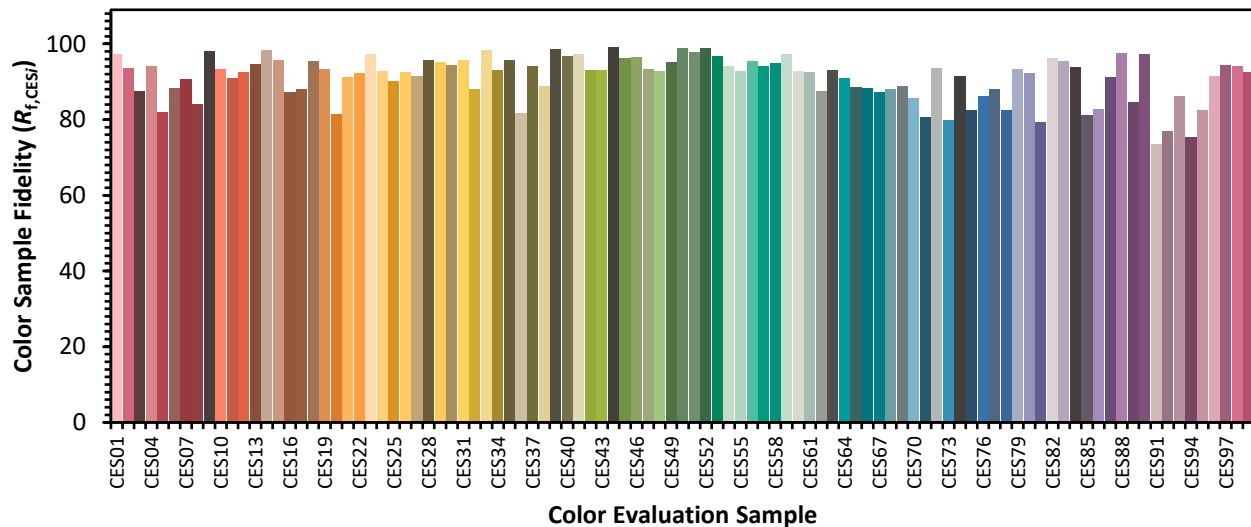

Color Rendition by Hue-Angle Bin

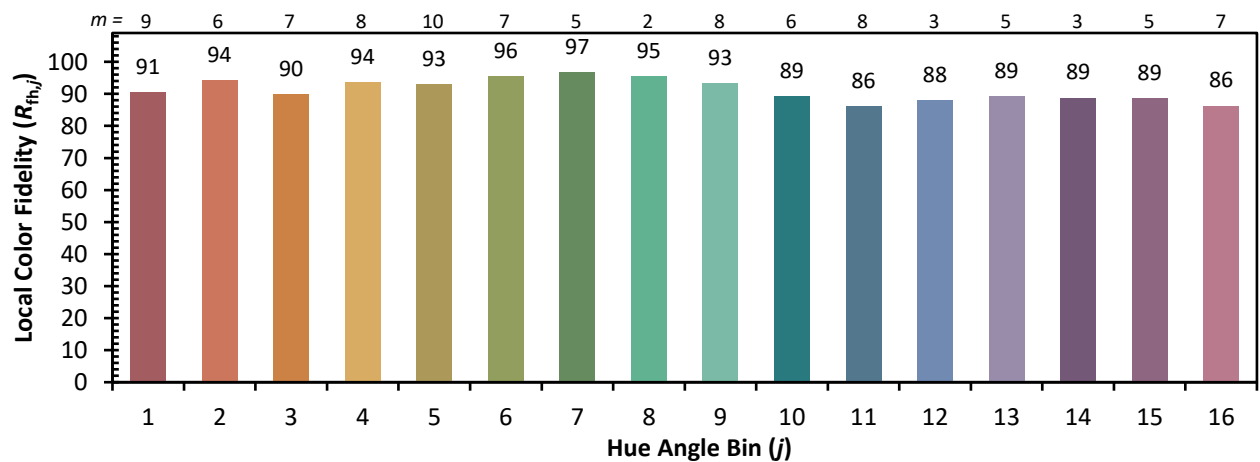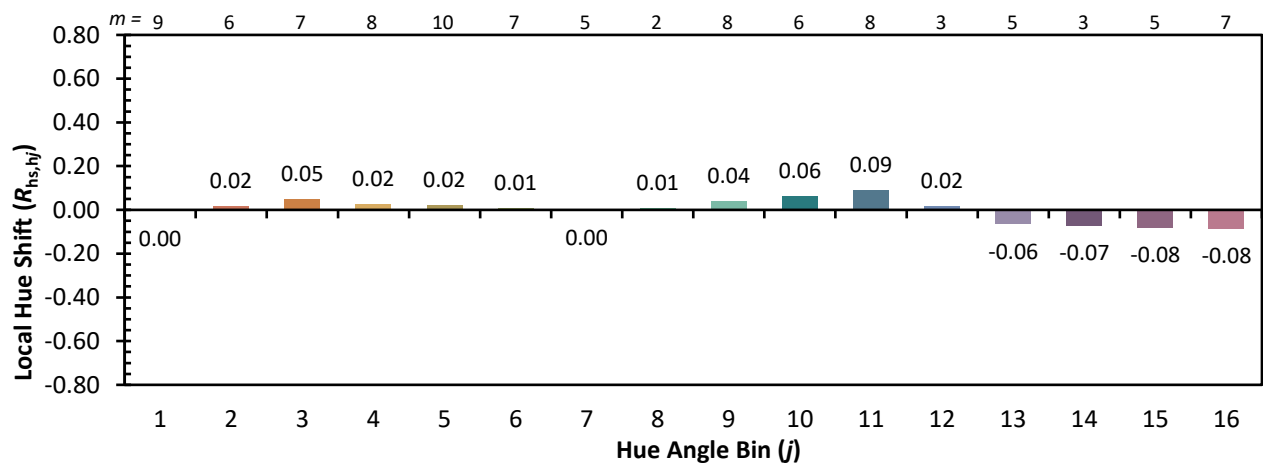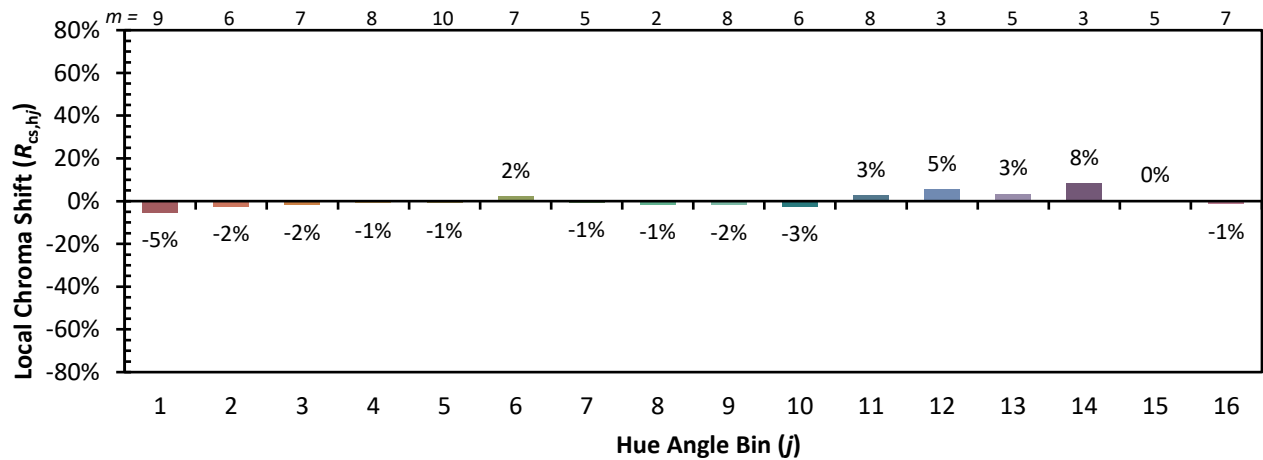

Measure Comparisons

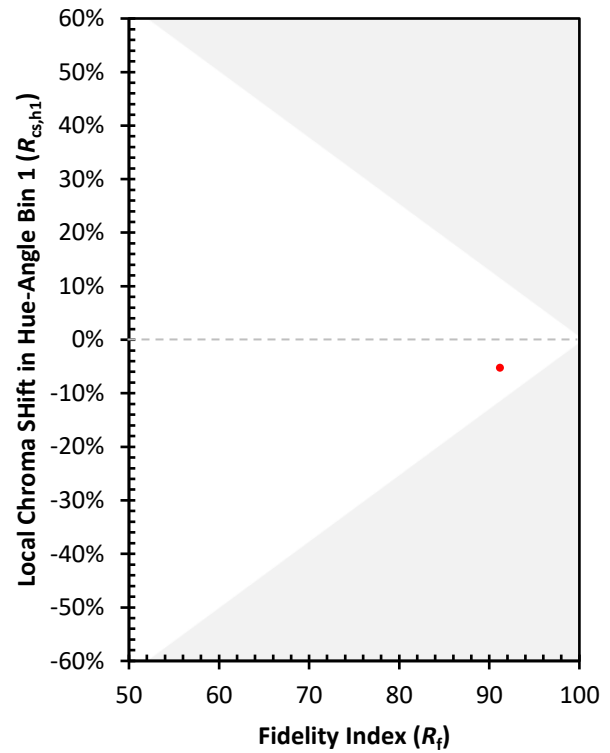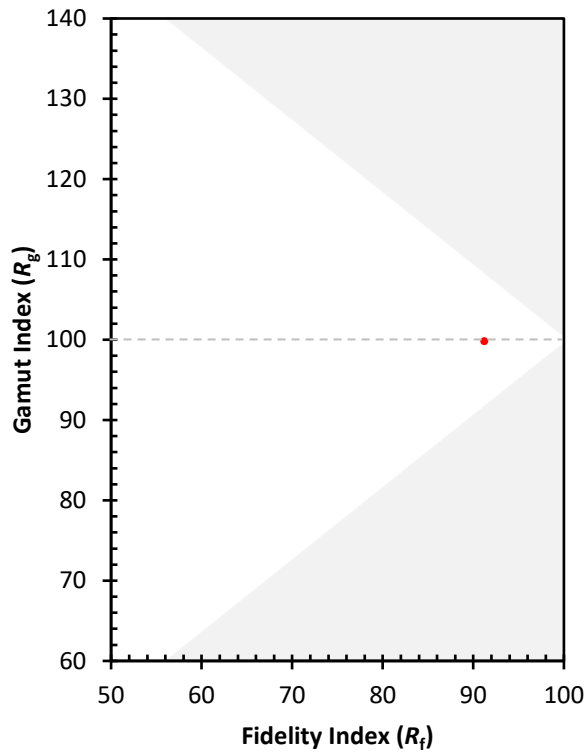

(END OF REPORT)