

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: METALUX

Report Number: P975527

Luminaire Tested: 24ENA-LD2-70-UNV-L950-CD1

Issue Date: 03/13/2025

Test Information

Test Method: LM-79-2019
Report Number: P975527
Test Lab: INNOVATION CENTER(P3)
Issue Date: 03/13/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: METALUX
Catalog Number: 24ENA-LD2-70-UNV-L950-CD1
Description: METALUX ENCOUNTER 2x4 7000LM PACKAGE 90CRI 5000K AIR VENTED TROFFER
Light Source: 5000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6846.8 lumens
Efficiency: N/A
Efficacy: 113.7 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.4
Luminous Opening: Rectangular (W 1.83' x L: 3.83' x H: 0')
CIE Type: Direct

Input Watts (W): 60.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 28.75 FT

TEST NUMBER: P975527

CATALOG NUMBER: 24ENA-LD2-70-UNV-L950-CD1

Luminous Intensity Polar Plot

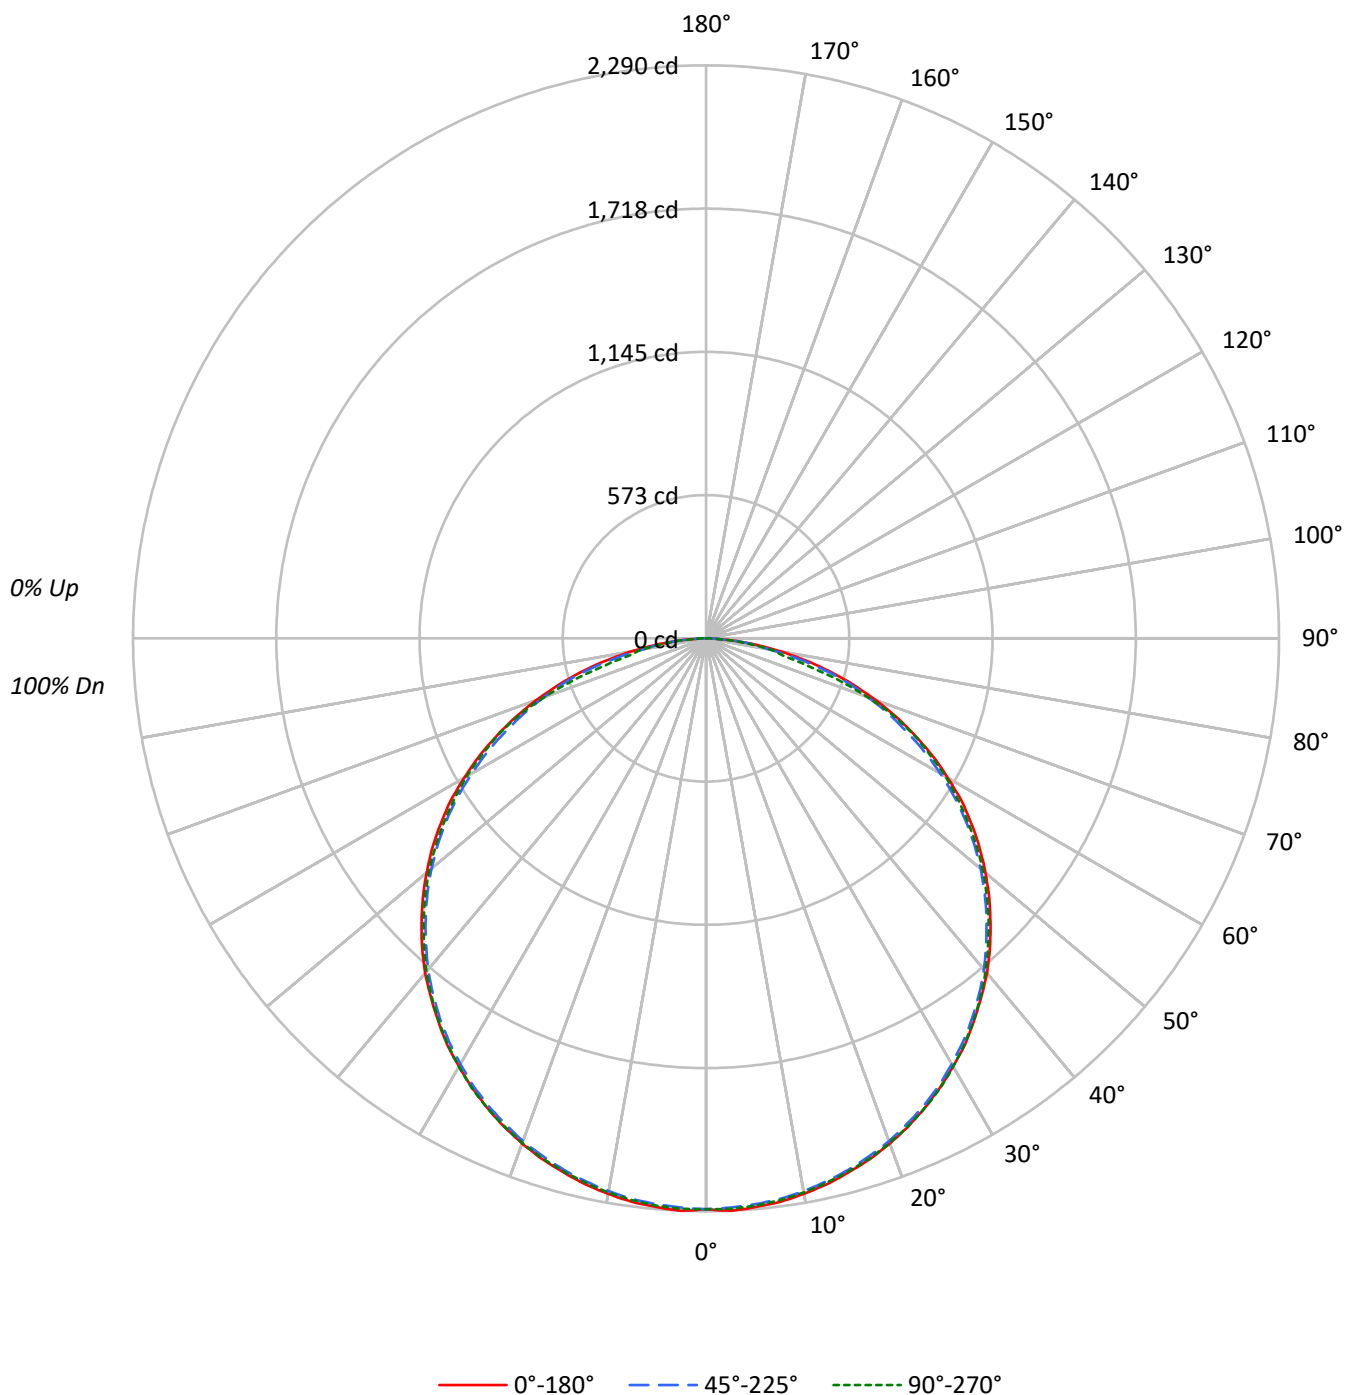

TEST NUMBER: P975527

CATALOG NUMBER: 24ENA-LD2-70-UNV-L950-CD1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	109	104	99	95	106	101	97	94	97	94	91		93	90	88		90
2	98	90	83	77	96	88	82	76	84	79	74		81	77	73		78
3	90	79	70	64	87	77	69	63	74	67	62		71	66	61		69
4	82	70	61	54	79	68	60	53	66	58	53		63	57	52		61
5	75	62	53	46	73	61	52	46	59	51	45		57	50	45		55
6	69	56	47	40	67	55	46	40	53	45	40		51	44	39		50
7	64	50	42	35	62	50	41	35	48	40	35		47	40	35		45
8	60	46	37	31	58	45	37	31	44	36	31		43	36	31		41
9	56	42	34	28	54	42	34	28	40	33	28		39	33	28		38
10	52	39	31	26	51	38	31	25	37	30	25		36	30	25		35

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3495	3495	3495
5°	3508	3490	3499
10°	3507	3489	3498
15°	3502	3486	3496
20°	3502	3486	3498
25°	3498	3481	3498
30°	3494	3474	3494
35°	3491	3467	3485
40°	3493	3455	3475
45°	3483	3433	3458
50°	3473	3412	3443
55°	3461	3377	3411
60°	3418	3313	3383
65°	3350	3209	3328
70°	3229	3094	3087
75°	3039	2904	2455
80°	2675	2271	2335
85°	2111	1988	1836

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3483 cd/sqm

TEST NUMBER: P975527

CATALOG NUMBER: 24ENA-LD2-70-UNV-L950-CD1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	216.1	3.2
10°-20°	621.6	9.1
20°-30°	951.1	13.9
30°-40°	1162.5	17.0
40°-50°	1228.5	17.9
50°-60°	1138.2	16.6
60°-70°	891.8	13.0
70°-80°	504.2	7.4
80°-90°	132.8	1.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1788.8	26.1
0°-40°	2951.3	43.1
0°-60°	5318.1	77.7
0°-90°	6846.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6846.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2282	2282	2282	2282	2282	
5°	2282	2275	2270	2269	2276	217
15°	2209	2200	2199	2197	2204	624
25°	2070	2061	2060	2060	2070	954
35°	1867	1858	1854	1854	1864	1169
45°	1608	1596	1585	1585	1596	1241
55°	1296	1282	1265	1268	1278	1158
65°	924	907	885	897	918	914
75°	514	499	491	438	415	540
85°	120	113	113	107	104	142
90°	0	0	0	0	0	

TEST NUMBER: P975527

CATALOG NUMBER: 24ENA-LD2-70-UNV-L950-CD1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2281.7	2281.7	2281.7	2281.7	2281.7
2.5°	2290.2	2280.3	2277.4	2274.7	2281.7
5°	2281.7	2274.7	2270.2	2268.8	2276.0
7.5°	2271.7	2263.2	2260.3	2257.3	2264.5
10°	2254.6	2246.1	2243.1	2241.6	2248.8
12.5°	2234.6	2224.4	2223.1	2221.7	2228.7
15°	2208.7	2200.1	2198.7	2197.4	2204.4
17.5°	2181.6	2173.1	2170.1	2168.8	2178.7
20°	2148.7	2140.2	2138.6	2137.2	2145.8
22.5°	2111.6	2103.0	2100.1	2101.4	2110.0
25°	2070.1	2061.3	2060.0	2060.0	2070.1
27.5°	2024.1	2015.6	2015.6	2015.6	2027.1
30°	1975.7	1968.5	1964.2	1965.6	1975.7
32.5°	1925.5	1914.0	1911.3	1912.6	1922.7
35°	1866.9	1858.3	1854.0	1854.0	1863.9
37.5°	1806.7	1798.2	1792.5	1792.5	1802.4
40°	1746.8	1733.7	1728.1	1725.2	1738.2
42.5°	1679.4	1669.5	1656.7	1656.7	1667.9
45°	1608.0	1596.5	1585.0	1585.0	1596.5
47.5°	1535.0	1523.5	1510.7	1510.7	1522.2
50°	1457.7	1446.2	1432.0	1432.0	1444.9
52.5°	1379.1	1366.2	1350.5	1348.9	1362.0
55°	1296.2	1281.8	1264.6	1267.6	1277.5
57.5°	1211.7	1193.0	1175.9	1175.9	1191.6
60°	1115.9	1100.2	1081.5	1084.4	1104.4
62.5°	1024.2	1004.2	985.7	992.7	1010.0
65°	924.2	907.1	885.4	896.9	918.3
67.5°	825.5	806.8	789.7	803.9	814.0
70°	721.0	703.9	691.0	691.0	689.4
72.5°	616.7	600.9	598.0	570.7	553.6
75°	513.5	499.3	490.7	437.8	414.8
77.5°	406.2	401.9	374.9	319.0	311.8
80°	303.3	306.2	257.5	258.9	264.7
82.5°	208.9	204.6	193.1	184.5	181.6
85°	120.1	113.1	113.1	107.2	104.5
87.5°	40.1	44.4	44.4	44.4	45.7
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-4

Test Date: 07/15/2025

Luminaire Tested: 14EN-LD2-51-UNV-L950-CD1-U

Data in this report applies to families of products including 14EN-LD2-51-UNV-L950-CD1-U


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-457-4
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 07/15/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Metalux
 Catalog Number: **14EN-LD2-51-UNV-L950-CD1-U**
 Description: 1x4 ENCOUNTER 5100LM WITH LIGHTNING BOARDS

Spectral Parameters

CCT (K): 4838
 CIE u' : 0.2122
 CIE v' : 0.4888
 Duv: 0.0015
 CIE x: 0.3502
 CIE y: 0.3586
 CIE z: 0.2912
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 573
 Purity: 12.68613
 R_f: 91.2
 R_g: 100.8

CRI (Ra): 93.6
 R1: 94.4
 R2: 94.8
 R3: 93.6
 R4: 94.8
 R5: 93.3
 R6: 91.9
 R7: 95.9
 R8: 89.8
 R9: 69.6
 R10: 86.3
 R11: 94.3
 R12: 70.2
 R13: 94.4
 R14: 96.0
 R15: 92.2

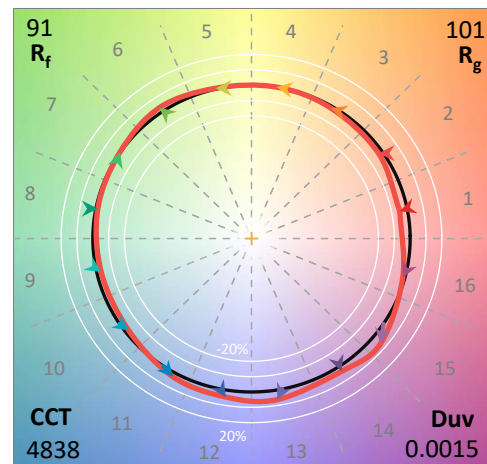

Test Conditions


Stabilization Time: M
 Operation Time: 1H 0M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-457-4


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-4

CIE 1931 Chromaticity Diagram

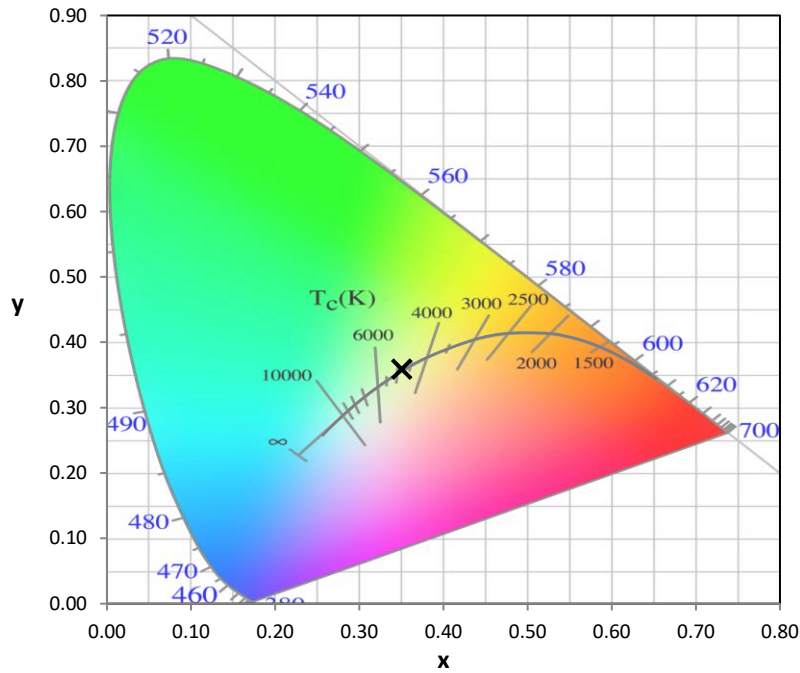


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

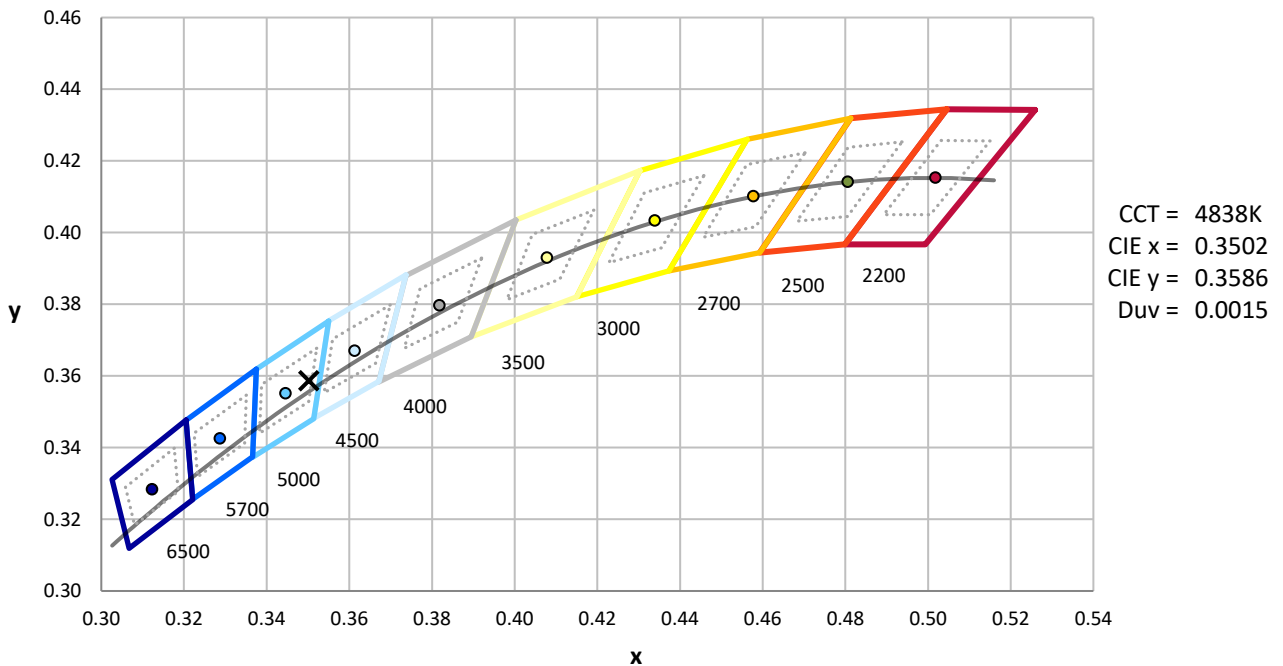

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-4

Photopic Flux vs. Wavelength

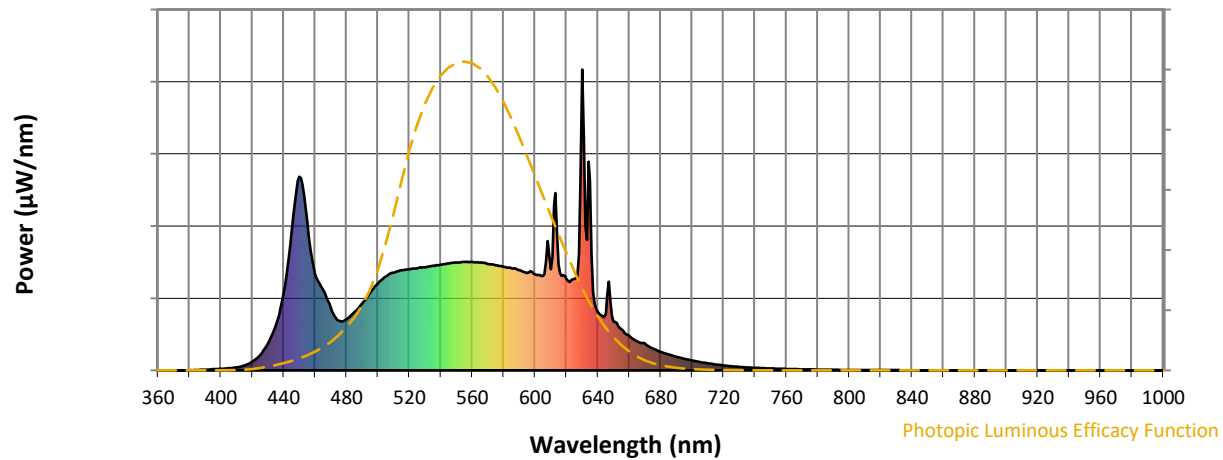


Photopic Lumens: NR

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4

Scotopic Flux vs. Wavelength

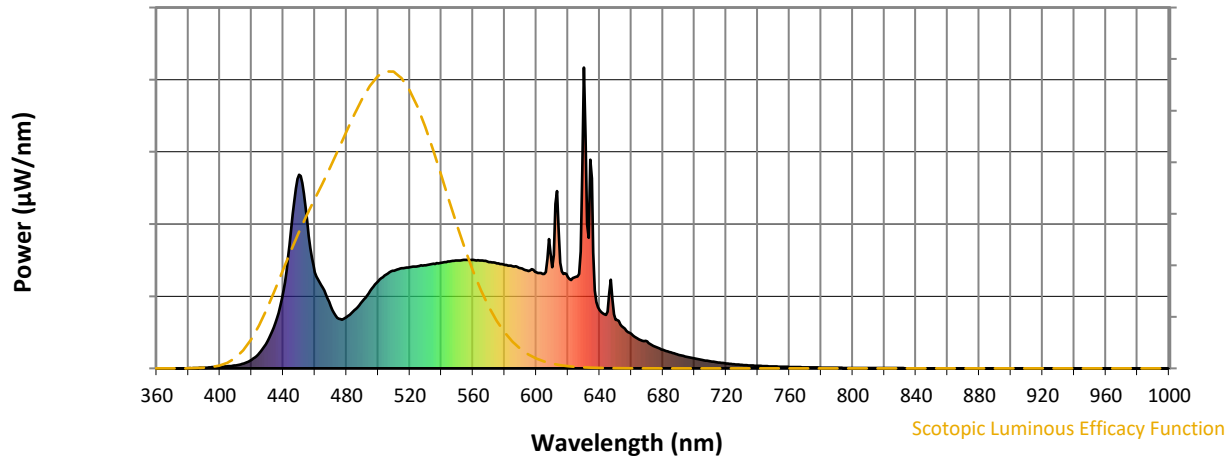


Scotopic Lumens: NR

S/P: 2.02

λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4

Melanopic Flux vs. Wavelength

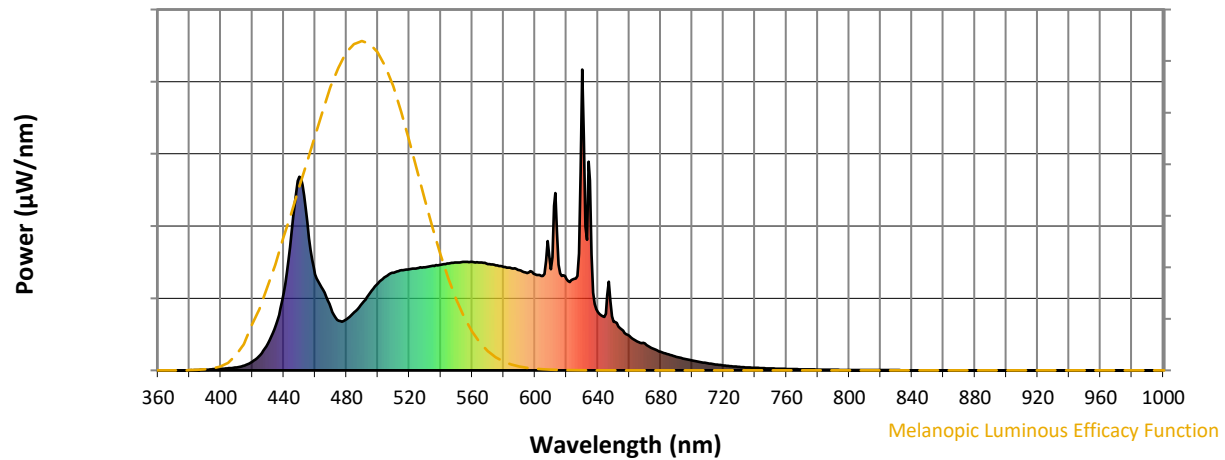

Melanopic Lumens: NR

M/P: 4.31


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	223	NR	620	303	NR	750	6	NR	880	0	NR
365	0	NR	495	258	NR	625	305	NR	755	5	NR	885	0	NR
370	0	NR	500	290	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	311	NR	635	631	NR	765	4	NR	895	0	NR
380	0	NR	510	325	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	333	NR	645	188	NR	775	3	NR	905	0	NR
390	2	NR	520	336	NR	650	162	NR	780	3	NR	910	0	NR
395	4	NR	525	340	NR	655	136	NR	785	2	NR	915	0	NR
400	5	NR	530	343	NR	660	115	NR	790	2	NR	920	0	NR
405	7	NR	535	348	NR	665	96	NR	795	2	NR	925	0	NR
410	10	NR	540	352	NR	670	89	NR	800	1	NR	930	0	NR
415	16	NR	545	356	NR	675	72	NR	805	1	NR	935	0	NR
420	28	NR	550	358	NR	680	62	NR	810	1	NR	940	0	NR
425	52	NR	555	361	NR	685	53	NR	815	1	NR	945	0	NR
430	89	NR	560	361	NR	690	45	NR	820	1	NR	950	0	NR
435	151	NR	565	359	NR	695	39	NR	825	1	NR	955	0	NR
440	256	NR	570	354	NR	700	33	NR	830	1	NR	960	0	NR
445	462	NR	575	349	NR	705	28	NR	835	1	NR	965	0	NR
450	643	NR	580	344	NR	710	23	NR	840	0	NR	970	0	NR
455	492	NR	585	339	NR	715	20	NR	845	0	NR	975	0	NR
460	319	NR	590	333	NR	720	16	NR	850	0	NR	980	0	NR
465	269	NR	595	324	NR	725	14	NR	855	0	NR	985	0	NR
470	207	NR	600	319	NR	730	11	NR	860	0	NR	990	0	NR
475	165	NR	605	314	NR	735	10	NR	865	0	NR	995	0	NR
480	171	NR	610	336	NR	740	8	NR	870	0	NR	1000	0	NR
485	194	NR	615	351	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-4





TM-30-18

Summary

$R_f = 91.2$
 $R_g = 100.8$
 $CIE R_a = 93.6$
 $R_9 = 69.6$

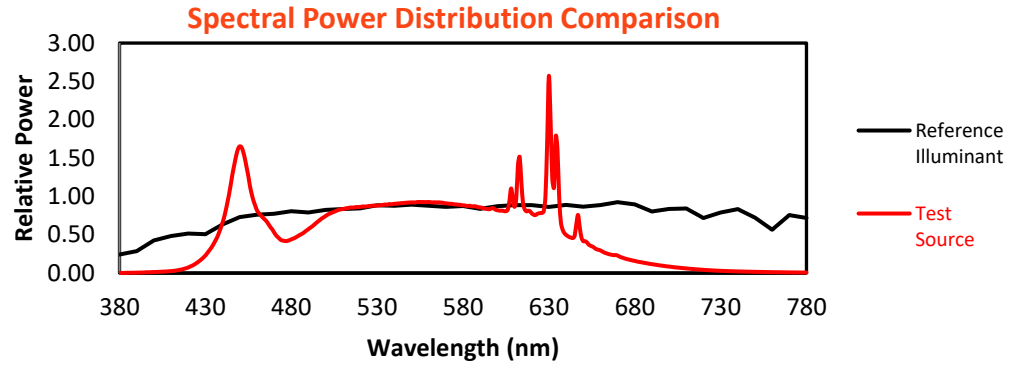


Color Vector Graphics

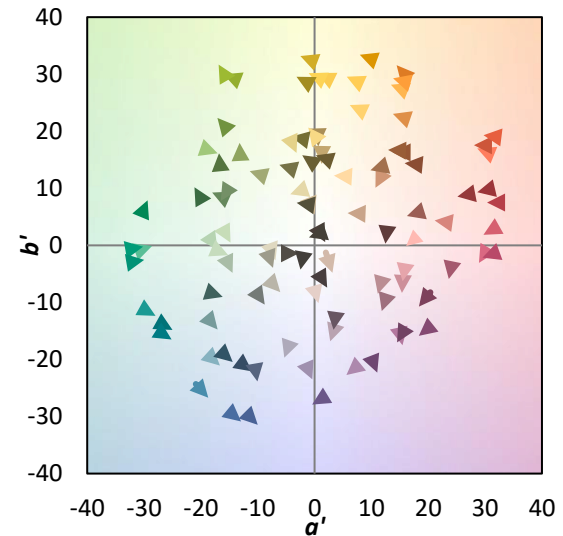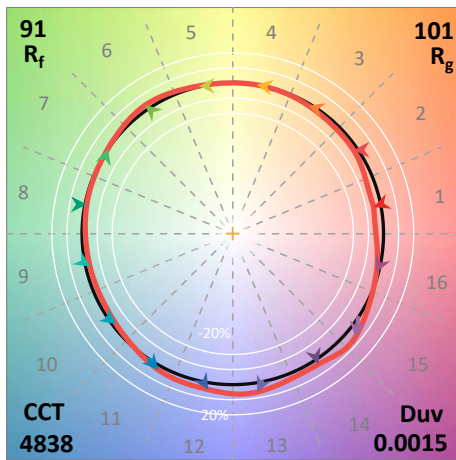
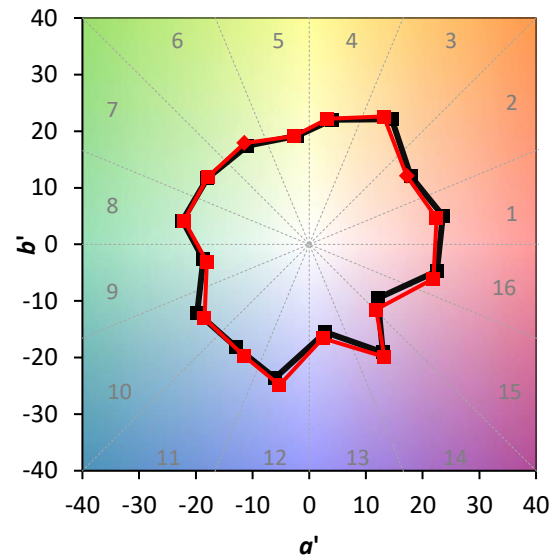
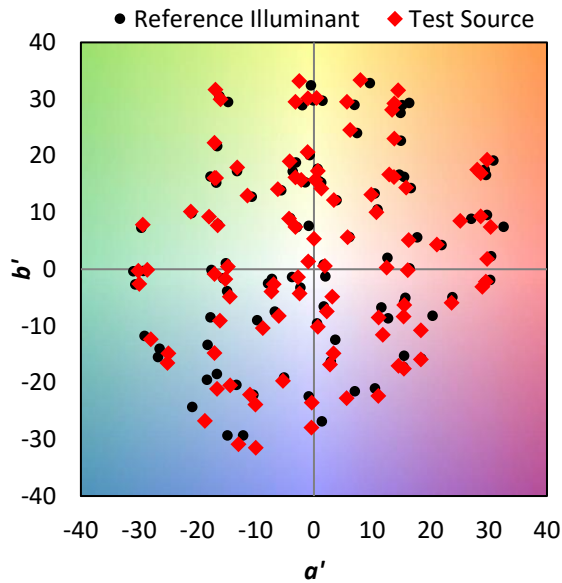


Individual Sample Fidelity Index ($R_{f,i}$)



CES01 = 85	CES26 = 90	CES51 = 99	CES76 = 83
CES02 = 61	CES27 = 93	CES52 = 98	CES77 = 88
CES03 = 31	CES28 = 94	CES53 = 96	CES78 = 80
CES04 = 69	CES29 = 92	CES54 = 96	CES79 = 95
CES05 = 48	CES30 = 98	CES55 = 94	CES80 = 92
CES06 = 50	CES31 = 93	CES56 = 95	CES81 = 84
CES07 = 41	CES32 = 86	CES57 = 94	CES82 = 96
CES08 = 40	CES33 = 96	CES58 = 95	CES83 = 96
CES09 = 29	CES34 = 90	CES59 = 98	CES84 = 93
CES10 = 73	CES35 = 94	CES60 = 94	CES85 = 84
CES11 = 56	CES36 = 84	CES61 = 93	CES86 = 87
CES12 = 62	CES37 = 93	CES62 = 90	CES87 = 90
CES13 = 42	CES38 = 92	CES63 = 93	CES88 = 97
CES14 = 74	CES39 = 98	CES64 = 91	CES89 = 86
CES15 = 71	CES40 = 96	CES65 = 89	CES90 = 98
CES16 = 47	CES41 = 98	CES66 = 88	CES91 = 75
CES17 = 48	CES42 = 91	CES67 = 87	CES92 = 79
CES18 = 56	CES43 = 91	CES68 = 88	CES93 = 88
CES19 = 70	CES44 = 99	CES69 = 89	CES94 = 78
CES20 = 65	CES45 = 94	CES70 = 84	CES95 = 83
CES21 = 85	CES46 = 95	CES71 = 80	CES96 = 92
CES22 = 77	CES47 = 94	CES72 = 93	CES97 = 93
CES23 = 91	CES48 = 95	CES73 = 78	CES98 = 93
CES24 = 90	CES49 = 94	CES74 = 93	CES99 = 94
CES25 = 70	CES50 = 99	CES75 = 81	

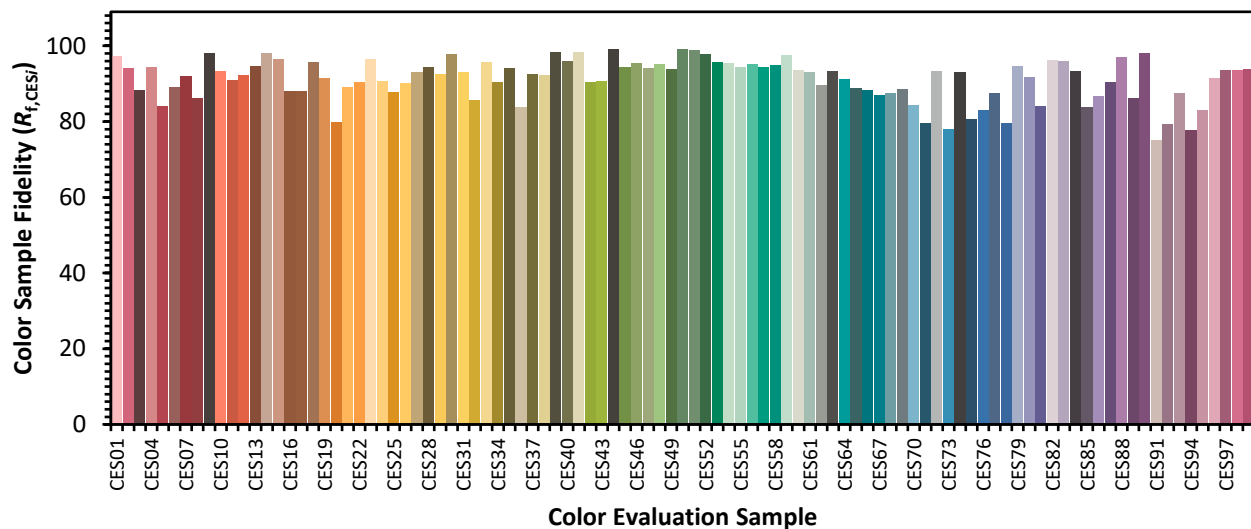

Color Rendition by Hue-Angle Bin

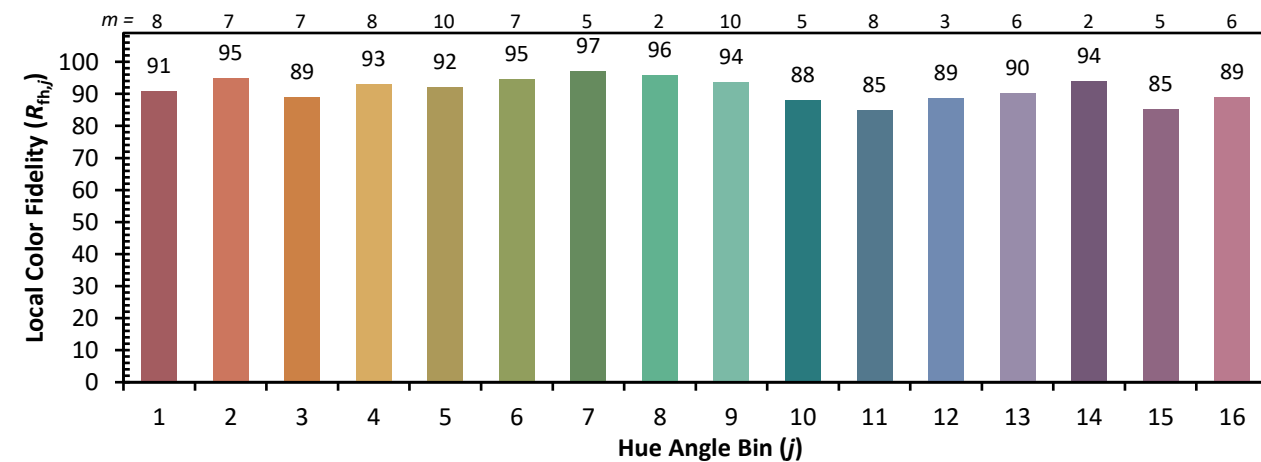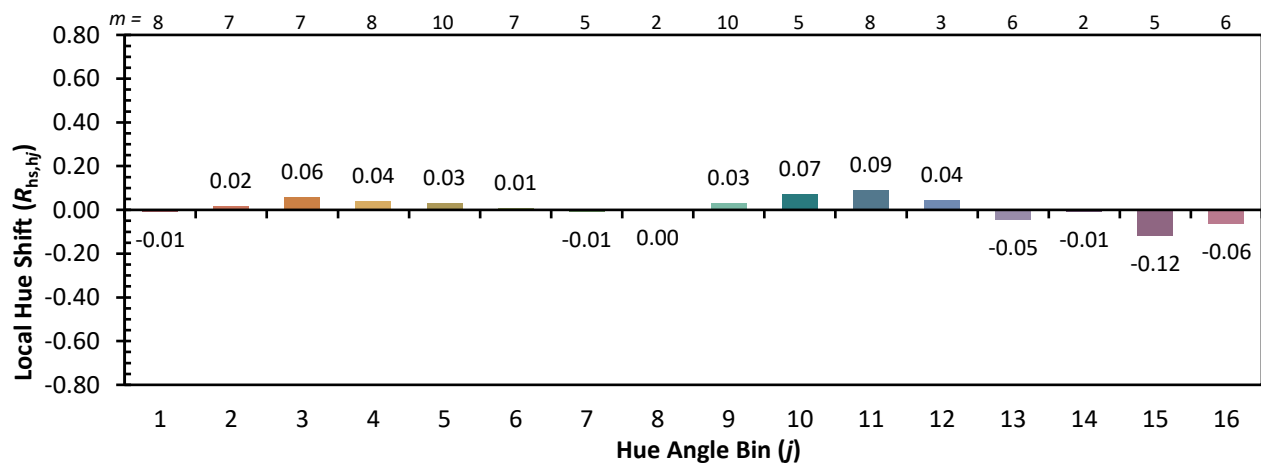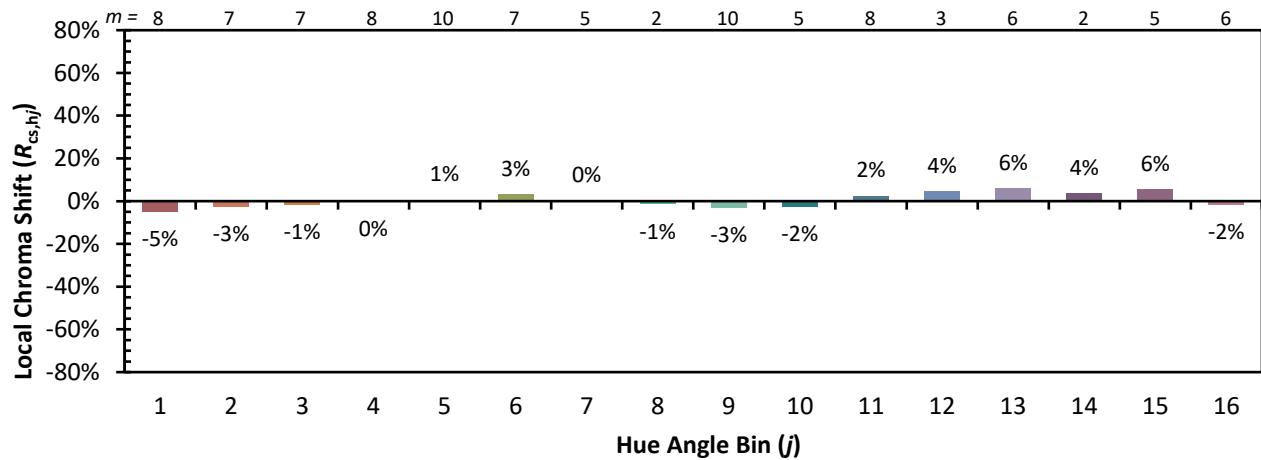

Measure Comparisons

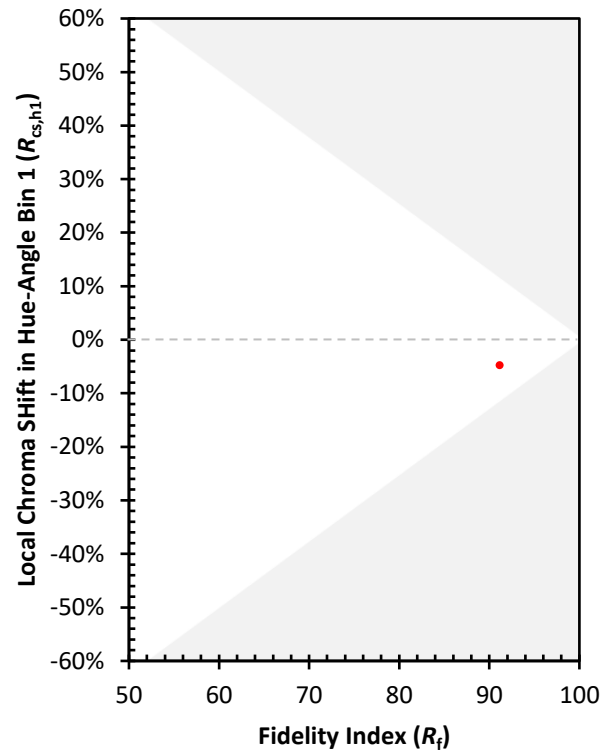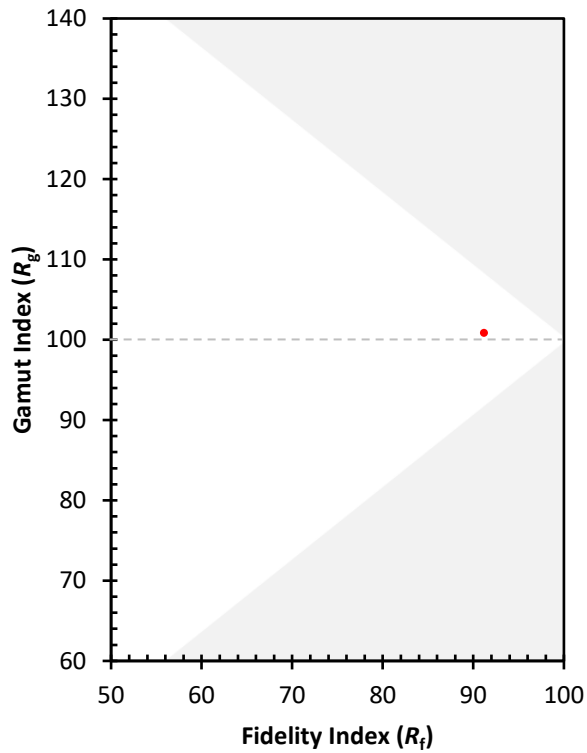

(END OF REPORT)