

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: METALUX

Report Number: P976911

Luminaire Tested: 24SR-LD2-C-64-UNV-L935-CD1-PL-U

Issue Date: 03/18/2025

**Test Information**

Test Method: LM-79-2019  
Report Number: P976911  
Test Lab: INNOVATION CENTER(P3)  
Issue Date: 03/18/2025  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: METALUX  
Catalog Number: 24SR-LD2-C-64-UNV-L935-CD1-PL-U  
Description: METALUX SKYRIDGE 2x4 6400LM PACKAGE 90CRI 3500K TROFFER with Pearl SKYTRIM  
Light Source: 3500K CCT, 90+ CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 5872.0 lumens  
Efficiency: N/A  
Efficacy: 123.4 lumens/watt  
Spacing Criteria (0/90/45): 1.29 / 1.98 / 1.87  
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')  
CIE Type: Direct

Input Watts (W): 47.6  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 28.75 FT

TEST NUMBER: P976911  
CATALOG NUMBER: 24SR-LD2-C-64-UNV-L935-CD1-PL-U

### Luminous Intensity Polar Plot

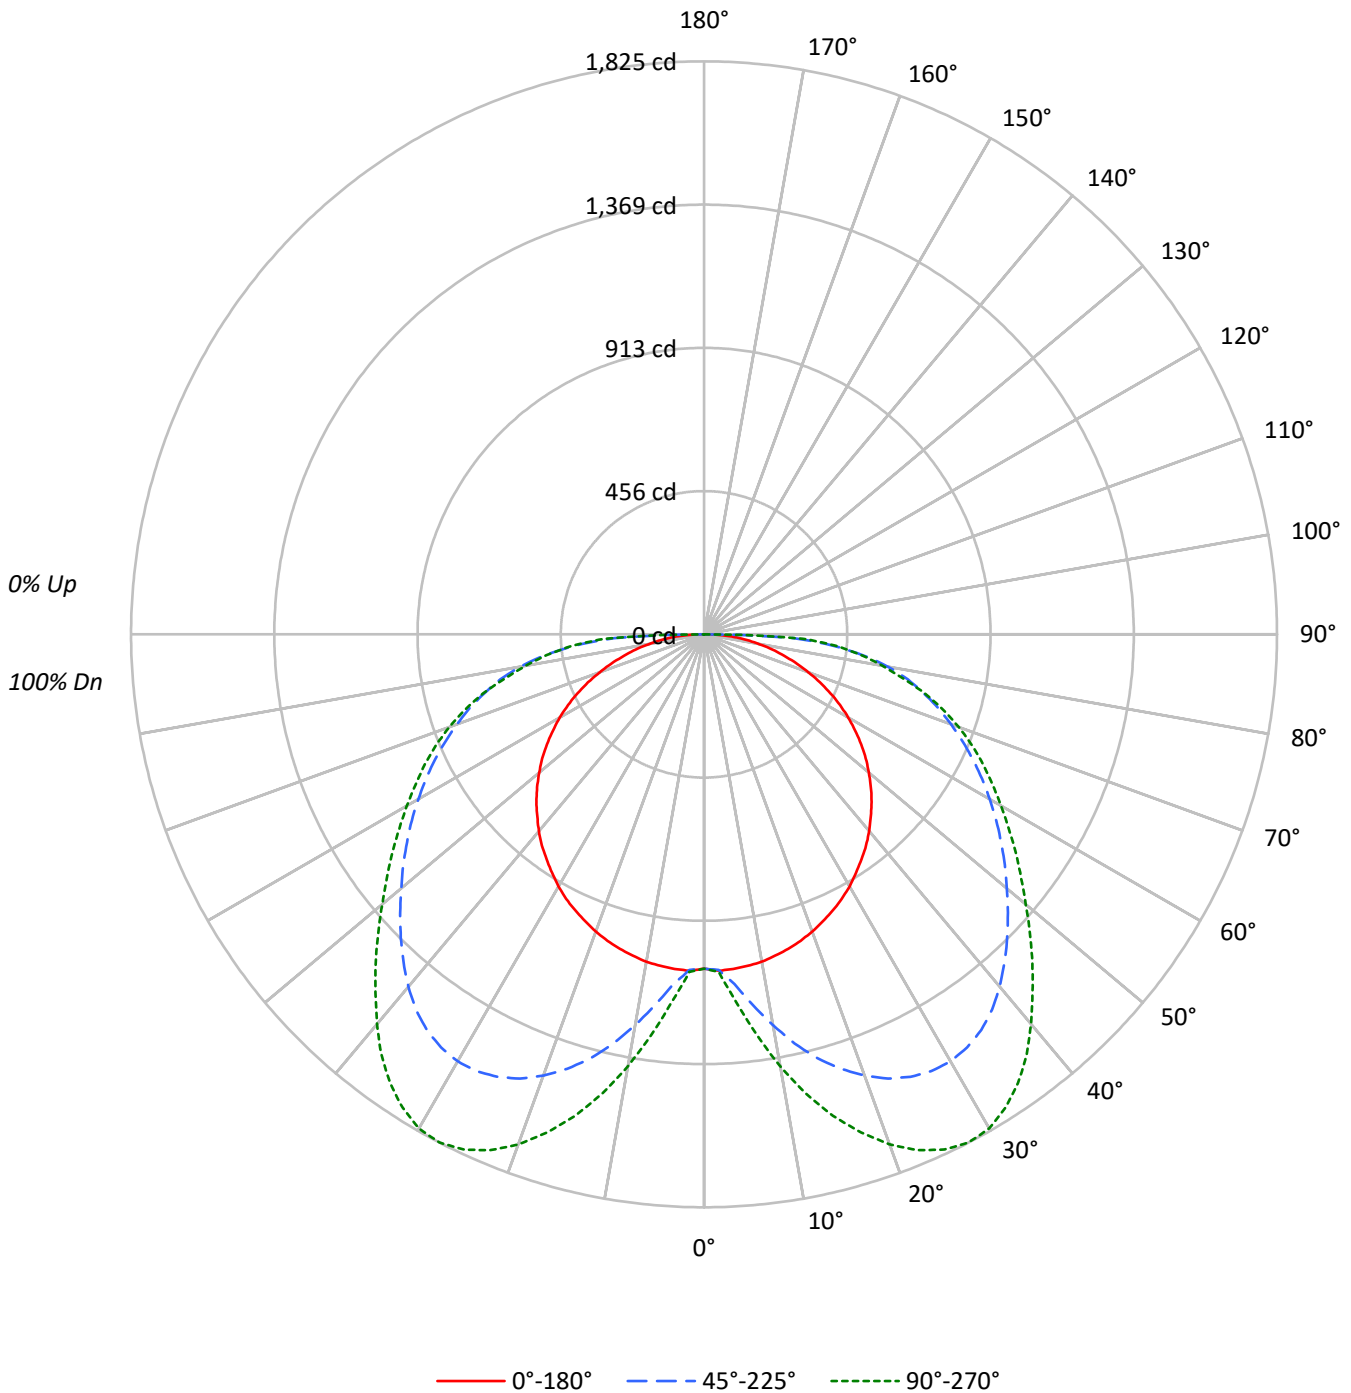



TEST NUMBER: P976911

CATALOG NUMBER: 24SR-LD2-C-64-UNV-L935-CD1-PL-U

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	106	100	95	90	103	98	93	88	93	89	85	89	86	83	86	83	80	78	78	78	78
2	95	85	77	70	92	83	76	70	80	73	68	76	71	66	73	69	65	62	62	62	62
3	86	74	64	57	83	72	63	56	69	61	55	66	60	54	63	58	53	51	51	51	51
4	78	64	55	47	75	63	54	47	60	52	46	58	51	45	56	50	45	42	42	42	42
5	71	57	47	40	69	56	47	40	54	45	39	52	44	39	50	43	38	36	36	36	36
6	65	51	41	34	63	50	41	34	48	40	34	46	39	33	45	38	33	31	31	31	31
7	60	46	36	30	59	45	36	30	43	35	29	42	35	29	40	34	29	27	27	27	27
8	56	42	32	26	54	41	32	26	39	32	26	38	31	26	37	30	26	23	23	23	23
9	52	38	29	23	51	37	29	23	36	28	23	35	28	23	34	27	23	21	21	21	21
10	49	35	26	21	48	34	26	21	33	26	21	32	25	21	31	25	20	19	19	19	19

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	1433	1433	1433
5°	1445	1510	1587
10°	1447	1726	1908
15°	1445	1948	2211
20°	1443	2142	2475
25°	1441	2308	2688
30°	1440	2440	2823
35°	1436	2528	2864
40°	1438	2573	2845
45°	1436	2599	2814
50°	1434	2635	2800
55°	1433	2709	2844
60°	1427	2828	2941
65°	1416	3011	3124
70°	1390	3293	3397
75°	1370	3763	3788
80°	1382	4613	4468
85°	1507	6390	6509

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 90°  
 Vertical Angle: 87.5°  
 Luminance: 9710 cd/sqm



TEST NUMBER: P976911  
 CATALOG NUMBER: 24SR-LD2-C-64-UNV-L935-CD1-PL-U

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	110.7	1.9
10°-20°	384.6	6.5
20°-30°	681.7	11.6
30°-40°	897.1	15.3
40°-50°	972.8	16.6
50°-60°	947.0	16.1
60°-70°	850.9	14.5
70°-80°	674.0	11.5
80°-90°	353.2	6.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1177.0	20.0
0°-40°	2074.2	35.3
0°-60°	3994.0	68.0
0°-90°	5872.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5872.0	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1065	1065	1065	1065	1065	
5°	1070	1070	1118	1160	1175	102
15°	1037	1172	1398	1538	1587	293
25°	970	1236	1555	1743	1811	448
35°	874	1204	1539	1696	1744	548
45°	755	1092	1366	1456	1479	582
55°	611	949	1155	1195	1212	546
65°	445	796	946	963	981	439
75°	264	598	724	725	729	280
85°	98	318	414	415	422	104
90°	0	0	0	0	0	



TEST NUMBER: P976911  
 CATALOG NUMBER: 24SR-LD2-C-64-UNV-L935-CD1-PL-U

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
0°	1064.9	1064.9	1064.9	1064.9	1064.9	1064.9	1064.9	1064.9	1064.9	1064.9	1064.9
2.5°	1072.6	1071.1	1069.7	1068.0	1066.6	1064.9	1064.9	1064.9	1066.6	1069.7	1074.3
5°	1069.7	1068.0	1066.6	1066.6	1068.0	1071.1	1080.5	1091.4	1102.2	1117.7	1134.8
7.5°	1064.9	1063.4	1063.4	1066.6	1078.9	1097.4	1119.1	1142.5	1165.6	1190.5	1213.8
10°	1058.8	1057.2	1058.8	1072.6	1100.6	1131.6	1164.2	1196.7	1227.8	1263.5	1296.0
12.5°	1048.0	1048.0	1055.7	1083.5	1123.9	1165.6	1207.6	1251.0	1291.2	1334.6	1371.9
15°	1037.1	1037.1	1054.0	1096.0	1147.1	1196.7	1249.5	1300.6	1348.6	1398.2	1441.6
17.5°	1023.2	1023.2	1052.6	1105.4	1164.2	1224.7	1285.2	1342.5	1396.8	1451.0	1497.5
20°	1007.5	1010.7	1049.5	1113.1	1179.6	1247.8	1312.9	1376.5	1437.0	1495.8	1547.0
22.5°	989.0	995.2	1044.9	1116.2	1192.1	1263.5	1334.6	1402.8	1466.4	1531.5	1582.6
25°	970.4	979.8	1038.6	1116.2	1196.7	1274.3	1348.6	1419.9	1488.1	1554.9	1610.6
27.5°	950.2	962.7	1029.2	1111.4	1198.2	1277.2	1354.8	1429.3	1500.6	1568.6	1626.0
30°	927.0	942.4	1015.4	1102.2	1192.1	1272.6	1353.4	1430.8	1502.1	1570.3	1626.0
32.5°	900.7	920.7	998.3	1088.2	1179.6	1261.8	1342.5	1419.9	1492.7	1559.5	1612.2
35°	874.2	899.1	979.8	1071.1	1162.5	1244.7	1325.4	1404.5	1475.8	1539.2	1585.8
37.5°	847.9	874.2	956.4	1048.0	1139.4	1221.5	1303.7	1379.7	1447.9	1506.7	1548.6
40°	818.5	847.9	930.1	1023.2	1113.1	1195.3	1275.8	1348.6	1410.7	1465.0	1503.6
42.5°	786.0	818.5	902.2	995.2	1083.5	1164.2	1241.6	1309.8	1368.8	1416.8	1449.3
45°	754.9	789.1	872.8	965.8	1052.6	1131.6	1206.1	1269.5	1322.3	1365.7	1393.6
47.5°	720.9	756.4	843.4	933.3	1018.4	1096.0	1167.3	1224.7	1275.8	1312.9	1337.7
50°	685.2	723.8	810.8	900.7	984.4	1060.3	1128.5	1181.3	1227.8	1258.7	1282.0
52.5°	649.6	689.8	776.6	866.5	950.2	1023.2	1088.2	1139.4	1179.6	1207.6	1227.8
55°	610.8	655.6	742.6	832.5	913.0	985.8	1048.0	1094.5	1131.6	1154.8	1173.6
57.5°	570.5	618.5	708.4	798.3	879.0	948.7	1007.5	1050.9	1083.5	1103.7	1117.7
60°	530.3	581.4	671.3	761.2	840.2	909.9	965.8	1006.1	1035.5	1050.9	1061.8
62.5°	488.3	542.6	633.9	723.8	804.6	869.6	922.4	959.5	985.8	998.3	1009.2
65°	444.9	502.3	595.3	685.2	765.8	826.3	877.4	911.6	934.7	945.6	951.8
67.5°	399.9	460.4	554.9	644.8	722.4	781.2	829.4	863.4	881.9	891.3	895.9
70°	353.4	417.0	511.5	601.4	675.9	731.8	778.3	809.1	827.7	837.1	838.6
72.5°	310.0	372.1	468.1	554.9	626.2	680.4	723.8	756.4	775.1	782.9	782.9
75°	263.5	325.6	420.1	503.8	572.0	624.7	668.1	699.2	716.1	723.8	723.8
77.5°	223.2	280.6	369.0	449.5	513.1	564.3	606.2	638.7	657.3	665.0	665.0
80°	178.4	234.0	316.2	390.7	449.5	496.0	539.4	573.6	592.2	595.3	590.5
82.5°	137.9	189.2	258.9	325.6	379.9	423.2	466.6	494.6	508.4	511.5	510.0
85°	97.6	139.6	198.4	252.6	297.7	337.9	369.0	395.3	409.3	413.9	417.0
87.5°	57.4	80.5	117.9	159.6	193.8	220.1	238.6	262.0	276.0	285.2	294.5
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P976911

CATALOG NUMBER: 24SR-LD2-C-64-UNV-L935-CD1-PL-U

**CANDELA DISTRIBUTION (continued):**

	55°	60°	65°	70°	75°	80°	85°	90°
0°	1064.9	1064.9	1064.9	1064.9	1064.9	1064.9	1064.9	1064.9
2.5°	1072.6	1074.3	1075.7	1075.7	1075.7	1077.4	1075.7	1075.7
5°	1140.8	1150.2	1157.9	1162.5	1167.3	1175.0	1173.6	1175.0
7.5°	1226.1	1241.6	1258.7	1268.1	1274.3	1283.5	1286.6	1286.6
10°	1314.6	1336.3	1356.3	1370.3	1379.7	1393.6	1395.1	1396.8
12.5°	1398.2	1424.5	1447.9	1463.3	1477.3	1489.6	1495.8	1497.5
15°	1469.6	1502.1	1528.4	1548.6	1562.6	1576.6	1584.3	1587.4
17.5°	1533.2	1567.2	1596.6	1620.0	1636.9	1650.8	1660.2	1663.4
20°	1582.6	1620.0	1652.5	1677.3	1697.4	1713.0	1725.3	1728.4
22.5°	1623.1	1661.7	1695.9	1723.8	1743.9	1762.4	1773.3	1778.1
25°	1652.5	1694.2	1729.9	1756.4	1778.1	1795.0	1805.8	1810.6
27.5°	1669.6	1711.3	1745.5	1771.8	1793.5	1809.0	1819.8	1824.6
30°	1669.6	1709.9	1743.9	1768.7	1788.9	1804.4	1812.1	1816.9
32.5°	1652.5	1691.3	1722.2	1743.9	1762.4	1778.1	1784.1	1787.3
35°	1624.6	1658.8	1686.5	1705.1	1720.7	1734.7	1740.7	1743.9
37.5°	1584.3	1615.2	1636.9	1654.0	1666.5	1680.5	1685.0	1688.2
40°	1533.2	1562.6	1578.0	1593.5	1604.3	1616.8	1620.0	1620.0
42.5°	1477.3	1502.1	1517.5	1528.4	1536.1	1544.0	1548.6	1548.6
45°	1418.5	1440.2	1451.0	1460.2	1467.9	1474.2	1478.7	1478.7
47.5°	1359.4	1376.5	1385.9	1392.0	1398.2	1404.5	1407.6	1407.6
50°	1300.6	1312.9	1320.6	1325.4	1331.7	1336.3	1339.4	1337.7
52.5°	1241.6	1251.0	1257.2	1261.8	1264.9	1269.5	1271.2	1272.6
55°	1182.7	1189.0	1193.6	1196.7	1203.0	1207.6	1209.0	1212.2
57.5°	1125.4	1128.5	1134.8	1136.2	1142.5	1147.1	1148.7	1150.2
60°	1066.6	1069.7	1074.3	1077.4	1085.1	1088.2	1089.7	1092.8
62.5°	1009.2	1010.7	1016.9	1023.2	1029.2	1032.3	1034.0	1035.5
65°	951.8	956.4	961.0	965.8	971.9	976.7	978.1	981.2
67.5°	895.9	899.1	905.3	909.9	914.5	919.3	922.4	923.9
70°	838.6	841.7	846.5	849.4	854.2	858.8	863.4	863.4
72.5°	782.9	782.9	786.0	789.1	793.7	796.8	798.3	798.3
75°	722.4	720.9	723.8	725.5	725.5	725.5	727.0	728.6
77.5°	657.3	651.0	647.9	647.9	649.6	646.4	647.9	649.6
80°	582.8	576.6	575.1	575.1	576.6	575.1	576.6	576.6
82.5°	503.8	503.8	499.2	500.6	502.3	499.2	502.3	505.4
85°	412.4	413.9	412.4	417.0	417.0	417.0	418.4	421.6
87.5°	296.0	305.4	302.3	308.5	306.8	308.5	310.0	314.8
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P976911  
 CATALOG NUMBER: 24SR-LD2-C-64-UNV-L935-CD1-PL-U

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room Dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.2	16.0	14.6	16.3	16.6	16.2	18.0	16.6	18.3	18.6
	3H	16.2	17.8	16.6	18.1	18.5	18.8	20.4	19.2	20.7	21.1
	4H	16.9	18.5	17.3	18.8	19.2	20.0	21.6	20.4	21.9	22.3
	6H	17.5	19.0	17.9	19.3	19.7	21.2	22.6	21.6	23.0	23.4
	8H	17.7	19.1	18.2	19.5	19.9	21.8	23.1	22.2	23.5	23.9
	12H	17.9	19.3	18.3	19.6	20.1	22.3	23.7	22.8	24.1	24.5
4H	2H	15.6	17.2	16.0	17.5	17.9	17.0	18.5	17.4	18.9	19.3
	3H	18.1	19.4	18.5	19.8	20.2	19.8	21.2	20.3	21.6	22.0
	4H	19.2	20.4	19.6	20.8	21.2	21.2	22.5	21.7	22.9	23.3
	6H	20.1	21.2	20.5	21.6	22.0	22.6	23.7	23.1	24.1	24.6
	8H	20.4	21.4	20.9	21.9	22.3	23.3	24.3	23.7	24.7	25.2
	12H	20.6	21.6	21.1	22.0	22.5	24.0	24.9	24.5	25.4	25.8
8H	4H	20.2	21.2	20.7	21.7	22.1	21.8	22.8	22.3	23.3	23.7
	6H	21.5	22.4	22.0	22.9	23.4	23.4	24.3	23.9	24.8	25.2
	8H	22.1	22.9	22.6	23.4	23.9	24.2	25.0	24.7	25.5	26.0
	12H	22.6	23.3	23.1	23.8	24.3	25.1	25.8	25.6	26.3	26.9
12H	4H	20.4	21.4	20.9	21.8	22.3	21.9	22.9	22.4	23.3	23.8
	6H	21.9	22.7	22.4	23.2	23.7	23.6	24.4	24.1	24.9	25.4
	8H	22.7	23.4	23.2	23.9	24.4	24.5	25.2	25.0	25.7	26.3

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-6

Test Date: 07/01/2025

Luminaire Tested: 24SR-LD2-64-C-UNV-L935-CD1-U

Data in this report applies to families of products including 24SR-LD2-64-C-UNV-L935-CD1-U

**Test Information**

Test Method: LM-79-2019  
 Report Number: SP1-2506-457-6  
 Test Lab: COOPER LIGHTING SOLUTIONS  
 Photometer: SP1 - 76IN SPHERE  
 Measurement Geometry: 4π  
 Issue Date: 07/02/2025  
 Manufacturer: COOPER LIGHTING SOLUTIONS  
 Product Line: Metalux  
 Catalog Number: **24SR-LD2-64-C-UNV-L935-CD1-U**  
 Description: 2X4 SKYRIDGE 6400LM Fixture with new LTN chip

**Spectral Parameters**

CCT (K): 3329  
 CIE u': 0.2411  
 CIE v': 0.5118  
 Duv: -0.0021  
 CIE x: 0.4128  
 CIE y: 0.3894  
 CIE z: 0.1979  
 Peak Wavelength (nm): 630  
 Dominant Wavelength (nm): 582  
 Purity: 40.74075  
 Rf: 91.4  
 Rg: 100.2

CRI (Ra):	93.9		
R1:	95.4	R9:	60.5
R2:	97.4	R10:	92.5
R3:	97.7	R11:	95.9
R4:	94.9	R12:	82.0
R5:	95.1	R13:	96.0
R6:	95.7	R14:	98.0
R7:	91.7	R15:	91.5
R8:	83.2		



**Test Conditions**


Stabilization Time: 48M  
 Operation Time: 1H 48M  
 Sphere Temperature (°C): 24.0

REPORT NUMBER: SP1-2506-457-6

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-6

CIE 1931 Chromaticity Diagram

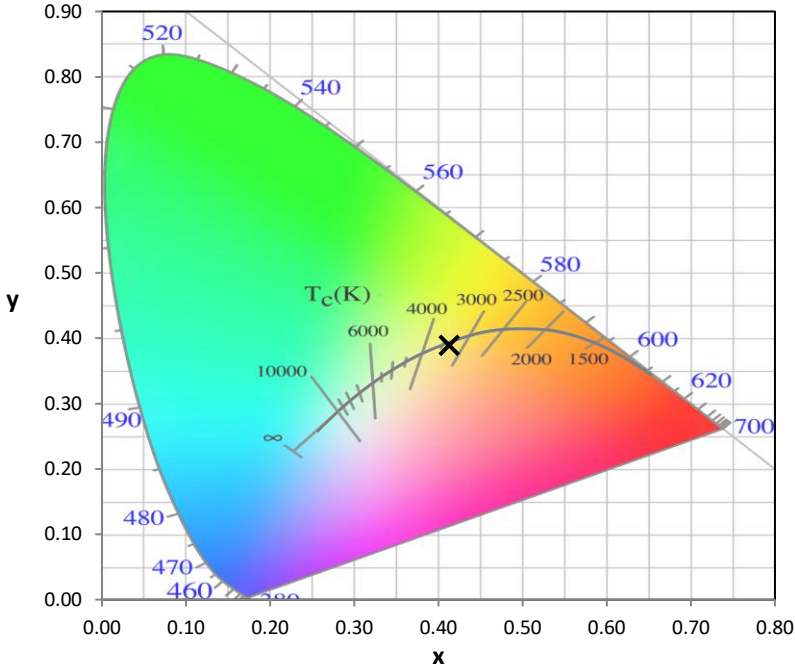

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3500K 7-step quadrangle

REPORT NUMBER: SP1-2506-457-6

**Photopic Flux vs. Wavelength**



**Photopic Lumens: NR**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	143	NR	620	358	NR	750	9	NR	880	0	NR
365	0	NR	495	166	NR	625	357	NR	755	7	NR	885	0	NR
370	0	NR	500	191	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	210	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	223	NR	640	239	NR	770	5	NR	900	0	NR
385	0	NR	515	233	NR	645	226	NR	775	4	NR	905	0	NR
390	1	NR	520	240	NR	650	201	NR	780	3	NR	910	0	NR
395	2	NR	525	246	NR	655	170	NR	785	3	NR	915	0	NR
400	3	NR	530	251	NR	660	145	NR	790	2	NR	920	0	NR
405	4	NR	535	260	NR	665	123	NR	795	2	NR	925	0	NR
410	6	NR	540	267	NR	670	113	NR	800	2	NR	930	0	NR
415	9	NR	545	276	NR	675	93	NR	805	2	NR	935	0	NR
420	16	NR	550	284	NR	680	80	NR	810	1	NR	940	0	NR
425	28	NR	555	294	NR	685	69	NR	815	1	NR	945	0	NR
430	46	NR	560	303	NR	690	59	NR	820	1	NR	950	0	NR
435	75	NR	565	313	NR	695	51	NR	825	1	NR	955	0	NR
440	120	NR	570	319	NR	700	43	NR	830	1	NR	960	0	NR
445	203	NR	575	327	NR	705	37	NR	835	1	NR	965	0	NR
450	311	NR	580	336	NR	710	31	NR	840	1	NR	970	0	NR
455	290	NR	585	344	NR	715	26	NR	845	1	NR	975	0	NR
460	197	NR	590	349	NR	720	22	NR	850	0	NR	980	0	NR
465	163	NR	595	350	NR	725	18	NR	855	0	NR	985	0	NR
470	135	NR	600	355	NR	730	15	NR	860	0	NR	990	0	NR
475	110	NR	605	357	NR	735	13	NR	865	0	NR	995	0	NR
480	108	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	123	NR	615	421	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-6

**Scotopic Flux vs. Wavelength**



**Scotopic Lumens: NR**

**S/P: 1.57**

$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)
360	0	NR	490	143	NR	620	358	NR	750	9	NR	880	0	NR
365	0	NR	495	166	NR	625	357	NR	755	7	NR	885	0	NR
370	0	NR	500	191	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	210	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	223	NR	640	239	NR	770	5	NR	900	0	NR
385	0	NR	515	233	NR	645	226	NR	775	4	NR	905	0	NR
390	1	NR	520	240	NR	650	201	NR	780	3	NR	910	0	NR
395	2	NR	525	246	NR	655	170	NR	785	3	NR	915	0	NR
400	3	NR	530	251	NR	660	145	NR	790	2	NR	920	0	NR
405	4	NR	535	260	NR	665	123	NR	795	2	NR	925	0	NR
410	6	NR	540	267	NR	670	113	NR	800	2	NR	930	0	NR
415	9	NR	545	276	NR	675	93	NR	805	2	NR	935	0	NR
420	16	NR	550	284	NR	680	80	NR	810	1	NR	940	0	NR
425	28	NR	555	294	NR	685	69	NR	815	1	NR	945	0	NR
430	46	NR	560	303	NR	690	59	NR	820	1	NR	950	0	NR
435	75	NR	565	313	NR	695	51	NR	825	1	NR	955	0	NR
440	120	NR	570	319	NR	700	43	NR	830	1	NR	960	0	NR
445	203	NR	575	327	NR	705	37	NR	835	1	NR	965	0	NR
450	311	NR	580	336	NR	710	31	NR	840	1	NR	970	0	NR
455	290	NR	585	344	NR	715	26	NR	845	1	NR	975	0	NR
460	197	NR	590	349	NR	720	22	NR	850	0	NR	980	0	NR
465	163	NR	595	350	NR	725	18	NR	855	0	NR	985	0	NR
470	135	NR	600	355	NR	730	15	NR	860	0	NR	990	0	NR
475	110	NR	605	357	NR	735	13	NR	865	0	NR	995	0	NR
480	108	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	123	NR	615	421	NR	745	10	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-6

**Melanopic Flux vs. Wavelength**



**Melanopic Lumens: NR**

**M/P: 3.17**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	143	NR	620	358	NR	750	9	NR	880	0	NR
365	0	NR	495	166	NR	625	357	NR	755	7	NR	885	0	NR
370	0	NR	500	191	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	210	NR	635	705	NR	765	5	NR	895	0	NR
380	0	NR	510	223	NR	640	239	NR	770	5	NR	900	0	NR
385	0	NR	515	233	NR	645	226	NR	775	4	NR	905	0	NR
390	1	NR	520	240	NR	650	201	NR	780	3	NR	910	0	NR
395	2	NR	525	246	NR	655	170	NR	785	3	NR	915	0	NR
400	3	NR	530	251	NR	660	145	NR	790	2	NR	920	0	NR
405	4	NR	535	260	NR	665	123	NR	795	2	NR	925	0	NR
410	6	NR	540	267	NR	670	113	NR	800	2	NR	930	0	NR
415	9	NR	545	276	NR	675	93	NR	805	2	NR	935	0	NR
420	16	NR	550	284	NR	680	80	NR	810	1	NR	940	0	NR
425	28	NR	555	294	NR	685	69	NR	815	1	NR	945	0	NR
430	46	NR	560	303	NR	690	59	NR	820	1	NR	950	0	NR
435	75	NR	565	313	NR	695	51	NR	825	1	NR	955	0	NR
440	120	NR	570	319	NR	700	43	NR	830	1	NR	960	0	NR
445	203	NR	575	327	NR	705	37	NR	835	1	NR	965	0	NR
450	311	NR	580	336	NR	710	31	NR	840	1	NR	970	0	NR
455	290	NR	585	344	NR	715	26	NR	845	1	NR	975	0	NR
460	197	NR	590	349	NR	720	22	NR	850	0	NR	980	0	NR
465	163	NR	595	350	NR	725	18	NR	855	0	NR	985	0	NR
470	135	NR	600	355	NR	730	15	NR	860	0	NR	990	0	NR
475	110	NR	605	357	NR	735	13	NR	865	0	NR	995	0	NR
480	108	NR	610	391	NR	740	11	NR	870	0	NR	1000	0	NR
485	123	NR	615	421	NR	745	10	NR	875	0	NR			

**Summary**

$R_f = 91.4$   
 $R_g = 100.2$   
 $CIE R_a = 93.9$   
 $R_9 = 60.5$



**Color Vector Graphics**






Individual Sample Fidelity Index ( $R_{f,i}$ )

CES01 = 86	CES26 = 93	CES51 = 98	CES76 = 88
CES02 = 63	CES27 = 93	CES52 = 98	CES77 = 87
CES03 = 31	CES28 = 96	CES53 = 97	CES78 = 85
CES04 = 70	CES29 = 95	CES54 = 95	CES79 = 91
CES05 = 50	CES30 = 96	CES55 = 94	CES80 = 92
CES06 = 51	CES31 = 95	CES56 = 96	CES81 = 75
CES07 = 43	CES32 = 87	CES57 = 95	CES82 = 96
CES08 = 42	CES33 = 97	CES58 = 96	CES83 = 94
CES09 = 29	CES34 = 94	CES59 = 98	CES84 = 95
CES10 = 75	CES35 = 96	CES60 = 94	CES85 = 80
CES11 = 58	CES36 = 84	CES61 = 93	CES86 = 79
CES12 = 64	CES37 = 95	CES62 = 89	CES87 = 91
CES13 = 44	CES38 = 91	CES63 = 94	CES88 = 97
CES14 = 74	CES39 = 99	CES64 = 92	CES89 = 83
CES15 = 72	CES40 = 97	CES65 = 90	CES90 = 98
CES16 = 48	CES41 = 97	CES66 = 90	CES91 = 77
CES17 = 49	CES42 = 93	CES67 = 89	CES92 = 77
CES18 = 56	CES43 = 92	CES68 = 89	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 91	CES94 = 74
CES20 = 67	CES45 = 96	CES70 = 88	CES95 = 84
CES21 = 86	CES46 = 96	CES71 = 84	CES96 = 92
CES22 = 78	CES47 = 91	CES72 = 94	CES97 = 95
CES23 = 91	CES48 = 94	CES73 = 83	CES98 = 94
CES24 = 90	CES49 = 94	CES74 = 91	CES99 = 92
CES25 = 71	CES50 = 98	CES75 = 86	



Color Rendition by Hue-Angle Bin

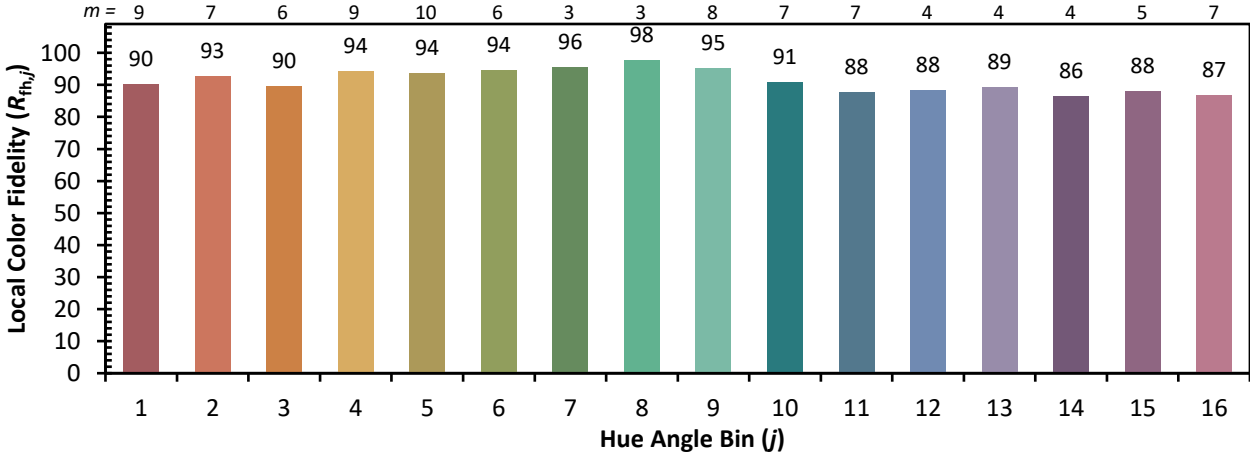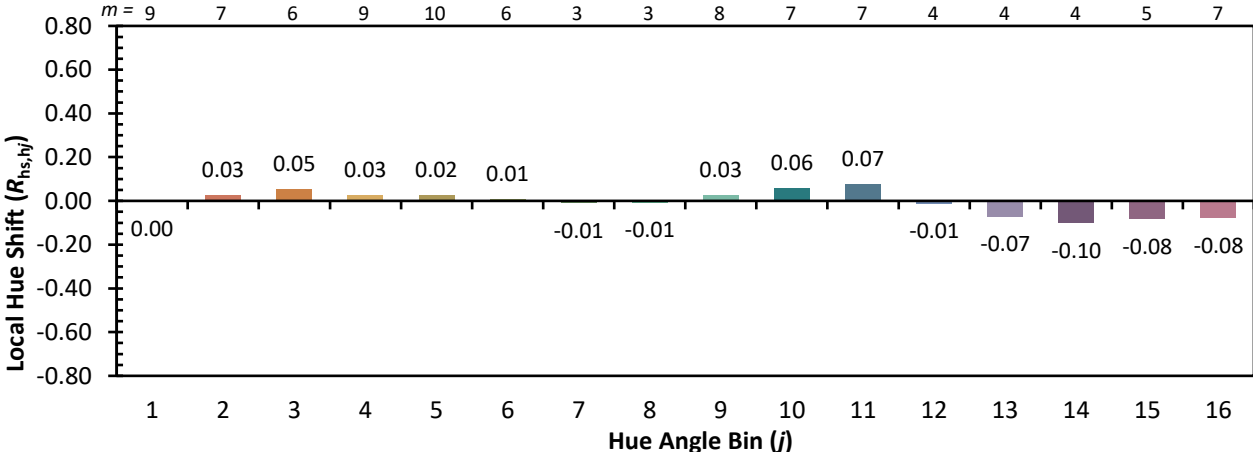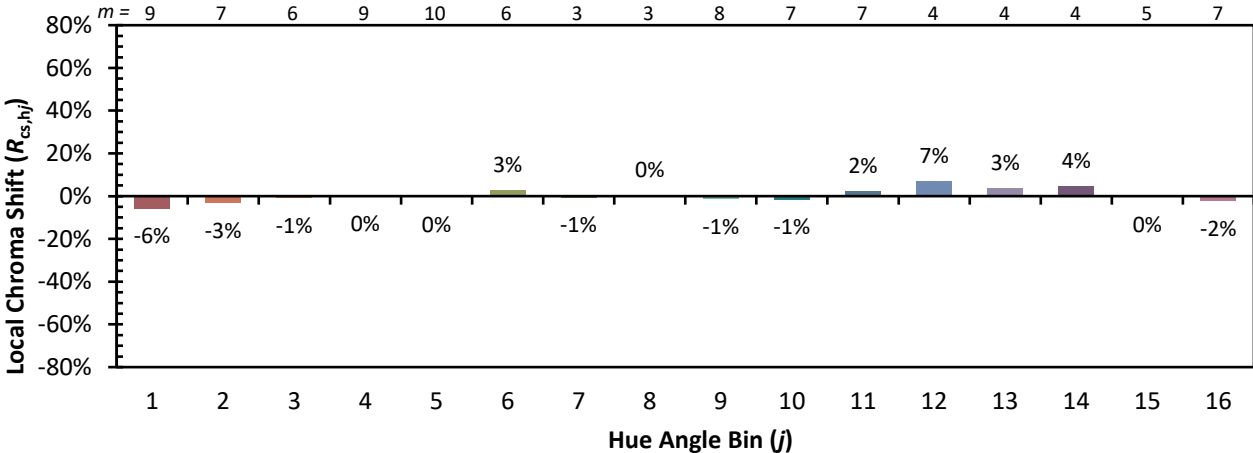

Measure Comparisons



(END OF REPORT)