

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: METALUX

Report Number: P976790

Luminaire Tested: 24SR-LD2-C-59-UNV-L940-CD1-MR-U

Issue Date: 03/18/2025

**Test Information**

Test Method: LM-79-2019  
Report Number: P976790  
Test Lab: INNOVATION CENTER(P3)  
Issue Date: 03/18/2025  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: METALUX  
Catalog Number: 24SR-LD2-C-59-UNV-L940-CD1-MR-U  
Description: METALUX SKYRIDGE 2x4 5900LM PACKAGE 90CRI 4000K TROFFER with Medium Red SKYTRIM  
Light Source: 4000K CCT, 90+ CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3412.0 lumens  
Efficiency: N/A  
Efficacy: 77.9 lumens/watt  
Spacing Criteria (0/90/45): 1.28 / 2.27 / 2.06  
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')  
CIE Type: Direct

Input Watts (W): 43.8  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 28.75 FT

TEST NUMBER: P976790  
CATALOG NUMBER: 24SR-LD2-C-59-UNV-L940-CD1-MR-U

### Luminous Intensity Polar Plot

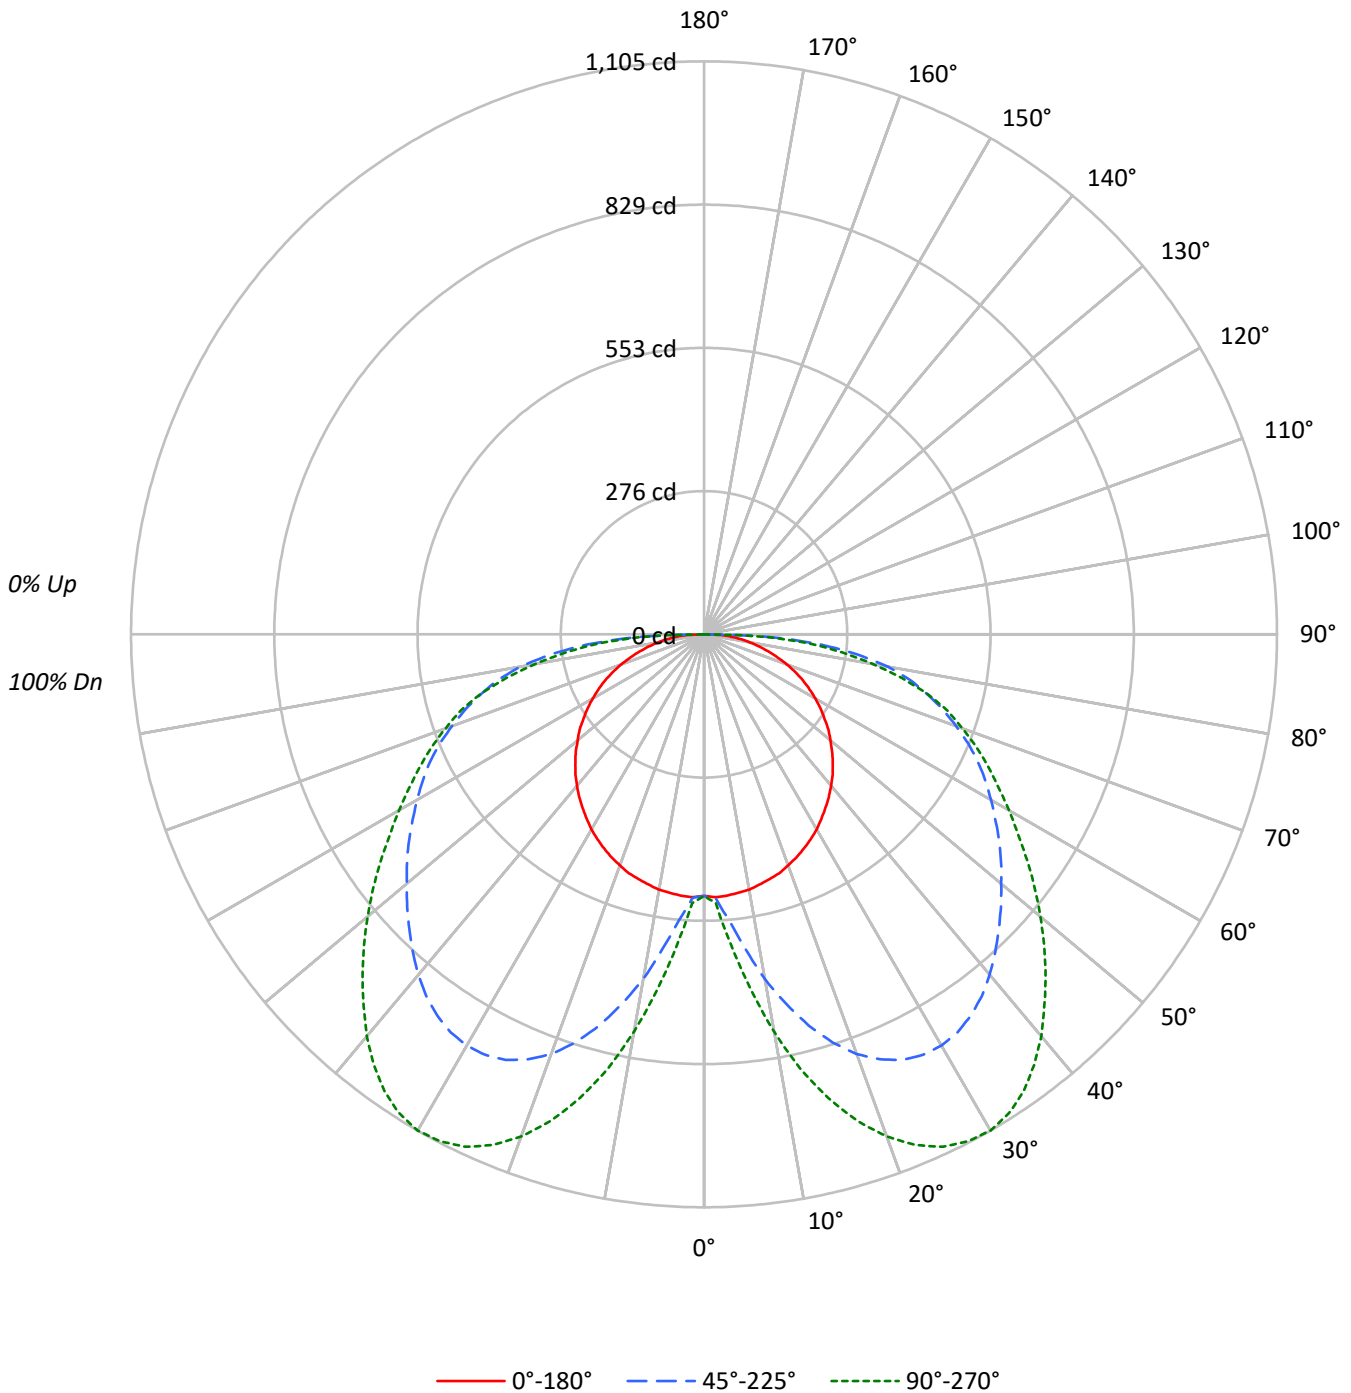



TEST NUMBER: P976790

CATALOG NUMBER: 24SR-LD2-C-59-UNV-L940-CD1-MR-U

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	102	102	102	100
1	106	100	95	90	103	98	93	88	93	89	85	89	86	83	86	83	80	86	83	80	78
2	95	85	77	70	92	83	76	69	79	73	68	76	71	66	73	68	64	73	68	64	62
3	85	73	64	56	83	72	63	56	69	61	55	66	59	54	63	58	53	63	58	53	50
4	78	64	54	47	75	63	53	46	60	52	46	58	51	45	55	49	44	55	49	44	42
5	71	57	47	39	69	55	46	39	53	45	39	51	44	38	49	43	38	49	43	38	35
6	65	50	41	34	63	49	40	33	48	39	33	46	38	33	44	38	32	44	38	32	30
7	60	45	36	29	58	45	35	29	43	35	29	41	34	29	40	33	28	40	33	28	26
8	56	41	32	26	54	40	32	26	39	31	25	38	30	25	36	30	25	36	30	25	23
9	52	38	29	23	50	37	28	23	36	28	23	35	27	22	33	27	22	33	27	22	20
10	48	34	26	20	47	34	26	20	33	25	20	32	25	20	31	25	20	31	25	20	18

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	679	679	679
5°	683	747	813
10°	683	922	1063
15°	681	1088	1289
20°	679	1233	1475
25°	676	1344	1619
30°	675	1423	1716
35°	671	1474	1765
40°	669	1505	1777
45°	668	1530	1772
50°	666	1566	1773
55°	666	1630	1785
60°	667	1720	1827
65°	670	1857	1925
70°	671	2035	2086
75°	671	2316	2324
80°	700	2787	2565
85°	818	3495	3162

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 40°  
 Vertical Angle: 87.5°  
 Luminance: 4291 cd/sqm



TEST NUMBER: P976790

CATALOG NUMBER: 24SR-LD2-C-59-UNV-L940-CD1-MR-U

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	55.9	1.6
10°-20°	212.0	6.2
20°-30°	390.0	11.4
30°-40°	519.9	15.2
40°-50°	569.5	16.7
50°-60°	560.0	16.4
60°-70°	508.2	14.9
70°-80°	404.6	11.9
80°-90°	191.8	5.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	657.9	19.3
0°-40°	1177.8	34.5
0°-60°	2307.4	67.6
0°-90°	3412.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3412.0	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	504	504	504	504	504	
5°	506	510	553	589	602	48
15°	489	605	781	890	926	138
25°	456	671	906	1041	1090	210
35°	408	660	897	1029	1075	256
45°	351	595	804	901	931	271
55°	284	525	695	747	761	254
65°	211	454	583	595	605	208
75°	129	355	446	443	447	137
85°	53	191	226	205	205	55
90°	0	0	0	0	0	



TEST NUMBER: P976790

CATALOG NUMBER: 24SR-LD2-C-59-UNV-L940-CD1-MR-U

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°
0°	504.4	504.4	504.4	504.4	504.4	504.4	504.4	504.4	504.4	504.4	504.4
2.5°	507.3	507.3	505.7	505.7	505.7	504.4	504.4	505.7	507.3	508.6	510.2
5°	505.7	505.7	505.7	505.7	507.3	513.1	520.2	530.2	538.7	553.2	560.3
7.5°	503.0	503.0	504.4	508.6	520.2	535.8	554.5	575.9	593.3	611.8	629.0
10°	500.1	500.1	503.0	517.3	540.2	567.4	594.6	621.8	646.1	674.9	696.3
12.5°	494.3	494.3	503.0	528.7	563.2	597.5	631.9	667.7	699.2	729.3	759.4
15°	488.6	488.6	505.7	541.6	584.6	626.1	666.2	707.9	745.1	781.0	812.4
17.5°	483.0	484.3	510.2	555.9	603.3	651.9	699.2	743.7	785.2	825.3	861.2
20°	474.3	477.2	513.1	565.9	618.9	673.5	723.7	772.3	818.2	861.2	898.4
22.5°	465.6	471.4	514.4	573.2	631.9	690.7	743.7	793.9	842.5	887.0	925.6
25°	455.6	462.9	515.8	577.5	640.5	700.7	756.5	809.5	859.7	905.6	944.3
27.5°	445.5	455.6	513.1	577.5	643.4	706.3	762.3	816.8	869.7	914.2	955.7
30°	434.2	447.1	508.6	575.9	643.4	705.0	762.3	818.2	869.7	915.6	955.7
32.5°	421.2	438.4	501.5	570.3	637.7	700.7	758.0	812.4	864.1	909.8	948.6
35°	408.3	427.0	493.0	561.7	629.0	690.7	746.4	801.0	851.2	897.1	935.6
37.5°	395.4	417.0	483.0	551.6	616.1	676.2	732.2	786.7	835.4	879.7	915.6
40°	381.1	404.1	470.0	537.4	601.8	659.1	715.0	766.5	813.9	857.0	891.3
42.5°	366.9	391.2	455.6	523.1	584.6	641.9	696.3	746.4	792.3	831.1	862.5
45°	351.0	376.9	441.3	505.7	565.9	623.4	676.2	723.7	768.0	803.9	832.5
47.5°	335.2	362.6	425.5	490.1	548.7	604.7	656.2	702.1	742.2	776.5	803.9
50°	318.1	346.8	409.9	472.9	531.6	586.0	636.1	679.1	717.9	748.0	773.8
52.5°	302.4	332.5	394.0	457.1	514.4	568.8	617.6	657.7	693.6	722.1	743.7
55°	283.7	316.7	379.8	441.3	498.6	551.6	597.5	636.1	669.1	694.9	713.6
57.5°	266.6	300.9	364.0	425.5	481.4	534.5	577.5	614.7	643.4	666.2	683.6
60°	247.8	285.1	348.1	409.9	465.6	517.3	558.8	593.3	620.5	639.0	653.5
62.5°	229.3	267.9	333.9	394.0	448.4	497.2	537.4	568.8	593.3	611.8	620.5
65°	210.6	250.7	316.7	378.2	431.3	477.2	515.8	545.8	567.4	583.3	588.9
67.5°	190.6	233.6	299.5	358.2	411.2	455.6	491.5	520.2	538.7	551.6	554.5
70°	170.5	213.5	279.5	338.1	388.3	429.9	465.6	490.1	508.6	517.3	520.2
72.5°	149.1	193.5	259.4	315.2	362.6	404.1	435.5	461.4	477.2	483.0	483.0
75°	129.0	171.9	236.5	289.5	335.2	374.0	404.1	427.0	441.3	445.5	444.2
77.5°	109.0	151.8	212.0	262.3	303.8	339.7	368.2	389.8	402.7	407.0	405.4
80°	90.3	130.4	183.4	230.7	267.9	300.9	326.7	349.7	361.1	359.7	351.0
82.5°	71.6	106.1	153.3	194.8	227.8	257.9	283.7	298.0	302.4	298.0	289.5
85°	53.0	80.2	119.0	151.8	179.2	203.5	219.3	229.3	230.7	226.4	219.3
87.5°	31.4	47.3	70.2	90.3	110.3	121.7	130.4	137.5	139.1	134.6	131.7
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P976790

CATALOG NUMBER: 24SR-LD2-C-59-UNV-L940-CD1-MR-U

**CANDELA DISTRIBUTION (continued):**

	55°	60°	65°	70°	75°	80°	85°	90°
0°	504.4	504.4	504.4	504.4	504.4	504.4	504.4	504.4
2.5°	511.5	513.1	514.4	517.3	515.8	517.3	517.3	518.6
5°	570.3	578.8	584.6	593.3	593.3	597.5	598.9	601.8
7.5°	641.9	653.5	666.2	679.1	680.7	687.8	690.7	690.7
10°	715.0	730.8	746.4	760.9	765.1	773.8	778.1	778.1
12.5°	781.0	798.1	819.5	835.4	841.1	851.2	857.0	858.3
15°	838.2	859.7	881.3	898.4	908.5	918.5	924.3	925.6
17.5°	887.0	912.7	935.6	952.8	964.4	975.8	982.9	984.4
20°	925.6	954.4	977.3	995.8	1008.7	1023.0	1028.8	1030.2
22.5°	955.7	982.9	1008.7	1028.8	1043.1	1057.5	1064.7	1066.0
25°	975.8	1004.5	1030.2	1051.8	1067.6	1080.3	1087.6	1090.3
27.5°	987.3	1017.4	1043.1	1063.1	1079.0	1093.2	1100.4	1101.9
30°	988.7	1018.8	1044.6	1064.7	1080.3	1094.8	1101.9	1104.8
32.5°	981.6	1011.6	1035.9	1056.0	1071.8	1084.7	1091.9	1094.8
35°	967.3	995.8	1020.1	1038.8	1053.1	1064.7	1073.2	1074.7
37.5°	947.2	974.4	995.8	1013.0	1027.5	1038.8	1046.0	1046.0
40°	919.8	945.7	964.4	980.0	994.5	1003.0	1011.6	1011.6
42.5°	889.7	914.2	931.4	945.7	955.7	965.7	971.5	971.5
45°	858.3	878.4	895.5	907.1	917.1	924.3	931.4	931.4
47.5°	826.9	844.0	857.0	868.3	877.0	884.1	889.7	889.7
50°	793.9	809.5	819.5	829.6	836.9	842.5	846.9	846.9
52.5°	760.9	773.8	781.0	789.4	795.2	801.0	803.9	803.9
55°	729.3	737.9	743.7	750.9	755.1	758.0	760.9	760.9
57.5°	694.9	700.7	706.3	710.8	713.6	716.3	719.2	717.9
60°	660.6	664.8	669.1	672.0	674.9	677.8	679.1	679.1
62.5°	626.1	627.6	629.0	634.8	637.7	639.0	640.5	640.5
65°	591.7	591.7	593.3	597.5	600.4	603.3	604.7	604.7
67.5°	554.5	555.9	557.4	561.7	563.2	565.9	568.8	568.8
70°	517.3	518.6	518.6	523.1	524.4	527.3	530.2	530.2
72.5°	481.4	481.4	481.4	484.3	487.2	490.1	493.0	493.0
75°	441.3	441.3	441.3	444.2	444.2	445.5	448.4	447.1
77.5°	398.3	394.0	389.8	388.3	388.3	389.8	391.2	391.2
80°	342.6	336.8	333.9	331.0	329.6	331.0	332.5	331.0
82.5°	283.7	276.6	272.3	270.8	270.8	270.8	272.3	269.4
85°	214.9	207.7	204.8	204.8	203.5	203.5	203.5	204.8
87.5°	129.0	124.6	120.4	121.7	120.4	119.0	120.4	123.2
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P976790

CATALOG NUMBER: 24SR-LD2-C-59-UNV-L940-CD1-MR-U

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room Dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.8	13.6	12.2	13.9	14.3	14.8	16.6	15.2	16.9	17.2
	3H	13.8	15.5	14.2	15.8	16.2	17.3	19.0	17.7	19.3	19.7
	4H	14.6	16.2	15.0	16.5	16.9	18.5	20.1	18.9	20.5	20.8
	6H	15.2	16.7	15.6	17.0	17.4	19.6	21.1	20.0	21.5	21.8
	8H	15.4	16.8	15.9	17.2	17.6	20.1	21.5	20.5	21.9	22.3
	12H	15.6	17.0	16.1	17.3	17.8	20.5	21.9	21.0	22.2	22.7
4H	2H	13.6	15.2	14.0	15.5	15.9	15.6	17.1	16.0	17.5	17.9
	3H	16.1	17.5	16.5	17.8	18.2	18.4	19.7	18.8	20.1	20.5
	4H	17.2	18.4	17.7	18.9	19.3	19.8	21.0	20.2	21.4	21.8
	6H	18.1	19.2	18.6	19.6	20.1	21.0	22.1	21.5	22.6	23.0
	8H	18.5	19.5	18.9	19.9	20.4	21.6	22.6	22.0	23.0	23.5
	12H	18.7	19.6	19.2	20.1	20.6	22.1	23.0	22.6	23.5	24.0
8H	4H	18.4	19.4	18.8	19.8	20.3	20.3	21.4	20.8	21.8	22.2
	6H	19.7	20.6	20.2	21.1	21.6	21.8	22.7	22.3	23.2	23.6
	8H	20.3	21.1	20.8	21.6	22.1	22.5	23.3	23.0	23.8	24.3
	12H	20.8	21.5	21.3	22.0	22.5	23.1	23.8	23.6	24.3	24.9
12H	4H	18.6	19.5	19.1	20.0	20.5	20.4	21.4	20.9	21.8	22.3
	6H	20.1	20.9	20.6	21.4	21.9	22.0	22.8	22.5	23.3	23.8
	8H	20.9	21.6	21.4	22.1	22.6	22.8	23.5	23.3	24.0	24.5

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2506-457-7

Test Date: 07/02/2025

Luminaire Tested: 24SR-LD2-64-C-UNV-L940-CD1-U

Data in this report applies to families of products including 24SR-LD2-64-C-UNV-L940-CD1-U

**Test Information**

Test Method: LM-79-2019  
 Report Number: SP1-2506-457-7  
 Test Lab: COOPER LIGHTING SOLUTIONS  
 Photometer: SP1 - 76IN SPHERE  
 Measurement Geometry: 4π  
 Issue Date: 07/02/2025  
 Manufacturer: COOPER LIGHTING SOLUTIONS  
 Product Line: Metalux  
 Catalog Number: **24SR-LD2-64-C-UNV-L940-CD1-U**  
 Description: 2X4 SKYRIDGE 6400LM Fixture with new LTN chip

**Spectral Parameters**

CCT (K): 3850  
 CIE u': 0.2283  
 CIE v': 0.5037  
 Duv: -0.0006  
 CIE x: 0.3868  
 CIE y: 0.3794  
 CIE z: 0.2338  
 Peak Wavelength (nm): 630  
 Dominant Wavelength (nm): 579  
 Purity: 29.94798  
 Rf: 91.3  
 Rg: 99.8

CRI (Ra): 94.0  
 R1: 95.3  
 R2: 96.3  
 R3: 95.7  
 R4: 95.2  
 R5: 94.4  
 R6: 94.3  
 R7: 94.1  
 R8: 86.7  
 R9: 65.3  
 R10: 89.6  
 R11: 95.5  
 R12: 76.1  
 R13: 95.5  
 R14: 96.8  
 R15: 92.3



**Test Conditions**

Stabilization Time: 38M  
 Operation Time: 1H 38M  
 Sphere Temperature (°C): 24.4

REPORT NUMBER: SP1-2506-457-7

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-457-7

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2506-457-7

**Photopic Flux vs. Wavelength**



**Photopic Lumens: NR**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	173	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	201	NR	625	342	NR	755	7	NR	885	0	NR
370	0	NR	500	231	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	253	NR	635	692	NR	765	5	NR	895	0	NR
380	0	NR	510	268	NR	640	226	NR	770	4	NR	900	0	NR
385	1	NR	515	277	NR	645	214	NR	775	4	NR	905	0	NR
390	1	NR	520	284	NR	650	190	NR	780	3	NR	910	0	NR
395	3	NR	525	290	NR	655	160	NR	785	3	NR	915	0	NR
400	4	NR	530	296	NR	660	136	NR	790	2	NR	920	0	NR
405	5	NR	535	303	NR	665	115	NR	795	2	NR	925	0	NR
410	8	NR	540	310	NR	670	106	NR	800	2	NR	930	0	NR
415	13	NR	545	316	NR	675	87	NR	805	2	NR	935	0	NR
420	22	NR	550	323	NR	680	75	NR	810	1	NR	940	0	NR
425	37	NR	555	330	NR	685	64	NR	815	1	NR	945	0	NR
430	62	NR	560	335	NR	690	55	NR	820	1	NR	950	0	NR
435	102	NR	565	340	NR	695	47	NR	825	1	NR	955	0	NR
440	164	NR	570	342	NR	700	40	NR	830	1	NR	960	0	NR
445	281	NR	575	345	NR	705	34	NR	835	1	NR	965	0	NR
450	423	NR	580	348	NR	710	29	NR	840	1	NR	970	0	NR
455	384	NR	585	350	NR	715	25	NR	845	1	NR	975	0	NR
460	256	NR	590	351	NR	720	21	NR	850	0	NR	980	0	NR
465	208	NR	595	348	NR	725	17	NR	855	0	NR	985	0	NR
470	169	NR	600	348	NR	730	14	NR	860	0	NR	990	0	NR
475	135	NR	605	347	NR	735	12	NR	865	0	NR	995	0	NR
480	133	NR	610	379	NR	740	11	NR	870	0	NR	1000	0	NR
485	149	NR	615	406	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-7

**Scotopic Flux vs. Wavelength**



**Scotopic Lumens: NR**

**S/P: 1.74**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	173	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	201	NR	625	342	NR	755	7	NR	885	0	NR
370	0	NR	500	231	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	253	NR	635	692	NR	765	5	NR	895	0	NR
380	0	NR	510	268	NR	640	226	NR	770	4	NR	900	0	NR
385	1	NR	515	277	NR	645	214	NR	775	4	NR	905	0	NR
390	1	NR	520	284	NR	650	190	NR	780	3	NR	910	0	NR
395	3	NR	525	290	NR	655	160	NR	785	3	NR	915	0	NR
400	4	NR	530	296	NR	660	136	NR	790	2	NR	920	0	NR
405	5	NR	535	303	NR	665	115	NR	795	2	NR	925	0	NR
410	8	NR	540	310	NR	670	106	NR	800	2	NR	930	0	NR
415	13	NR	545	316	NR	675	87	NR	805	2	NR	935	0	NR
420	22	NR	550	323	NR	680	75	NR	810	1	NR	940	0	NR
425	37	NR	555	330	NR	685	64	NR	815	1	NR	945	0	NR
430	62	NR	560	335	NR	690	55	NR	820	1	NR	950	0	NR
435	102	NR	565	340	NR	695	47	NR	825	1	NR	955	0	NR
440	164	NR	570	342	NR	700	40	NR	830	1	NR	960	0	NR
445	281	NR	575	345	NR	705	34	NR	835	1	NR	965	0	NR
450	423	NR	580	348	NR	710	29	NR	840	1	NR	970	0	NR
455	384	NR	585	350	NR	715	25	NR	845	1	NR	975	0	NR
460	256	NR	590	351	NR	720	21	NR	850	0	NR	980	0	NR
465	208	NR	595	348	NR	725	17	NR	855	0	NR	985	0	NR
470	169	NR	600	348	NR	730	14	NR	860	0	NR	990	0	NR
475	135	NR	605	347	NR	735	12	NR	865	0	NR	995	0	NR
480	133	NR	610	379	NR	740	11	NR	870	0	NR	1000	0	NR
485	149	NR	615	406	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2506-457-7

**Melanopic Flux vs. Wavelength**



**Melanopic Lumens: NR**

**M/P: 3.6**


λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	173	NR	620	343	NR	750	8	NR	880	0	NR
365	0	NR	495	201	NR	625	342	NR	755	7	NR	885	0	NR
370	0	NR	500	231	NR	630	1000	NR	760	6	NR	890	0	NR
375	0	NR	505	253	NR	635	692	NR	765	5	NR	895	0	NR
380	0	NR	510	268	NR	640	226	NR	770	4	NR	900	0	NR
385	1	NR	515	277	NR	645	214	NR	775	4	NR	905	0	NR
390	1	NR	520	284	NR	650	190	NR	780	3	NR	910	0	NR
395	3	NR	525	290	NR	655	160	NR	785	3	NR	915	0	NR
400	4	NR	530	296	NR	660	136	NR	790	2	NR	920	0	NR
405	5	NR	535	303	NR	665	115	NR	795	2	NR	925	0	NR
410	8	NR	540	310	NR	670	106	NR	800	2	NR	930	0	NR
415	13	NR	545	316	NR	675	87	NR	805	2	NR	935	0	NR
420	22	NR	550	323	NR	680	75	NR	810	1	NR	940	0	NR
425	37	NR	555	330	NR	685	64	NR	815	1	NR	945	0	NR
430	62	NR	560	335	NR	690	55	NR	820	1	NR	950	0	NR
435	102	NR	565	340	NR	695	47	NR	825	1	NR	955	0	NR
440	164	NR	570	342	NR	700	40	NR	830	1	NR	960	0	NR
445	281	NR	575	345	NR	705	34	NR	835	1	NR	965	0	NR
450	423	NR	580	348	NR	710	29	NR	840	1	NR	970	0	NR
455	384	NR	585	350	NR	715	25	NR	845	1	NR	975	0	NR
460	256	NR	590	351	NR	720	21	NR	850	0	NR	980	0	NR
465	208	NR	595	348	NR	725	17	NR	855	0	NR	985	0	NR
470	169	NR	600	348	NR	730	14	NR	860	0	NR	990	0	NR
475	135	NR	605	347	NR	735	12	NR	865	0	NR	995	0	NR
480	133	NR	610	379	NR	740	11	NR	870	0	NR	1000	0	NR
485	149	NR	615	406	NR	745	9	NR	875	0	NR			

**Summary**

$R_f = 91.3$   
 $R_g = 99.8$   
 $CIE R_a = 94.0$   
 $R_9 = 65.3$



**Color Vector Graphics**

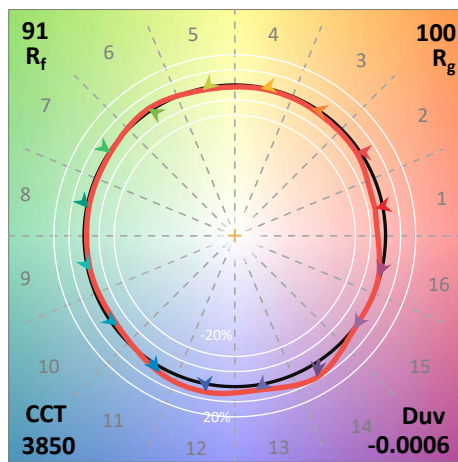


**Individual Sample Fidelity Index ( $R_{f,i}$ )**


CES01 = 86	CES26 = 93	CES51 = 98	CES76 = 87
CES02 = 62	CES27 = 91	CES52 = 99	CES77 = 88
CES03 = 31	CES28 = 96	CES53 = 97	CES78 = 83
CES04 = 69	CES29 = 96	CES54 = 94	CES79 = 93
CES05 = 49	CES30 = 93	CES55 = 92	CES80 = 92
CES06 = 50	CES31 = 96	CES56 = 95	CES81 = 79
CES07 = 42	CES32 = 88	CES57 = 94	CES82 = 96
CES08 = 41	CES33 = 99	CES58 = 95	CES83 = 95
CES09 = 29	CES34 = 93	CES59 = 97	CES84 = 94
CES10 = 74	CES35 = 96	CES60 = 93	CES85 = 81
CES11 = 57	CES36 = 81	CES61 = 92	CES86 = 83
CES12 = 63	CES37 = 94	CES62 = 87	CES87 = 92
CES13 = 43	CES38 = 88	CES63 = 93	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 91	CES89 = 85
CES15 = 71	CES40 = 97	CES65 = 89	CES90 = 97
CES16 = 47	CES41 = 97	CES66 = 88	CES91 = 73
CES17 = 49	CES42 = 93	CES67 = 87	CES92 = 77
CES18 = 56	CES43 = 93	CES68 = 88	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 89	CES94 = 76
CES20 = 66	CES45 = 96	CES70 = 86	CES95 = 83
CES21 = 85	CES46 = 97	CES71 = 81	CES96 = 92
CES22 = 78	CES47 = 93	CES72 = 94	CES97 = 95
CES23 = 91	CES48 = 92	CES73 = 80	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 91	CES99 = 93
CES25 = 71	CES50 = 98	CES75 = 83	



Color Rendition by Hue-Angle Bin

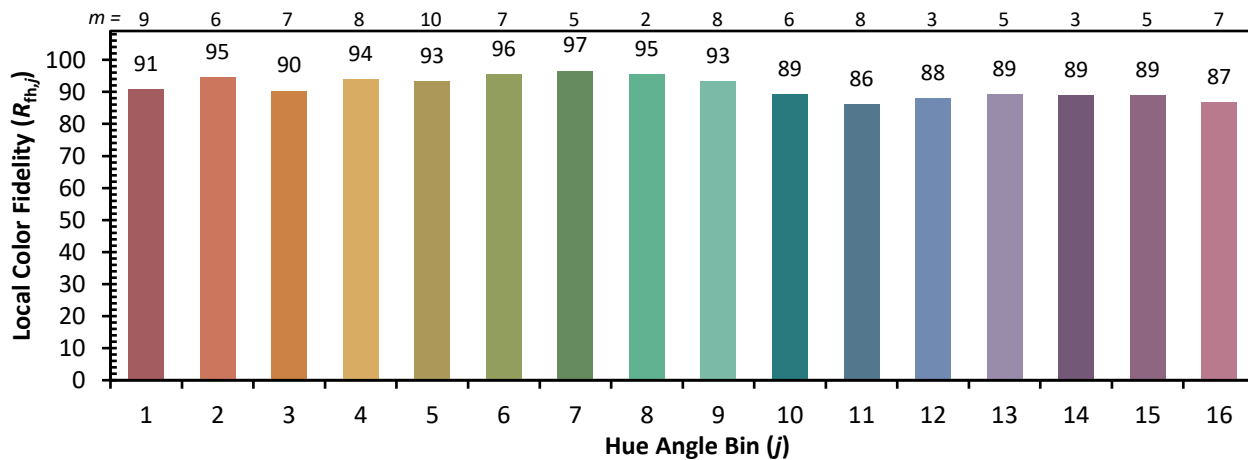

Measure Comparisons

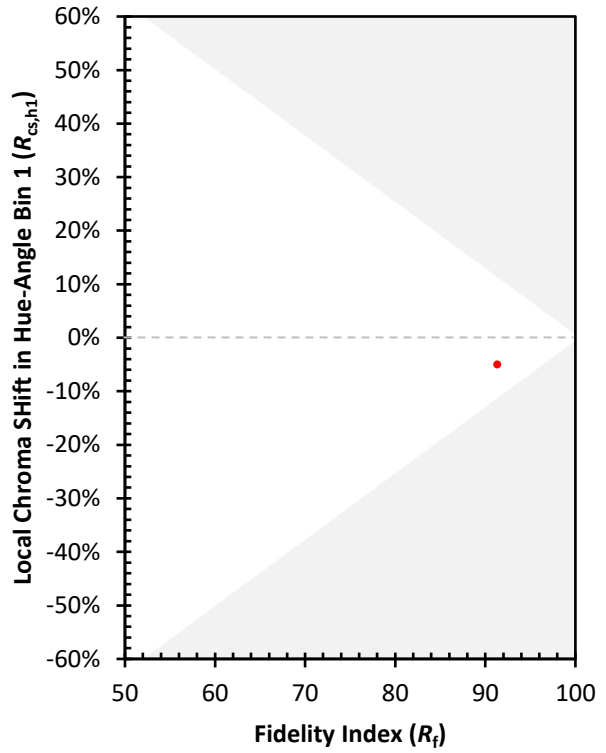

(END OF REPORT)