Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1357695

Luminaire Tested: **GSS-SB3A-735-U-T4FT**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1357695
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB3A-735-U-T4FT
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 3SQUARE 85W 70CRI 3500K FIXTURE w/ TYPE IV FORWARD THROW DISTRIBUTION OPTIC
Light Source:	(78) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	11847.5 lumens
Efficiency:	N/A
Efficacy:	139.4 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 0.5' x H: 0')
IES Classification:	Type IV - Short
BUG Rating:	B2 - U0 - G2


Input Watts (W):	85
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	11.0%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1357695
CATALOG NUMBER: GSS-SB3A-735-U-T4FT

Iso-Footcandle Lines of Horizontal Illumination

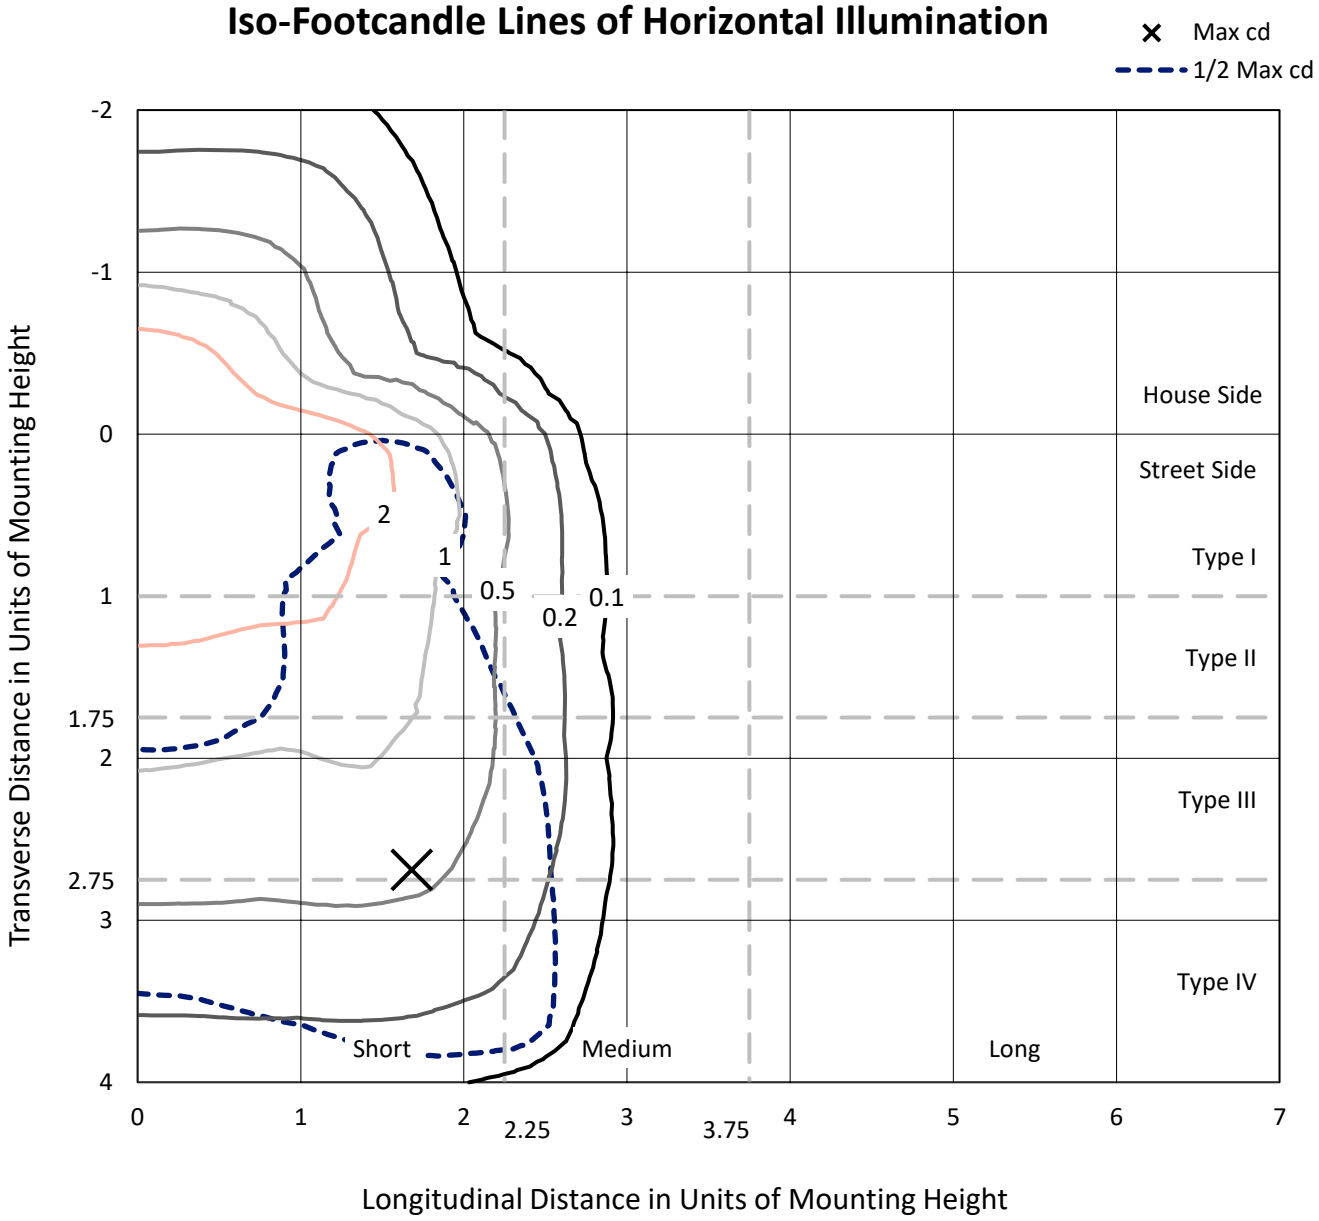


Based on 20 foot mounting height. Maximum calculated value = 4.4 fc
Type IV - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1357695
CATALOG NUMBER: GSS-SB3A-735-U-T4FT

Luminous Intensity Polar Plot

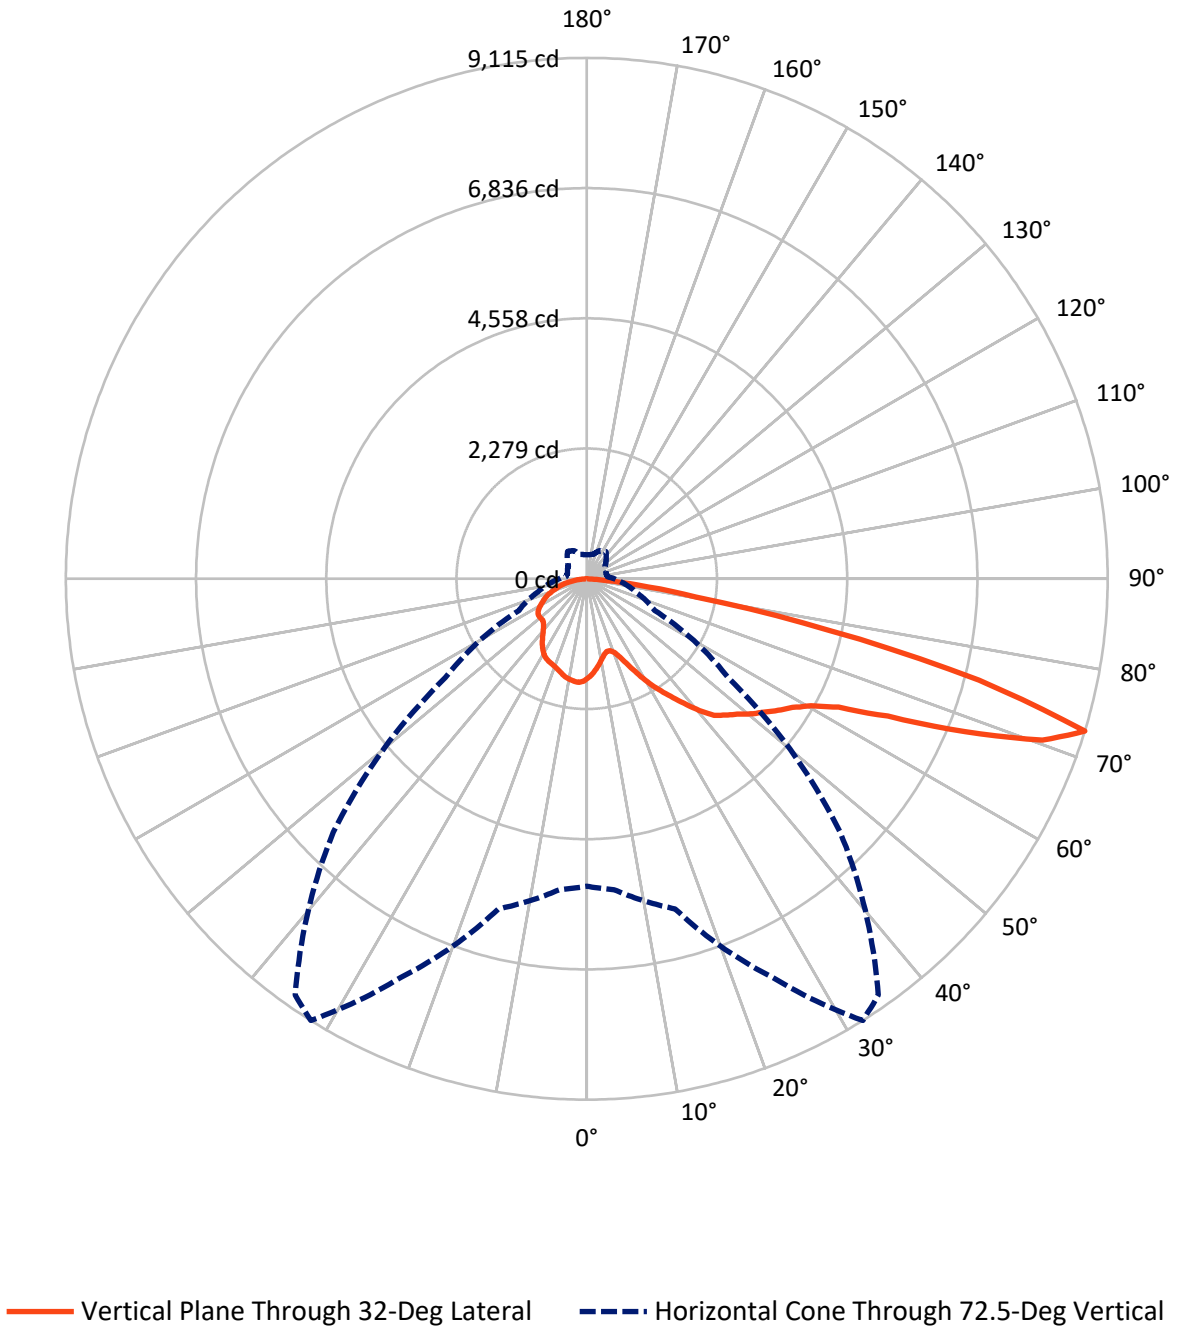

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1357695
CATALOG NUMBER: GSS-SB3A-735-U-T4FT

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	2857.2	0.0	2857.2
	% Fixture	24.1	0.0	24.1
Street Side	Lumens	8990.3	0.0	8990.3
	% Fixture	75.9	0.0	75.9
Total	Lumens	11847.5	0.0	11847.5
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	162.8	1.4
10°-20°	461.8	3.9
20°-30°	800.2	6.8
30°-40°	1264.0	10.7
40°-50°	1842.2	15.5
50°-60°	2497.3	21.1
60°-70°	2874.1	24.3
70°-80°	1798.5	15.2
80°-90°	146.7	1.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	11847.5	100.0
0°-180°	11847.5	100.0

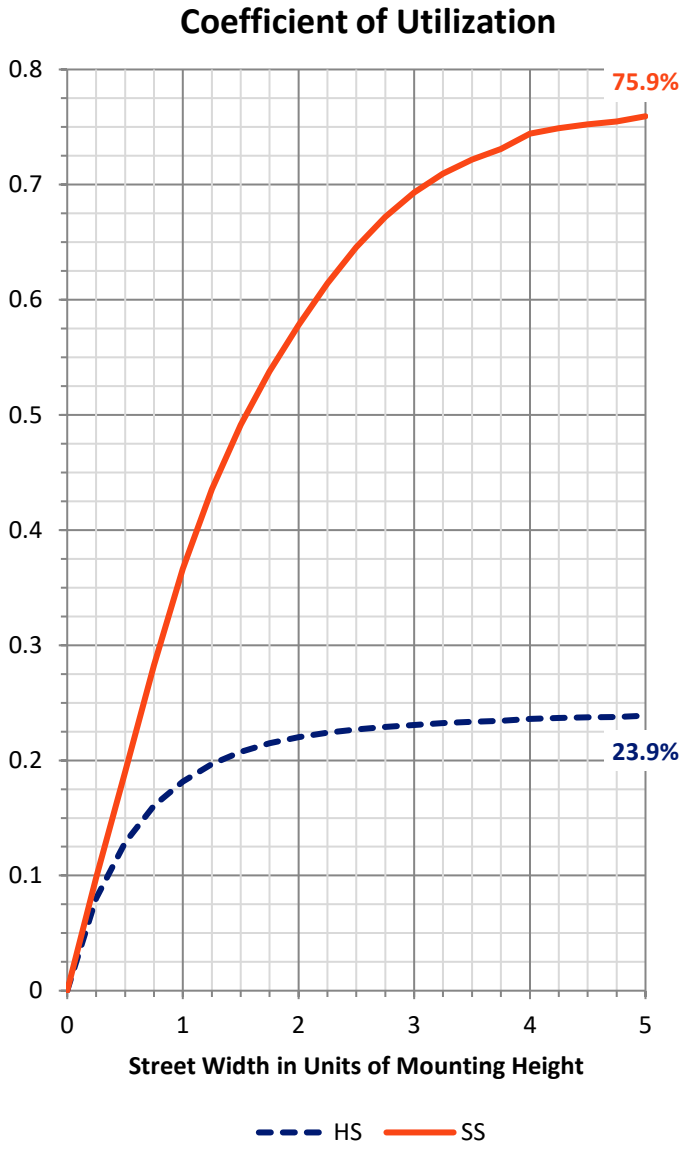

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1357695
CATALOG NUMBER: GSS-SB3A-735-U-T4FT

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	702.8	5.9			
FM	(30°-60°)	4092.6	34.5			
FH	(60°-80°)	4094.1	34.6			G2/5000
FVH	(80°-90°)	100.8	0.9			G2/225
BL	(0°-30°)	722.0	6.1	B2/1000		
BM	(30°-60°)	1510.9	12.8	B2/2500		
BH	(60°-80°)	578.5	4.9	B2/1000		G2/1000
BVH	(80°-90°)	45.9	0.4			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B2-U0-G2
Type IV Short

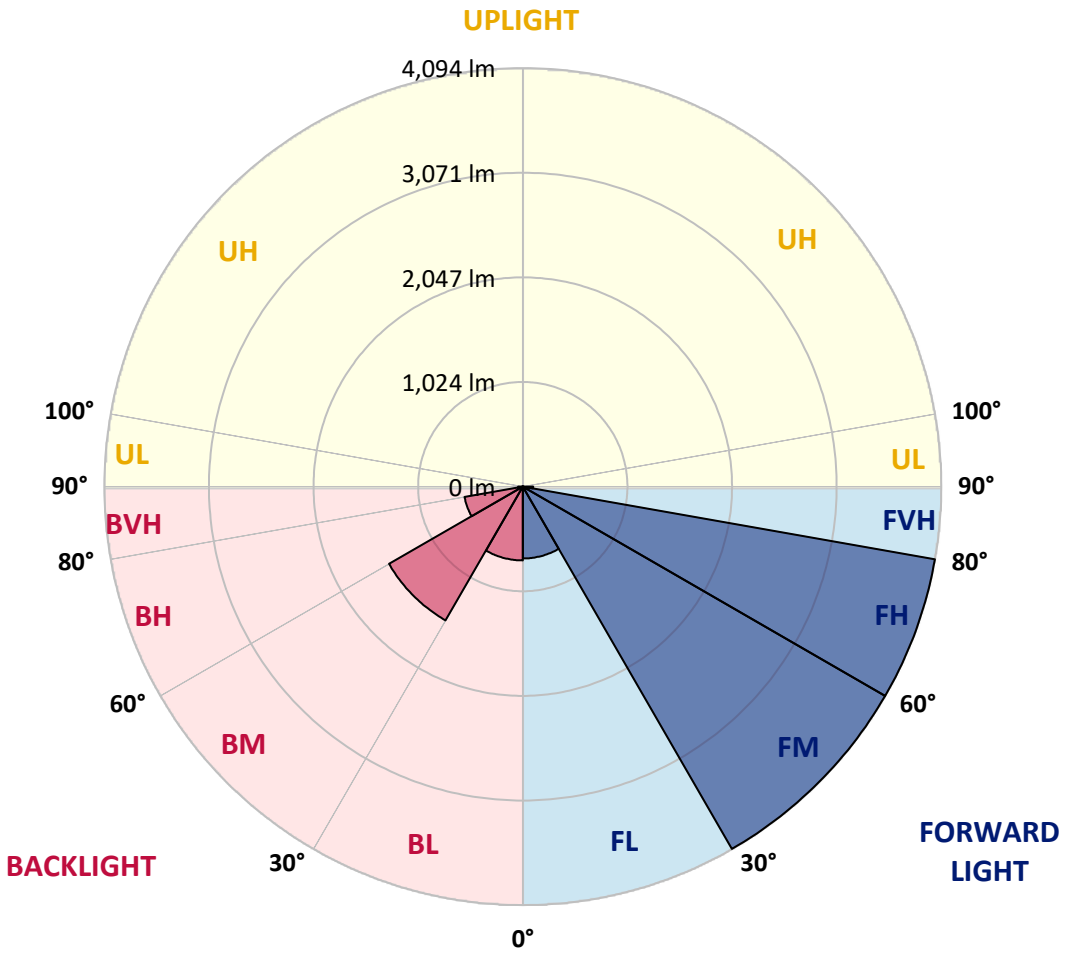

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1357695
CATALOG NUMBER: GSS-SB3A-735-U-T4FT

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	32°	35°	45°	55°	65°	75°	85°
0°	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2
2.5°	1666.7	1664.0	1677.6	1672.2	1683.0	1677.6	1677.6	1693.9	1707.6	1726.6	1740.2
5°	1574.1	1576.8	1574.1	1601.3	1601.3	1604.1	1625.9	1669.4	1702.1	1723.9	1737.5
7.5°	1454.3	1459.7	1470.6	1500.6	1519.6	1533.3	1574.1	1620.4	1674.9	1715.7	1764.7
10°	1356.2	1348.1	1372.6	1405.3	1432.5	1446.1	1514.2	1587.7	1661.3	1729.3	1770.2
12.5°	1285.4	1285.4	1299.0	1329.0	1359.0	1380.7	1457.0	1546.9	1644.9	1729.3	1805.6
15°	1271.8	1277.3	1282.7	1293.6	1320.8	1331.7	1405.3	1516.9	1625.9	1753.9	1830.1
17.5°	1318.1	1312.7	1307.2	1312.7	1323.6	1329.0	1383.5	1492.4	1615.0	1756.6	1843.7
20°	1443.4	1432.5	1424.3	1383.5	1375.3	1380.7	1402.5	1484.2	1617.7	1794.7	1900.9
22.5°	1617.7	1623.1	1590.4	1522.4	1489.7	1487.0	1459.7	1514.2	1634.0	1824.7	1949.9
25°	1868.2	1843.7	1811.0	1729.3	1661.3	1636.7	1579.6	1576.8	1669.4	1879.1	2020.7
27.5°	2121.5	2107.9	2056.1	1941.8	1865.5	1830.1	1726.6	1674.9	1721.2	1944.5	2102.4
30°	2404.7	2404.7	2320.3	2192.3	2091.5	2026.2	1903.6	1805.6	1808.3	2031.6	2219.5
32.5°	2696.1	2679.8	2598.1	2410.2	2309.4	2244.1	2080.7	1979.9	1947.2	2154.2	2380.2
35°	2905.8	2911.3	2835.0	2668.9	2524.6	2461.9	2314.9	2200.5	2127.0	2325.8	2584.5
37.5°	3096.5	3101.9	3055.6	2892.2	2764.2	2701.6	2535.5	2456.5	2344.8	2570.9	2829.6
40°	3191.8	3178.2	3164.6	3104.6	3031.1	2982.1	2810.5	2707.0	2609.0	2835.0	3096.5
42.5°	3262.6	3262.6	3240.8	3268.0	3268.0	3235.4	3101.9	3009.3	2911.3	3202.7	3379.7
45°	3344.3	3308.9	3308.9	3333.4	3401.5	3423.3	3434.2	3347.0	3257.2	3567.6	3687.4
47.5°	3428.7	3436.9	3415.1	3445.1	3540.4	3635.7	3777.3	3698.3	3600.3	4000.6	4036.0
50°	3534.9	3545.8	3545.8	3611.2	3717.4	3829.1	4177.7	4096.0	3932.5	4490.8	4420.0
52.5°	3562.2	3567.6	3649.3	3722.8	3878.1	4030.6	4578.0	4460.9	4286.6	4937.5	4755.0
55°	3513.1	3554.0	3701.1	3842.7	4066.0	4248.5	4959.3	4812.2	4545.3	5277.9	5019.2
57.5°	3624.8	3641.1	3777.3	3938.0	4248.5	4482.7	5335.1	5125.4	4725.0	5558.4	5125.4
60°	3861.7	3850.8	3970.7	4150.4	4509.9	4812.2	5740.9	5392.3	4874.8	5604.7	4915.7
62.5°	4392.8	4338.3	4381.9	4545.3	4948.4	5359.6	6157.5	5610.1	4782.2	5147.2	4207.6
65°	5111.8	5095.4	5068.2	5239.8	5792.6	6143.9	6677.7	5563.8	4319.3	4343.8	3382.4
67.5°	5754.5	5776.3	5759.9	6217.5	7146.1	7467.5	7230.6	5228.9	3578.5	3099.2	2176.0
70°	6002.3	6045.9	6334.6	7206.0	8458.8	8831.9	7481.1	4376.5	2478.3	1674.9	1070.3
72.5°	5381.4	5460.4	5980.5	7699.0	9115.1	8894.5	6271.9	3020.2	1307.2	882.4	596.4
75°	3720.1	3801.8	4591.6	6457.1	7091.7	6729.5	3850.8	1301.8	675.4	514.7	367.7
77.5°	1459.7	1672.2	2189.6	3603.0	4346.5	4264.8	1824.7	449.4	375.8	313.2	239.7
80°	490.2	555.6	814.3	1421.6	1928.1	2037.1	664.5	228.8	217.9	190.6	149.8
82.5°	177.0	198.8	348.6	536.5	879.6	885.1	215.1	122.6	133.4	114.4	79.0
85°	59.9	65.4	81.7	166.1	215.1	231.5	59.9	46.3	54.5	49.0	35.4
87.5°	5.4	5.4	5.4	8.2	8.2	8.2	8.2	10.9	10.9	8.2	8.2
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1357695
CATALOG NUMBER: GSS-SB3A-735-U-T4FT

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2	1740.2
2.5°	1743.0	1751.1	1756.6	1767.5	1781.1	1783.8	1794.7	1797.4	1792.0	1797.4	1792.0
5°	1759.3	1772.9	1783.8	1800.1	1811.0	1824.7	1821.9	1813.8	1813.8	1800.1	1821.9
7.5°	1781.1	1800.1	1808.3	1824.7	1827.4	1819.2	1808.3	1805.6	1778.4	1778.4	1783.8
10°	1811.0	1827.4	1835.6	1841.0	1824.7	1811.0	1789.3	1775.6	1764.7	1753.9	1756.6
12.5°	1832.8	1849.2	1849.2	1830.1	1811.0	1789.3	1770.2	1743.0	1734.8	1721.2	1721.2
15°	1846.4	1873.7	1854.6	1824.7	1786.5	1756.6	1726.6	1702.1	1691.2	1688.5	1699.4
17.5°	1881.8	1895.5	1849.2	1797.4	1756.6	1715.7	1683.0	1664.0	1650.4	1647.6	1669.4
20°	1922.7	1911.8	1832.8	1767.5	1721.2	1666.7	1639.5	1634.0	1628.6	1644.9	1644.9
22.5°	1963.6	1944.5	1816.5	1743.0	1669.4	1631.3	1606.8	1623.1	1625.9	1636.7	1647.6
25°	2023.5	1977.2	1811.0	1704.8	1609.5	1582.3	1585.0	1606.8	1612.2	1612.2	1617.7
27.5°	2088.8	2031.6	1813.8	1647.6	1549.6	1541.4	1560.5	1568.7	1576.8	1568.7	1571.4
30°	2181.4	2088.8	1800.1	1582.3	1497.9	1511.5	1522.4	1519.6	1484.2	1476.1	1481.5
32.5°	2317.6	2167.8	1789.3	1530.5	1470.6	1470.6	1459.7	1427.0	1391.6	1359.0	1369.9
35°	2472.8	2265.8	1748.4	1489.7	1443.4	1432.5	1388.9	1334.5	1269.1	1231.0	1233.7
37.5°	2636.2	2355.7	1704.8	1443.4	1399.8	1372.6	1309.9	1225.5	1160.2	1122.0	1116.6
40°	2848.6	2456.5	1639.5	1380.7	1339.9	1296.3	1225.5	1132.9	1067.6	1037.6	1053.9
42.5°	3063.8	2573.6	1563.2	1293.6	1260.9	1233.7	1154.7	1064.8	1002.2	983.1	994.0
45°	3303.4	2693.4	1484.2	1190.1	1173.8	1168.3	1100.2	1029.4	975.0	947.7	945.0
47.5°	3548.6	2818.7	1375.3	1097.5	1089.3	1124.8	1073.0	1013.1	966.8	923.2	920.5
50°	3823.6	2941.2	1228.2	980.4	1018.5	1100.2	1081.2	1015.8	936.8	868.8	857.9
52.5°	4068.7	2984.8	1073.0	887.8	964.1	1103.0	1089.3	999.5	896.0	814.3	803.4
55°	4234.8	2911.3	939.6	806.1	923.2	1083.9	1078.5	975.0	855.1	768.0	757.1
57.5°	4245.7	2696.1	811.6	738.0	857.9	1029.4	1045.8	925.9	792.5	719.0	710.8
60°	3984.3	2342.1	708.1	678.1	787.1	958.6	985.9	857.9	735.3	656.3	650.9
62.5°	3398.8	1873.7	610.0	612.8	719.0	863.3	915.1	800.7	678.1	601.9	593.7
65°	2704.3	1432.5	542.0	555.6	631.8	770.7	849.7	743.5	620.9	547.4	536.5
67.5°	1816.5	988.6	468.4	495.7	547.4	675.4	784.3	683.6	550.1	490.2	482.0
70°	866.0	574.6	403.1	435.7	468.4	571.9	689.0	599.1	492.9	443.9	441.2
72.5°	*482.0*	*367.7*	*348.6*	*373.1*	*392.2*	*479.3*	*582.8*	*542.0*	*441.2*	*422.1*	*419.4*
75°	307.7	261.4	277.8	307.7	318.6	378.5	503.8	484.8	397.6	408.5	408.5
77.5°	190.6	179.7	212.4	239.7	247.8	310.5	414.0	411.2	332.3	326.8	288.7
80°	122.6	119.8	152.5	155.2	168.8	236.9	329.5	315.9	250.6	228.8	215.1
82.5°	65.4	68.1	92.6	98.0	95.3	144.3	226.0	223.3	185.2	160.7	152.5
85°	24.5	24.5	35.4	43.6	46.3	73.5	119.8	122.6	100.8	76.3	79.0
87.5°	5.4	5.4	5.4	8.2	8.2	16.3	21.8	24.5	27.2	13.6	8.2
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

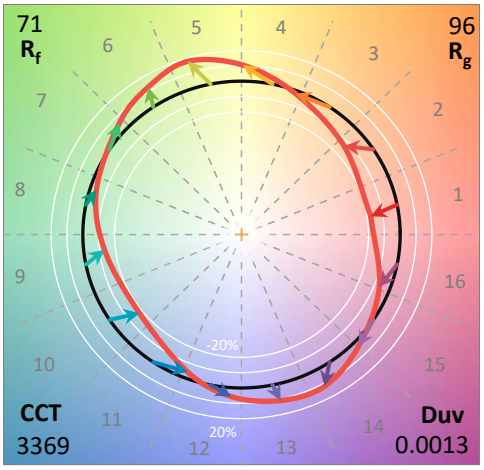

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

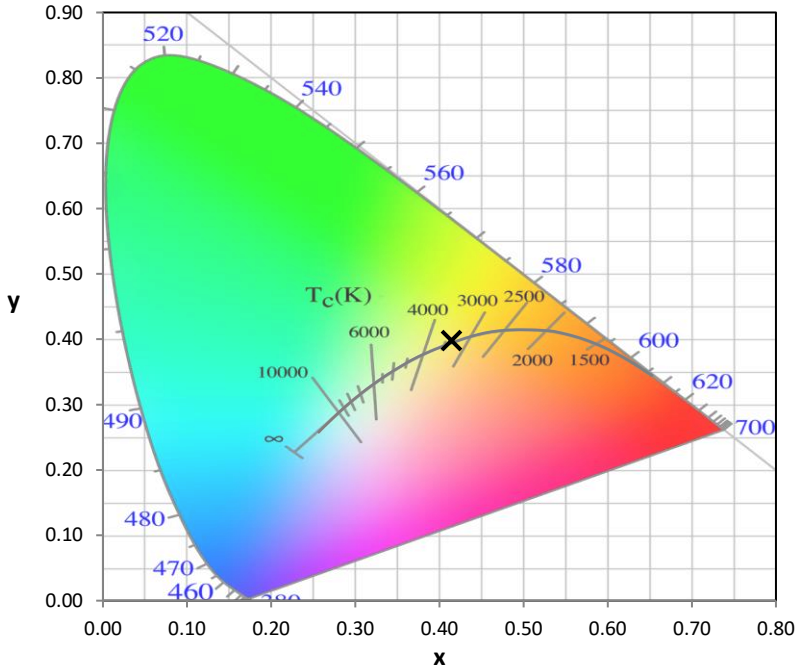

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

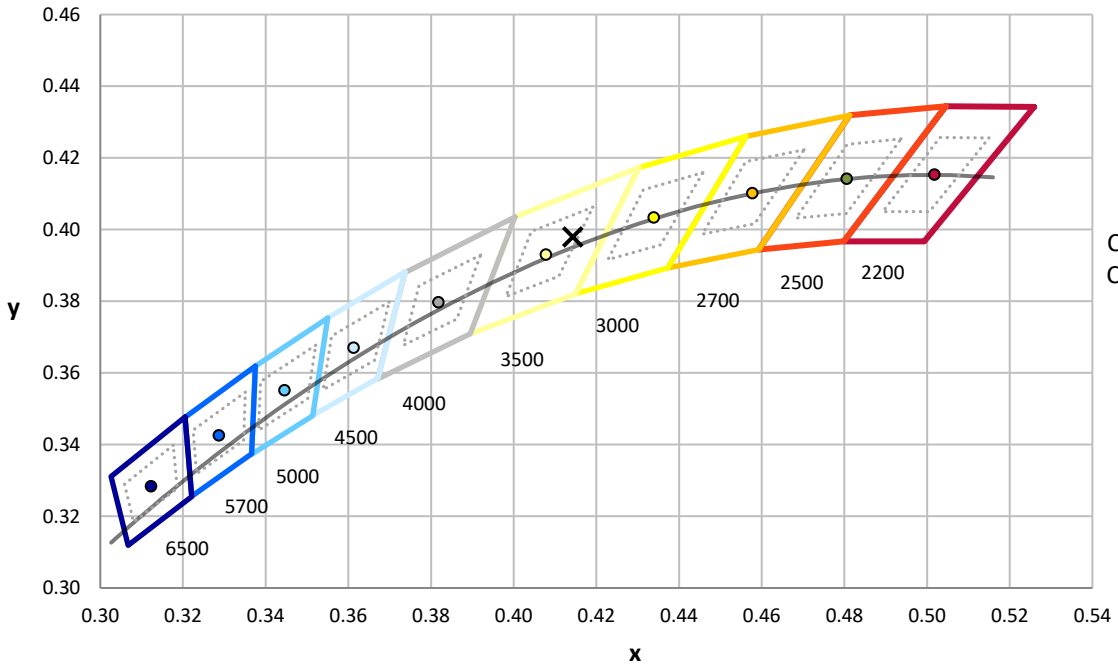


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

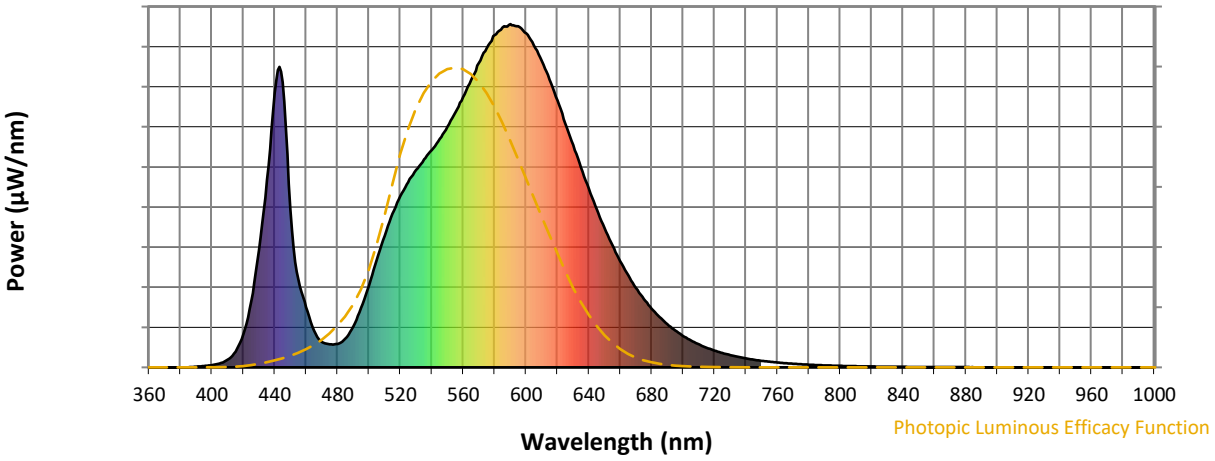


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

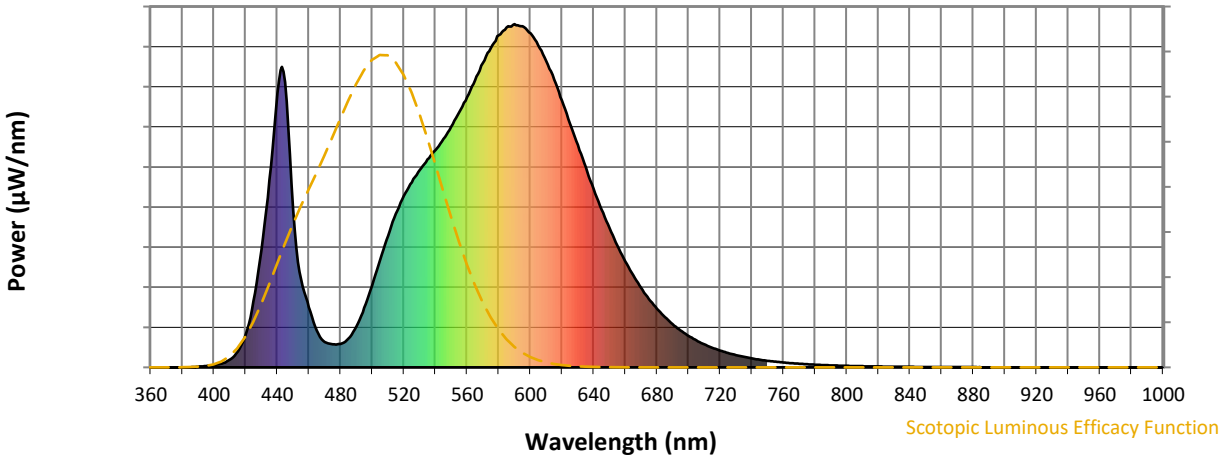


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

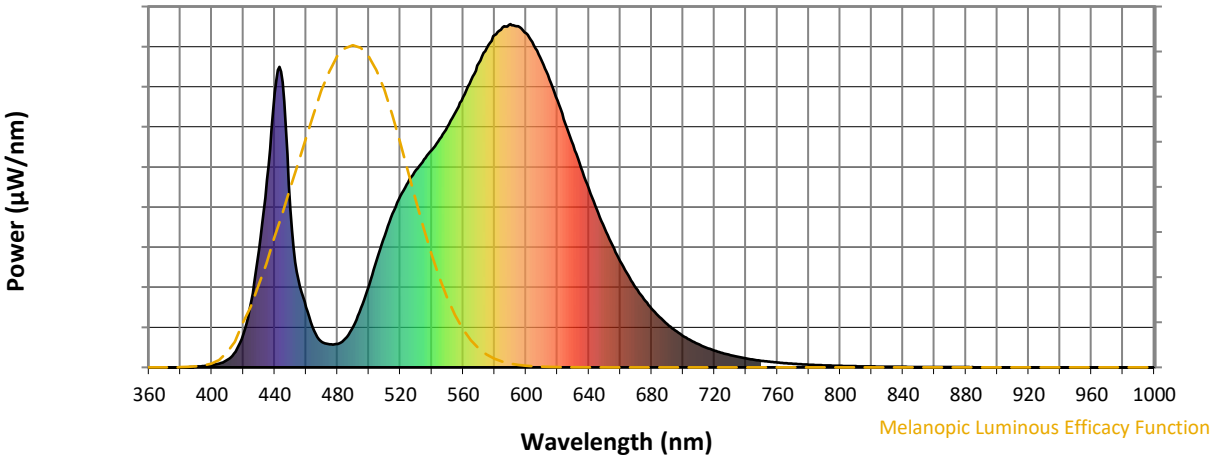

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

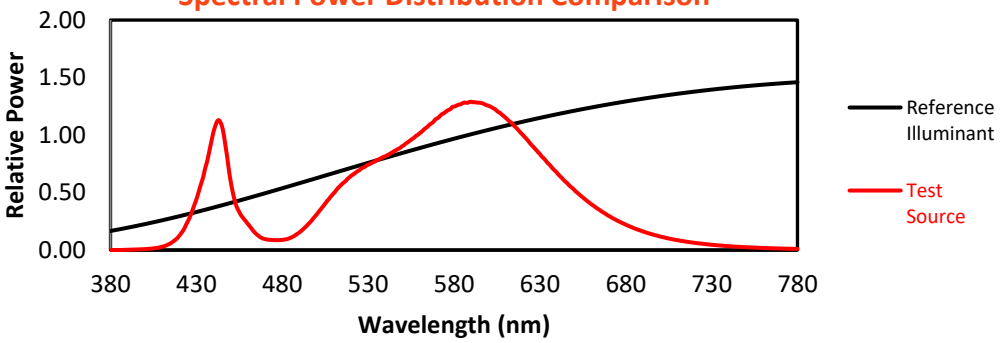


Color Vector Graphics

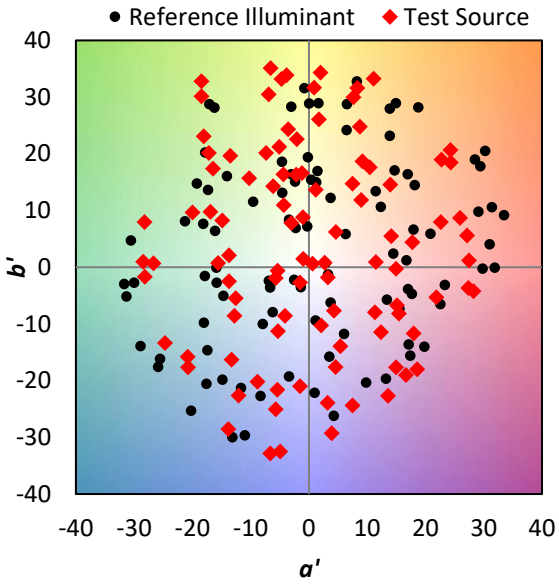

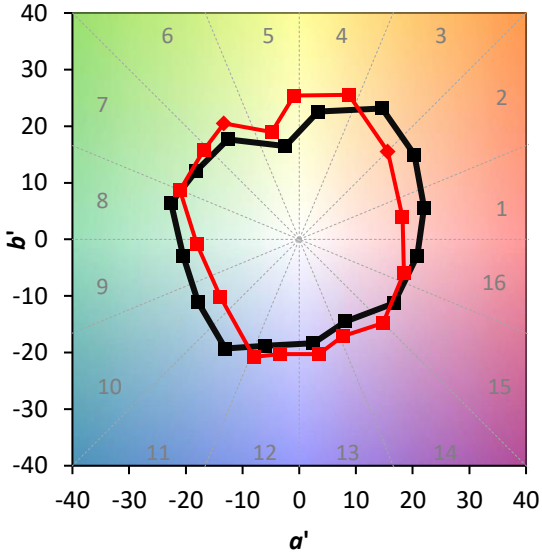

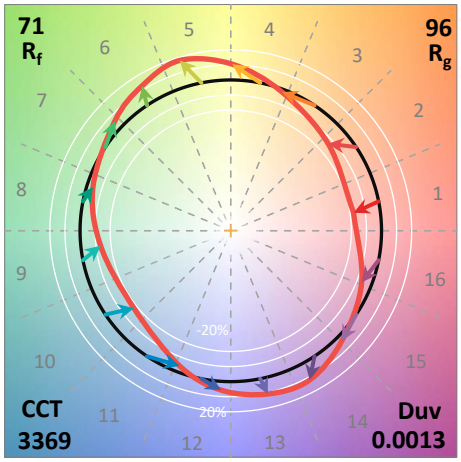

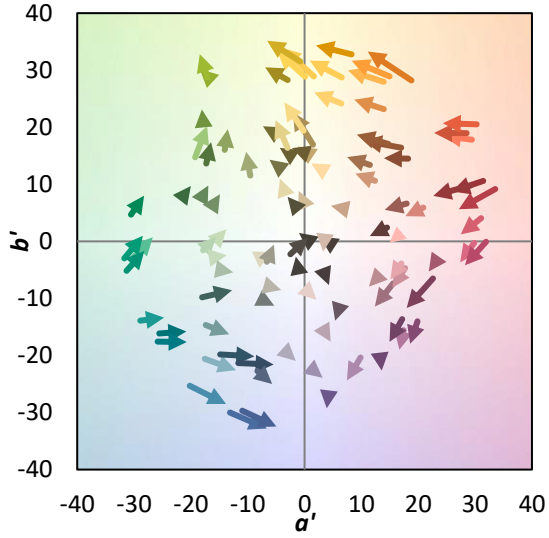


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

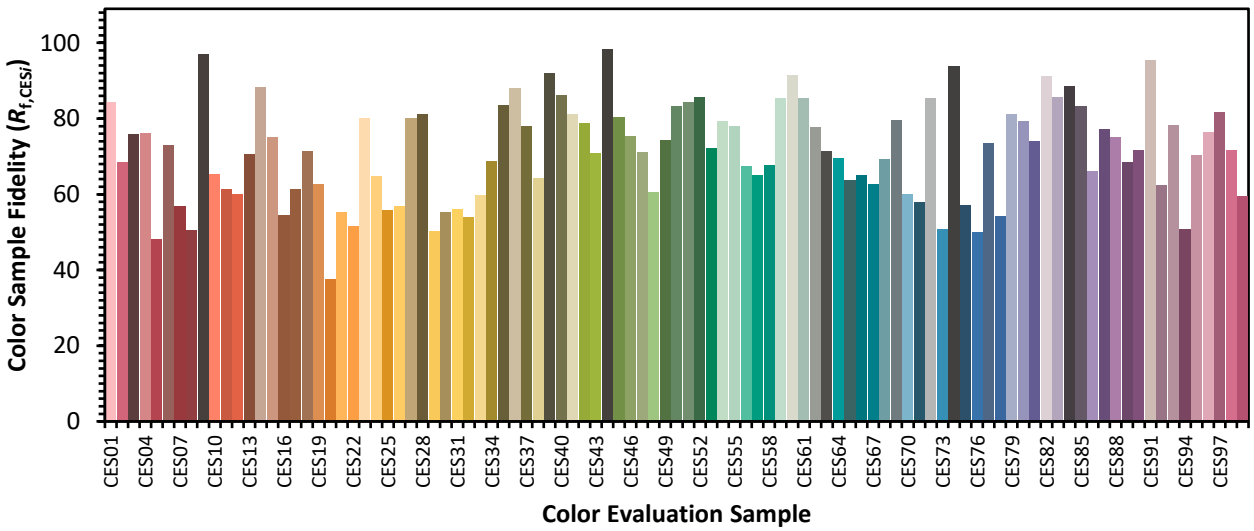



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

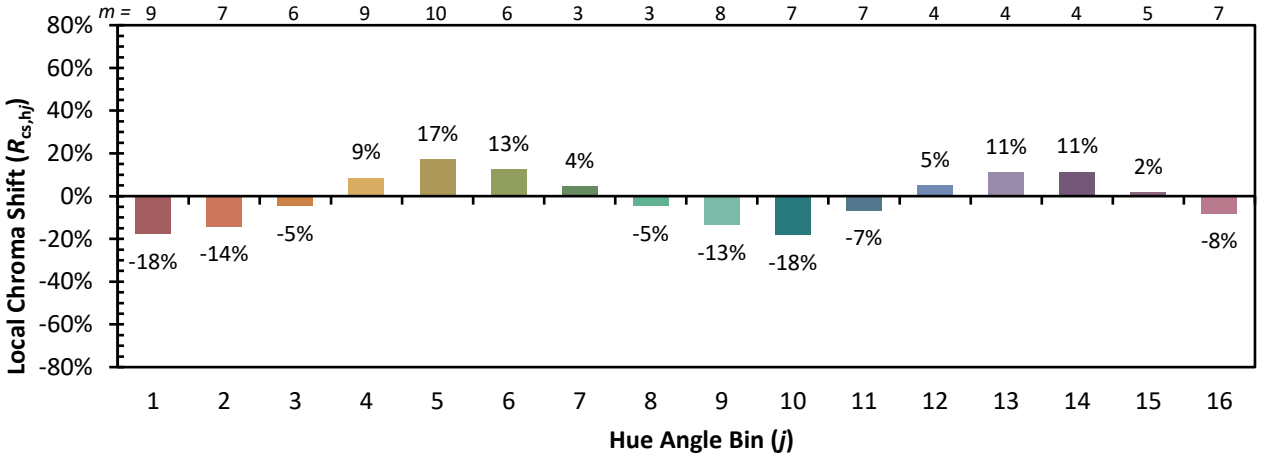

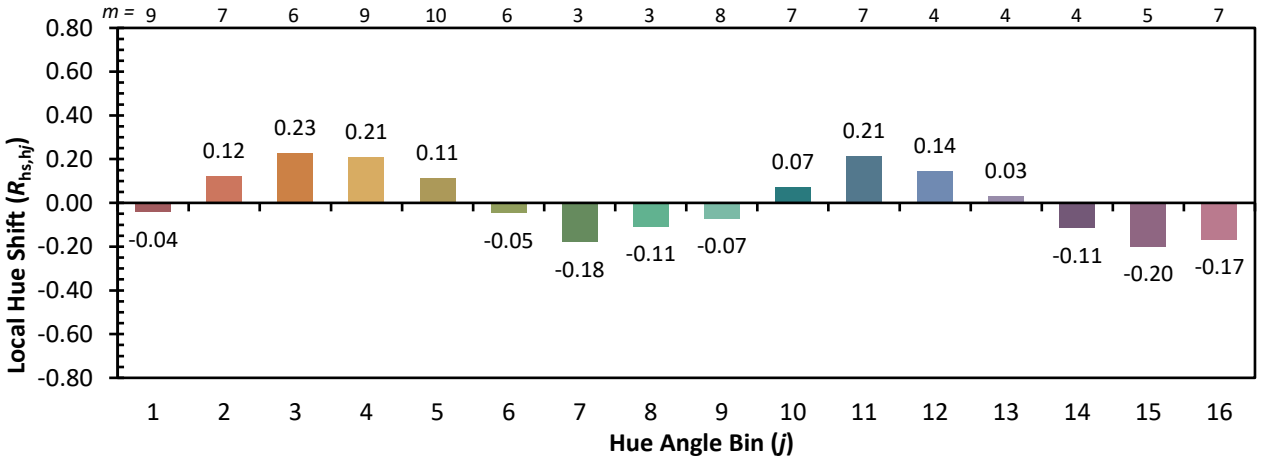


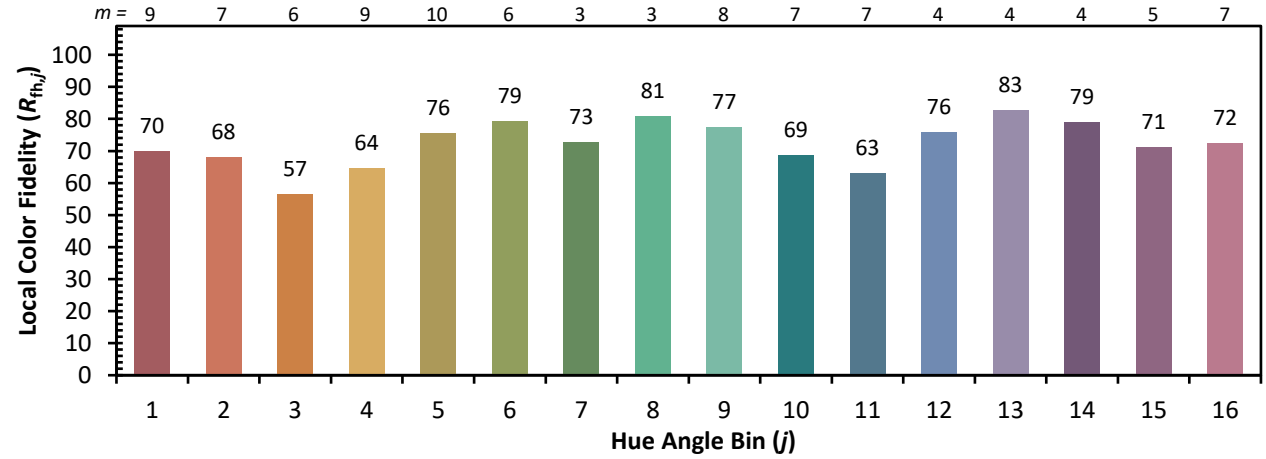


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

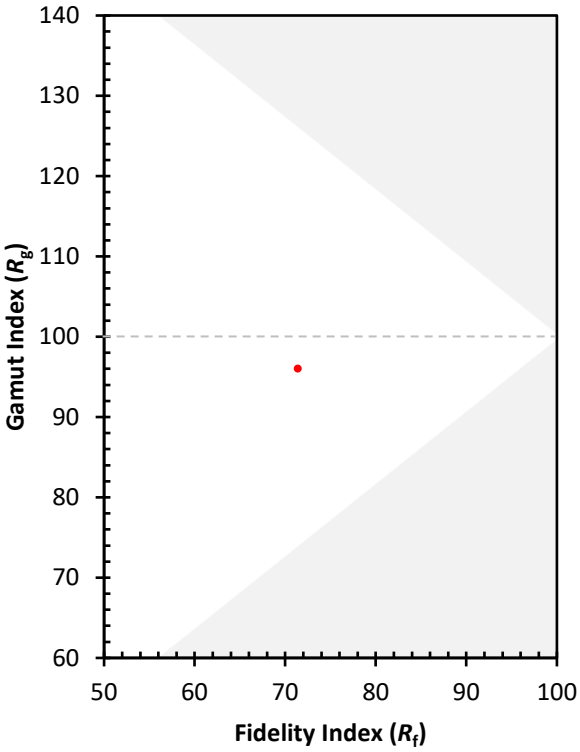

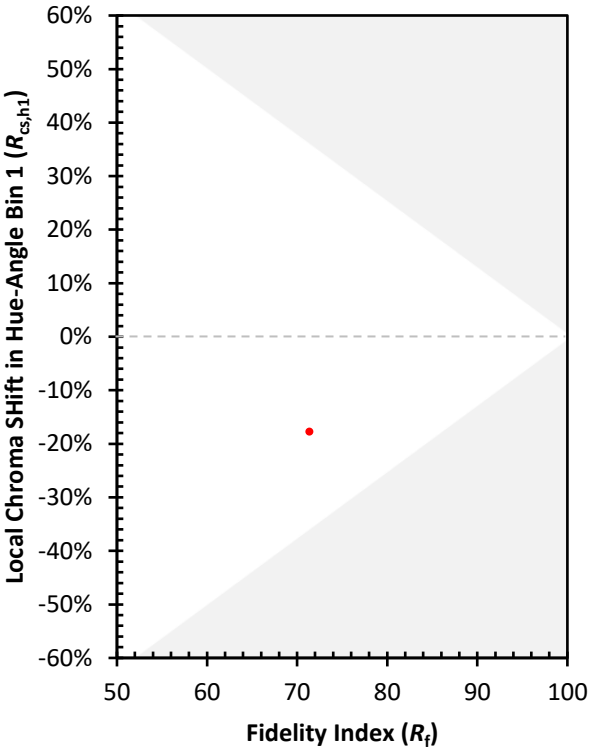

(END OF REPORT)