Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360775

Luminaire Tested: **GSS-SB5A-735-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360775
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB5A-735-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 5SQUARE 143W 70CRI 3500K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(130) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	21489.6 lumens
Efficiency:	N/A
Efficacy:	150.3 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B4 - U0 - G4


Input Watts (W):	143
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	10.5%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360775
CATALOG NUMBER: GSS-SB5A-735-U-T1

Iso-Footcandle Lines of Horizontal Illumination

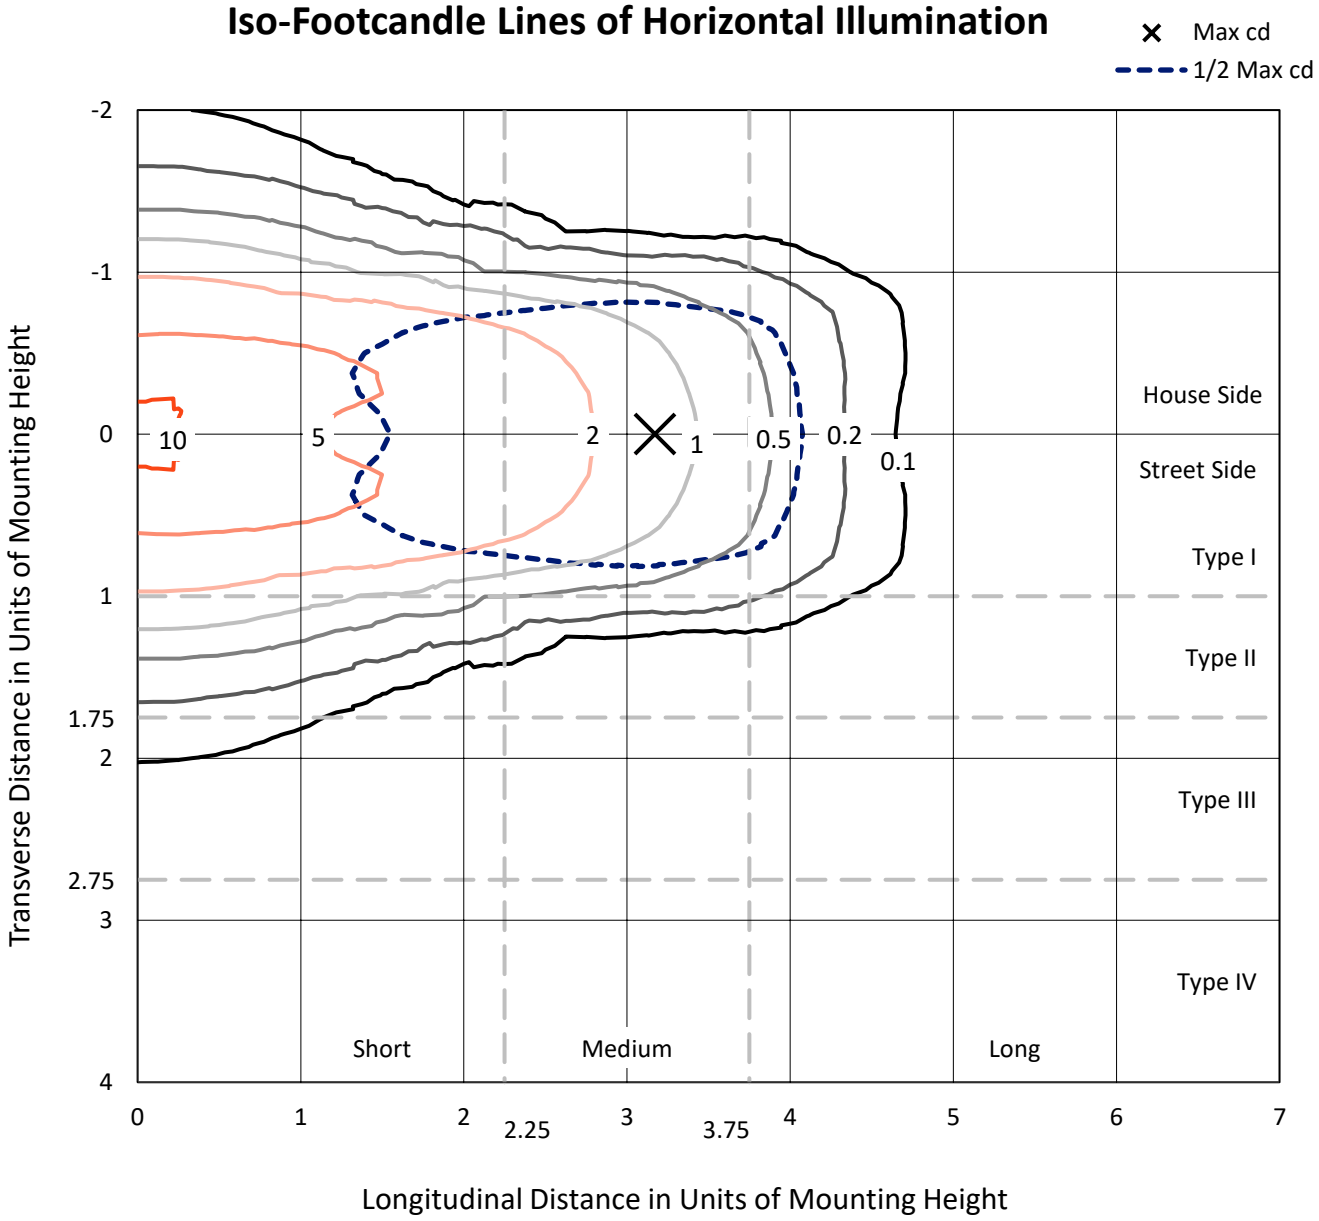


Based on 20 foot mounting height. Maximum calculated value = 10.6 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360775
CATALOG NUMBER: GSS-SB5A-735-U-T1

Luminous Intensity Polar Plot

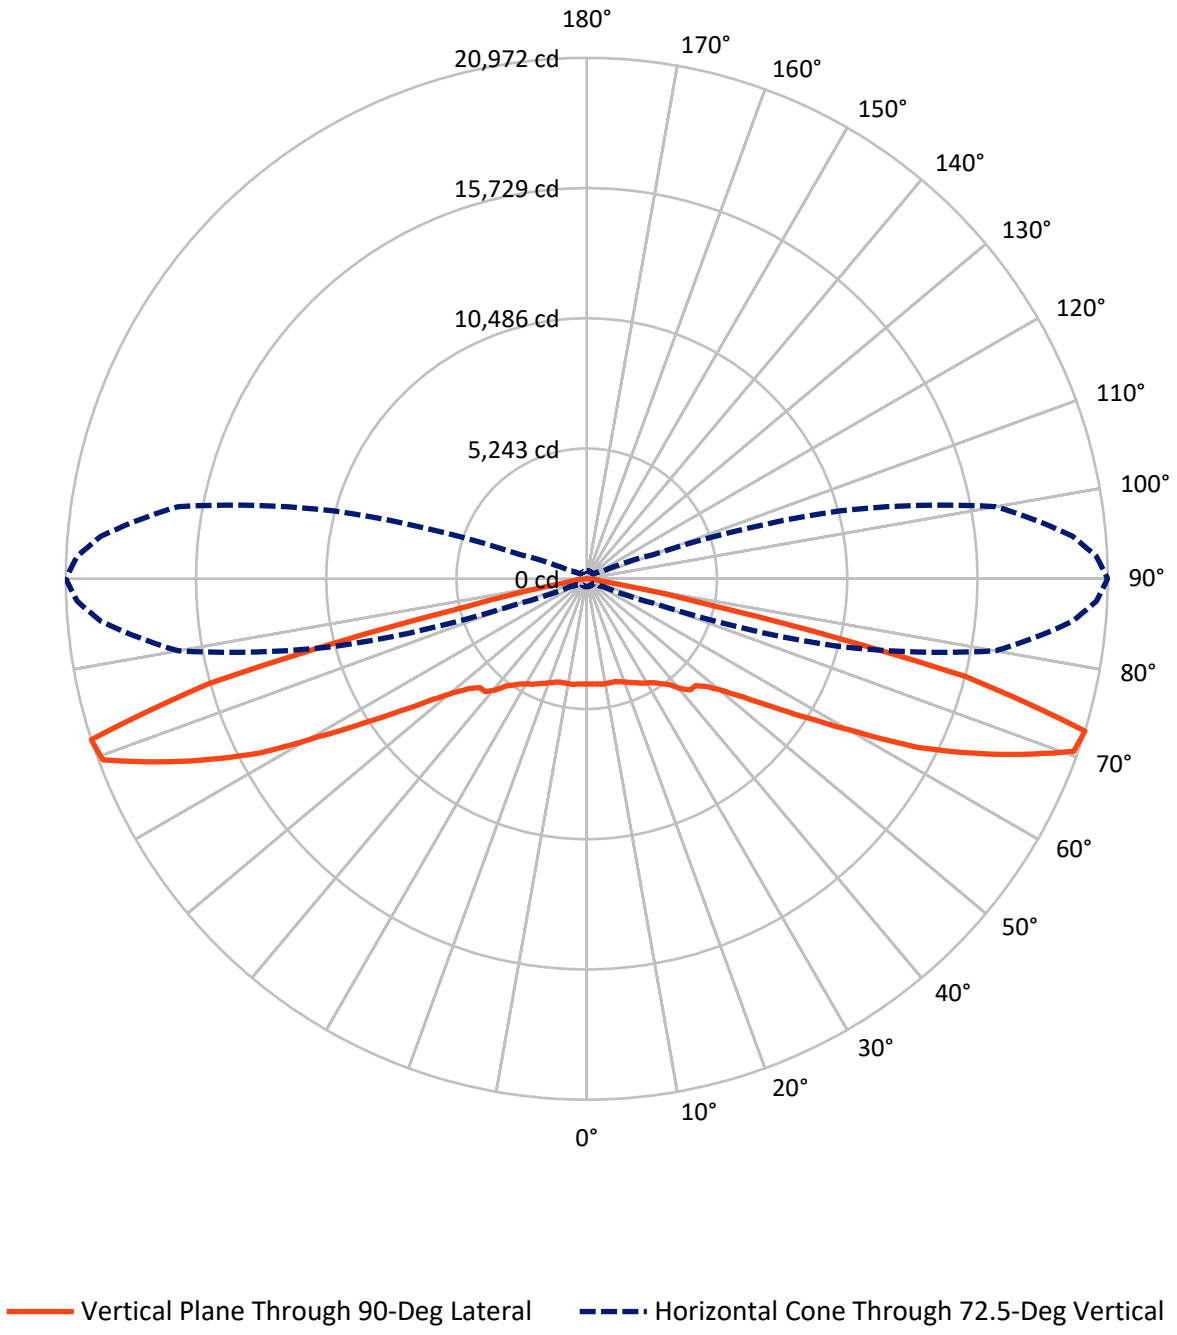

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360775
CATALOG NUMBER: GSS-SB5A-735-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	10744.8	0.0	10744.8
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	10744.8	0.0	10744.8
	% Fixture	50.0	0.0	50.0
Total	Lumens	21489.6	0.0	21489.6
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	409.8	1.9
10°-20°	1249.1	5.8
20°-30°	2087.7	9.7
30°-40°	2879.1	13.4
40°-50°	3529.4	16.4
50°-60°	4135.9	19.2
60°-70°	4592.9	21.4
70°-80°	2497.6	11.6
80°-90°	108.2	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	21489.6	100.0
0°-180°	21489.6	100.0

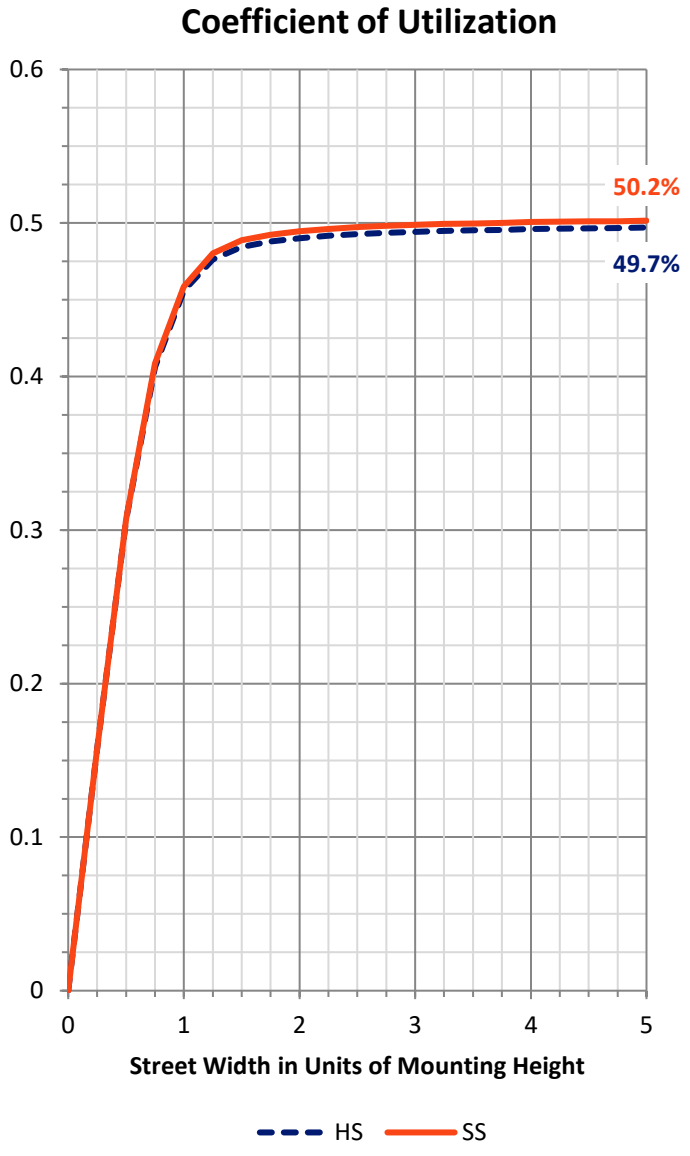

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360775
CATALOG NUMBER: GSS-SB5A-735-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1873.3	8.7			
FM	(30°-60°)	5272.2	24.5			
FH	(60°-80°)	3545.2	16.5			G2/5000
FVH	(80°-90°)	54.1	0.3			G1/100
BL	(0°-30°)	1873.3	8.7	B3/2500		
BM	(30°-60°)	5272.2	24.5	B4/8500		
BH	(60°-80°)	3545.2	16.5	B4/5000		G4/5000
BVH	(80°-90°)	54.1	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B4-U0-G4
Type I Short

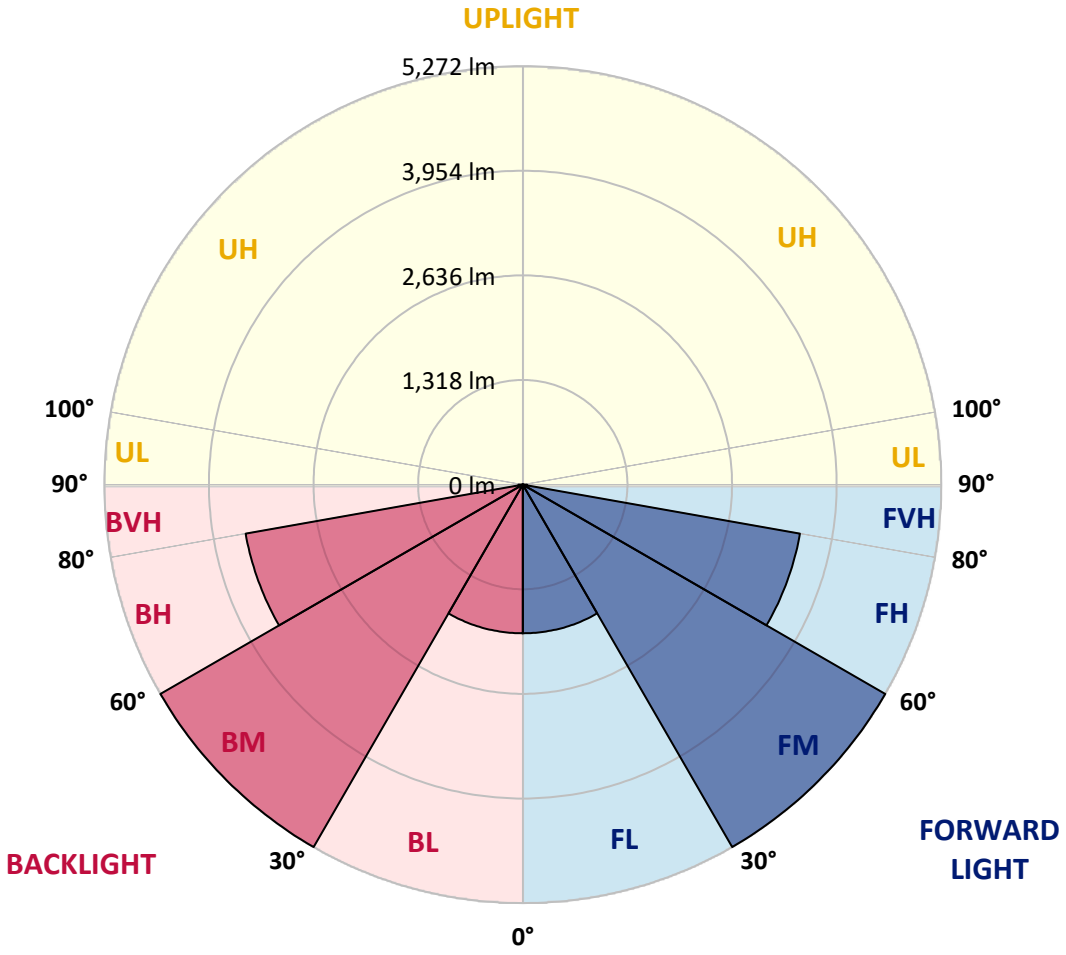

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360775
CATALOG NUMBER: GSS-SB5A-735-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	4234.0	4234.0	4234.0	4234.0	4234.0	4234.0	4234.0	4234.0	4234.0	4234.0	4234.0
2.5°	4238.7	4238.7	4224.6	4243.4	4234.0	4238.7	4243.4	4238.7	4234.0	4238.7	4243.4
5°	4262.2	4252.8	4262.2	4271.6	4257.5	4266.9	4262.2	4238.7	4252.8	4252.8	4252.8
7.5°	4304.5	4314.0	4304.5	4328.1	4314.0	4342.2	4314.0	4295.1	4290.4	4285.7	4285.7
10°	4323.4	4323.4	4318.7	4361.0	4370.4	4398.6	4379.8	4351.6	4337.5	4318.7	4299.8
12.5°	4271.6	4281.0	4304.5	4384.5	4422.2	4478.6	4464.5	4408.0	4365.7	4351.6	4323.4
15°	4215.2	4224.6	4271.6	4370.4	4459.8	4544.5	4539.8	4469.2	4417.5	4379.8	4337.5
17.5°	4125.8	4139.9	4205.8	4356.3	4516.2	4610.3	4638.6	4568.0	4511.5	4450.4	4393.9
20°	3975.2	3975.2	4092.9	4285.7	4506.8	4718.5	4793.8	4737.4	4671.5	4572.7	4497.4
22.5°	3805.9	3815.3	3932.9	4186.9	4502.1	4812.6	4958.5	4897.3	4831.4	4723.2	4610.3
25°	3636.5	3636.5	3768.2	4055.2	4441.0	4878.5	5151.3	5118.4	4986.7	4887.9	4742.1
27.5°	3481.3	3481.3	3622.4	3923.5	4337.5	4897.3	5344.2	5344.2	5198.4	5052.6	4892.6
30°	3297.8	3344.8	3504.8	3820.0	4243.4	4864.4	5485.4	5574.7	5443.0	5254.8	5019.6
32.5°	3142.6	3175.5	3340.1	3674.2	4107.0	4826.7	5645.3	5866.4	5730.0	5471.2	5207.8
35°	2959.1	2954.4	3142.6	3471.9	3914.1	4742.1	5772.3	6214.5	6082.8	5805.3	5447.7
37.5°	2719.2	2719.2	2912.0	3231.9	3730.6	4596.2	5875.8	6600.3	6501.5	6186.3	5805.3
40°	2460.4	2488.6	2658.0	2982.6	3509.5	4422.2	5875.8	6915.5	6967.3	6642.6	6247.5
42.5°	2272.2	2281.6	2436.9	2742.7	3264.9	4196.3	5800.6	7188.4	7343.6	7070.8	6558.0
45°	2074.7	2098.2	2229.9	2512.2	3010.8	3928.2	5668.8	7494.2	7743.5	7555.3	6882.6
47.5°	1834.7	1858.2	2008.8	2295.8	2770.9	3636.5	5447.7	7814.1	8336.2	8199.8	7461.2
50°	1557.2	1576.0	1717.1	2022.9	2502.8	3302.5	5170.2	8054.0	8929.0	9065.4	8336.2
52.5°	1218.4	1232.6	1383.1	1679.5	2182.9	2982.6	4779.7	8199.8	9526.5	10006.3	9507.6
55°	875.0	898.5	1030.3	1274.9	1759.5	2554.5	4314.0	8275.1	10180.4	11121.3	10961.3
57.5°	630.4	639.8	729.2	917.4	1307.8	2051.1	3716.5	8148.1	10768.4	12452.6	12786.6
60°	522.2	522.2	536.3	625.7	893.8	1449.0	3001.4	7677.6	11271.8	13798.1	14828.4
62.5°	479.9	479.9	489.3	503.4	588.1	940.9	2145.2	6722.6	11328.3	15091.8	17067.7
65°	437.5	437.5	446.9	456.3	475.1	611.6	1293.7	4920.8	10222.7	15105.9	18272.0
67.5°	399.9	399.9	404.6	409.3	418.7	446.9	710.4	2982.6	8181.0	14706.0	18733.0
70°	362.2	362.2	362.2	357.5	371.6	376.4	470.4	1514.8	5471.2	13280.6	18511.9
72.5°	*319.9*	*319.9*	*315.2*	*305.8*	*310.5*	*310.5*	*348.1*	*743.3*	*2841.5*	*10556.7*	*16714.8*
75°	272.9	277.6	258.7	249.3	244.6	249.3	277.6	423.4	1270.2	6402.7	12490.3
77.5°	230.5	239.9	211.7	192.9	188.2	188.2	216.4	263.4	545.7	2324.0	5598.3
80°	174.1	178.8	155.2	136.4	136.4	131.7	160.0	192.9	258.7	691.6	1256.1
82.5°	98.8	98.8	89.4	80.0	75.3	80.0	108.2	131.7	160.0	244.6	343.4
85°	23.5	23.5	28.2	32.9	32.9	42.3	61.2	70.6	84.7	98.8	131.7
87.5°	4.7	4.7	4.7	9.4	14.1	14.1	23.5	32.9	42.3	51.7	56.5
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360775
CATALOG NUMBER: GSS-SB5A-735-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	4234.0	4234.0	*4234.0*
2.5°	4243.4	4248.1	*4243.4*
5°	4271.6	4262.2	*4248.1*
7.5°	4276.3	4281.0	*4285.7*
10°	4295.1	4314.0	*4285.7*
12.5°	4314.0	4299.8	*4290.4*
15°	4328.1	4323.4	*4295.1*
17.5°	4379.8	4361.0	*4356.3*
20°	4459.8	4455.1	*4441.0*
22.5°	4553.9	4544.5	*4539.8*
25°	4690.3	4657.4	*4638.6*
27.5°	4803.2	4775.0	*4765.6*
30°	4916.1	4859.7	*4859.7*
32.5°	5014.9	5000.8	*4991.4*
35°	5250.1	5179.6	*5189.0*
37.5°	5537.1	5466.5	*5405.4*
40°	5941.7	5847.6	*5810.0*
42.5°	6200.4	6106.3	*6115.8*
45°	6346.3	6181.6	*6139.3*
47.5°	6741.4	6534.4	*6478.0*
50°	7381.2	7127.2	*7056.6*
52.5°	8416.2	8006.9	*7912.8*
55°	9714.6	9211.3	*9117.2*
57.5°	11492.9	10824.9	*10622.6*
60°	13656.9	12829.0	*12523.2*
62.5°	16258.5	15237.6	*14946.0*
65°	18215.5	17364.0	*16912.4*
67.5°	19782.1	19081.2	*18864.7*
70°	20713.6	20746.5	*20803.0*
72.5°	*19636.3*	*20539.5*	*20972.3*
75°	14390.8	15091.8	*15764.5*
77.5°	5560.6	5014.9	*4855.0*
80°	898.5	842.1	*870.3*
82.5°	404.6	428.1	*451.6*
85°	263.4	305.8	*324.6*
87.5°	61.2	61.2	*61.2*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

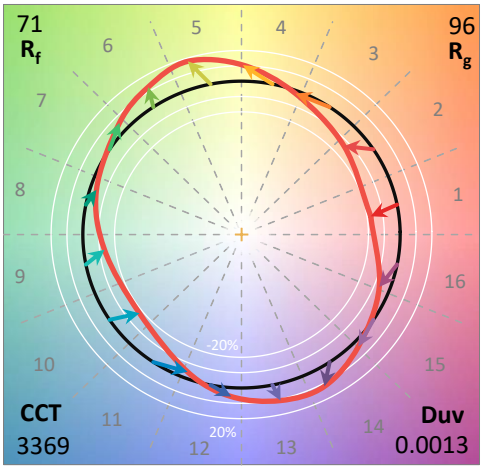

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

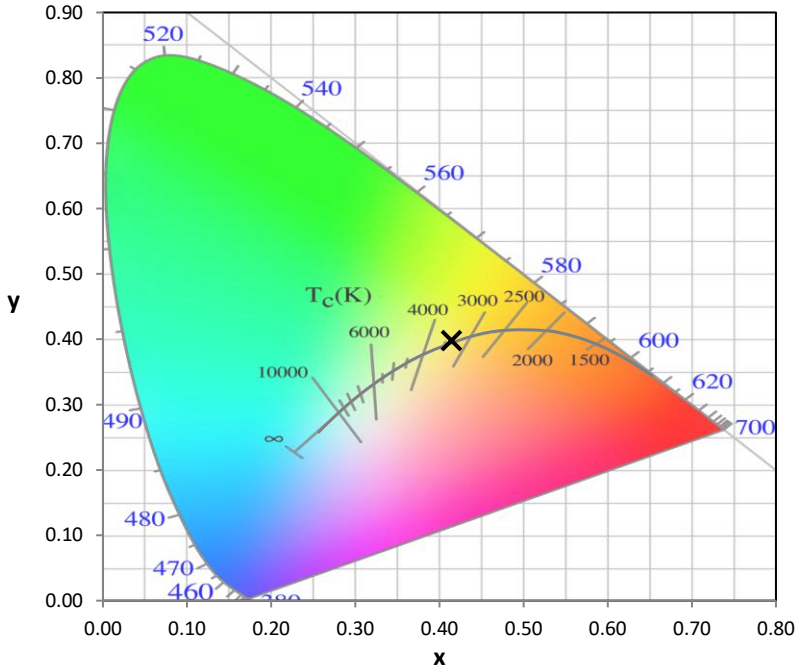

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

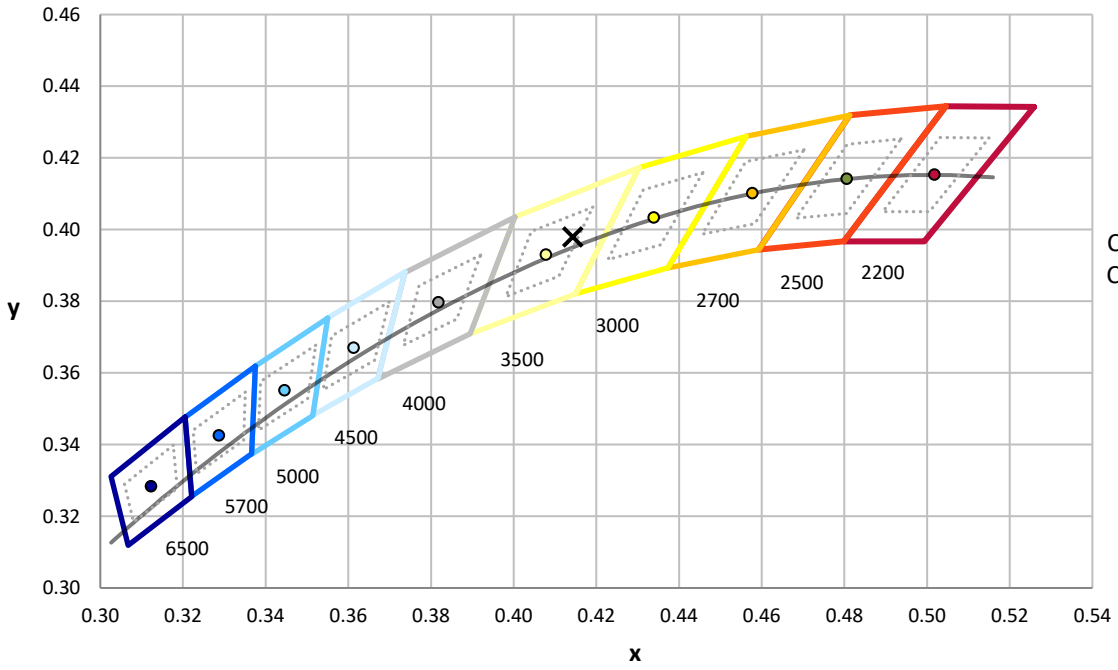


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

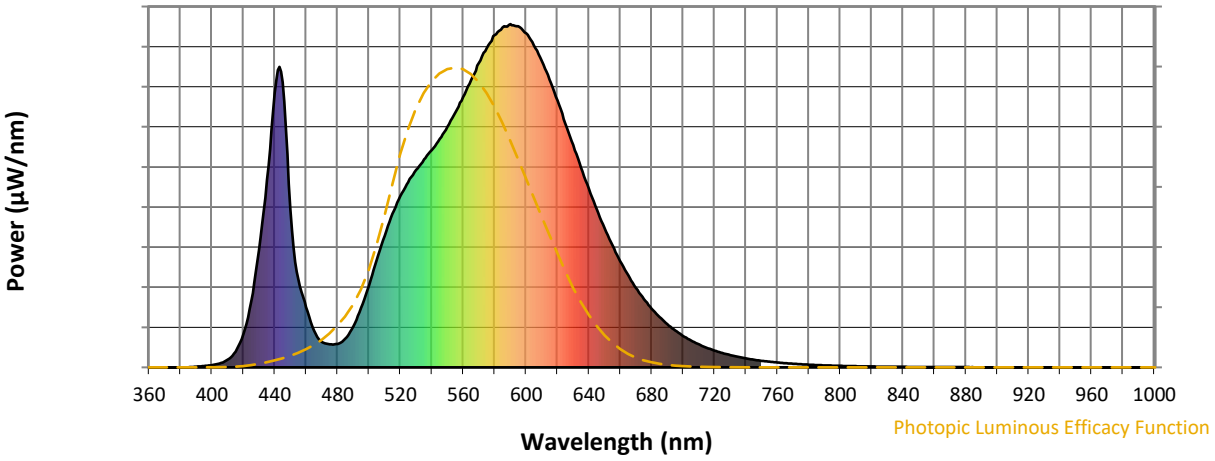


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

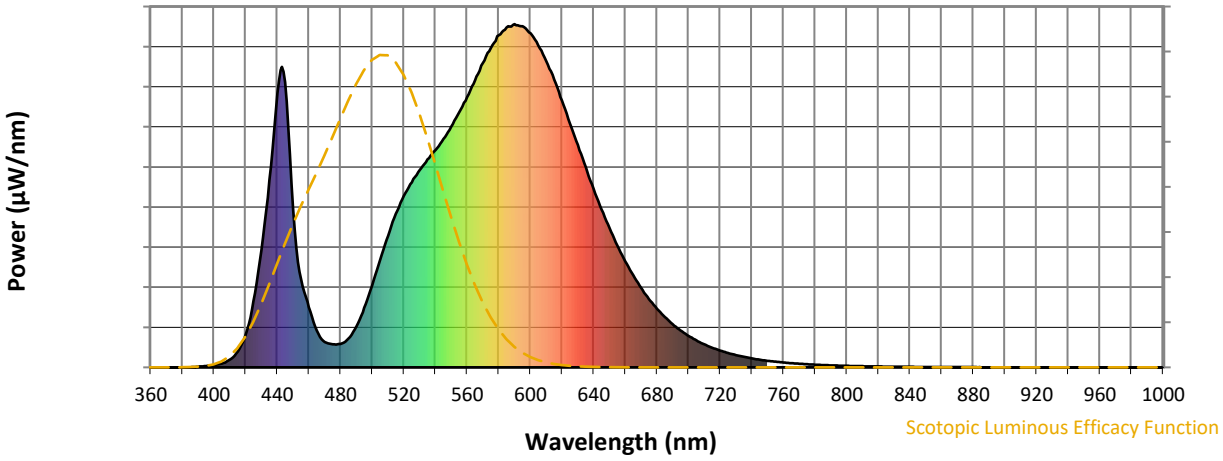


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

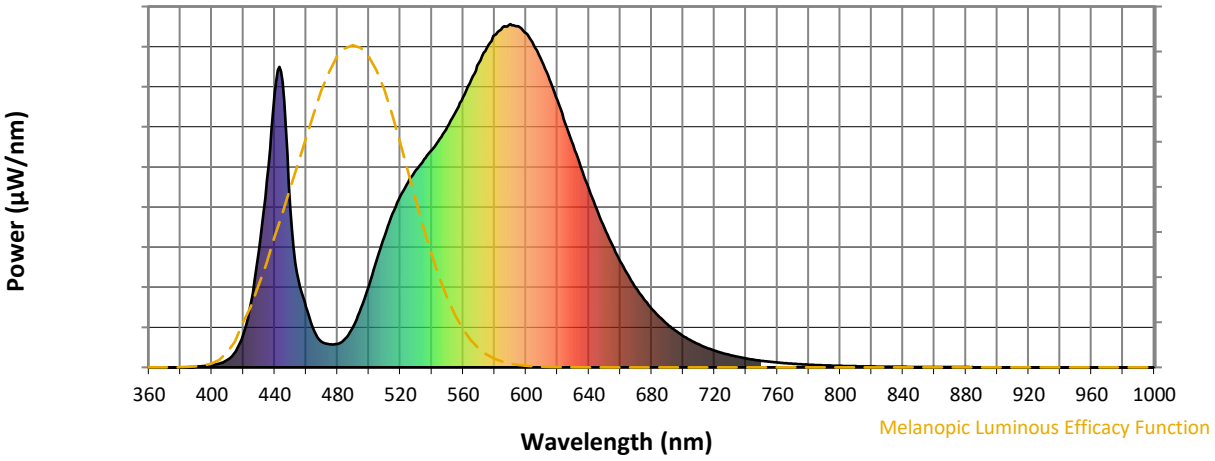

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

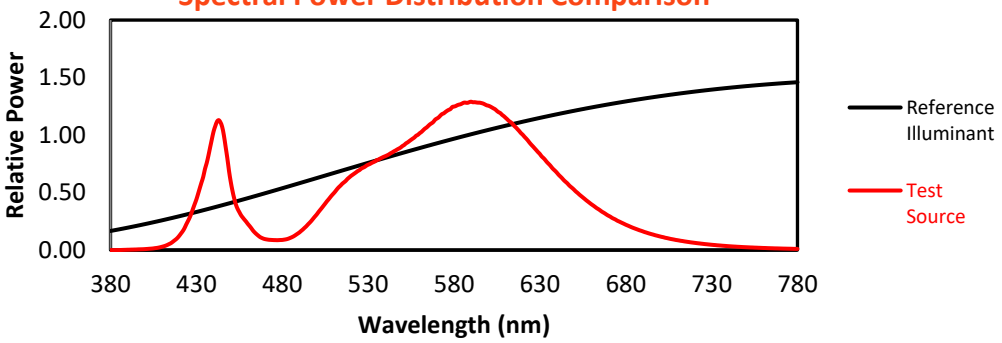


Color Vector Graphics

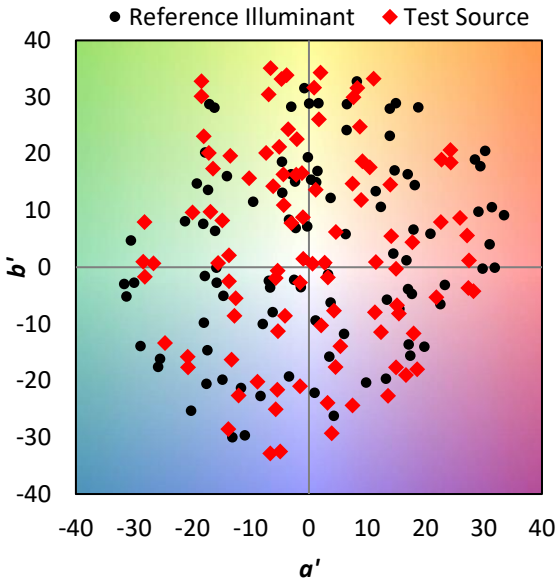

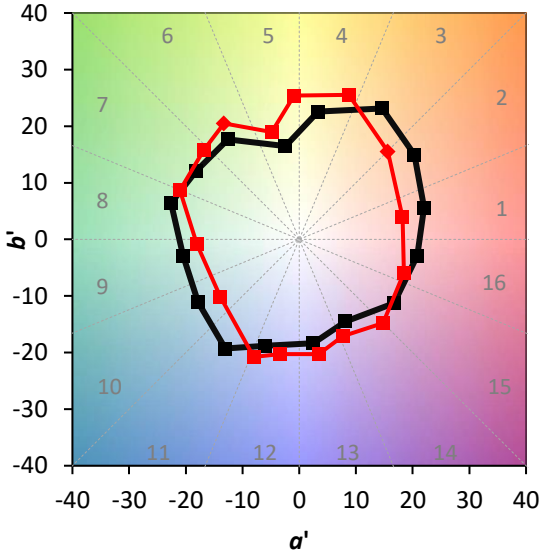

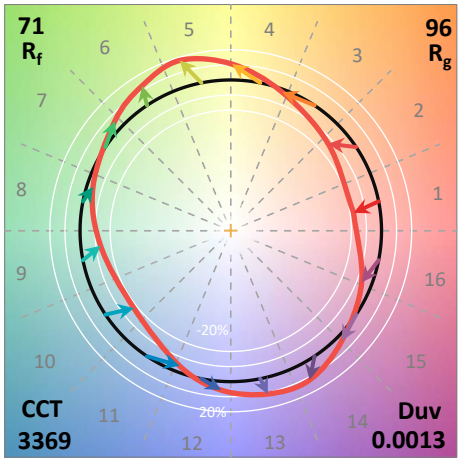

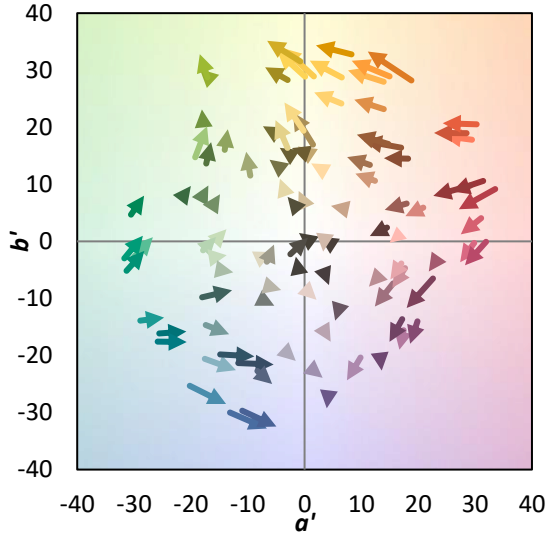


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

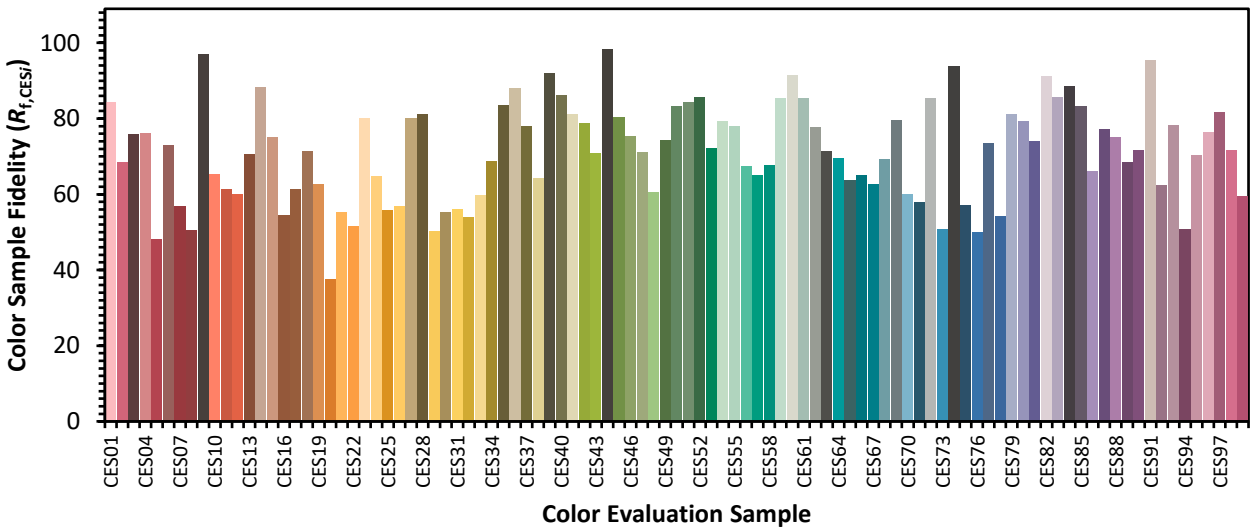



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

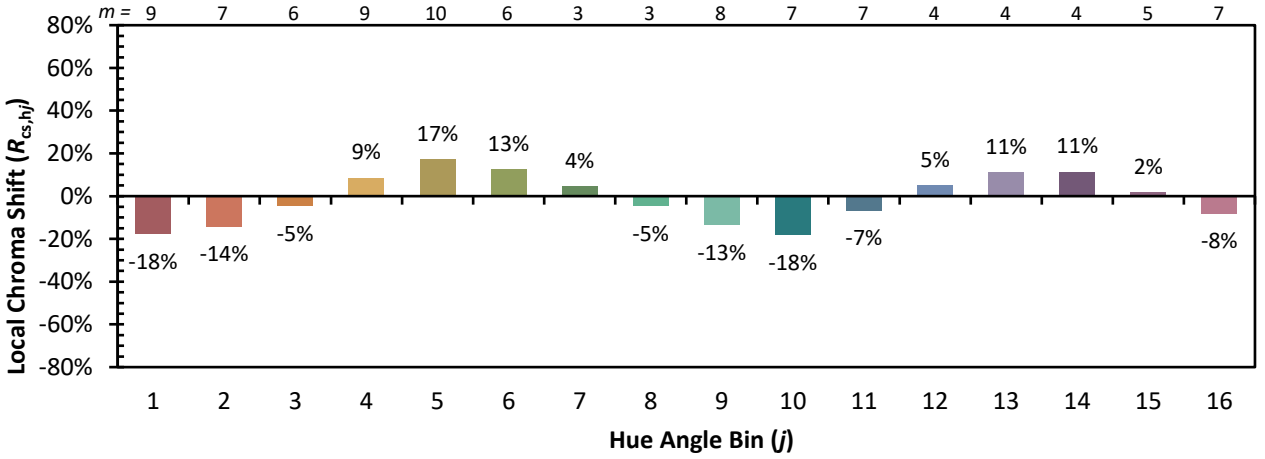

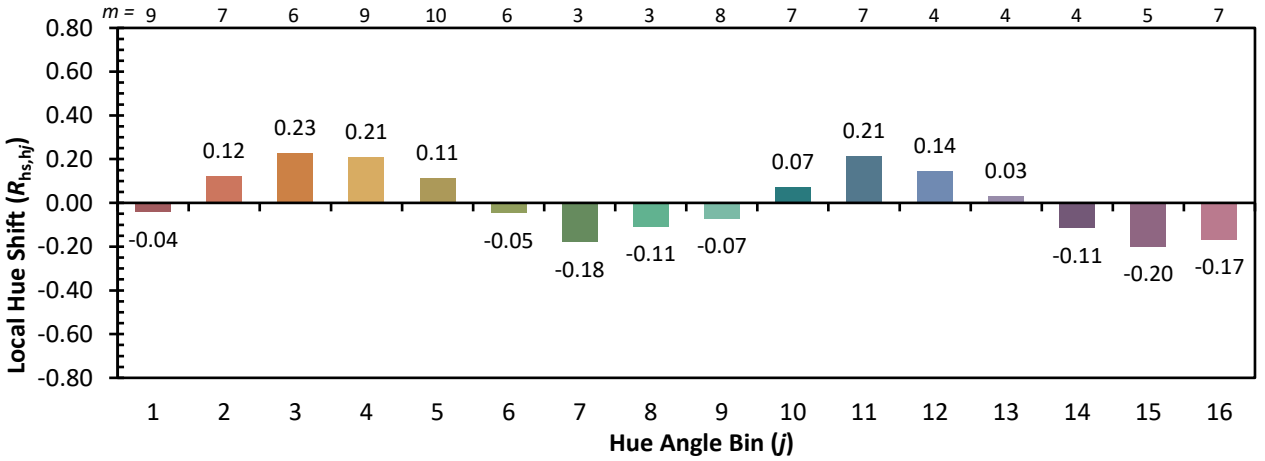


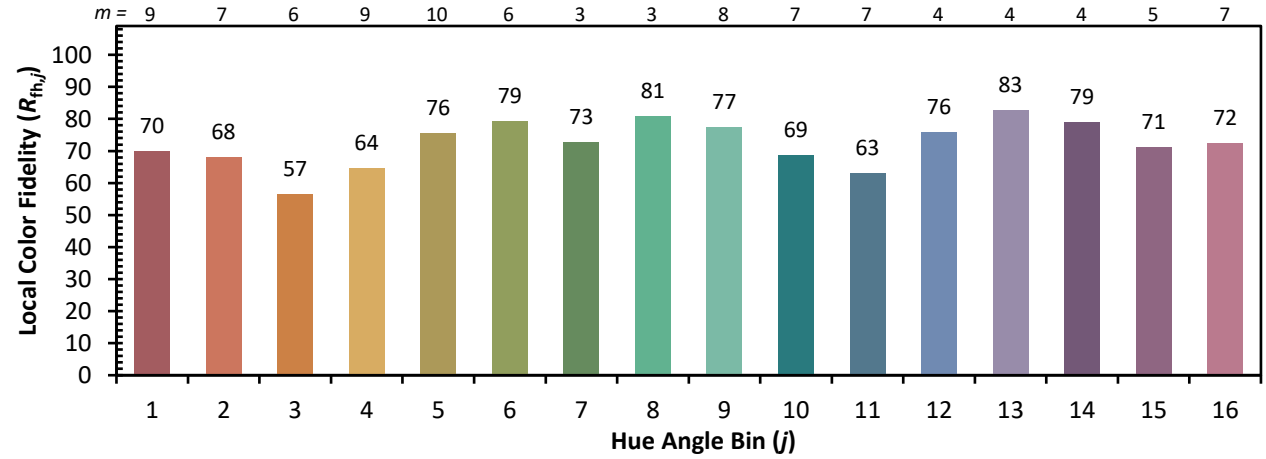


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

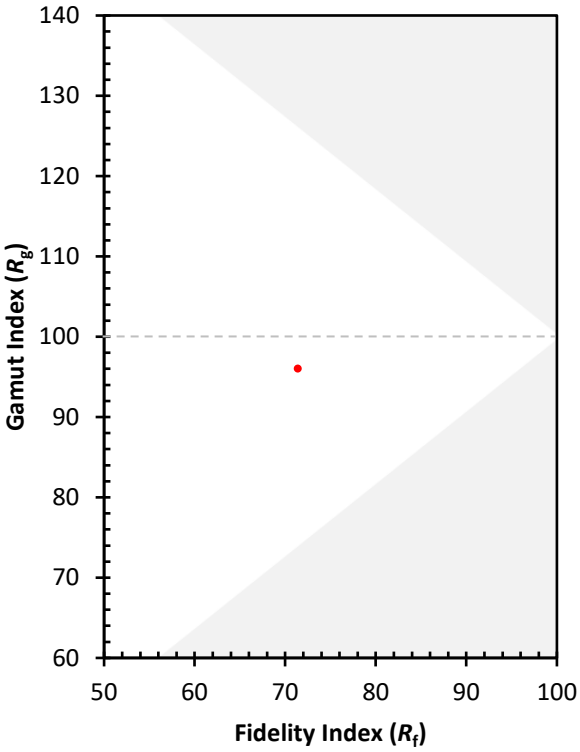

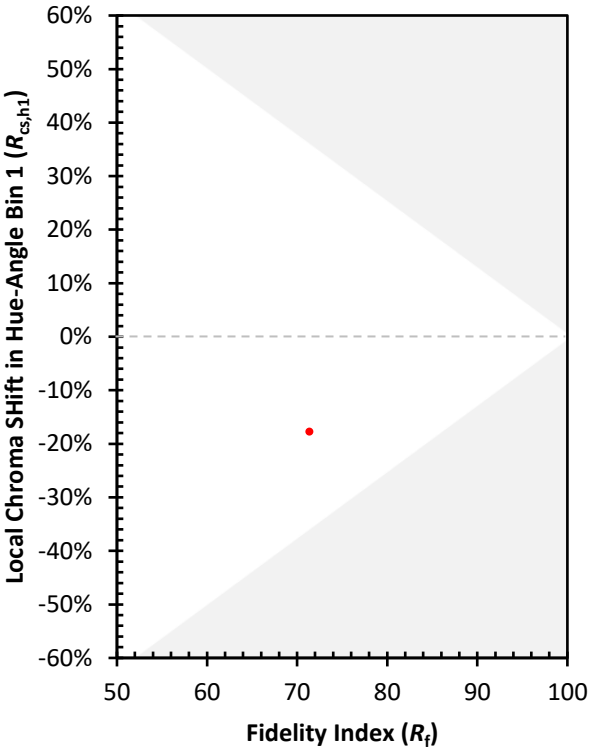

(END OF REPORT)