Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1360764

Luminaire Tested: **GSS-SB2B-735-U-T1**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1360764
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB2B-735-U-T1
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 2SQUARE 74W 70CRI 3500K FIXTURE w/ TYPE I DISTRIBUTION OPTIC
Light Source:	(52) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	10348 lumens
Efficiency:	N/A
Efficacy:	139.8 lumens/watt
Luminous Opening:	Rectangular (W 1' x L: 0.5' x H: 0')
IES Classification:	Type I - Short
BUG Rating:	B3 - U0 - G3


Input Watts (W):	74
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	13.6%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360764
CATALOG NUMBER: GSS-SB2B-735-U-T1

Iso-Footcandle Lines of Horizontal Illumination

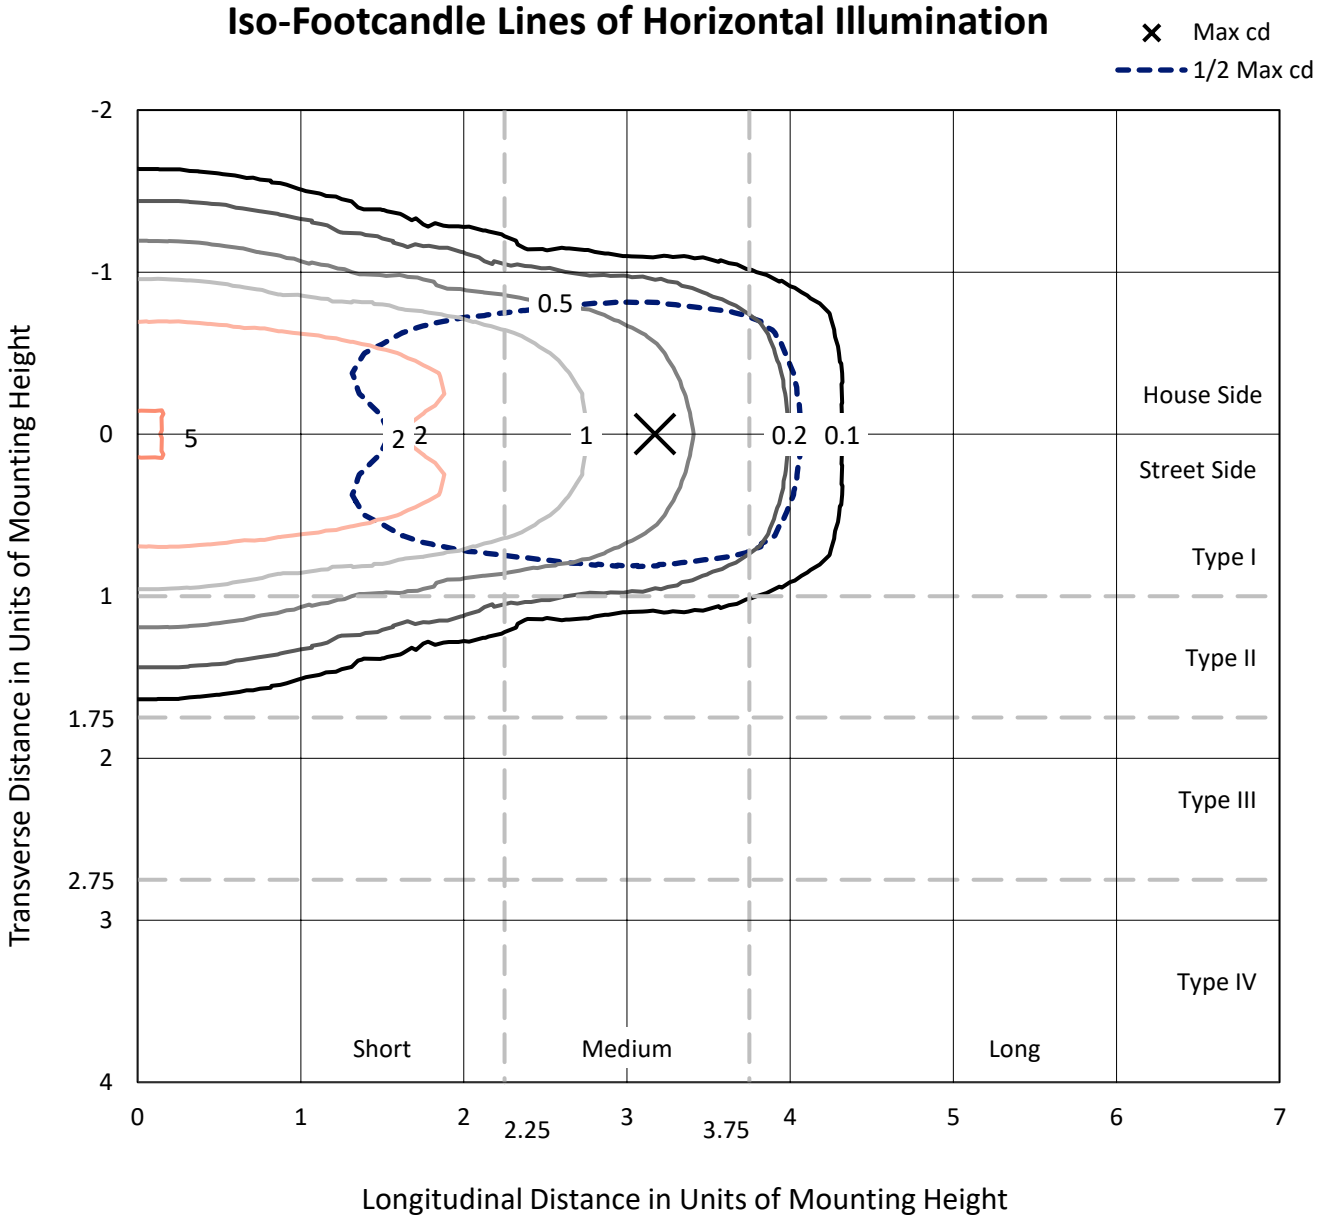


Based on 20 foot mounting height. Maximum calculated value = 5.1 fc
Type I - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360764
CATALOG NUMBER: GSS-SB2B-735-U-T1

Luminous Intensity Polar Plot

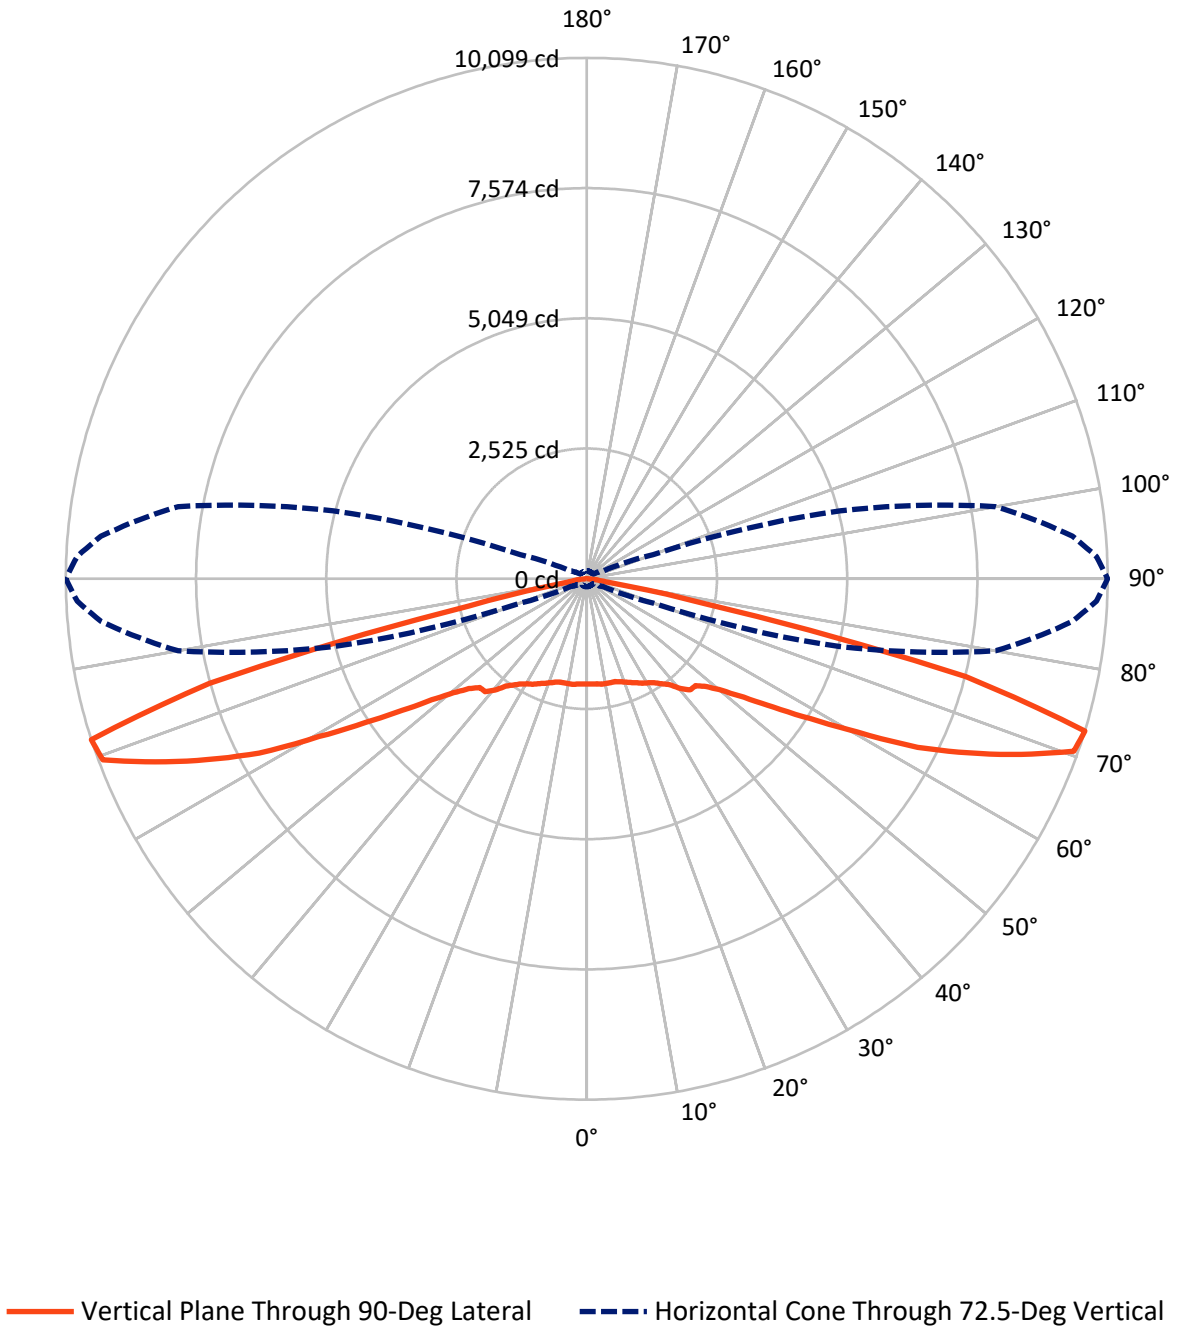

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1360764
CATALOG NUMBER: GSS-SB2B-735-U-T1

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	5174.0	0.0	5174.0
	% Fixture	50.0	0.0	50.0
Street Side	Lumens	5174.0	0.0	5174.0
	% Fixture	50.0	0.0	50.0
Total	Lumens	10348.0	0.0	10348.0
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	197.3	1.9
10°-20°	601.5	5.8
20°-30°	1005.3	9.7
30°-40°	1386.4	13.4
40°-50°	1699.5	16.4
50°-60°	1991.6	19.2
60°-70°	2211.6	21.4
70°-80°	1202.7	11.6
80°-90°	52.1	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	10348.0	100.0
0°-180°	10348.0	100.0

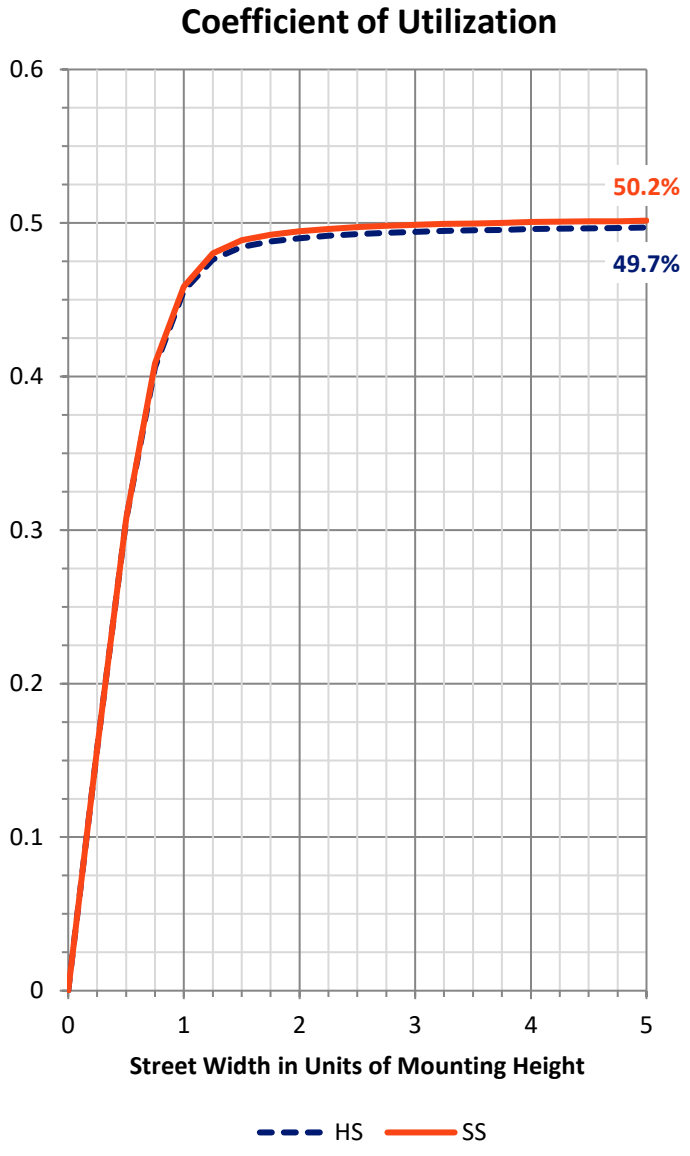

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1360764
CATALOG NUMBER: GSS-SB2B-735-U-T1

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	902.0	8.7			
FM	(30°-60°)	2538.7	24.5			
FH	(60°-80°)	1707.1	16.5			G1/1800
FVH	(80°-90°)	26.1	0.3			G1/100
BL	(0°-30°)	902.0	8.7	B2/1000		
BM	(30°-60°)	2538.7	24.5	B3/5000		
BH	(60°-80°)	1707.1	16.5	B3/2500		G3/2500
BVH	(80°-90°)	26.1	0.3			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B3-U0-G3
Type I Short

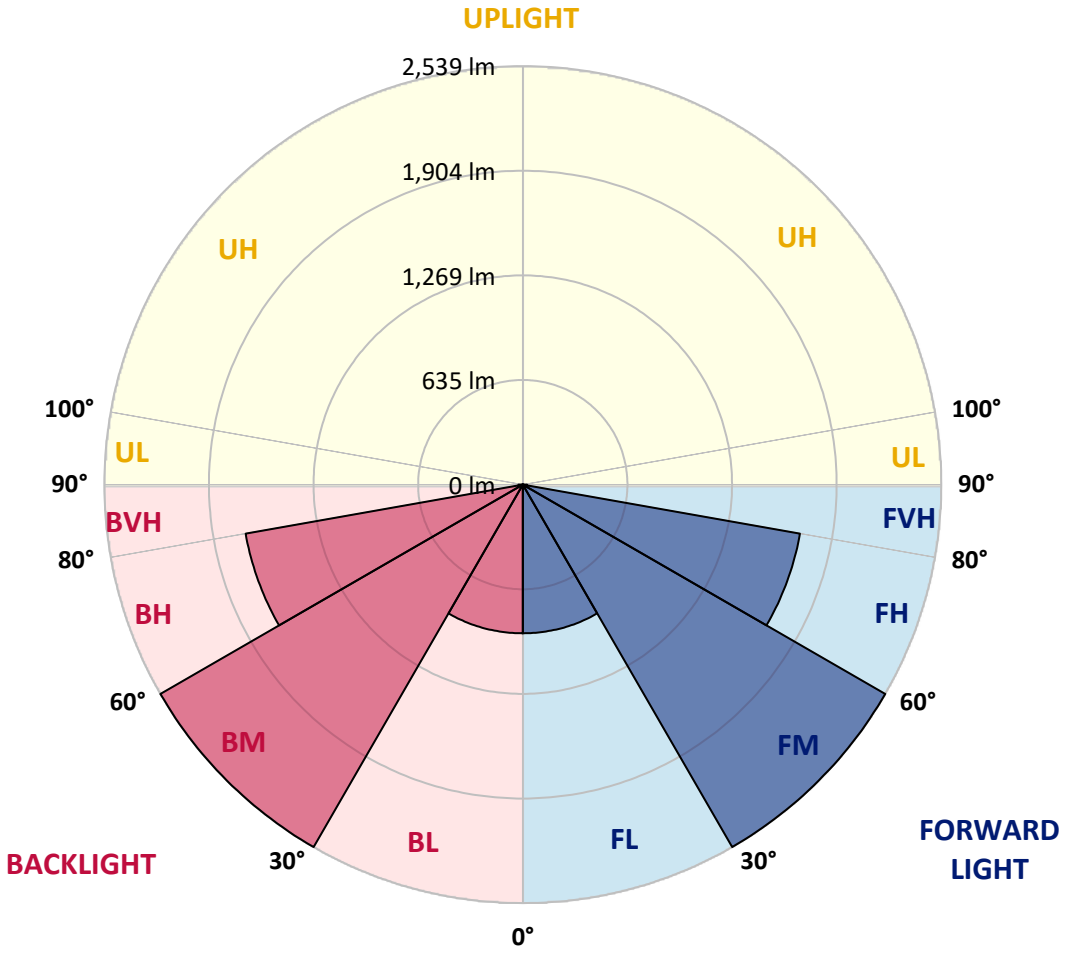

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360764
CATALOG NUMBER: GSS-SB2B-735-U-T1

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	70°	75°	80°
0°	2038.8	2038.8	2038.8	2038.8	2038.8	2038.8	2038.8	2038.8	2038.8	2038.8	2038.8
2.5°	2041.1	2041.1	2034.3	2043.3	2038.8	2041.1	2043.3	2041.1	2038.8	2041.1	2043.3
5°	2052.4	2047.9	2052.4	2056.9	2050.1	2054.7	2052.4	2041.1	2047.9	2047.9	2047.9
7.5°	2072.8	2077.3	2072.8	2084.1	2077.3	2090.9	2077.3	2068.3	2066.0	2063.7	2063.7
10°	2081.8	2081.8	2079.6	2100.0	2104.5	2118.1	2109.0	2095.4	2088.6	2079.6	2070.5
12.5°	2056.9	2061.5	2072.8	2111.3	2129.4	2156.6	2149.8	2122.6	2102.2	2095.4	2081.8
15°	2029.7	2034.3	2056.9	2104.5	2147.5	2188.3	2186.1	2152.1	2127.2	2109.0	2088.6
17.5°	1986.7	1993.5	2025.2	2097.7	2174.7	2220.0	2233.6	2199.6	2172.5	2143.0	2115.8
20°	1914.2	1914.2	1970.8	2063.7	2170.2	2272.1	2308.4	2281.2	2249.5	2201.9	2165.7
22.5°	1832.7	1837.2	1893.8	2016.2	2167.9	2317.4	2387.7	2358.2	2326.5	2274.4	2220.0
25°	1751.1	1751.1	1814.5	1952.7	2138.5	2349.2	2480.5	2464.7	2401.3	2353.7	2283.5
27.5°	1676.4	1676.4	1744.3	1889.3	2088.6	2358.2	2573.4	2573.4	2503.2	2433.0	2356.0
30°	1588.0	1610.7	1687.7	1839.5	2043.3	2342.4	2641.4	2684.4	2621.0	2530.4	2417.1
32.5°	1513.2	1529.1	1608.4	1769.2	1977.6	2324.2	2718.4	2824.9	2759.2	2634.6	2507.7
35°	1424.9	1422.6	1513.2	1671.8	1884.8	2283.5	2779.6	2992.5	2929.1	2795.4	2623.3
37.5°	1309.4	1309.4	1402.2	1556.3	1796.4	2213.2	2829.4	3178.3	3130.7	2978.9	2795.4
40°	1184.8	1198.4	1279.9	1436.2	1689.9	2129.4	2829.4	3330.0	3355.0	3198.7	3008.4
42.5°	1094.2	1098.7	1173.4	1320.7	1572.1	2020.7	2793.2	3461.4	3536.2	3404.8	3157.9
45°	999.0	1010.3	1073.8	1209.7	1449.8	1891.6	2729.7	3608.7	3728.7	3638.1	3314.2
47.5°	883.5	894.8	967.3	1105.5	1334.3	1751.1	2623.3	3762.7	4014.2	3948.5	3592.8
50°	749.8	758.9	826.8	974.1	1205.2	1590.3	2489.6	3878.3	4299.6	4365.3	4014.2
52.5°	586.7	593.5	666.0	808.7	1051.1	1436.2	2301.6	3948.5	4587.3	4818.4	4578.2
55°	421.4	432.7	496.1	613.9	847.2	1230.1	2077.3	3984.7	4902.2	5355.3	5278.2
57.5°	303.6	308.1	351.1	441.7	629.8	987.7	1789.6	3923.6	5185.4	5996.4	6157.2
60°	251.5	251.5	258.2	301.3	430.4	697.7	1445.3	3697.0	5427.8	6644.2	7140.3
62.5°	231.1	231.1	235.6	242.4	283.2	453.1	1033.0	3237.2	5454.9	7267.2	8218.6
65°	210.7	210.7	215.2	219.7	228.8	294.5	623.0	2369.5	4922.6	7274.0	8798.6
67.5°	192.6	192.6	194.8	197.1	201.6	215.2	342.1	1436.2	3939.4	7081.4	9020.6
70°	174.4	174.4	174.4	172.2	179.0	181.2	226.5	729.4	2634.6	6395.0	8914.1
72.5°	*154.0*	*154.0*	*151.8*	*147.2*	*149.5*	*149.5*	*167.6*	*357.9*	*1368.3*	*5083.4*	*8048.7*
75°	131.4	133.7	124.6	120.1	117.8	120.1	133.7	203.9	611.6	3083.1	6014.5
77.5°	111.0	115.5	101.9	92.9	90.6	90.6	104.2	126.9	262.8	1119.1	2695.8
80°	83.8	86.1	74.8	65.7	65.7	63.4	77.0	92.9	124.6	333.0	604.8
82.5°	47.6	47.6	43.0	38.5	36.2	38.5	52.1	63.4	77.0	117.8	165.4
85°	11.3	11.3	13.6	15.9	15.9	20.4	29.4	34.0	40.8	47.6	63.4
87.5°	2.3	2.3	2.3	4.5	6.8	6.8	11.3	15.9	20.4	24.9	27.2
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1360764
CATALOG NUMBER: GSS-SB2B-735-U-T1

CANDELA DISTRIBUTION (continued):

	85°	87.5°	90°
0°	2038.8	2038.8	*2038.8*
2.5°	2043.3	2045.6	*2043.3*
5°	2056.9	2052.4	*2045.6*
7.5°	2059.2	2061.5	*2063.7*
10°	2068.3	2077.3	*2063.7*
12.5°	2077.3	2070.5	*2066.0*
15°	2084.1	2081.8	*2068.3*
17.5°	2109.0	2100.0	*2097.7*
20°	2147.5	2145.3	*2138.5*
22.5°	2192.8	2188.3	*2186.1*
25°	2258.5	2242.7	*2233.6*
27.5°	2312.9	2299.3	*2294.8*
30°	2367.3	2340.1	*2340.1*
32.5°	2414.9	2408.1	*2403.5*
35°	2528.1	2494.1	*2498.7*
37.5°	2666.3	2632.3	*2602.9*
40°	2861.1	2815.8	*2797.7*
42.5°	2985.7	2940.4	*2944.9*
45°	3055.9	2976.7	*2956.3*
47.5°	3246.2	3146.6	*3119.4*
50°	3554.3	3432.0	*3398.0*
52.5°	4052.7	3855.6	*3810.3*
55°	4677.9	4435.5	*4390.2*
57.5°	5534.2	5212.5	*5115.1*
60°	6576.3	6177.6	*6030.3*
62.5°	7829.0	7337.4	*7197.0*
65°	8771.4	8361.4	*8143.9*
67.5°	9525.7	9188.2	*9084.0*
70°	9974.3	9990.1	*10017.3*
72.5°	*9455.5*	*9890.5*	*10098.9*
75°	6929.7	7267.2	*7591.1*
77.5°	2677.6	2414.9	*2337.8*
80°	432.7	405.5	*419.1*
82.5°	194.8	206.1	*217.5*
85°	126.9	147.2	*156.3*
87.5°	29.4	29.4	*29.4*
90°	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

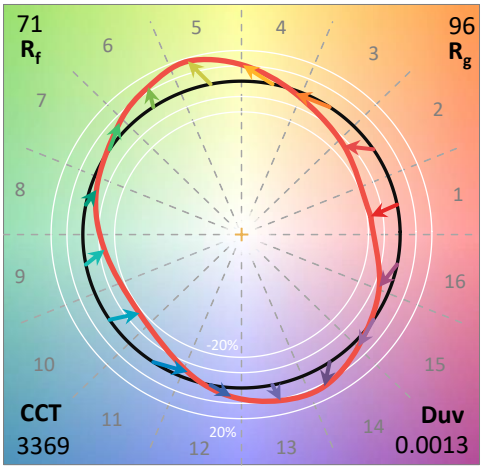

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

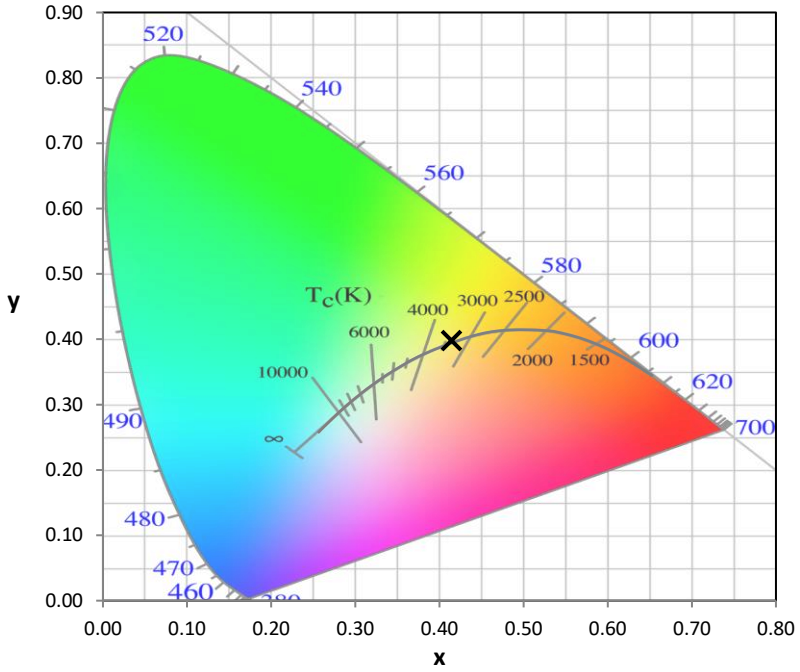

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

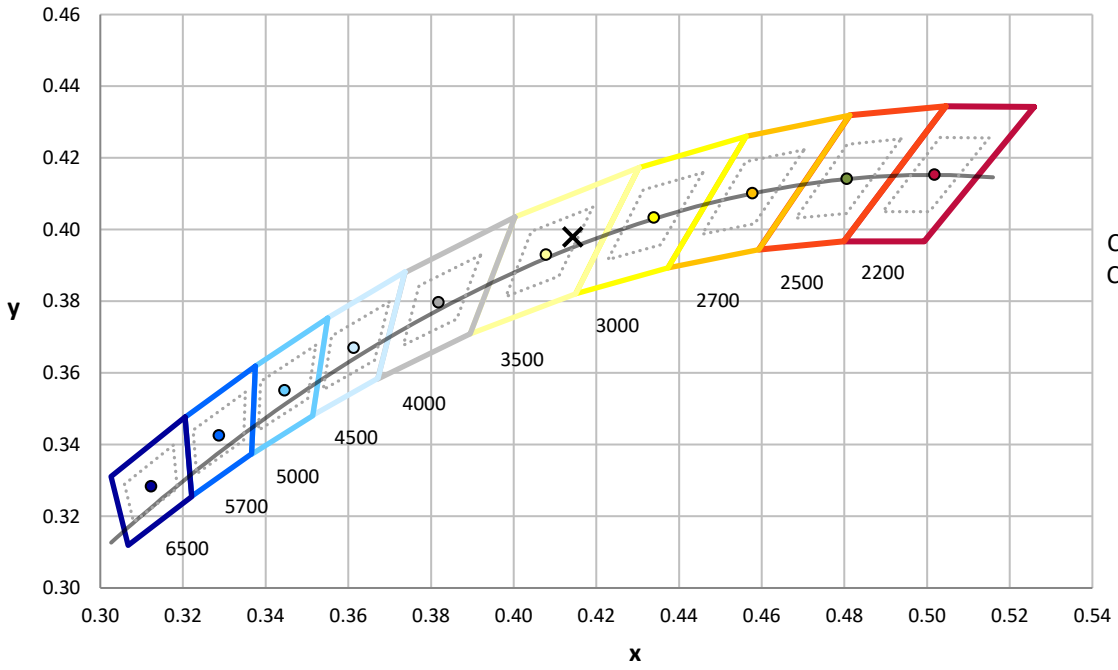


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

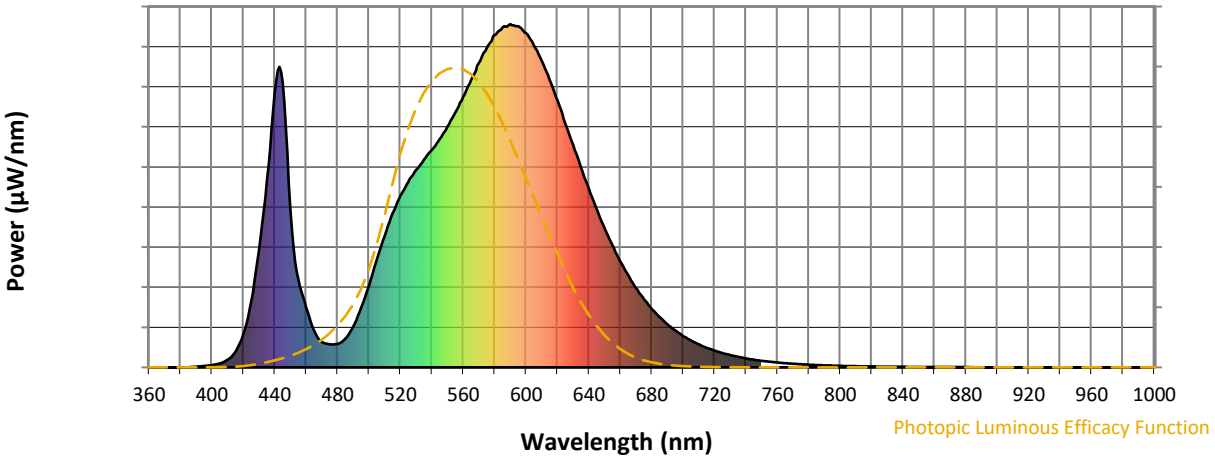


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

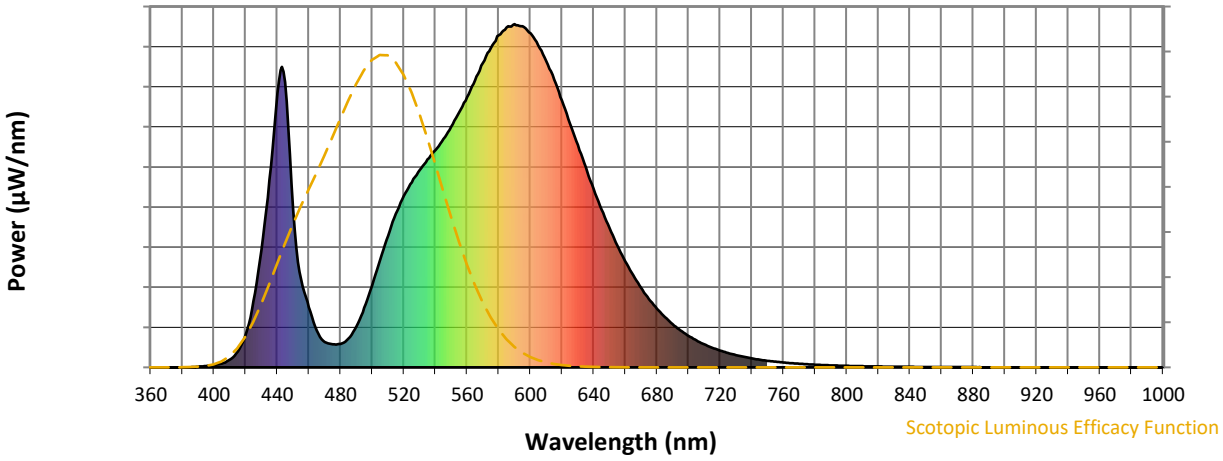


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

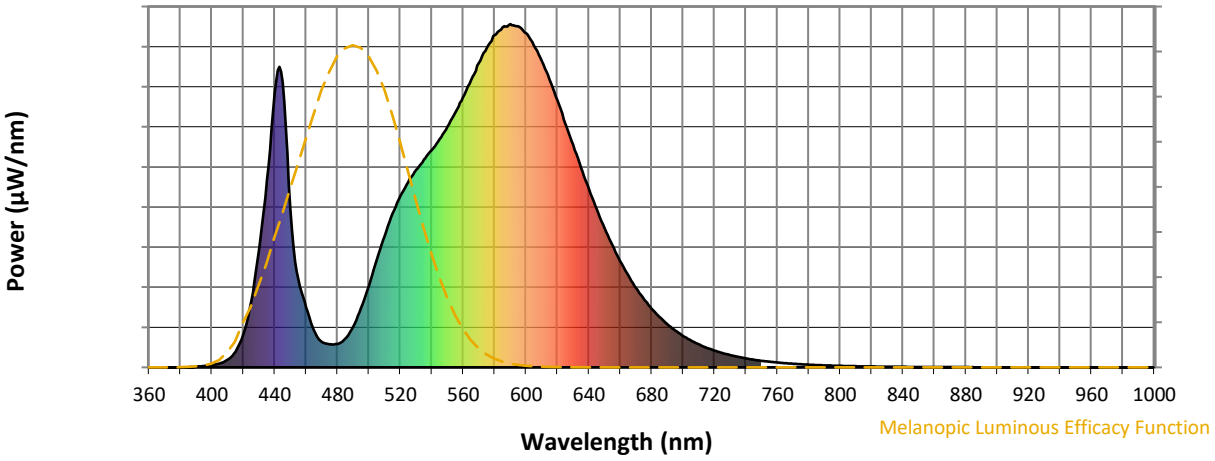

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

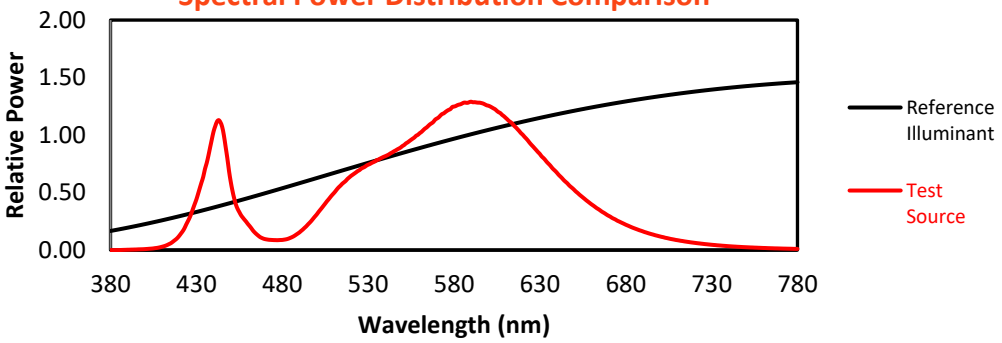


Color Vector Graphics

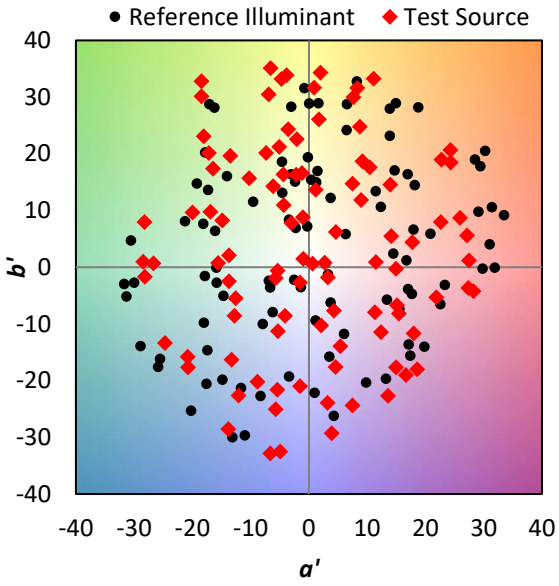

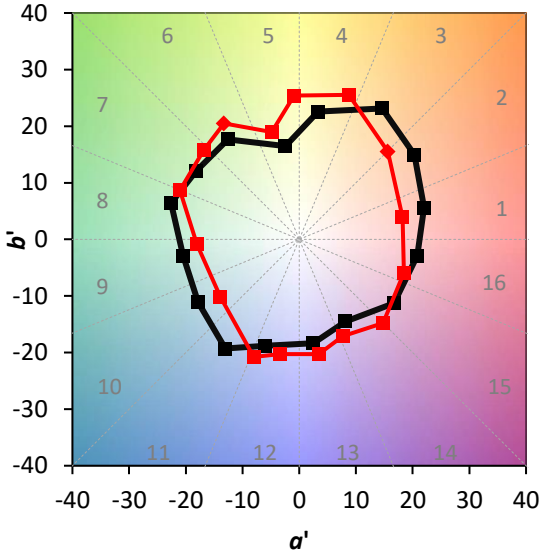

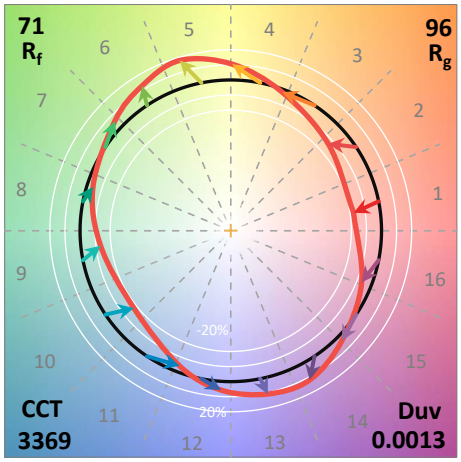

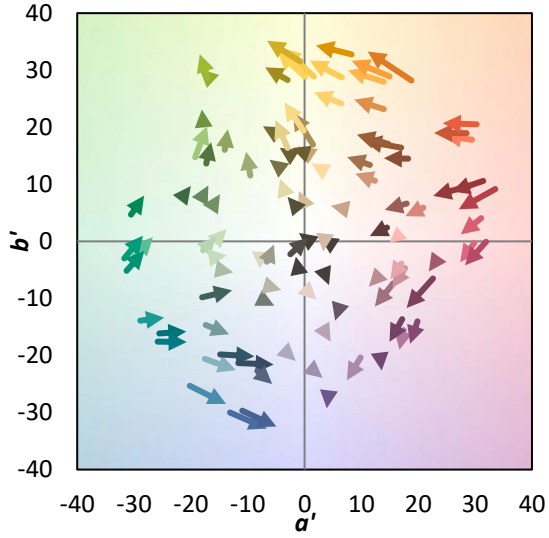


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

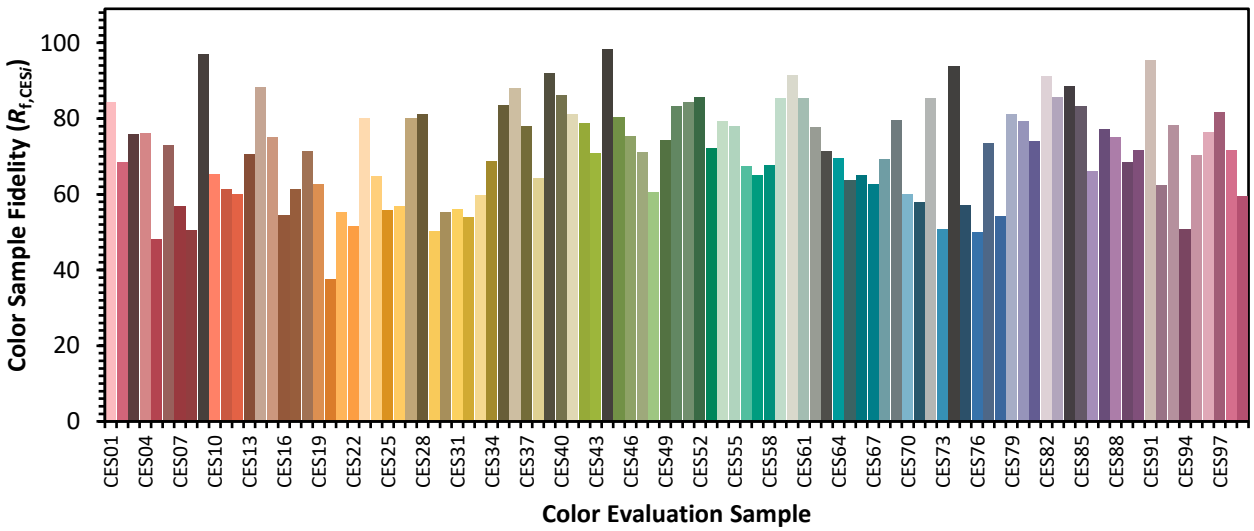



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

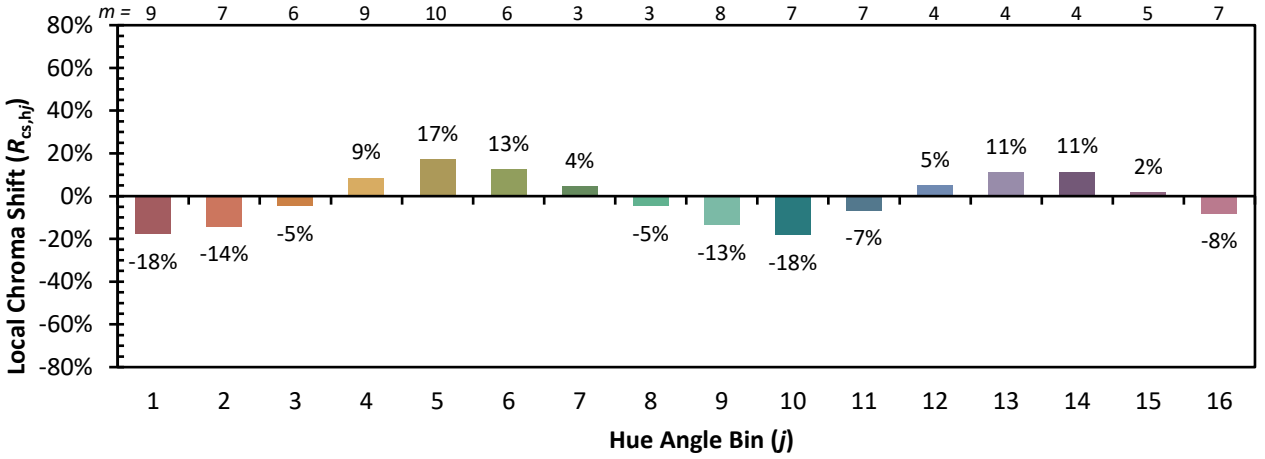

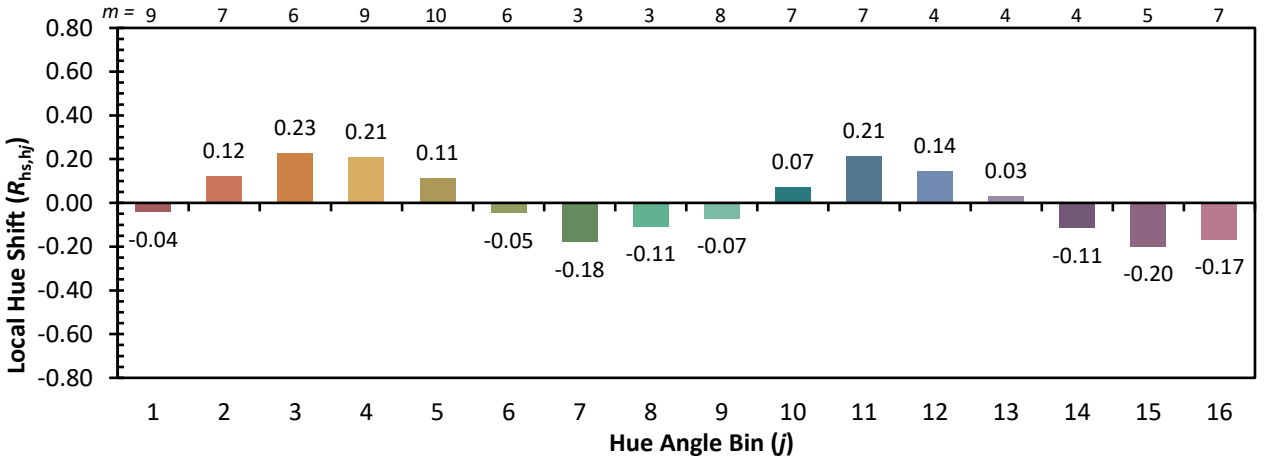


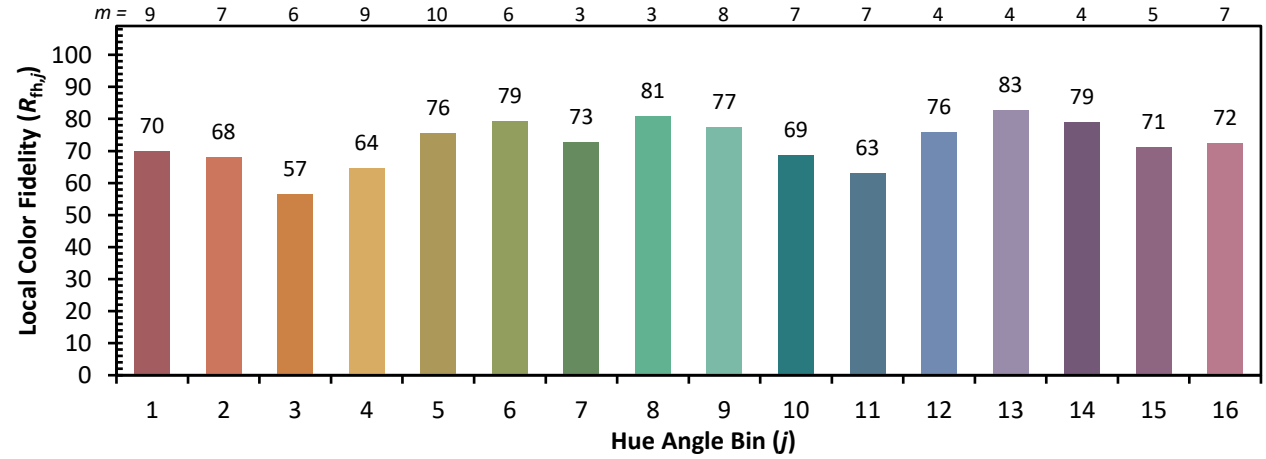


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

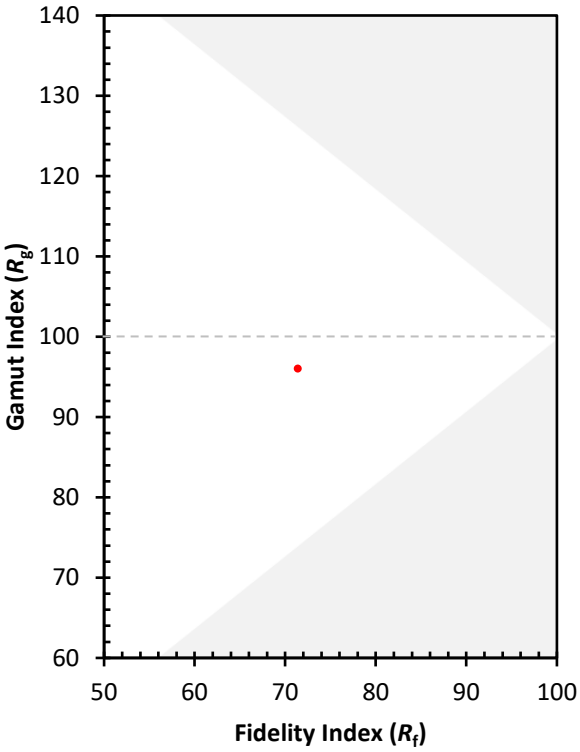

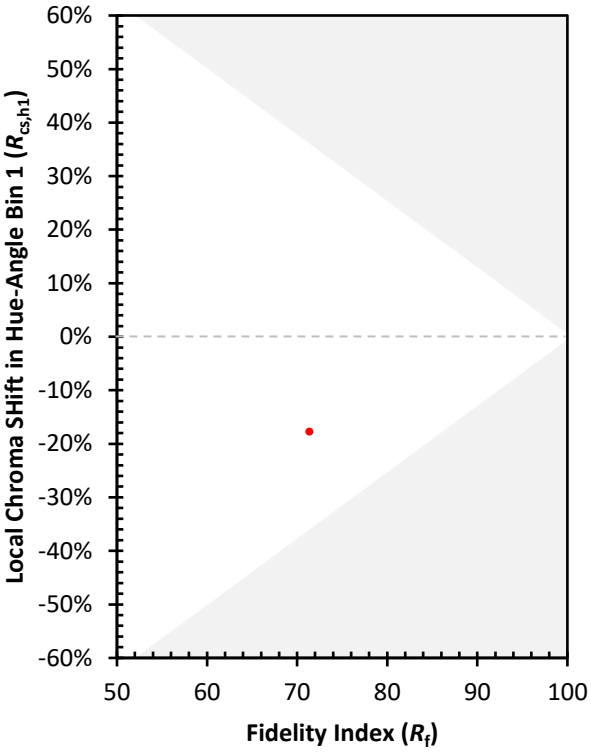

(END OF REPORT)