Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: McGRAW-EDISON

Report Number: P1358852

Luminaire Tested: **GSS-SB4B-735-U-SL4-HSS**

Issue Date: 02/18/2026

Report Generated By 670245763

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-08
Report Number:	P1358852
Test Lab:	INNOVATION CENTER(G3)
Issue Date:	02/18/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line:	McGRAW-EDISON
Catalog Number:	GSS-SB4B-735-U-SL4-HSS
Description:	GALLEON II SLIM SITE HIGH DENSITY LED ARRAYS 4SQUARE 148W 70CRI 3500K FIXTURE w/ TYPE IV SPILL CONTROL DISTRIBUTION OPTIC AND HOUSE SIDE SHIELD
Light Source:	(104) 3500K CCT, 70 CRI LEDS
Ballast/Driver:	ELECTRONIC DRIVER

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	13975.7 lumens
Efficiency:	N/A
Efficacy:	94.4 lumens/watt
Luminous Opening:	Rectangular (W 1.5' x L: 1' x H: 0')
IES Classification:	Type IV - Short
BUG Rating:	B2 - U0 - G3


Input Watts (W):	148
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	0.98
Total Harmonic Distortion (THDi):	13.6%
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	28.75 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358852
CATALOG NUMBER: GSS-SB4B-735-U-SL4-HSS

Iso-Footcandle Lines of Horizontal Illumination

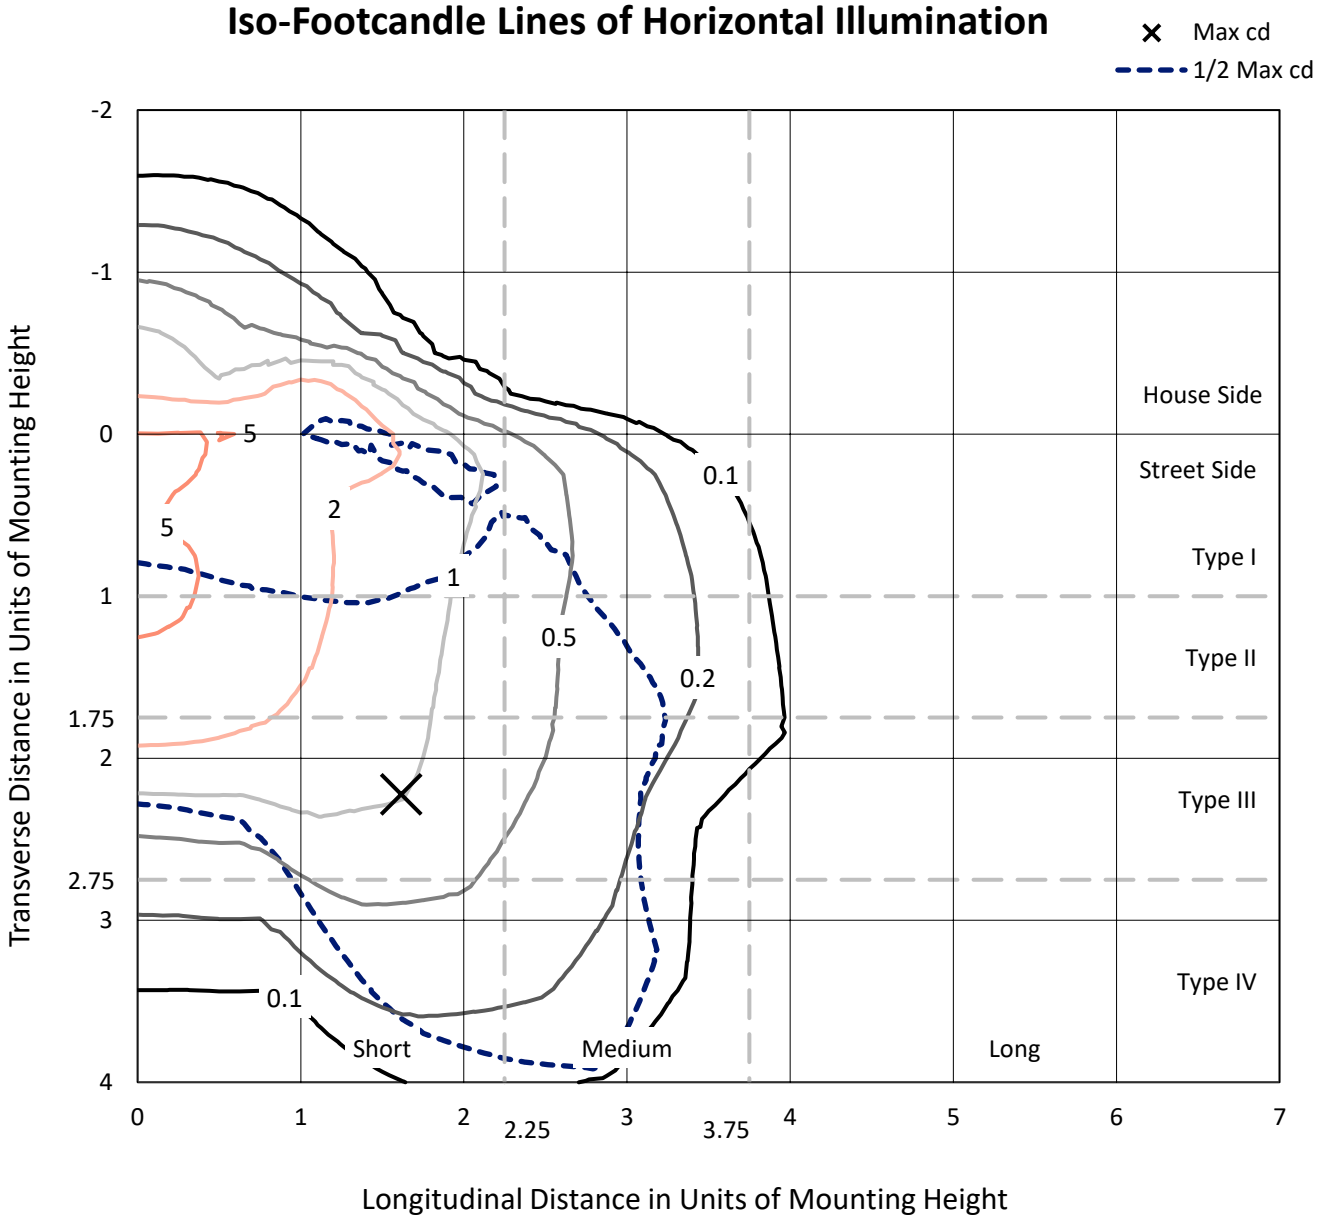


Based on 20 foot mounting height. Maximum calculated value = 6.2 fc
Type IV - Short - N/A

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358852
CATALOG NUMBER: GSS-SB4B-735-U-SL4-HSS

Luminous Intensity Polar Plot

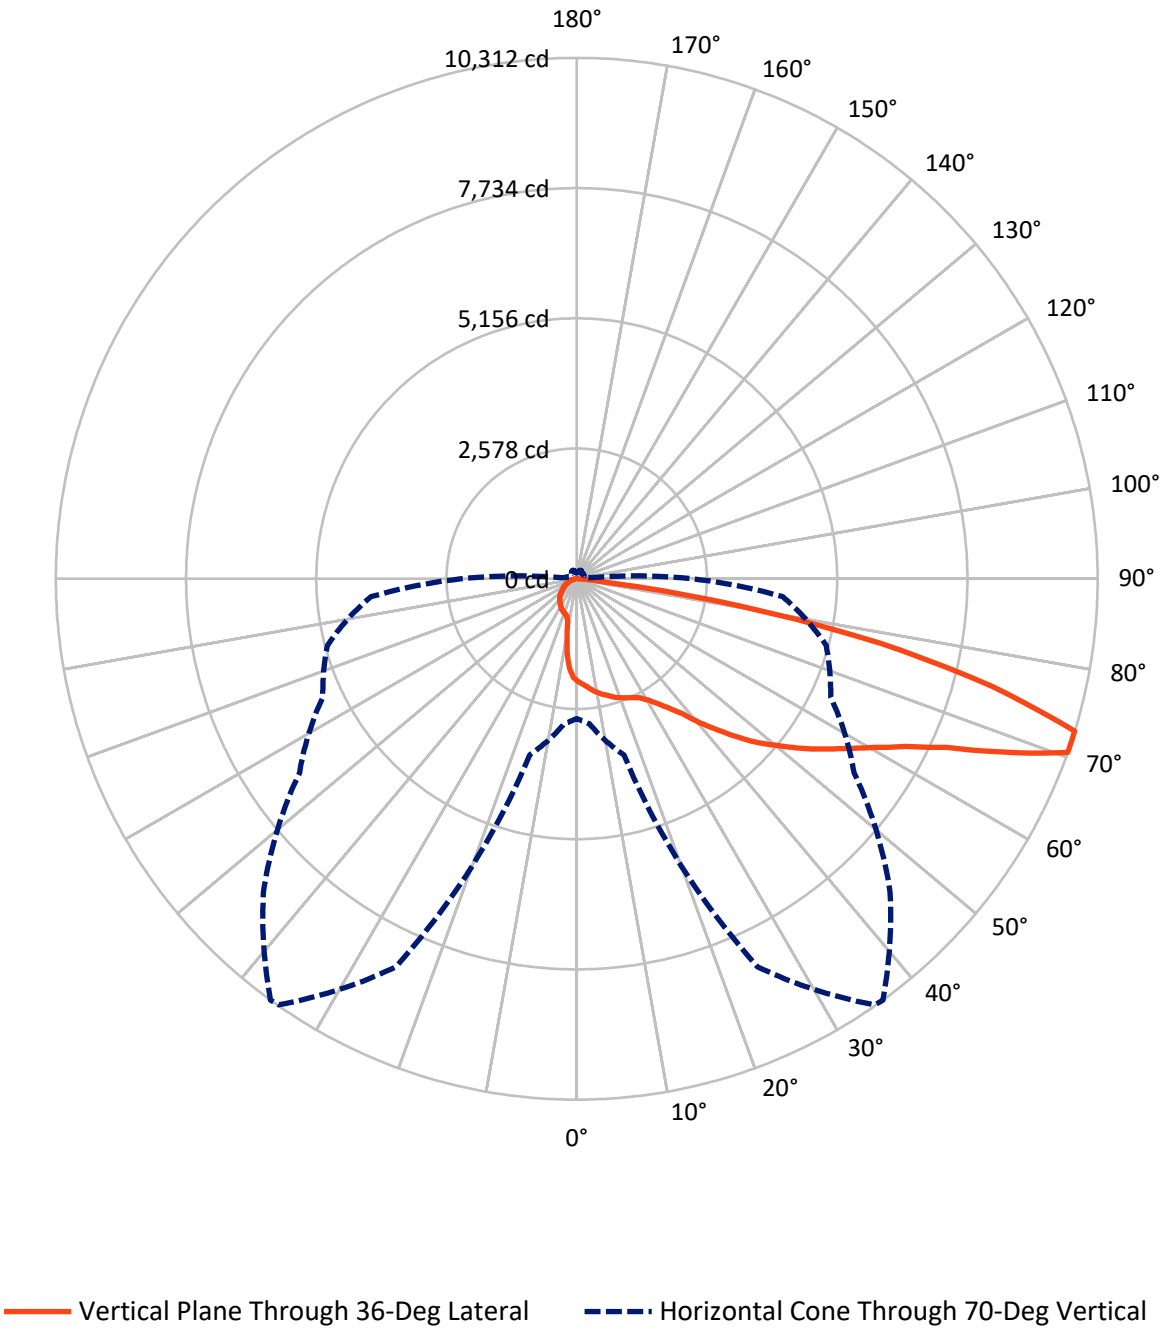

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report


REPORT NUMBER: P1358852
CATALOG NUMBER: GSS-SB4B-735-U-SL4-HSS

FLUX DISTRIBUTION:

		Downward	Upward	Total
House Side	Lumens	2063.1	0.0	2063.1
	% Fixture	14.8	0.0	14.8
Street Side	Lumens	11912.6	0.0	11912.6
	% Fixture	85.2	0.0	85.2
Total	Lumens	13975.7	0.0	13975.7
	% Fixture	100.0	0.0	100.0

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.7	1.3
10°-20°	512.1	3.7
20°-30°	863.2	6.2
30°-40°	1378.7	9.9
40°-50°	2253.2	16.1
50°-60°	3040.1	21.8
60°-70°	3376.3	24.2
70°-80°	2235.3	16.0
80°-90°	132.1	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-90°	13975.7	100.0
0°-180°	13975.7	100.0

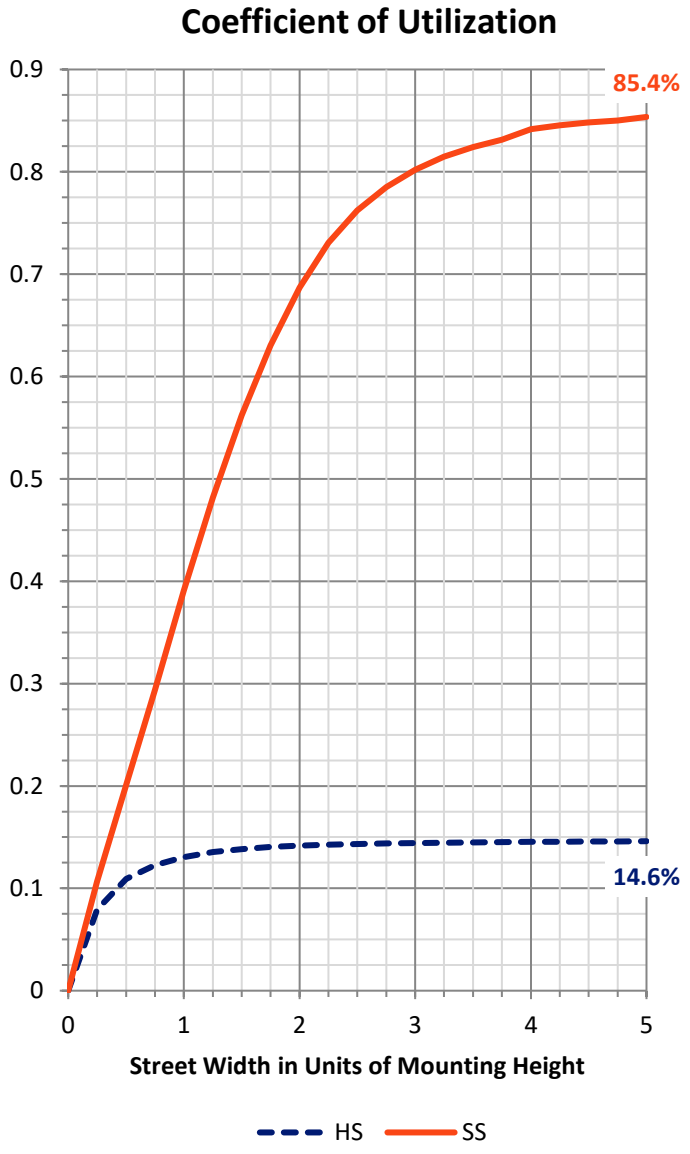

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

REPORT NUMBER: P1358852
CATALOG NUMBER: GSS-SB4B-735-U-SL4-HSS

LUMINAIRE CLASSIFICATION SYSTEM LUMEN TABLE AND BUG RATING:

Zone		Lumens	% Fixture	Zone Rating/Lumen Limit B	U	G
FL	(0°-30°)	1068.8	7.6			
FM	(30°-60°)	5377.9	38.5			
FH	(60°-80°)	5350.8	38.3			G3/7500
FVH	(80°-90°)	115.2	0.8			G2/225
BL	(0°-30°)	491.2	3.5	B1/500		
BM	(30°-60°)	1294.1	9.3	B2/2500		
BH	(60°-80°)	260.8	1.9	B1/500		G1/500
BVH	(80°-90°)	16.9	0.1			G1/100
UL	(90°-100°)	0.0	0.0		U0/0	
UH	(100°-180°)	0.0	0.0		U0/0	

BUG Rating: B2-U0-G3
Type IV Short

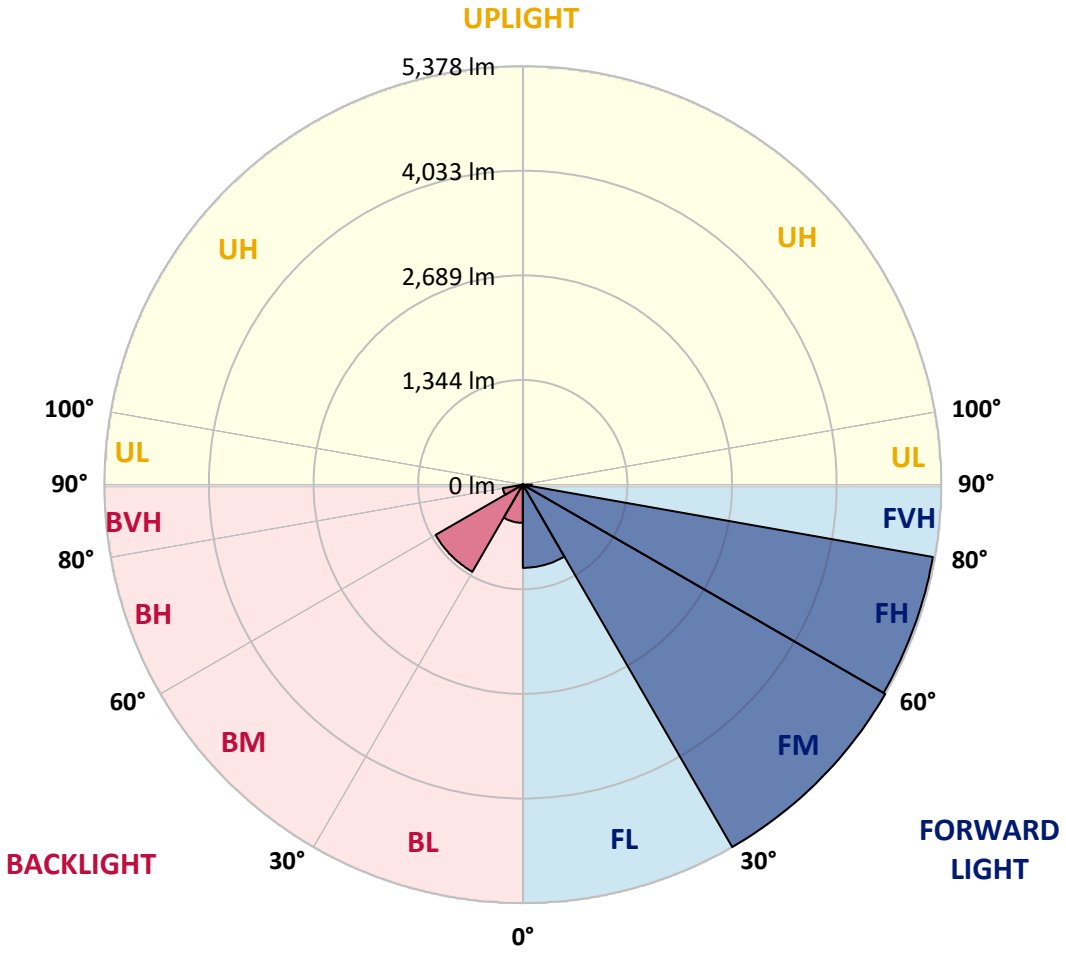

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358852
CATALOG NUMBER: GSS-SB4B-735-U-SL4-HSS

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	36°	45°	55°	65°	75°	85°
0°	2027.2	2027.2	2027.2	2027.2	2027.2	*2027.2*	2027.2	2027.2	2027.2	2027.2	2027.2
2.5°	2098.7	2079.7	2089.2	2094.0	2079.7	*2084.4*	2074.9	2070.1	2051.0	2065.3	2046.3
5°	2175.1	2170.3	2165.5	2165.5	2151.2	*2146.4*	2132.1	2122.6	2103.5	2089.2	2065.3
7.5°	2265.7	2237.1	2232.3	2241.8	2213.2	*2227.5*	2213.2	2198.9	2165.5	2127.4	2089.2
10°	2337.2	2322.9	2303.8	2299.1	2303.8	*2294.3*	2280.0	2265.7	2246.6	2198.9	2156.0
12.5°	2418.3	2408.8	2389.7	2380.2	2346.8	*2351.5*	2351.5	2332.5	2303.8	2275.2	2227.5
15°	2508.9	2470.8	2461.2	2437.4	2418.3	*2404.0*	2408.8	2413.5	2380.2	2351.5	2303.8
17.5°	2551.9	2542.3	2518.5	2489.9	2489.9	*2470.8*	2466.0	2466.0	2451.7	2442.2	2384.9
20°	2618.6	2609.1	2566.2	2542.3	2518.5	*2513.7*	2528.0	2528.0	2504.2	2499.4	2489.9
22.5°	2718.8	2690.2	2633.0	2594.8	2566.2	*2561.4*	2580.5	2575.7	2575.7	2580.5	2599.6
25°	2814.2	2780.8	2718.8	2656.8	2594.8	*2604.3*	2628.2	2633.0	2613.9	2642.5	2714.0
27.5°	2957.3	2952.5	2857.1	2733.1	2675.9	*2671.1*	2680.7	2671.1	2652.0	2685.4	2819.0
30°	3334.1	3291.2	3133.8	2904.8	2776.1	*2785.6*	2771.3	2714.0	2666.3	2704.5	2919.1
32.5°	3701.4	3601.2	3439.1	3176.7	2938.2	*2943.0*	2842.8	2733.1	2680.7	2723.6	3019.3
35°	4235.6	4130.7	3887.4	3429.5	3186.3	*3143.3*	2938.2	2804.7	2709.3	2757.0	3133.8
37.5°	4989.3	4836.6	4507.5	3930.4	3405.7	*3386.6*	3105.2	2866.7	2733.1	2752.2	3286.4
40°	5571.2	5423.3	5156.2	4459.8	3782.5	*3744.3*	3367.5	2985.9	2737.9	2776.1	3429.5
42.5°	6076.8	6000.5	5642.7	4927.3	4173.6	*4092.5*	3620.3	3133.8	2838.1	2838.1	3668.0
45°	6754.1	6611.0	6205.6	5366.1	4564.7	*4474.1*	3954.2	3367.5	2962.1	2909.6	3916.0
47.5°	7350.3	7231.1	6758.9	5781.1	4936.8	*4860.5*	4273.8	3620.3	3119.5	3038.4	4207.0
50°	8003.8	7879.8	7336.0	6277.1	5304.1	*5194.4*	4626.8	3854.0	3310.3	3238.7	4555.2
52.5°	8456.9	8352.0	7808.2	6725.5	5657.0	*5580.7*	4912.9	4092.5	3534.5	3462.9	4889.1
55°	8757.4	8590.5	8061.0	7116.6	6048.2	*5952.8*	5170.5	4359.6	3787.3	3763.4	5175.3
57.5°	8900.5	8733.6	8285.2	7460.0	6434.5	*6329.6*	5490.1	4650.6	4116.4	4135.5	5480.6
60°	8824.2	8700.2	8371.1	7784.4	6863.8	*6778.0*	5795.4	4984.5	4455.0	4536.1	5623.7
62.5°	8261.4	8290.0	8380.6	8266.2	7412.4	*7307.4*	6239.0	5409.0	4917.7	4932.0	5609.3
65°	6391.6	6510.8	7550.7	8824.2	8180.3	*8042.0*	6849.5	5943.2	5232.5	5070.4	5237.3
67.5°	4063.9	4316.7	5461.5	9134.3	9253.5	*9167.7*	7655.6	6382.1	5308.8	5275.5	4898.6
70°	*2766.5*	*2881.0*	*3610.8*	*8476.0*	*10298.1*	*10312.4*	*8771.8*	*6701.6*	*5547.3*	*5113.3*	*4092.5*
72.5°	2175.1	2184.6	2551.9	7636.5	10255.2	*10307.7*	8690.7	7035.5	5380.4	4555.2	3119.5
75°	1459.6	1497.7	1741.0	6229.4	8519.0	*8476.0*	7097.5	5404.2	4908.2	3601.2	2022.4
77.5°	410.2	424.5	725.0	3968.5	5971.9	*6153.1*	5151.4	1855.5	3415.2	1650.4	763.2
80°	124.0	133.6	295.7	1140.0	2857.1	*3272.1*	2680.7	558.1	825.2	391.1	152.6
82.5°	52.5	57.2	176.5	262.3	653.5	*705.9*	629.6	147.9	257.6	124.0	52.5
85°	19.1	23.8	57.2	62.0	100.2	*90.6*	71.5	47.7	66.8	57.2	28.6
87.5°	0.0	4.8	4.8	9.5	14.3	*14.3*	19.1	19.1	19.1	19.1	19.1
90°	0.0	0.0	0.0	0.0	0.0	*0.0*	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

REPORT NUMBER: P1358852
CATALOG NUMBER: GSS-SB4B-735-U-SL4-HSS

CANDELA DISTRIBUTION (continued):

	90°	95°	105°	115°	125°	135°	145°	155°	165°	175°	180°
0°	2027.2	2027.2	2027.2	2027.2	2027.2	2027.2	2027.2	2027.2	2027.2	2027.2	2027.2
2.5°	2032.0	2027.2	2008.1	1984.3	1969.9	1965.2	1950.9	1922.3	1931.8	1936.6	1912.7
5°	2051.0	2017.6	1979.5	1931.8	1879.3	1836.4	1779.2	1736.2	1707.6	1702.8	1698.1
7.5°	2070.1	2041.5	1974.7	1869.8	1764.8	1655.1	1507.3	1402.3	1326.0	1287.9	1302.2
10°	2132.1	2084.4	1969.9	1807.8	1583.6	1345.1	1130.5	1006.4	934.9	901.5	887.2
12.5°	2194.1	2127.4	1969.9	1698.1	1316.5	1016.0	844.3	806.1	806.1	815.6	810.9
15°	2275.2	2198.9	1984.3	1531.1	1044.6	796.6	767.9	772.7	787.0	796.6	796.6
17.5°	2365.8	2308.6	1984.3	1321.2	815.6	739.3	744.1	758.4	772.7	777.5	782.3
20°	2494.6	2413.5	1922.3	1078.0	715.5	715.5	725.0	734.6	753.6	763.2	767.9
22.5°	2613.9	2523.3	1807.8	858.6	686.9	691.6	710.7	720.2	739.3	748.9	744.1
25°	2761.7	2675.9	1683.8	696.4	658.2	667.8	682.1	696.4	725.0	734.6	734.6
27.5°	2923.9	2847.6	1588.4	682.1	629.6	643.9	667.8	686.9	710.7	720.2	720.2
30°	3100.4	3024.1	1531.1	734.6	615.3	610.5	639.2	653.5	682.1	705.9	710.7
32.5°	3286.4	3167.2	1512.0	839.5	624.9	586.7	610.5	629.6	667.8	696.4	696.4
35°	3553.5	3381.8	1512.0	954.0	663.0	562.8	581.9	605.8	648.7	677.3	677.3
37.5°	3882.7	3720.5	1659.9	1035.1	696.4	543.8	553.3	577.2	610.5	648.7	653.5
40°	4273.8	4197.5	2051.0	1087.5	715.5	524.7	534.2	543.8	562.8	601.0	610.5
42.5°	4693.5	4612.4	2609.1	1140.0	705.9	510.4	505.6	505.6	515.1	539.0	543.8
45°	5099.0	4984.5	3109.9	1120.9	663.0	481.8	472.2	457.9	457.9	477.0	477.0
47.5°	5456.7	5251.6	3353.2	992.1	610.5	453.1	434.1	410.2	410.2	419.7	419.7
50°	5685.7	5242.1	3200.6	787.0	534.2	424.5	395.9	376.8	372.0	376.8	372.0
52.5°	5719.1	4908.2	2633.0	610.5	462.7	391.1	357.7	348.2	343.4	343.4	343.4
55°	5494.9	4292.9	1850.7	467.4	405.4	353.0	329.1	324.3	319.6	314.8	310.0
57.5°	5108.5	3400.9	1130.5	376.8	367.3	319.6	305.3	300.5	291.0	276.7	271.9
60°	4593.4	2504.2	596.2	319.6	319.6	281.4	281.4	281.4	257.6	238.5	229.0
62.5°	4021.0	1688.5	333.9	271.9	267.1	252.8	257.6	252.8	229.0	195.6	190.8
65°	3381.8	958.7	224.2	224.2	229.0	219.4	229.0	224.2	190.8	157.4	147.9
67.5°	2919.1	500.8	176.5	190.8	190.8	181.3	195.6	200.3	171.7	138.3	128.8
70°	*2284.8*	*252.8*	*143.1*	*157.4*	*157.4*	*143.1*	*171.7*	*186.0*	*157.4*	*119.2*	*114.5*
72.5°	1612.2	157.4	119.2	124.0	119.2	109.7	147.9	166.9	138.3	100.2	95.4
75°	982.6	104.9	90.6	100.2	85.9	85.9	128.8	147.9	119.2	81.1	76.3
77.5°	457.9	76.3	66.8	71.5	62.0	66.8	104.9	114.5	85.9	66.8	62.0
80°	114.5	52.5	52.5	47.7	47.7	52.5	76.3	71.5	62.0	57.2	52.5
82.5°	47.7	38.2	33.4	33.4	33.4	38.2	47.7	47.7	52.5	47.7	47.7
85°	23.8	23.8	23.8	23.8	28.6	28.6	38.2	42.9	42.9	42.9	38.2
87.5°	14.3	14.3	14.3	14.3	14.3	19.1	23.8	28.6	33.4	19.1	14.3
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

McGraw-Edison

Report Number: SP1-2407-184-5

Test Date: 10/10/2024

Luminaire Tested: GSS-SB1A-735-U-5WQ

Data in this report applies to families of products including GSS-SB1A-735-U-5WQ

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.04


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2407-184-5
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	10/15/2024
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	McGraw-Edison
Catalog Number:	**GSS-SB1A-735-U-5WQ**
Description:	GALLEON II SITE SLIM 1SQ 350MA 5WQ HIGH DENSITY LIGHTSQUARE WITH 70 CRI 3500K CCT 26 LEDS

Spectral Parameters

CCT (K):	3369
CIE u':	0.2386
CIE v':	0.5156
Duv:	0.0013
CIE x:	0.4143
CIE y:	0.3980
CIE z:	0.1877
Peak Wavelength (nm):	590
Dominant Wavelength (nm):	580
Purity:	43.80166
Rf:	71.4
Rg:	96

CRI (Ra):	70.1
R1:	66.6
R2:	77.6
R3:	88.5
R4:	69.5
R5:	66.4
R6:	69.6
R7:	77.5
R8:	44.9
R9:	-40.2
R10:	49.1
R11:	66.3
R12:	45.7
R13:	68.0
R14:	93.4
R15:	57.6

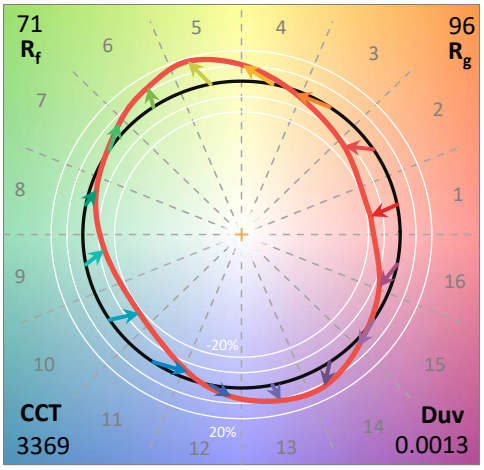

Test Conditions


Stabilization Time:	21M
Operation Time:	1H 21M
Sphere Temperature (°C):	25.2

REPORT NUMBER: SP1-2407-184-5


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	6/18/2024	12/18/2024
Power Meter	INXT2011004	2/8/2024	2/8/2025
AC Power Source	IN0063	10/24/2023	10/24/2024
DC Power Source	IN0208	10/24/2023	10/24/2024
Sphere Thermometer	IN0085	10/24/2023	10/24/2024
Room Thermometer	IN0046	10/24/2023	10/24/2024

REPORT NUMBER: SP1-2407-184-5

CIE 1931 Chromaticity Diagram

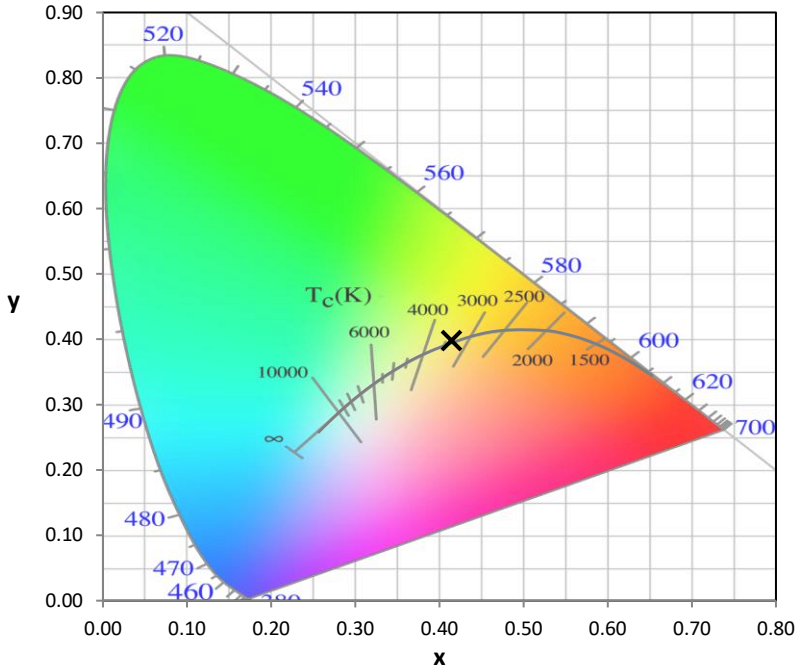

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

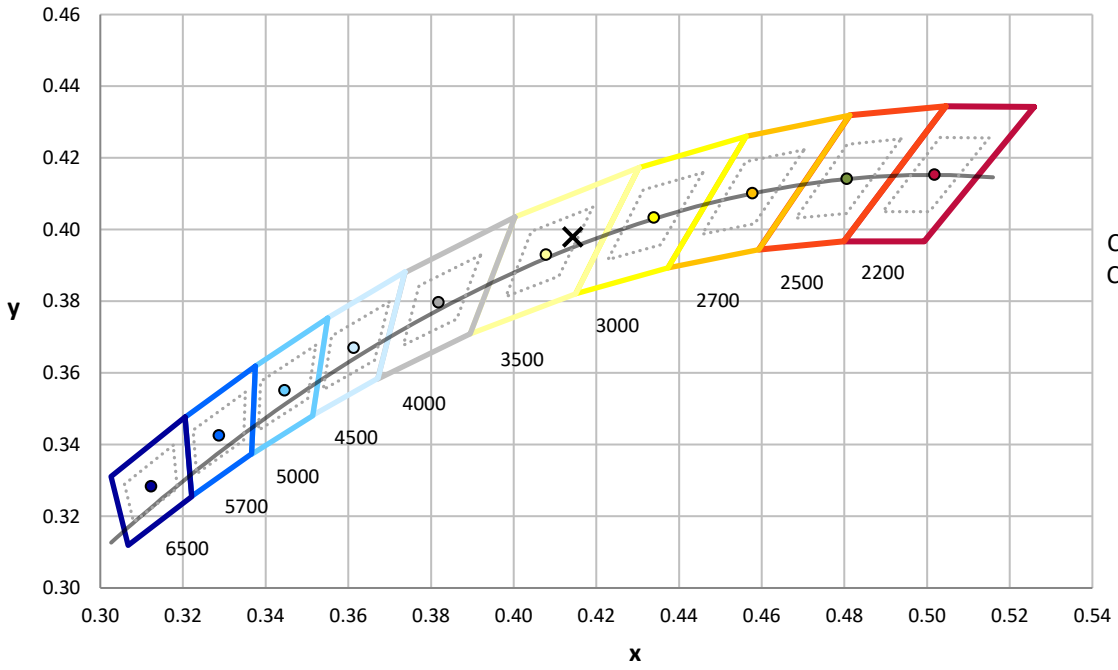


CCT = 3369K
CIE x = 0.4143
CIE y = 0.3980
Duv = 0.0013

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2407-184-5

Photopic Flux vs. Wavelength

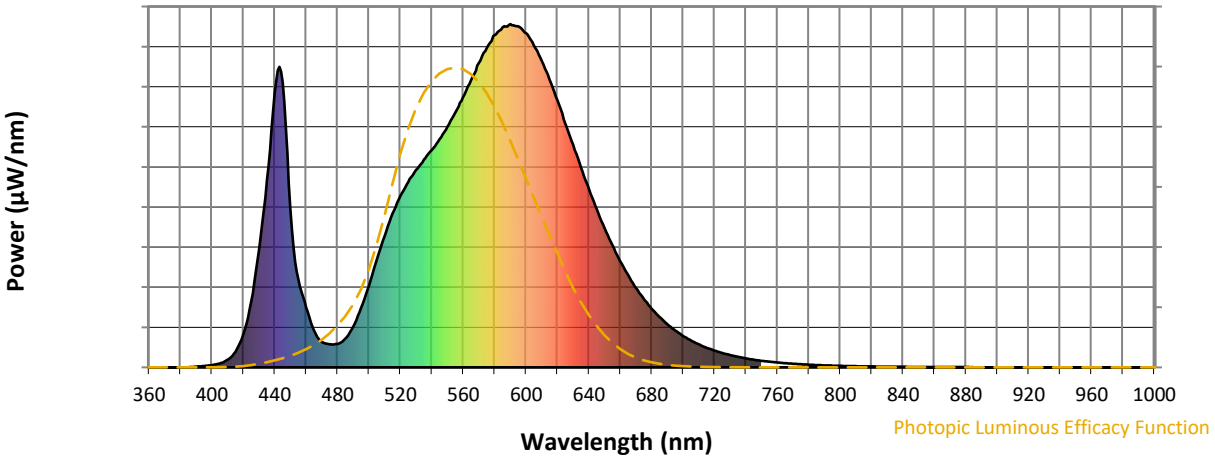


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Scotopic Flux vs. Wavelength

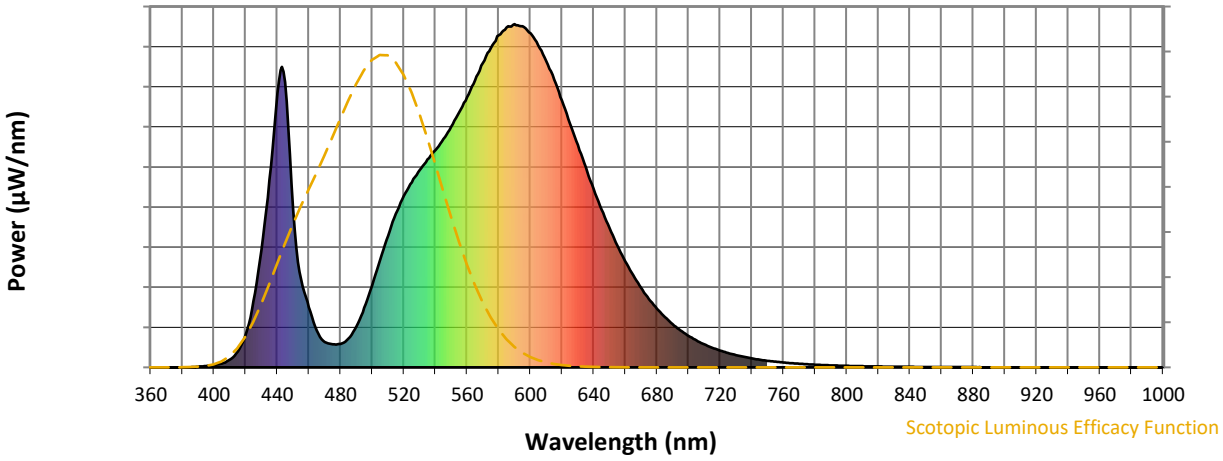


Scotopic Lumens: NR **S/P: 1.29**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			

REPORT NUMBER: SP1-2407-184-5

Melanopic Flux vs. Wavelength

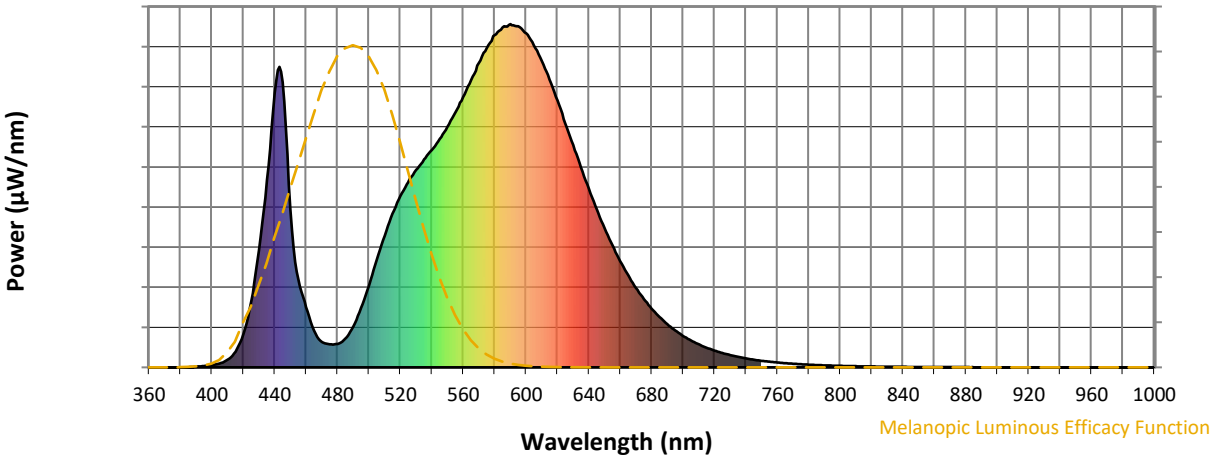

Melanopic Lumens: NR **M/P: 2.36**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	119	NR	620	778	NR	750	19	NR	880	1	NR
365	0	NR	495	173	NR	625	711	NR	755	16	NR	885	0	NR
370	0	NR	500	239	NR	630	648	NR	760	14	NR	890	0	NR
375	0	NR	505	313	NR	635	582	NR	765	12	NR	895	0	NR
380	0	NR	510	383	NR	640	520	NR	770	11	NR	900	0	NR
385	0	NR	515	448	NR	645	460	NR	775	9	NR	905	0	NR
390	2	NR	520	500	NR	650	406	NR	780	8	NR	910	0	NR
395	4	NR	525	539	NR	655	355	NR	785	7	NR	915	0	NR
400	6	NR	530	575	NR	660	309	NR	790	6	NR	920	0	NR
405	11	NR	535	606	NR	665	269	NR	795	5	NR	925	0	NR
410	22	NR	540	633	NR	670	231	NR	800	4	NR	930	0	NR
415	45	NR	545	666	NR	675	199	NR	805	4	NR	935	0	NR
420	96	NR	550	701	NR	680	171	NR	810	3	NR	940	0	NR
425	193	NR	555	743	NR	685	147	NR	815	3	NR	945	0	NR
430	341	NR	560	788	NR	690	126	NR	820	3	NR	950	0	NR
435	547	NR	565	837	NR	695	107	NR	825	2	NR	955	0	NR
440	799	NR	570	887	NR	700	92	NR	830	2	NR	960	0	NR
445	831	NR	575	931	NR	705	78	NR	835	2	NR	965	0	NR
450	461	NR	580	967	NR	710	67	NR	840	2	NR	970	0	NR
455	256	NR	585	990	NR	715	57	NR	845	1	NR	975	0	NR
460	176	NR	590	1000	NR	720	49	NR	850	1	NR	980	0	NR
465	107	NR	595	994	NR	725	42	NR	855	1	NR	985	0	NR
470	74	NR	600	973	NR	730	36	NR	860	1	NR	990	0	NR
475	67	NR	605	938	NR	735	31	NR	865	1	NR	995	0	NR
480	68	NR	610	892	NR	740	26	NR	870	1	NR	1000	0	NR
485	84	NR	615	838	NR	745	22	NR	875	1	NR			


REPORT NUMBER: SP1-2407-184-5

TM-30-18


Summary


R_f = 71.4
R_g = 96
CIE R_a = 70.1
R_9 = -40.2


Spectral Power Distribution Comparison

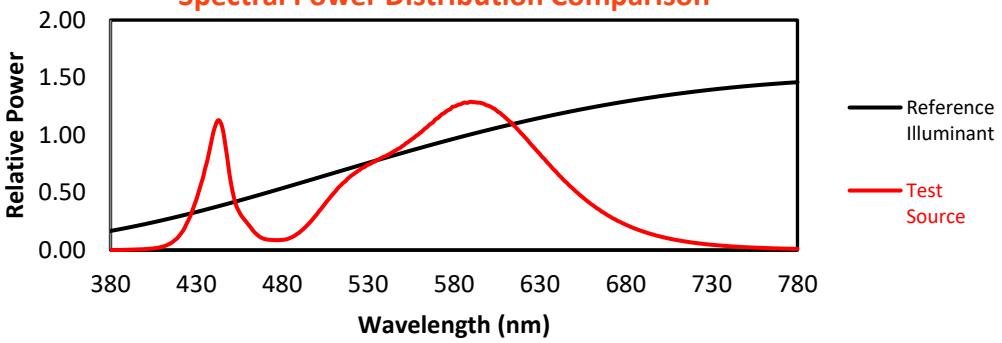


Color Vector Graphics

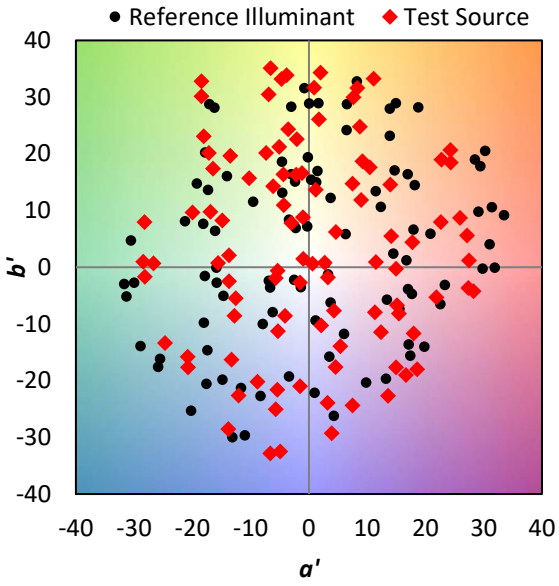

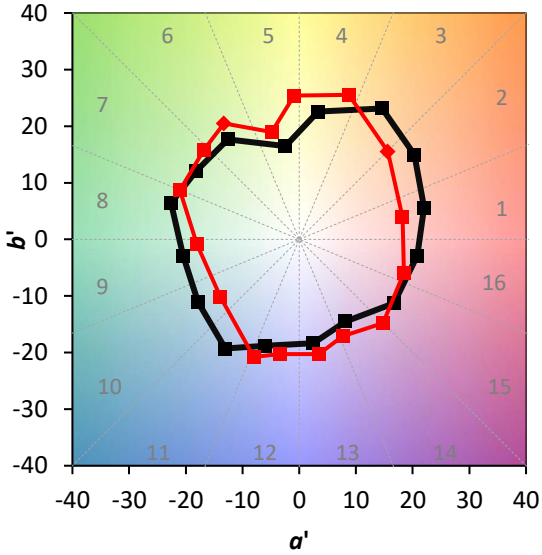

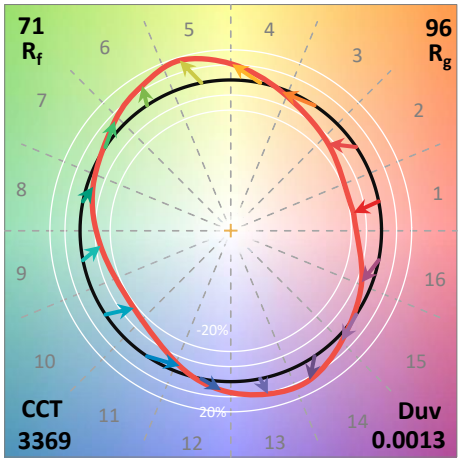

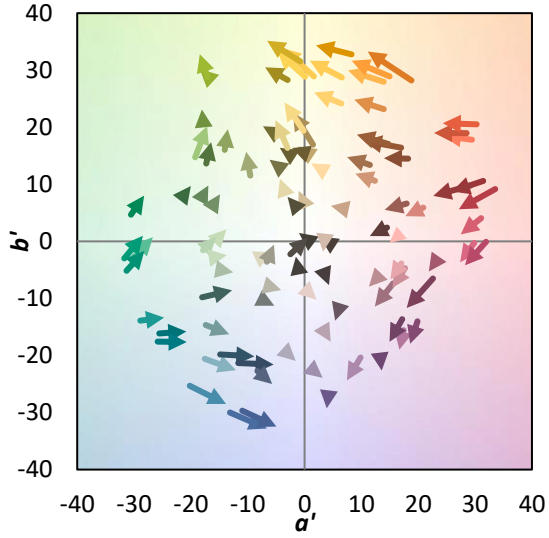


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 57	CES51 = 84	CES76 = 50
CES02 = 62	CES27 = 80	CES52 = 86	CES77 = 74
CES03 = 31	CES28 = 81	CES53 = 72	CES78 = 54
CES04 = 70	CES29 = 50	CES54 = 79	CES79 = 81
CES05 = 48	CES30 = 55	CES55 = 78	CES80 = 79
CES06 = 51	CES31 = 56	CES56 = 67	CES81 = 74
CES07 = 40	CES32 = 54	CES57 = 65	CES82 = 91
CES08 = 39	CES33 = 60	CES58 = 68	CES83 = 86
CES09 = 29	CES34 = 69	CES59 = 85	CES84 = 89
CES10 = 75	CES35 = 83	CES60 = 91	CES85 = 83
CES11 = 58	CES36 = 88	CES61 = 85	CES86 = 66
CES12 = 64	CES37 = 78	CES62 = 78	CES87 = 77
CES13 = 43	CES38 = 64	CES63 = 71	CES88 = 75
CES14 = 74	CES39 = 92	CES64 = 70	CES89 = 68
CES15 = 71	CES40 = 86	CES65 = 64	CES90 = 72
CES16 = 47	CES41 = 81	CES66 = 65	CES91 = 95
CES17 = 50	CES42 = 79	CES67 = 63	CES92 = 62
CES18 = 56	CES43 = 71	CES68 = 69	CES93 = 78
CES19 = 72	CES44 = 98	CES69 = 80	CES94 = 51
CES20 = 65	CES45 = 80	CES70 = 60	CES95 = 70
CES21 = 87	CES46 = 75	CES71 = 58	CES96 = 76
CES22 = 79	CES47 = 71	CES72 = 85	CES97 = 82
CES23 = 92	CES48 = 61	CES73 = 51	CES98 = 72
CES24 = 91	CES49 = 74	CES74 = 94	CES99 = 60
CES25 = 72	CES50 = 83	CES75 = 57	

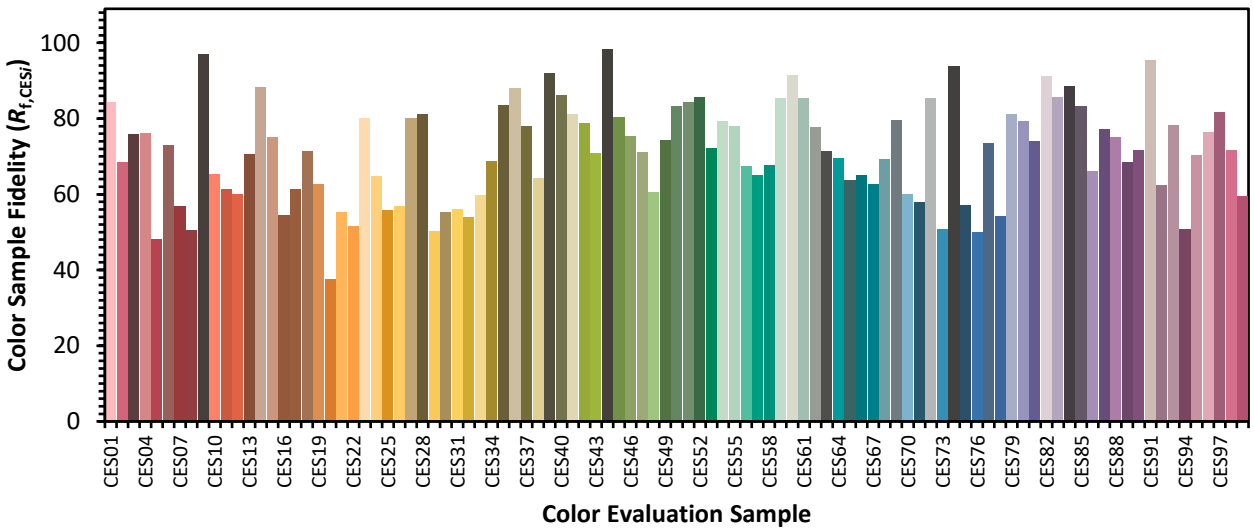



REPORT NUMBER: SP1-2407-184-5

TM-30-18

Color Rendition by Hue-Angle Bin

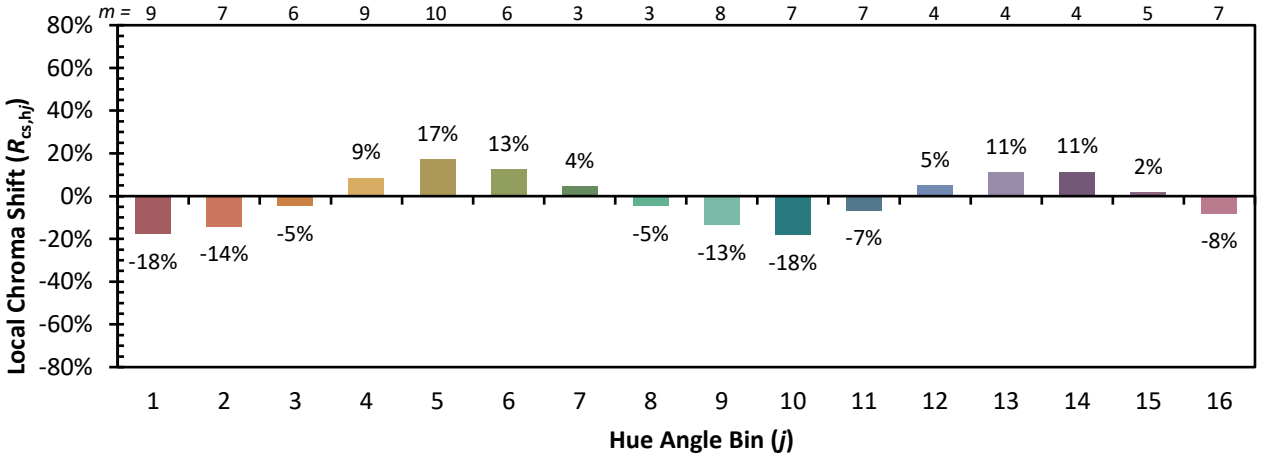

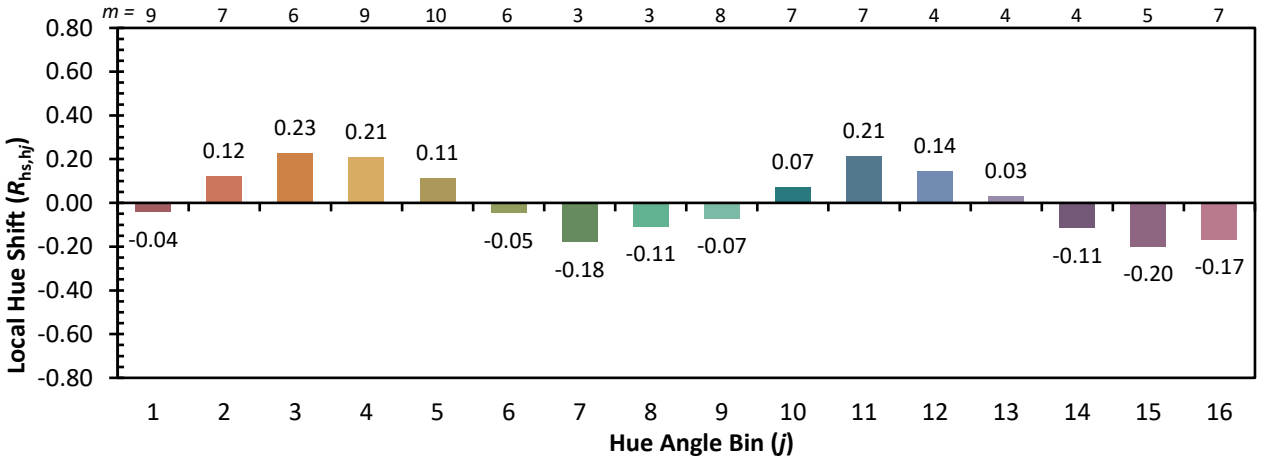


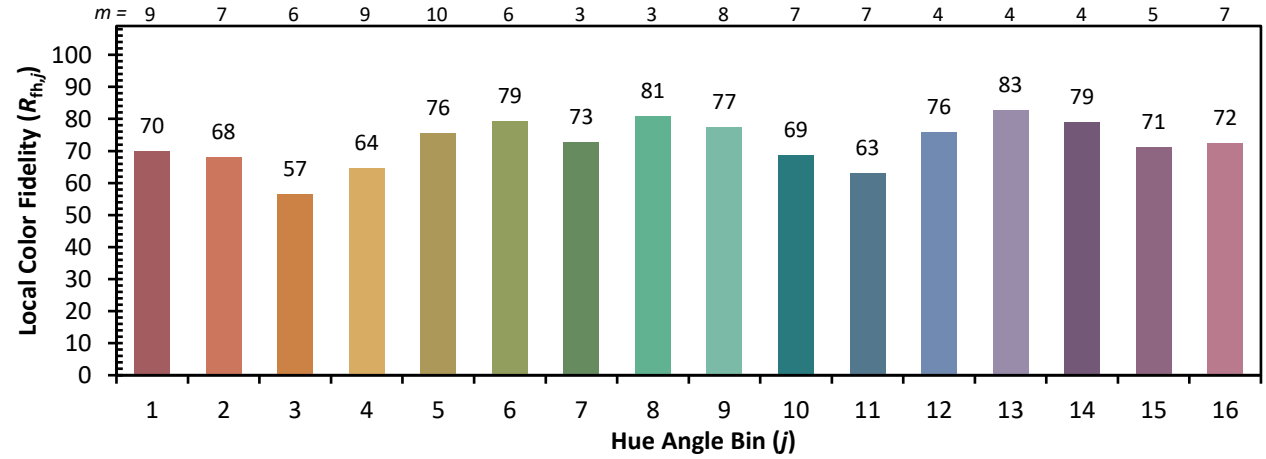


REPORT NUMBER: SP1-2407-184-5

TM-30-18

Measure Comparisons

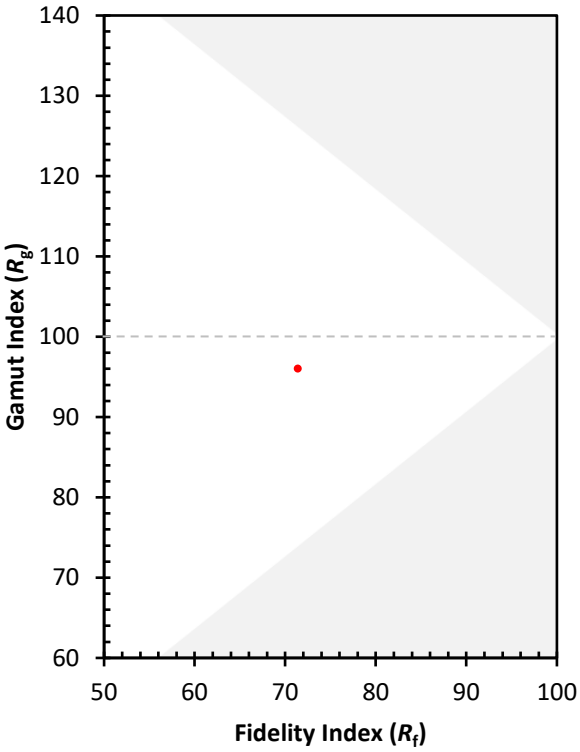

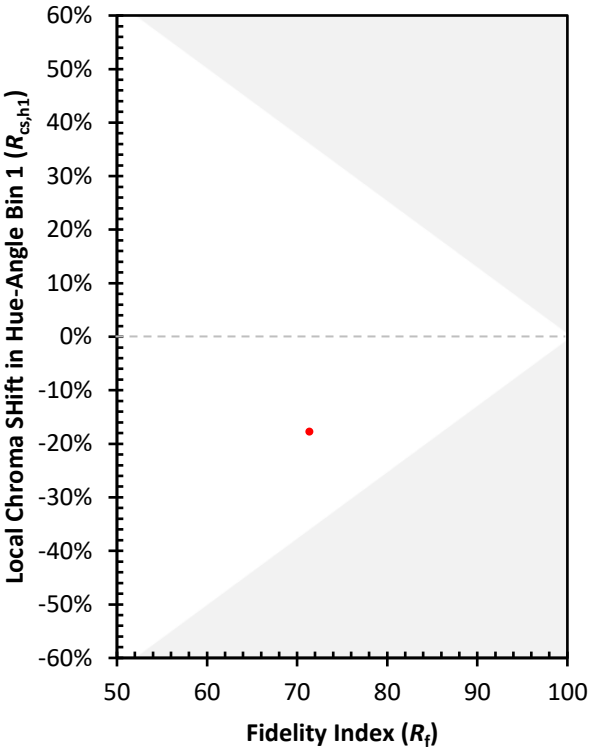

(END OF REPORT)